



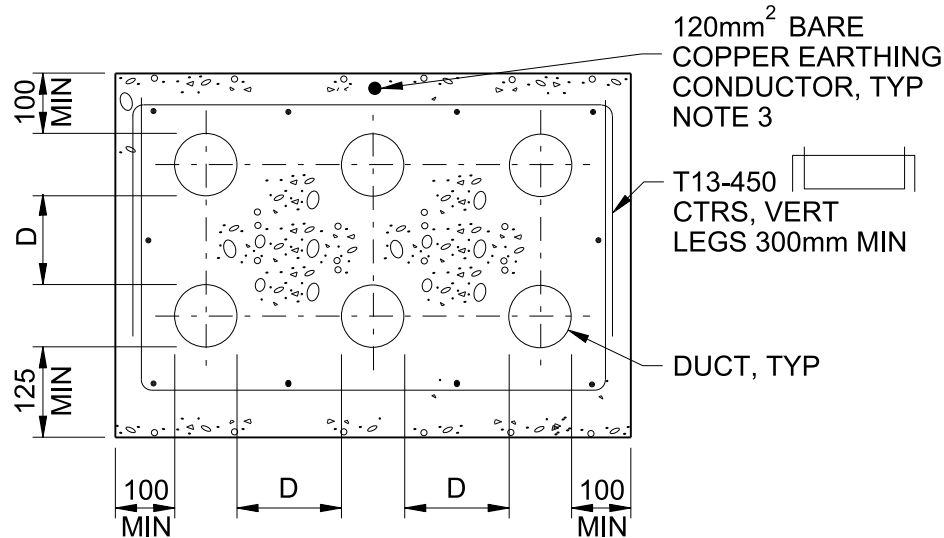

FOR LARGER DUCT BANKS,
CONTINUE PATTERN OF REBAR,
CONDUIT SEPARATION AND
CONCRETE COVER.

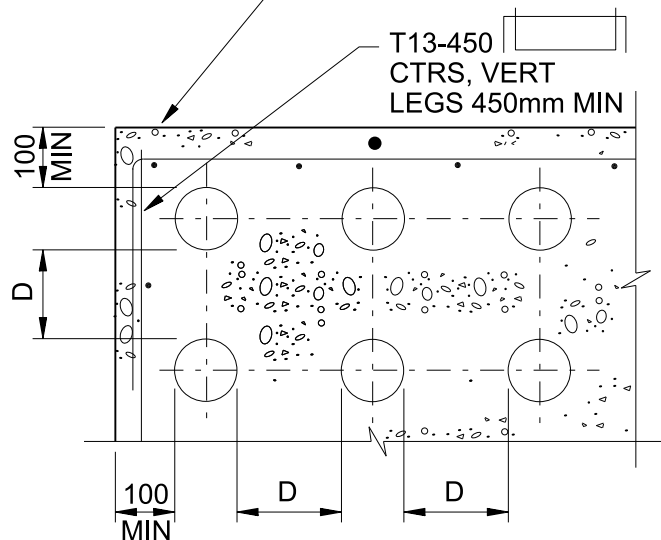

D = 75mm FOR 50mm AND
LARGER CONDUITS

D = 50mm FOR 38mm AND
SMALLER CONDUITS

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. PROVIDE 200mm MINIMUM COMPACTED GRAVEL, 19mm MINUS, UNDER ALL CONCRETE ENCASED DUCT RUNS.
3. EARTHING CONDUCTOR TO BE CONTINUOUS AND CONNECTED TO EARTH BAR AT EACH END OF DUCT BANKS.

DUCT BANK

NTS

STANDARD DETAIL

16400B

JACOBS