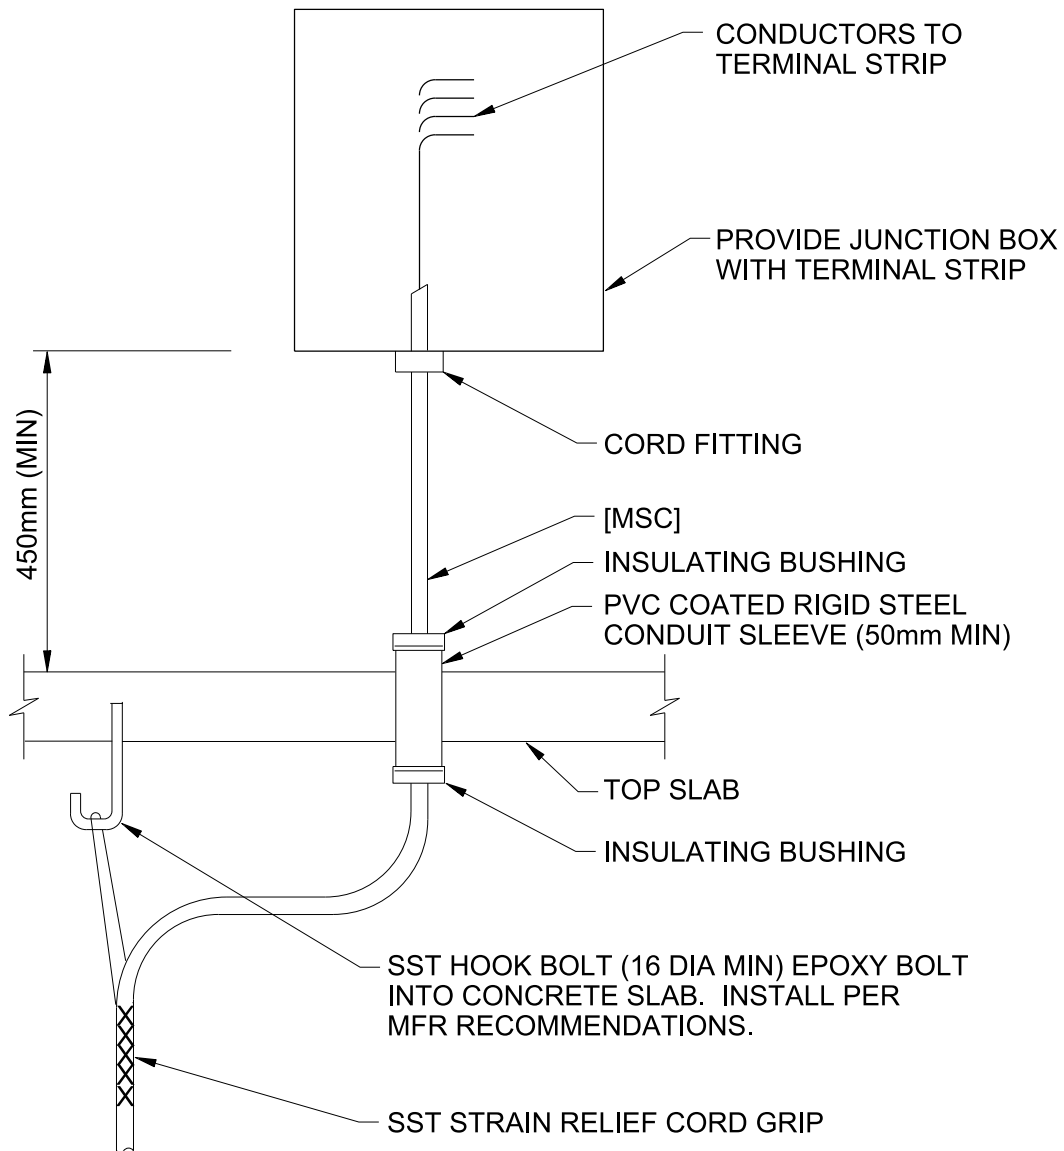


**NOTES:**

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. ALL HARDWARE SHALL BE STAINLESS STEEL.
3. THIS DETAIL SHALL BE USED FOR TERMINATION OF ALL MANUFACTURE SUPPLIED CABLES (MSC) EXITING A WET WELL IF NO OTHER DETAIL IS CALLED OUT ON THE DRAWINGS.
4. FILL CONDUIT SLEEVE WITH EXPANDABLE SEALING COMPOUND.

MSC CABLE TERMINATION

NTS

STANDARD DETAIL

16561

JACOBS