


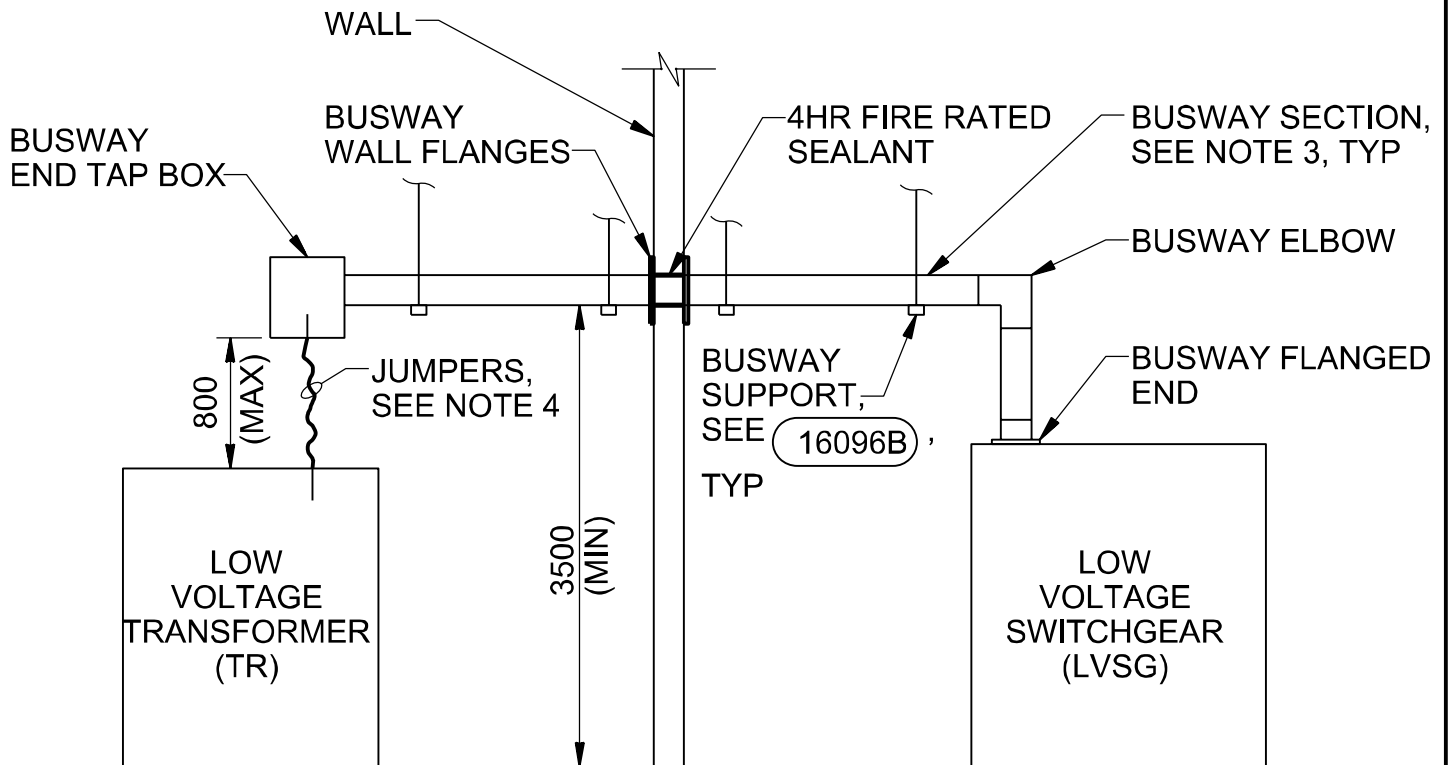

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. FOR BUSWAY AMPERE RATING, SEE SINGLE-LINE DIAGRAMS.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING COMPLETE BUSWAY INCLUDING ELBOWS, OFFSETS AND FITTINGS SHOWN HERE-IN AND AS SHOWN ON PLANS AND SECTIONS AND SPECIFICATIONS.
4. PROVIDE 600V RATED JUMPERS WITH AMPACITY IN AIR TO MATCH BUSWAY RATING AND SS638 REQUIREMENTS.

BUSWAY MOUNTING SYSTEM

NTS

16096A

STANDARD DETAIL

JACOBS