


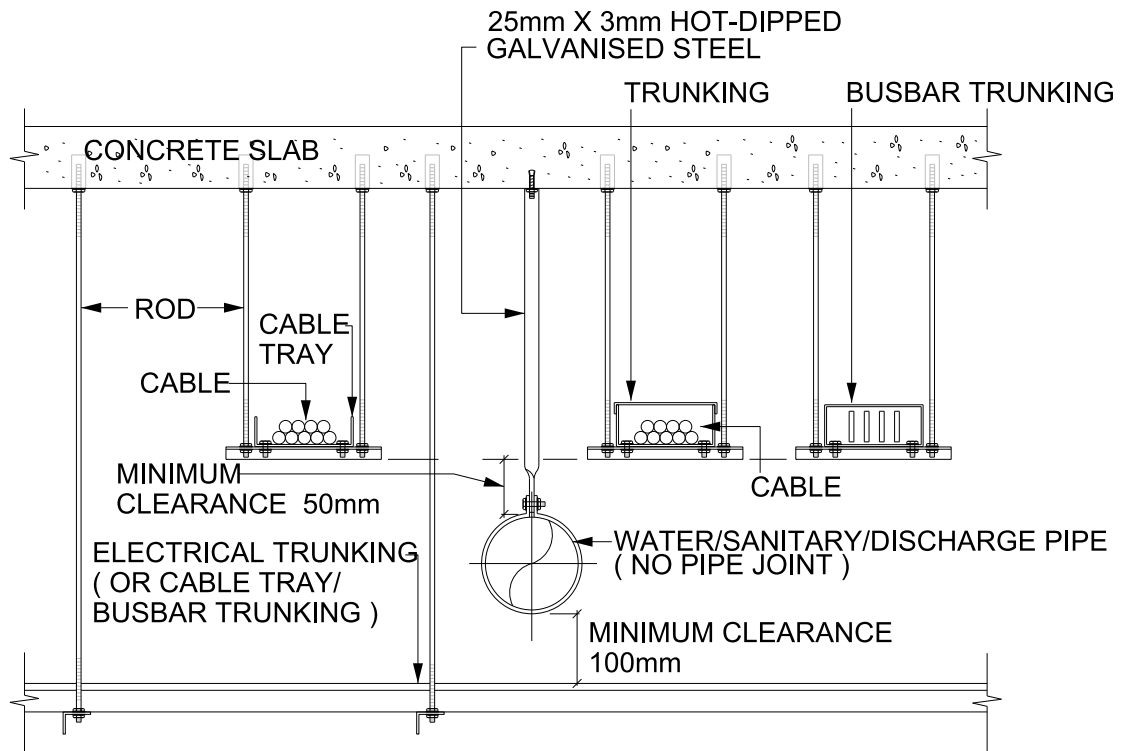

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. THIS DETAIL SHALL BE APPLIED TO ALL CABLE TRAY, CABLE LADDER AND TRUNKING INSTALLATION
3. ELECTRICAL CABLE TRAYS AND TRUNKINGS SHALL BE PERMITTED TO UNDER CROSS SANITARY, WATER AND DISCHARGE PIPES. BUT IT SHALL BE AWAY FROM PIPE & ELBOW JOINTS, REDUCERS, ETC BY A MINIMUM CLEARANCE OF 100mm
4. BUSBAR TRUNKINGS SHALL BE IN ALL CIRCUMSTANCES INSTALLED ABOVE SANITARY, WATER AND DISCHARGE PIPES.
5. WHEN ELECTRICAL CABLE TRAY, TRUNKING AND BUSBAR TRUNKING HAVE TO BE INSTALLED BESIDE THE SANITARY, WATER AND DISCHARGE PIPE, IT SHALL BE HIGHER THAN THE LATTER BY 50mm.

ELECTRICAL TRUNKING OR CABLE TRAY CROSSING, SANITARY & DISCHARGE PIPES

NTS

STANDARD DETAIL

16142

JACOBS