


25mm x 3mm COPPER TAPE IN
40mm H.D. UPVC PIPE
ENCASED IN WALL/COLUMN

(150mm x 150mm x 100mm) TEST LINK BOX WITH
HINGED & CAPTIVE SCREWS FLUSHED
MOUNTED ON COLUMN OR WALL C/W COVER
ENGRAVE "LIGHTNING PROTECTION TEST LINK"

SEE DETAIL 16446 FOR
EARTH INSPECTION PIT

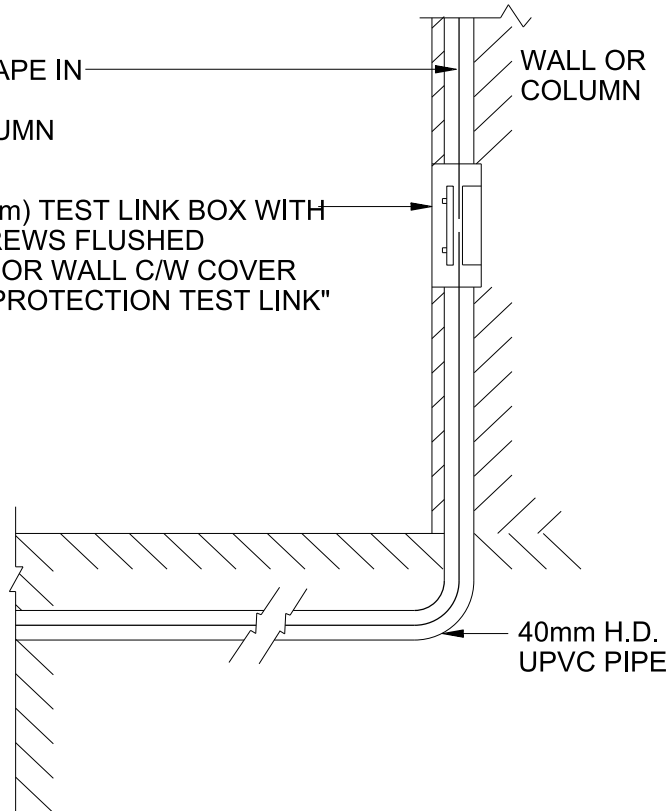

NOTES :

- 1: ALL DIMENSIONS IN MILLIMETERS,
UNLESS OTHERWISE NOTED.

CONCEAL COPPER TAPE AND TEST LINK BOX

NTS

STANDARD DETAIL

16442

JACOBS