


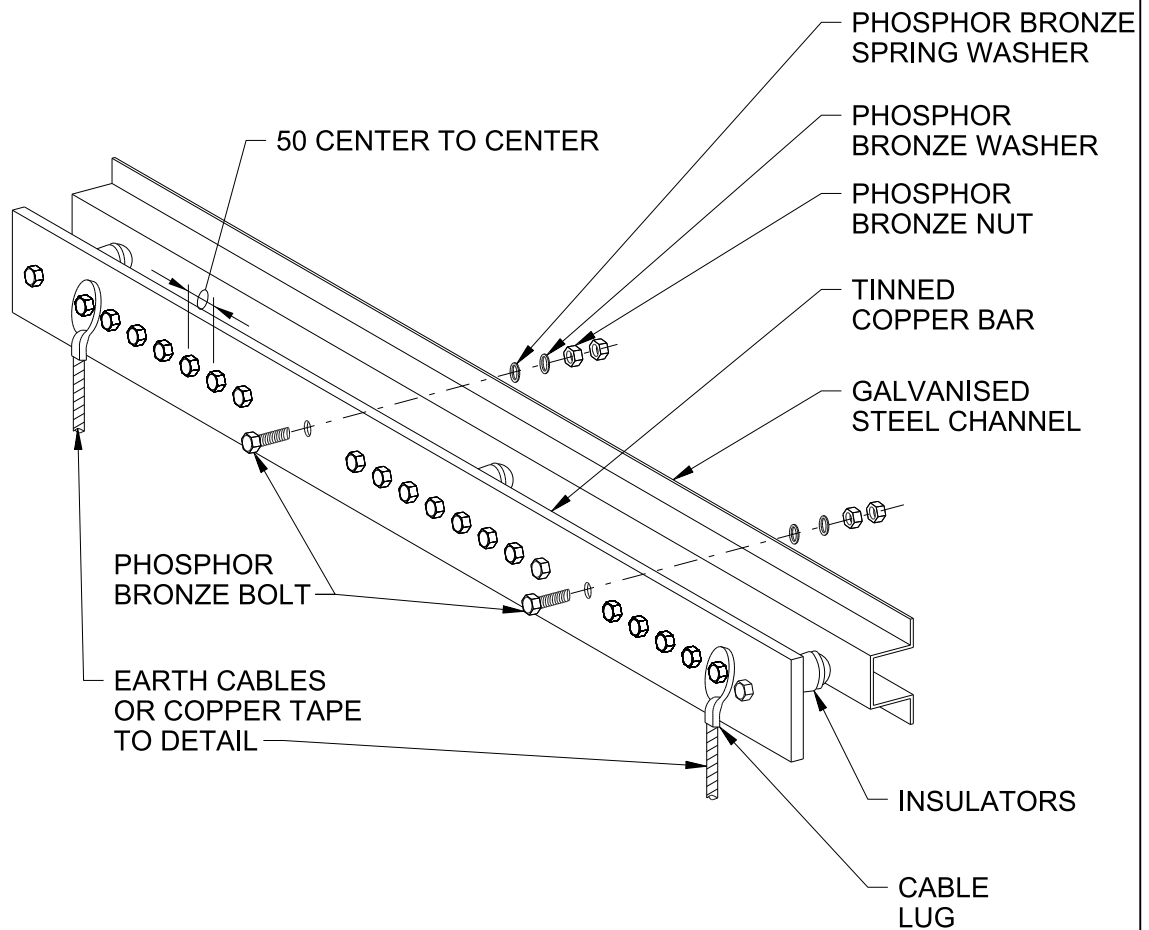

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. THE NUMBER OF TERMINATIONS REQUIRED SHALL REFER TO THE EARTHING SCHEMATIC DIAGRAM.
3. MOUNTING HEIGHT AT 600 ABOVE FINISHED FLOOR.

EARTH BAR FOR EARTHING SYSTEM

NTS

STANDARD DETAIL

16447

JACOBS