


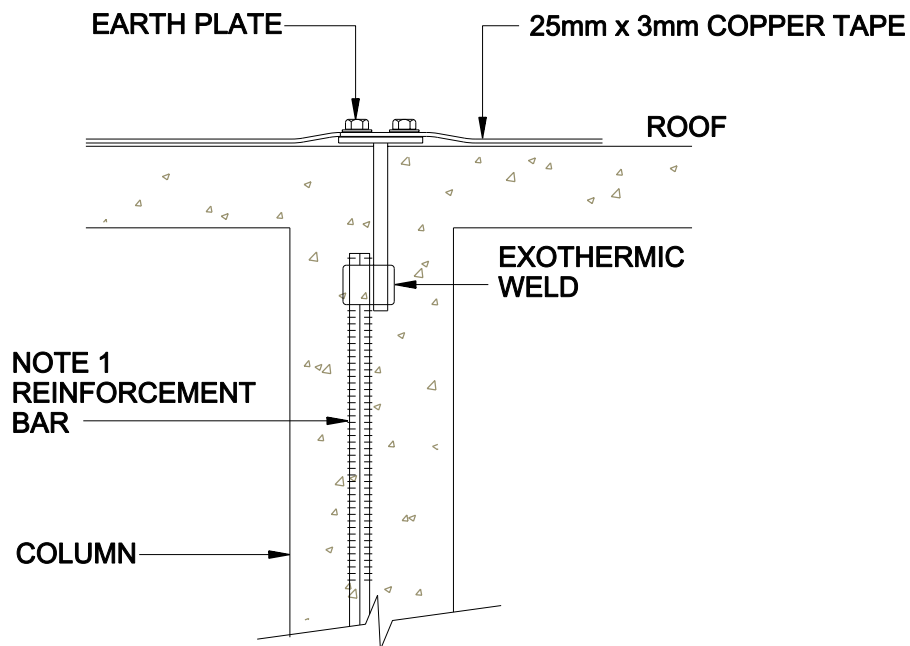

NOTES :

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED
2. PROVIDE CONTINUOUSLY WELDED REBAR CONNECTION (T25 MINIMUM) FROM EARTH PLATE TO PILE CAP STARTER BAR.
MINIMUM WELD OVERLAP 200mm. MINIMUM WELD THROAT THICKNESS 10mm.

EARTH CONNECTION TO REINFORCEMENT BAR AT ROOF

NTS

STANDARD DETAIL

16459C

JACOBS