


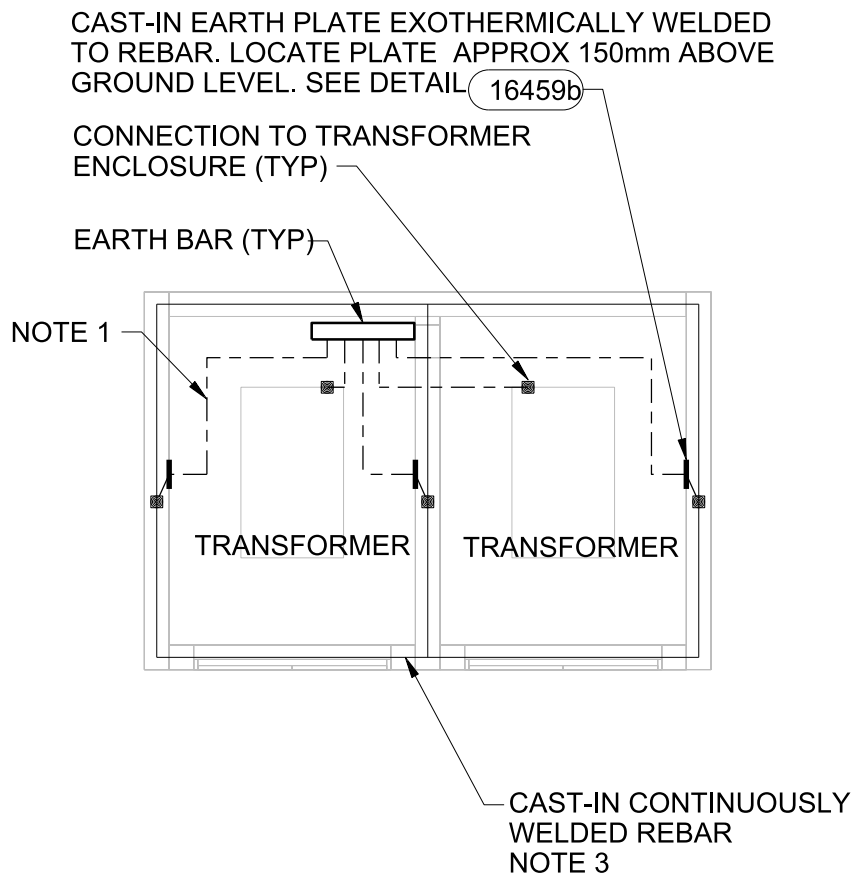

NOTES:

1. CABLE TYPE 6, 240mm^{37/64} COPPER CONDUCTOR
2. WIRE TIE WELDED REBAR TO ADJACENT REINFORCING STEEL. MINIMUM 300mm SPACING. SEE DETAIL 16463
3. CONTINUOUSLY WELDED REBAR T25 MINIMUM. PROVIDE MINIMUM 200mm WELD OVERLAP AND MINIMUM 10mm WELD THROAT THICKNESS
4. WHERE CONDUCTIVE METAL GATES ARE PROVIDED FOR TRANSFORMER ENCLOSURES, PROVIDE EQUIPOTENTIAL BONDING VIA 120mm^{37/64} FLEXIBLE COPPER CONDUCTOR.

TRANSFORMER TYPICAL EARTHING CONFIGURATION

NTS

STANDARD DETAIL

16462

JACOBS