


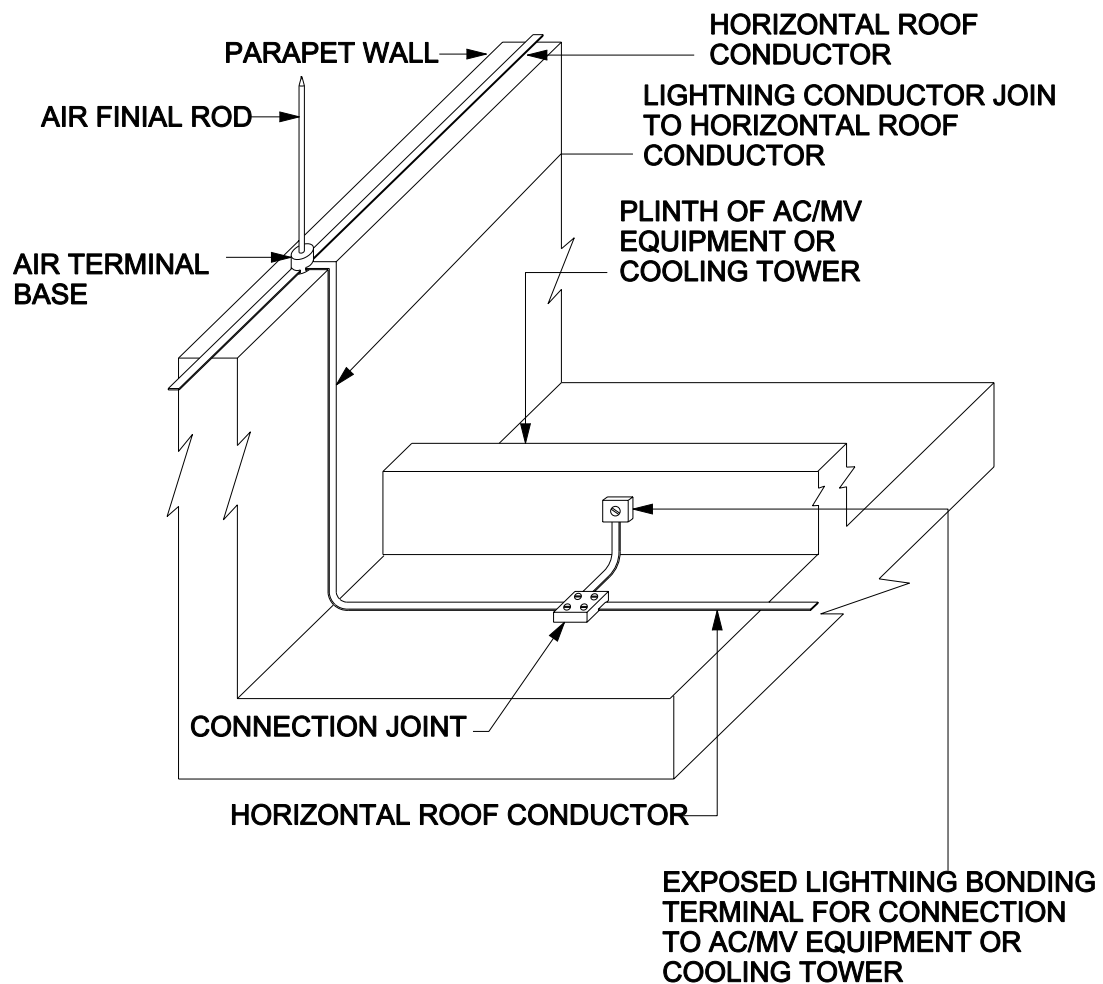

BONDING DETAIL OF LIGHTNING CONDUCTOR TO ACMV EQUIPMENT OR COOLING TOWER

NTS

STANDARD DETAIL

16574

JACOBS