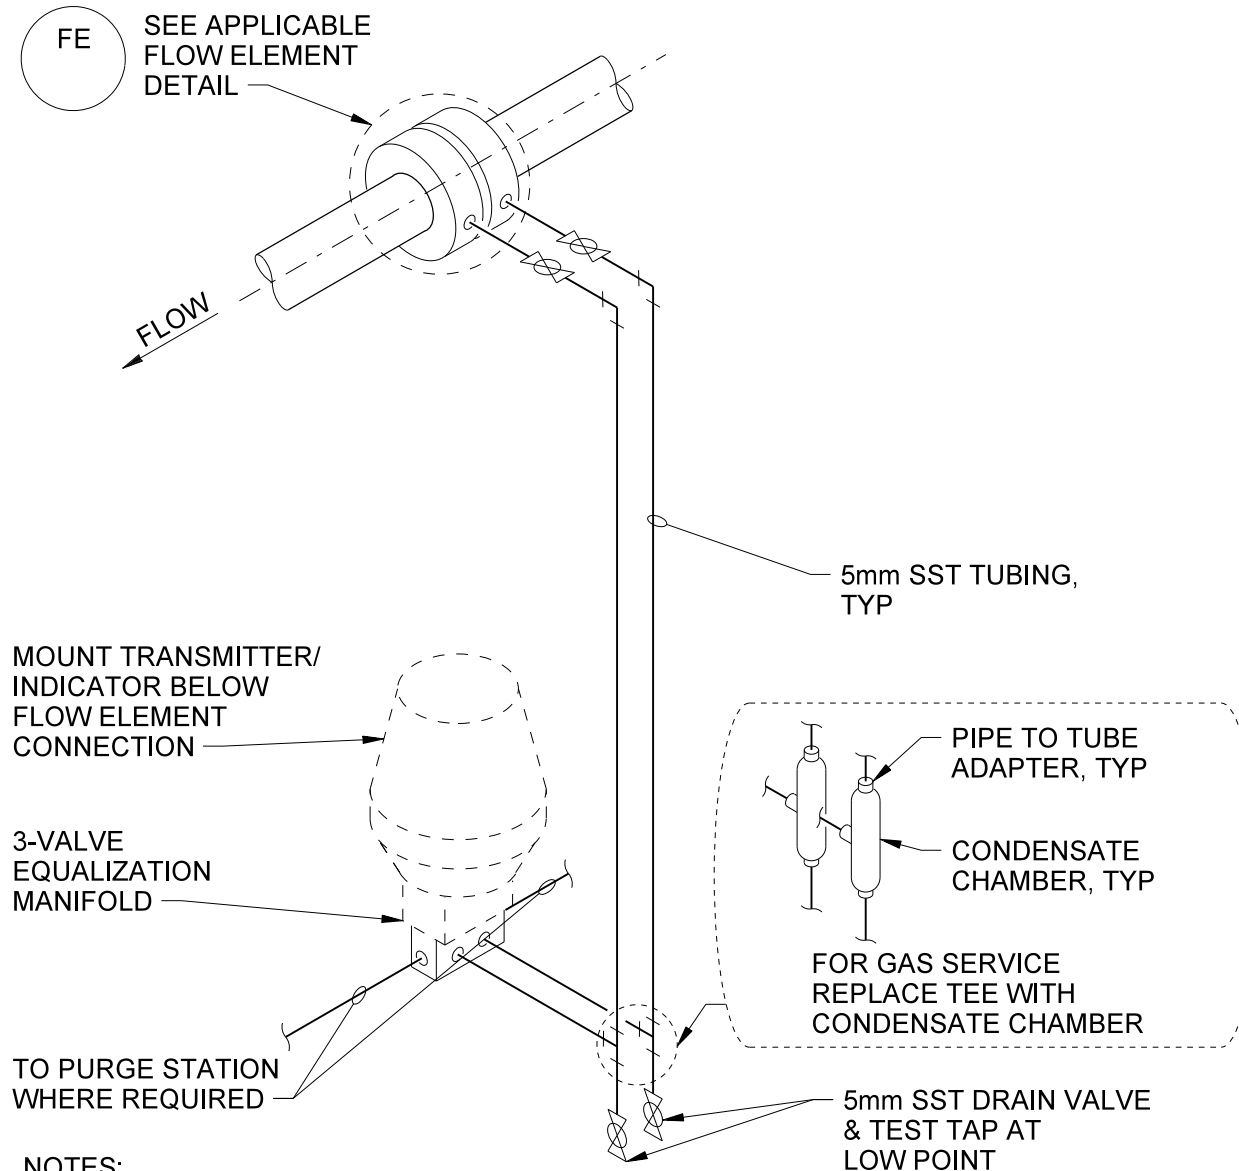


**NOTES:**

1. FOR LIQUID SERVICE, SLOPE ALL LINES DOWNWARD TOWARD INSTRUMENT.
2. FOR GAS SERVICE, SLOPE ALL LINES DOWNWARD TOWARD CONDENSATE CHAMBER.
3. ALL LINES SHALL HAVE A CONTINUOUS SLOPE OF 10mm PER 300mm MIN (25mm PER 300mm PREFERRED).

PRESSURE DIFFERENTIAL TRANSMITTER/INDICATOR FOR FLOW SERVICE INSTALLATION

NTS

STANDARD DETAIL

13206

JACOBS