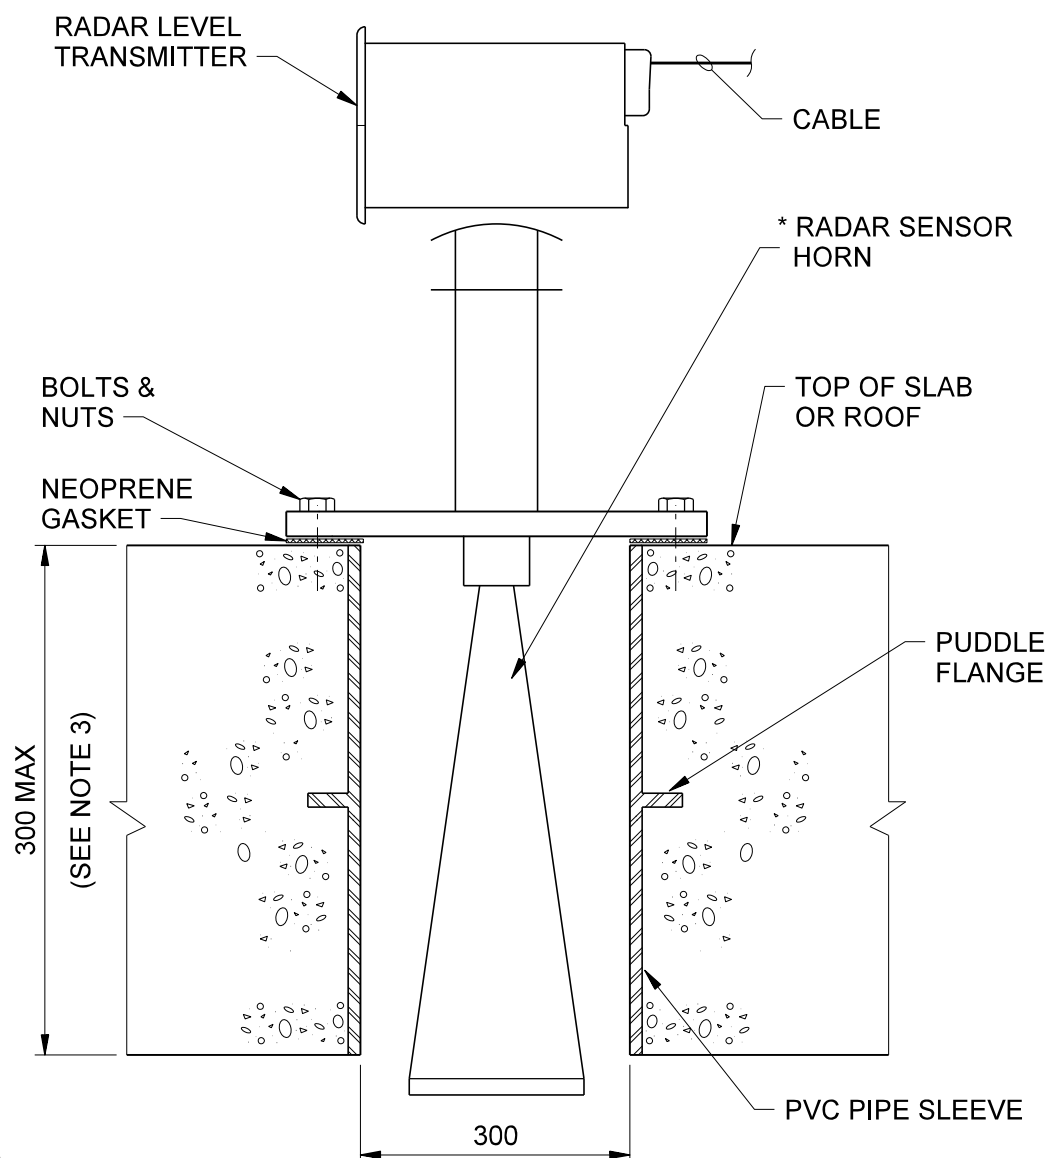


**NOTES:**

1. ALL DIMENSIONS IN MILLIMETER.
2. COMPONENTS DESIGNATED BY * ARE SUPPLIED BY INSTRUMENTS MANUFACTURER.
3. WHERE ROOF SLAB THICKNESS IS SUCH THAT ALLOWABLE DISTANCE WOULD BE EXCEEDED, PROVIDE ELEMENT EXTENSION TO BRING TRANSDUCER TO WITHIN 300mm MAX FROM BOTTOM OPENING OF FLOOR PIPE..

RADAR LEVEL ELEMENT INSTALLATION

CONCRETE ROOF OR FLOOR

NTS

STANDARD DETAIL

13255

JACOBS