


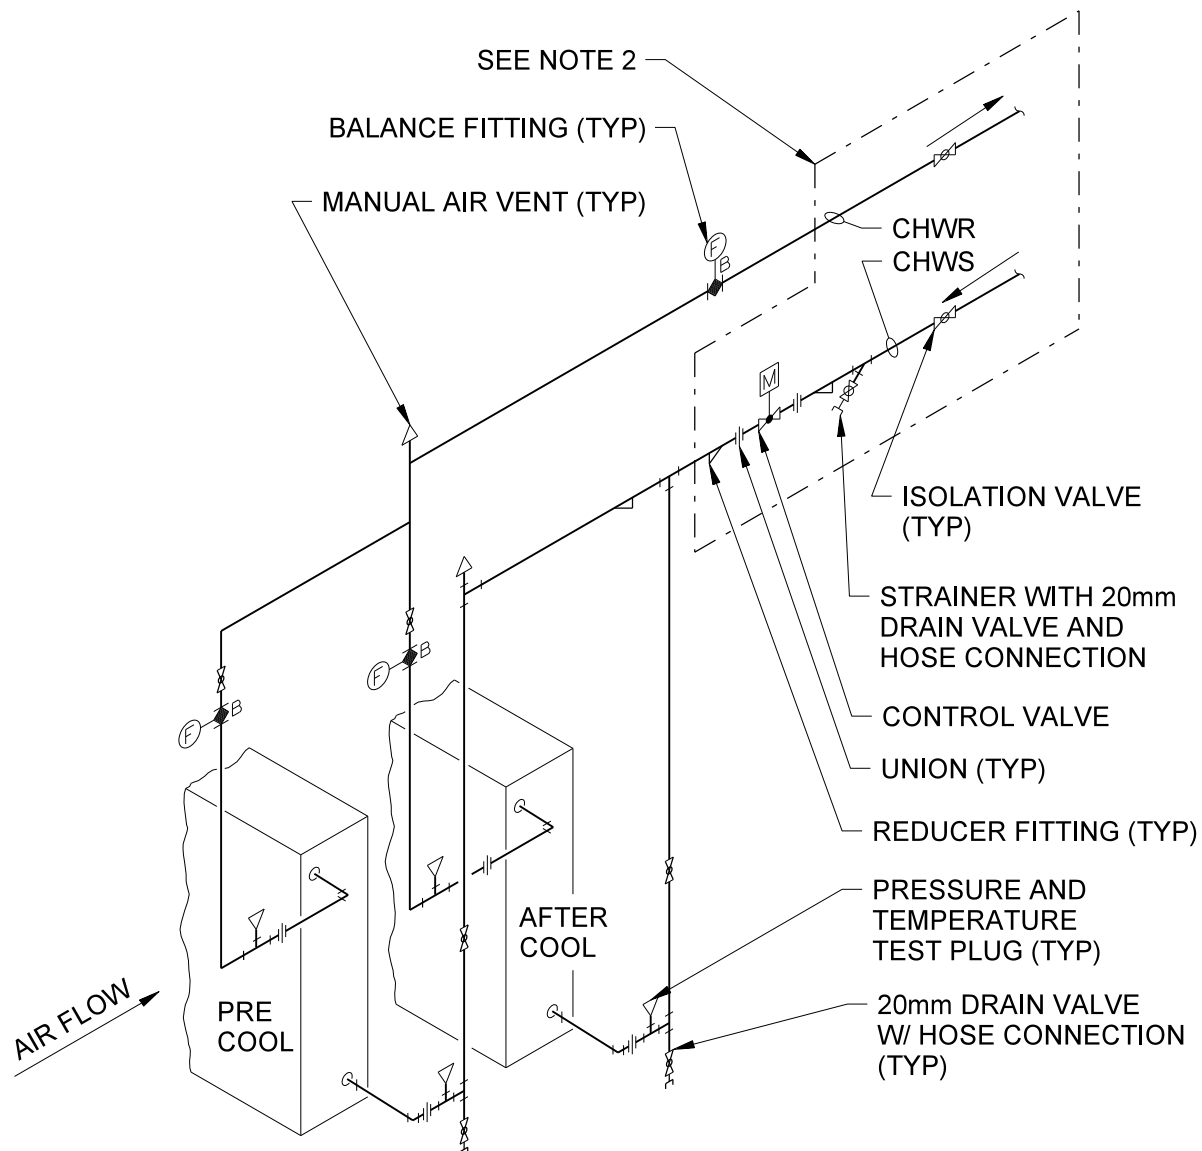

NOTES:

1. DETAIL GIVES REQUIRED SEQUENCE OF EQUIPMENT AND VALVES. PIPING ARRANGEMENT MAY VARY TO SUIT FIELD REQUIREMENTS. PIPE COIL FOR COUNTER FLOW WITH AIR.
2. SEE P&ID's FOR ISOLATION & CONTROL VALVE TAGS AND OTHER CONTROL ELEMENTS.

PRE - COOLING COIL ARRANGEMENT

NTS

STANDARD DETAIL

15452

JACOBS