


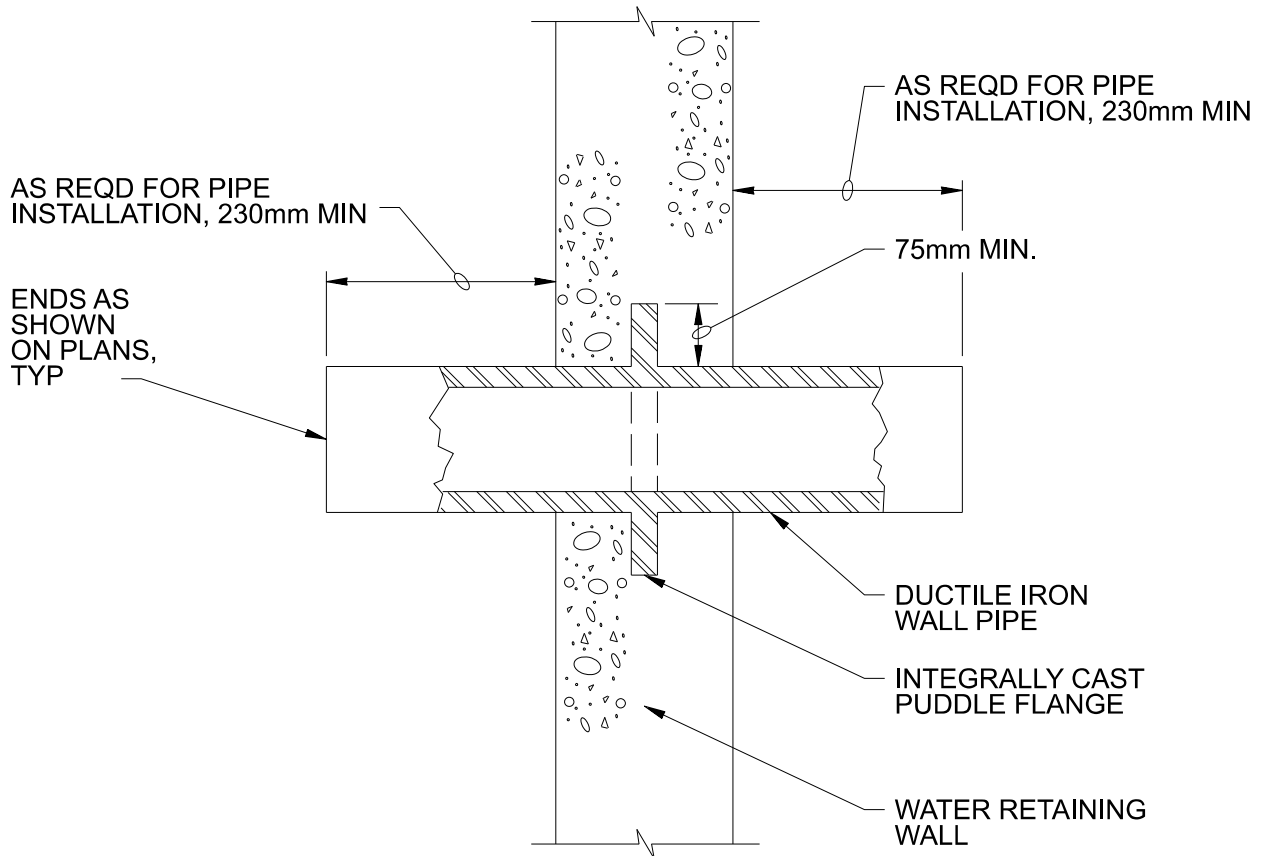

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. COAT WALL PIPE WITH SPECIFIED PAINT SYSTEM PRIOR TO CONCRETE PLACEMENT.
3. PUDDLE FLANGE THICKNESS SHALL BE DESIGNED FOR AT LEAST PN2.5 IN ACCORDANCE WITH BS EN 1092.

DUCTILE IRON WALL PIPE

NTS

STANDARD DETAIL

15600

JACOBS