


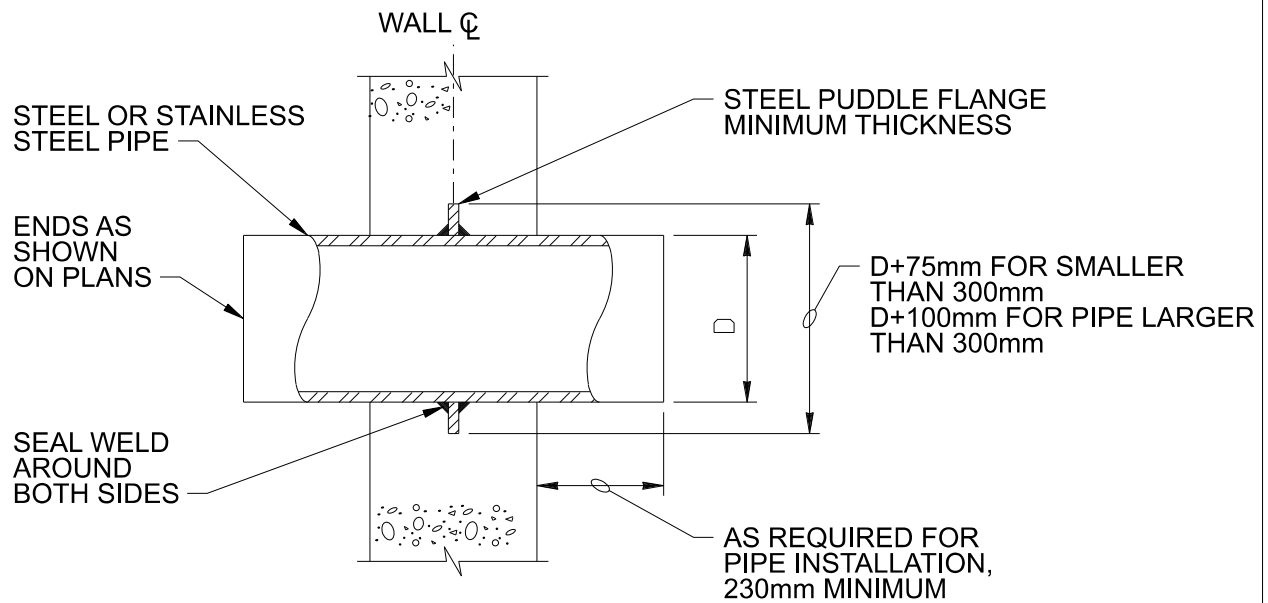

NOTES :

- 1: ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
- 2: PUDDLE FLANGE THICKNESS SHALL BE DESIGNED FOR AT LEAST PN2.5 IN ACCORDANCE WITH BS EN 1092.

STEEL/STAINLESS STEEL WALL PIPE

NTS

STANDARD DETAIL

15605

JACOBS