15991.dgn

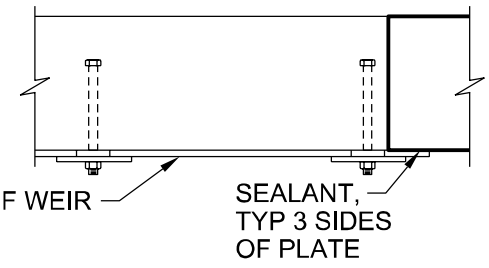

PLAN

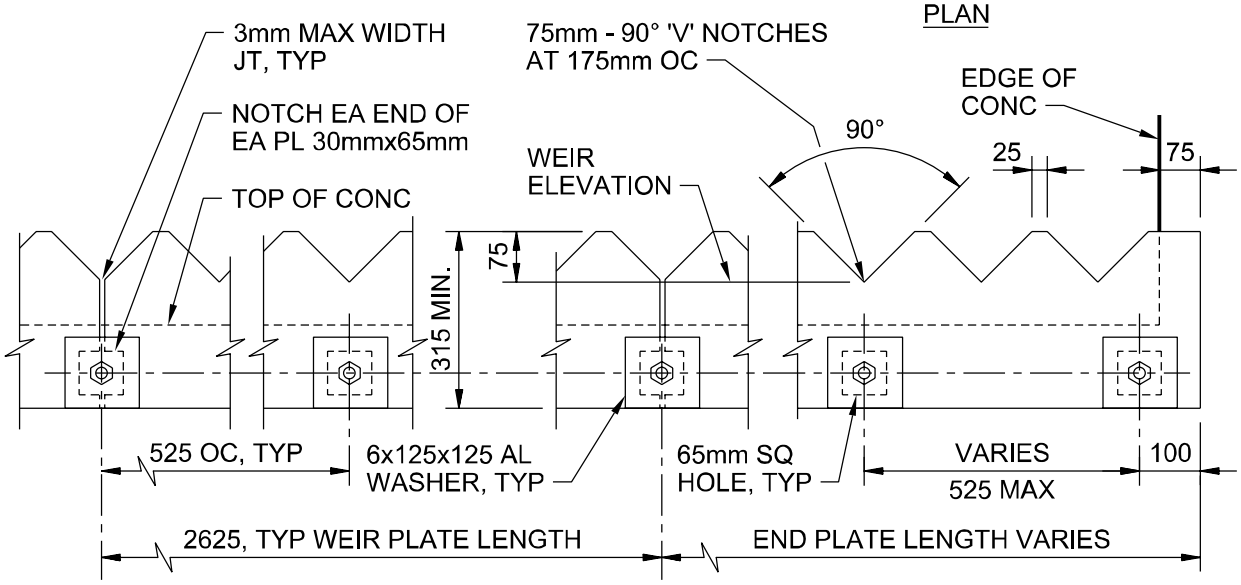

NOTES:

1. ALL PARTS EXCEPT FASTENERS SHALL BE ALUMINUM AS SPECIFIED.
2. ALL FASTENERS SHALL BE SS AS SPECIFIED.
3. STEEL TROWEL TOP OF CONCRETE WALL TO OBTAIN SMOOTH, DENSE FINISH.
4. PROVIDE CONTINUOUS SEALANT BETWEEN WEIR PLATE AND CONCRETE WALL AND BETWEEN END OF WEIR PLATE AND CONCRETE WALL.
5. CHANGE ALUMINUM REFERENCES TO SS316L FOR STAINLESS STEEL WEIRS.
6. PROVIDE SLOTTED HOLES TO ALLOW ADJUSTMENT OF WEIR HEIGHT.

ELEVATION

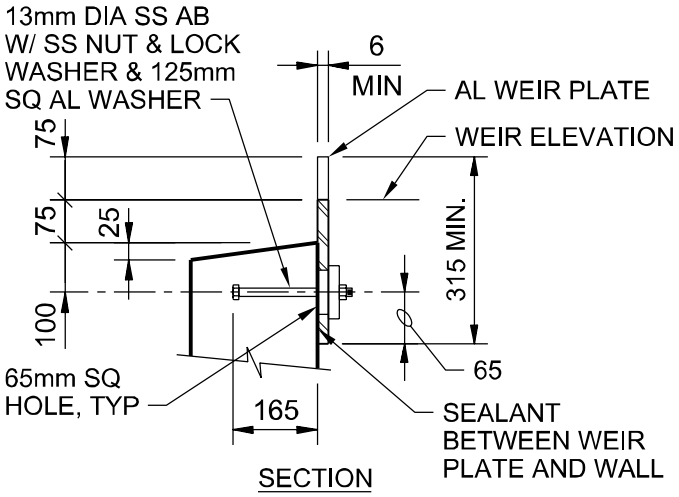

SECTION

V-NOTCH WEIR - TYPE B

NTS ALUMINUM

STANDARD DETAIL

DETAIL 2 OF 2

15991

JACOBS