


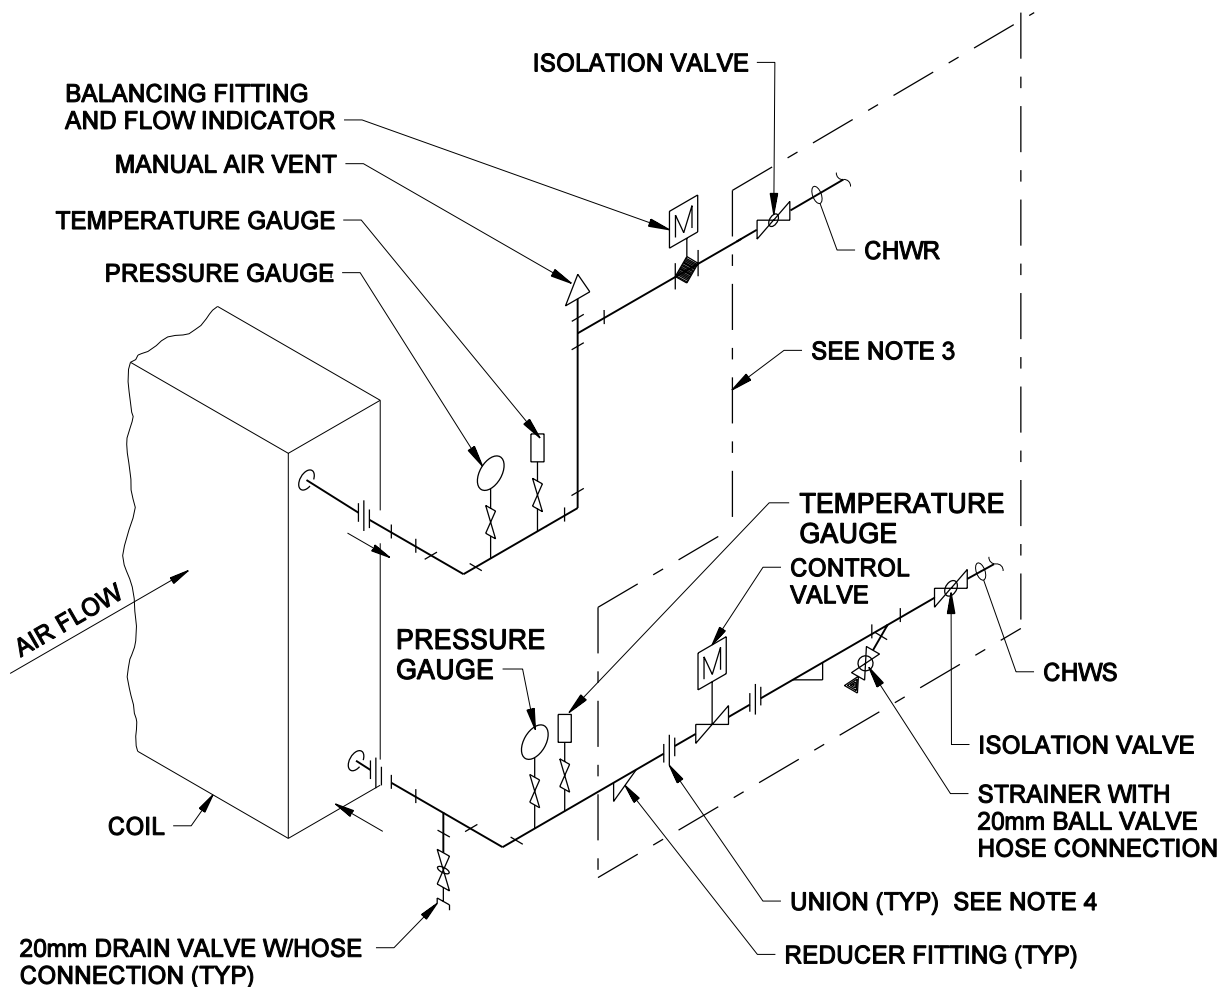

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED..
2. DETAIL GIVES REQUIRED SEQUENCE OF EQUIPMENT AND VALVES. PIPING ARRANGEMENT MAY VARY TO SUIT FIELD REQUIREMENTS. PIPE COIL FOR COUNTER FLOW WITH AIR.
3. ISOLATION VALVE : BELOW 100mm BALL VALVE, 100mm AND LARGER, BUTTERFLY VALVES .
4. SEE P&IDs FOR ISOLATION & CONTROL VALVE TAGS AND OTHER CONTROL ELEMENTS
5. USE FLANGE FOR 80mm AND LARGER

SINGLE COOLING COIL ARRANGEMENT

NTS

STANDARD DETAIL

15434

JACOBS