


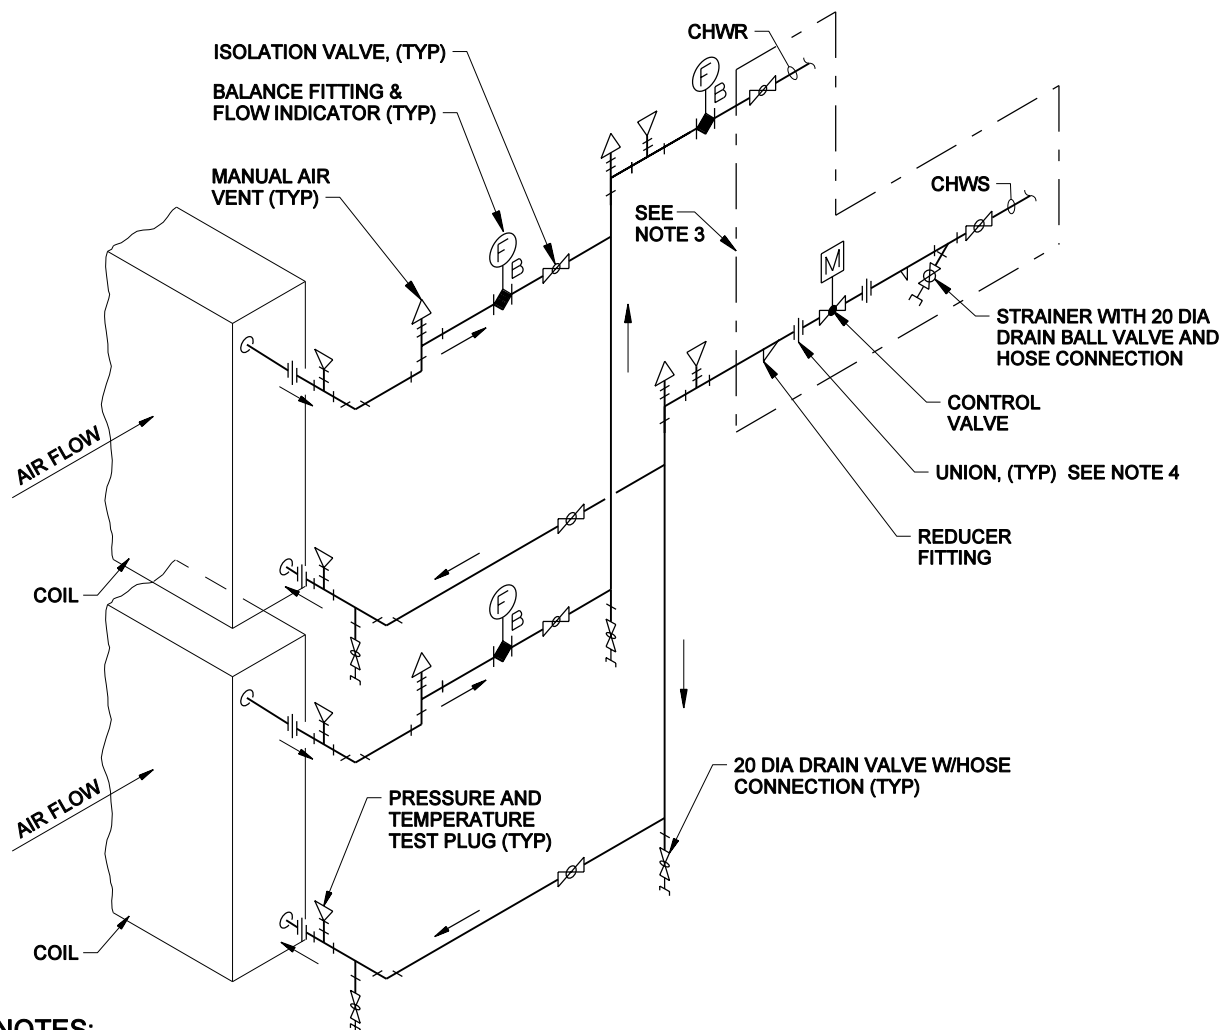

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. DETAIL GIVES REQUIRED SEQUENCE OF EQUIPMENT AND VALVES. PIPING ARRANGEMENT MAY VARY TO SUIT FIELD REQUIREMENTS. PIPE COIL FOR COUNTER FLOW WITH AIR.
3. FOR PIPE SIZES 100 DIA AND LARGER, USE BUTTERFLY VALVES IN LIEU OF BALL VALVES.
4. SEE P&IDs FOR ISOLATION AND CONTROL VALVES TAGS & OTHER CONTROL ELEMENTS.
5. USE FLANGE FOR 80mm AND LARGER

DOUBLE COOLING COIL ARRANGEMENT

NTS

STANDARD DETAIL

15448

JACOBS