


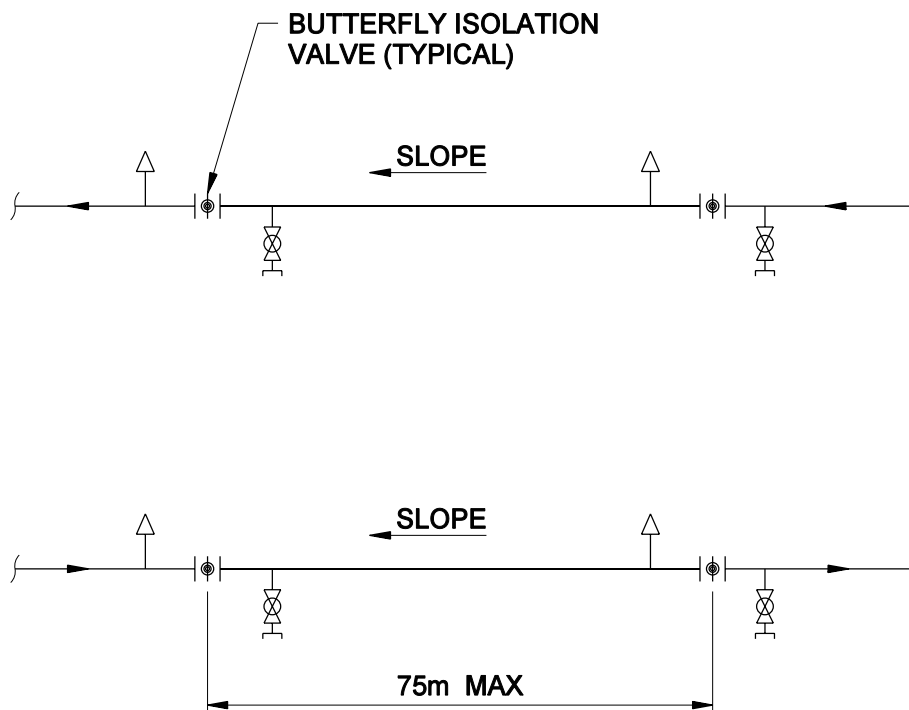

NOTES:

1. PROVIDE ISOLATION VALVE ASSEMBLY ON ALL CHW PIPING FOR PIPE RUNS EXCEEDING 75m. LOCATE 20mm HOSE VALVE IN LOWEST AND MANUAL AIR VENT IN HIGHEST POINT OF THE ISOLATED SECTION.
2. APPLICABLE FOR PIPE SIZE 65mm AND LARGER.
3. LOCATE ISOLATION VALVE ASSEMBLY TO BE ACCESSIBLE FOR MAINTENANCE.

ISOLATION VALVE ASSEMBLY

NTS

STANDARD DETAIL

15450

JACOBS