


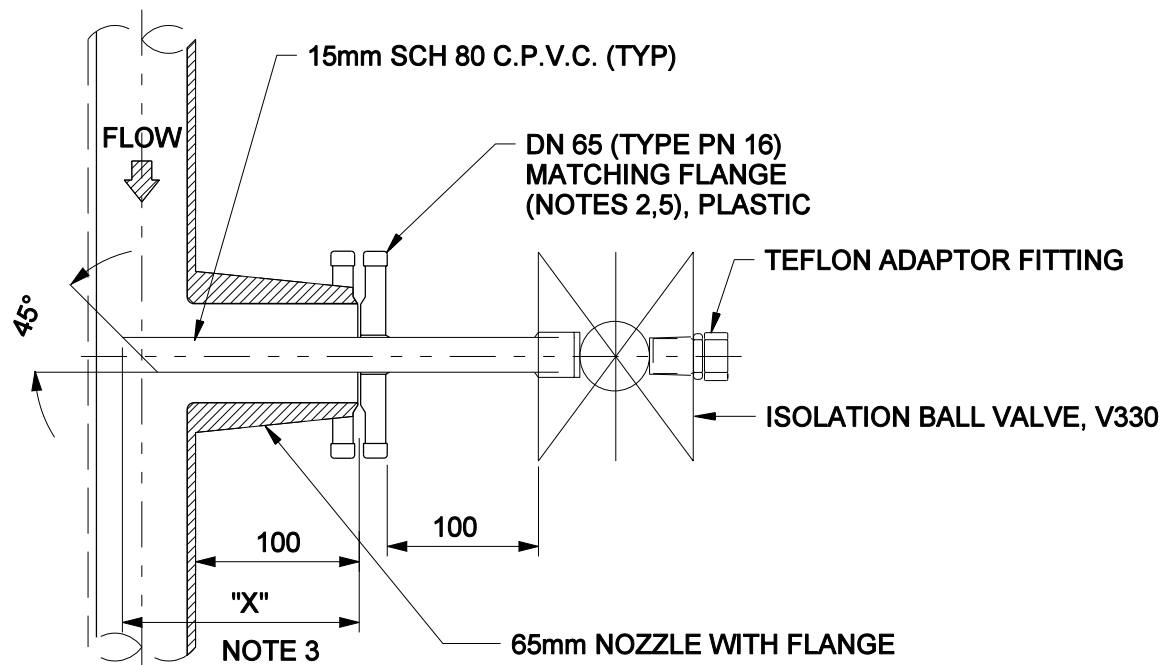

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. MATERIAL OF NOZZLE TO MATCH THE PROCESS PIPING MATERIAL .
3. FLANGE TO BE STAMPED WITH TAG NUMBER AND DIRECTION OF FLOW INDICATION.
4. "X" = 1/2 ID OF PIPE + THICKNESS OF PIPE + 100mm
5. ALL BOLTS, NUTS AND (2) FLAT WASHERS PER BOLT FOR FLANGE TO BE 316 SS AND TO BE SUPPLIED BY OTHERS. GASKETS FOR ALL FLANGES TO BE 3mm THK. NEOPRENE AND SUPPLIED BY OTHERS.
6. THE CPVC PIPE CONNECTION TO DN 65 FLANGE TO BE FULL COUPLING SOLVENT WELDED TO PLASTIC FLANGE.

SAMPLING PROBE INSTALLATION

NTS

STANDARD DETAIL

15897

JACOBS