


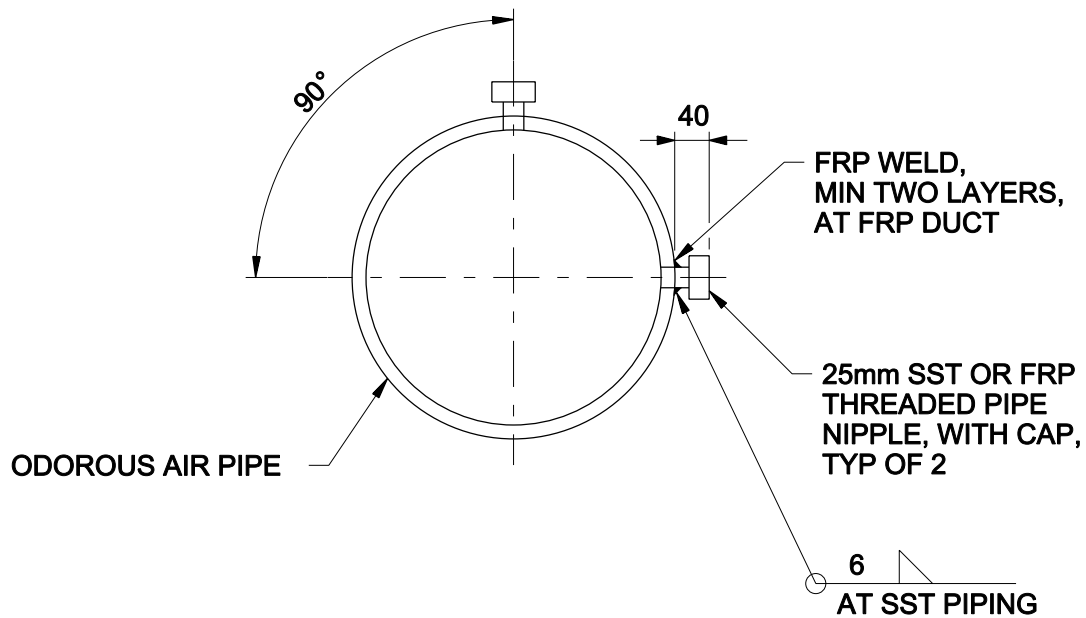

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. LOCATE TEST PORTS AT CROWN OF DUCT/PIPE AND AT HORIZONTAL CENTERLINE, AS SHOWN.

ODOROUS AIR TEST PORT

NTS

STANDARD DETAIL

15899

JACOBS