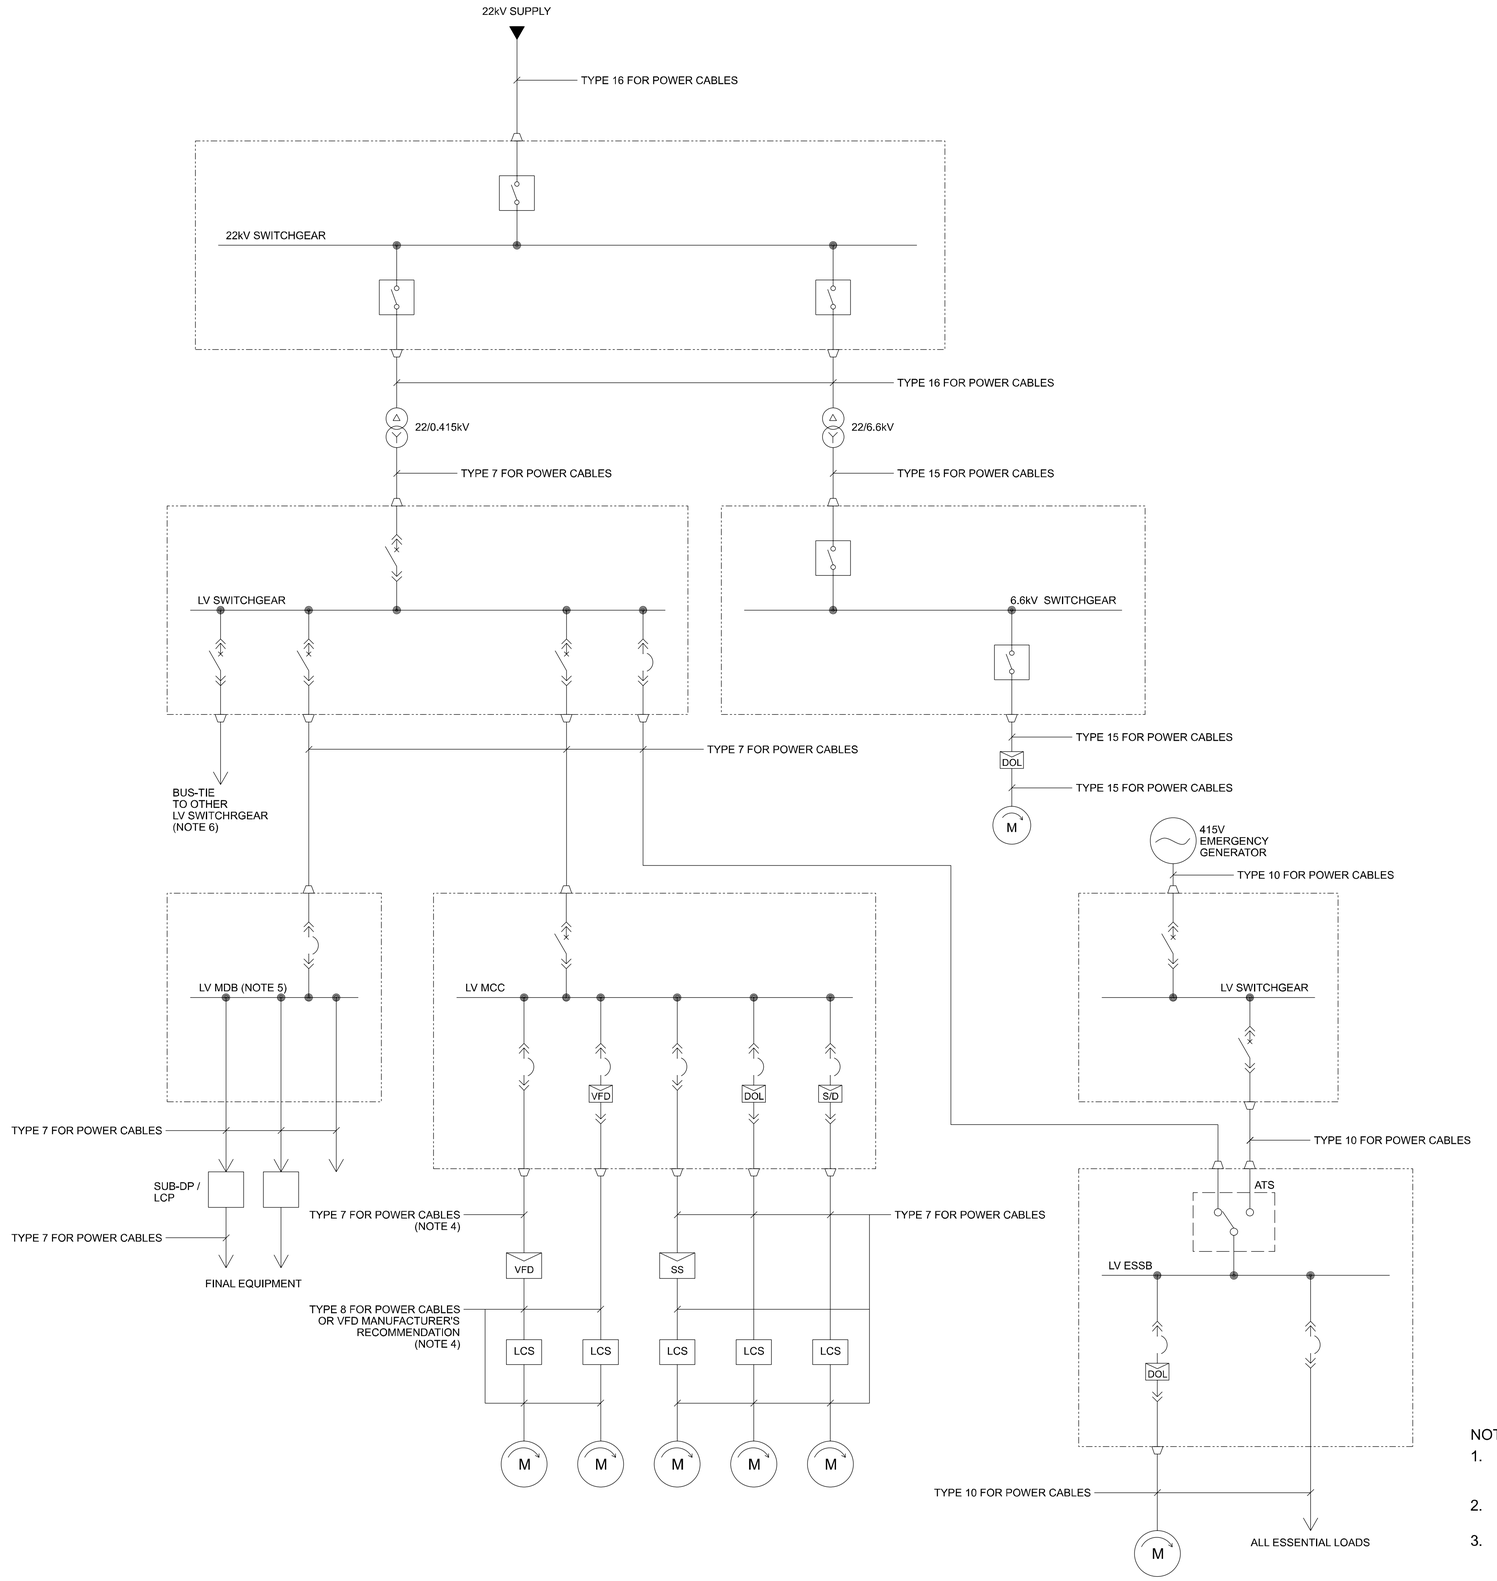


NOTES:

1. THIS DRAWING IS INTENDED TO SHOW THE TYPE OF CABLES THAT SHALL BE USED. REFER TO RESPECTIVE SINGLE LINE DRAWINGS FOR ACTUAL BREAKER TYPE AND RATINGS.
2. THE CONTRACTOR SHALL SIZE AND PROVIDE ALL CABLES IN ALLOWANCE WITH ALL LOCAL CODES / REGULATIONS.
3. TYPE 10 FIRE RESISTANT CABLES SHALL BE PROVIDED FOR EQUIPMENT THAT IS REQUIRED TO OPERATE DURING AN EMERGENCY AND SHALL BE IN COMPLIANCE WITH THE FIRE CODE. THESE CABLES SHALL COMPLY WITH SS299.
4. ALSO APPLICABLE TO VFDs DIRECTLY CONNECTED TO LV SWITCHGEAR.
5. ALSO APPLICABLE TO NON-PROCESS MDB.
6. ALSO APPLICABLE TO BUS-TIE CABLES BETWEEN MCC & MDB.

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER	LBL	LF

CLIENT:
PUB SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:
binnies AECOM
A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:
Jacobs
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:
TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE
CABLE SELECTION CRITERIA

DRAFTED:	DESIGNED:	SHEET SIZE:
UM	GR	A1
DRAFTING CHECK:	DESIGN CHECK:	SCALE:
DW	SK/PC	NA
DATE:	REVIEWED:	PBS:
20/05/22	LBL	131101

CONTRACT: C4B
DRAWING NUMBER: PUB-DTSS2-TWRP
SHEET NUMBER: WSW41-E-7400
REVISION: T1

THIS DRAWING IS COPYRIGHT