


Supplement | EXPLORATORY / CONFOUNDED NSTDB sensitivity

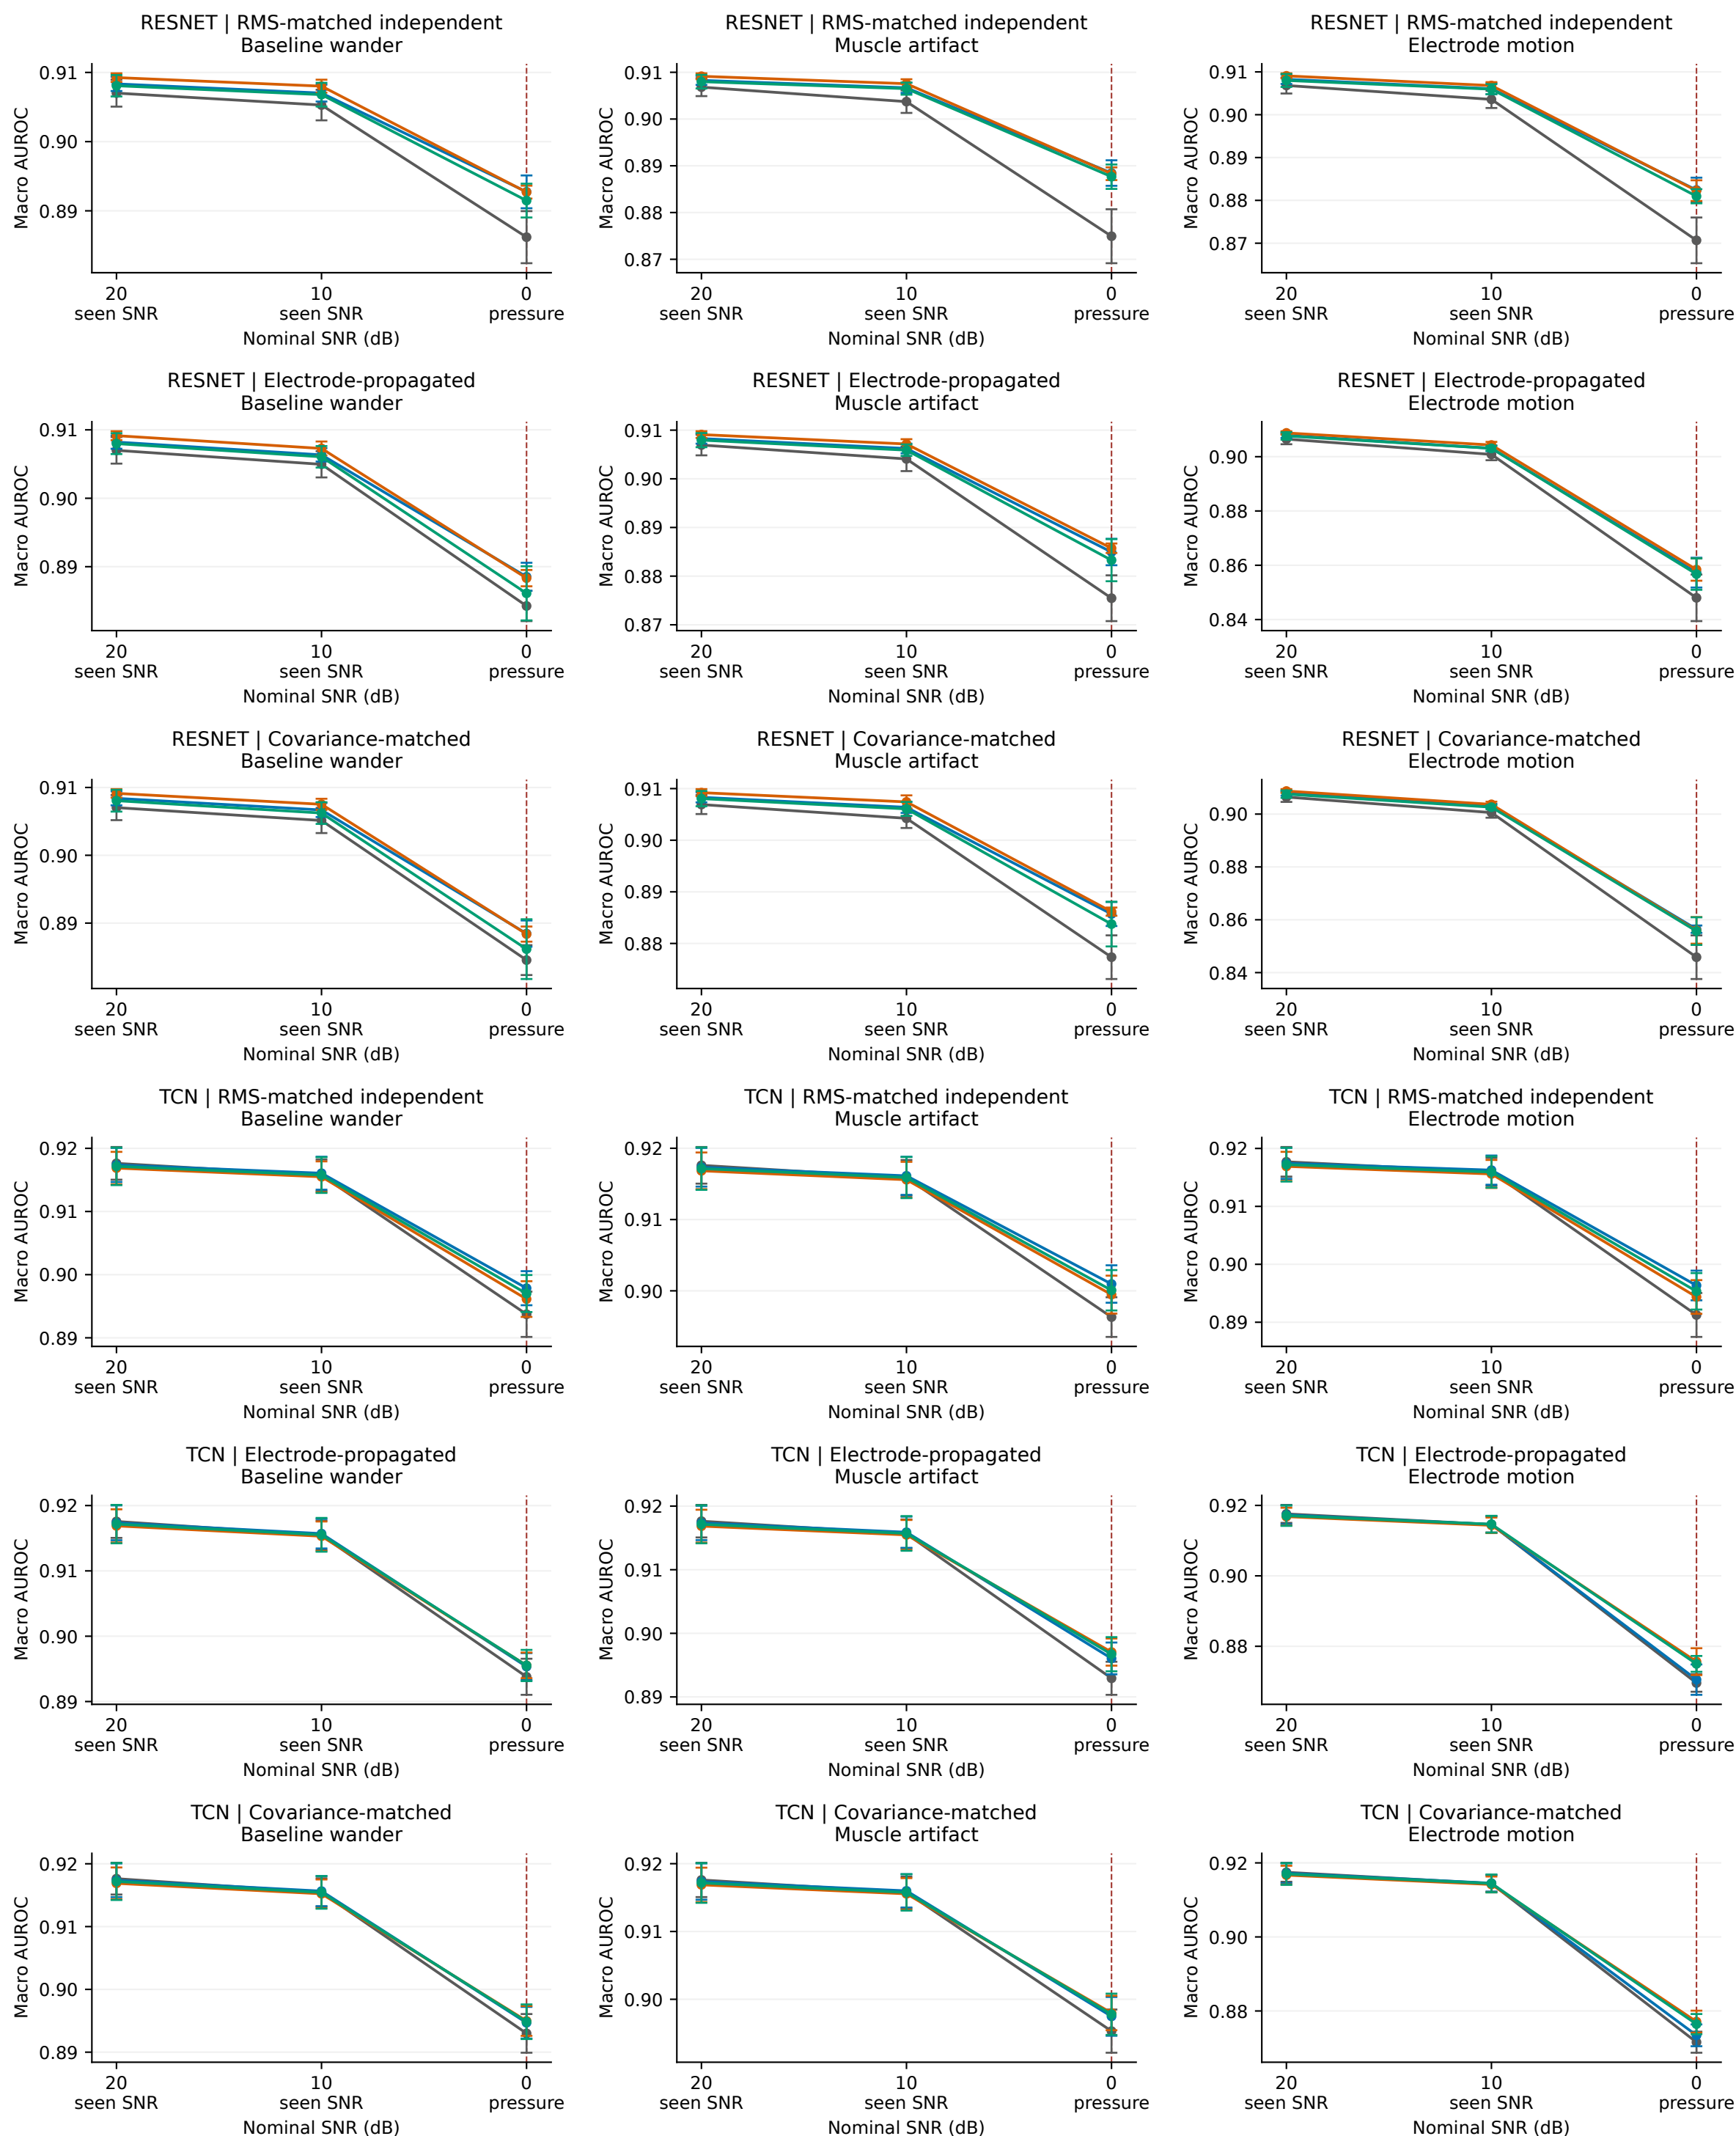

Lower-evidence sensitivity analysis, not a pure electrode-domain causal test: recorded lead-space NSTDB sources are repurposed as electrode disturbances, with source/recording mismatch. All noise types and perturbation structures are shown in the all-electrode stress configuration. Mean $\pm$ 1 sample SD across 5 training seeds (not a CI). No confirmatory inference; 0 dB is pressure. AP/F1, Brier/ECE, and other detailed metrics remain in the persisted CSVs.

— Clean only — Independent RMS augmentation — Electrode augmentation — Mixed augmentation