


RESNET | Classwise reliability (descriptive)

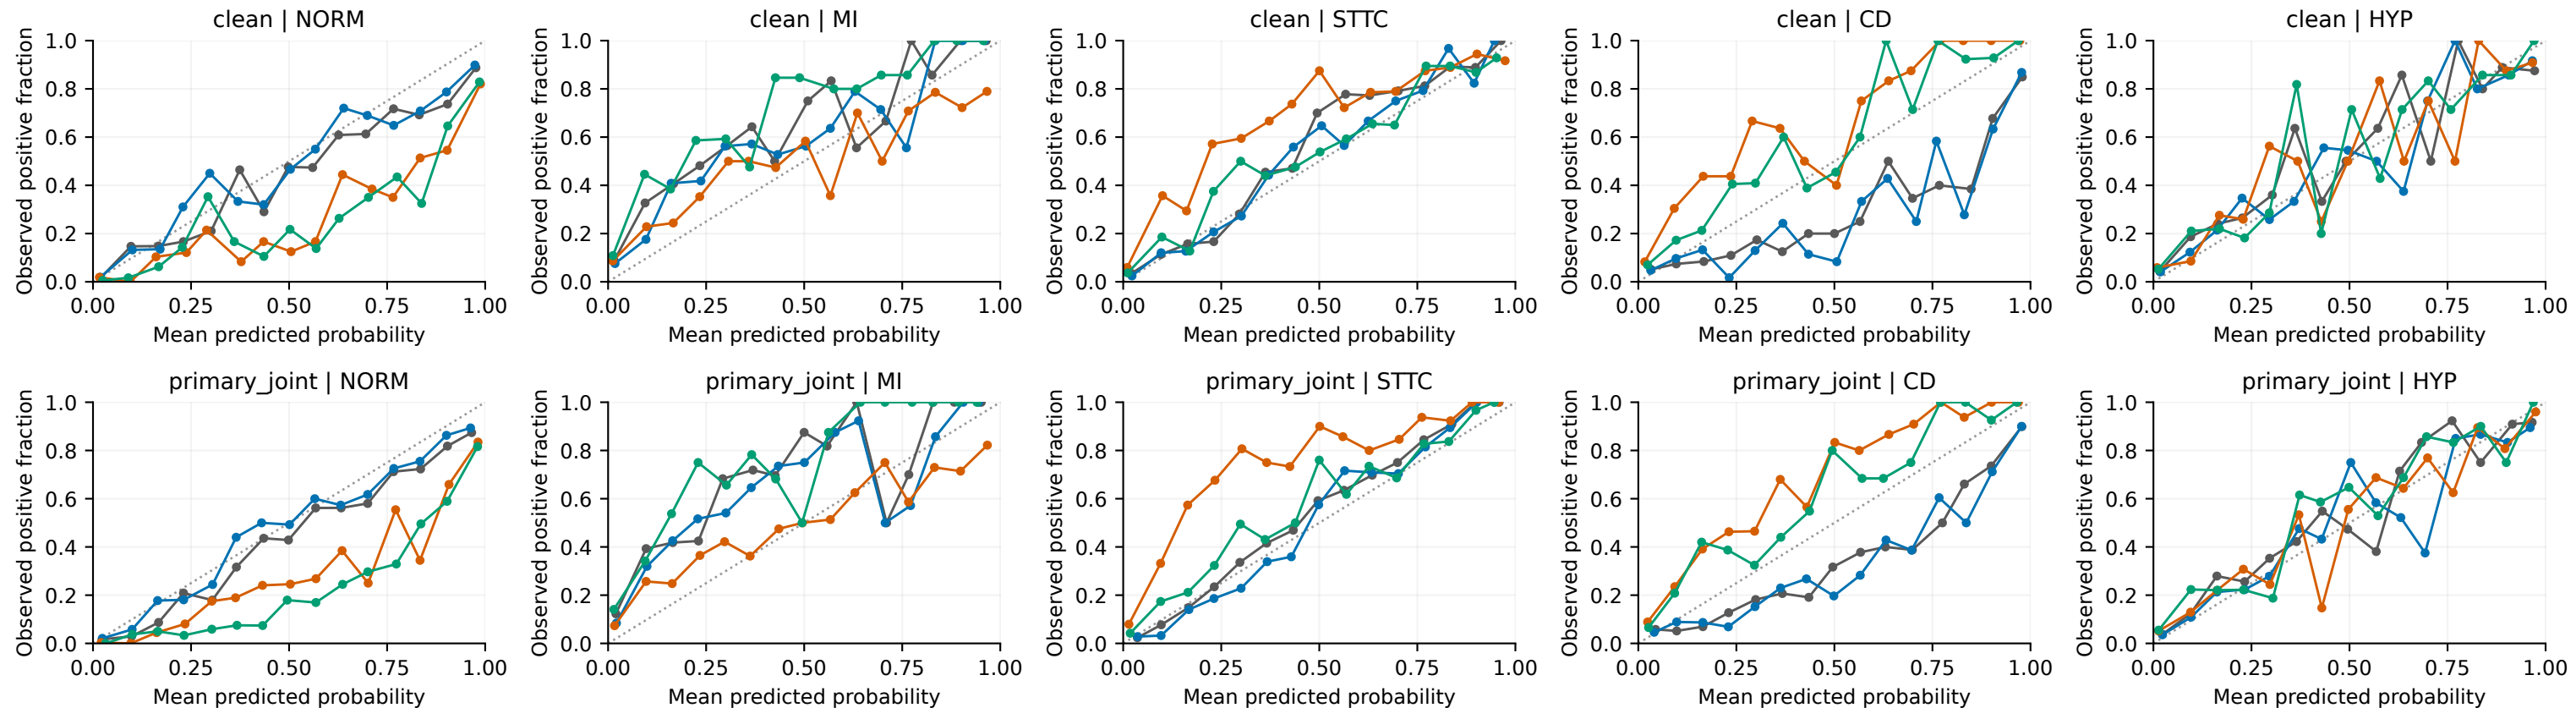

TECHNICAL PILOT; not confirmatory. Saved 15-bin sufficient statistics pooled across fixed checkpoints and group cases. Repeated predictions are descriptive, not independent patients and not an ensemble. Empty bins are omitted, not assigned zero accuracy. No calibration fitting on test data, and no CI. Primary group = available joint unseen-SNR held-out combinations.

— Clean only — Independent RMS augmentation — Electrode augmentation — Mixed augmentation