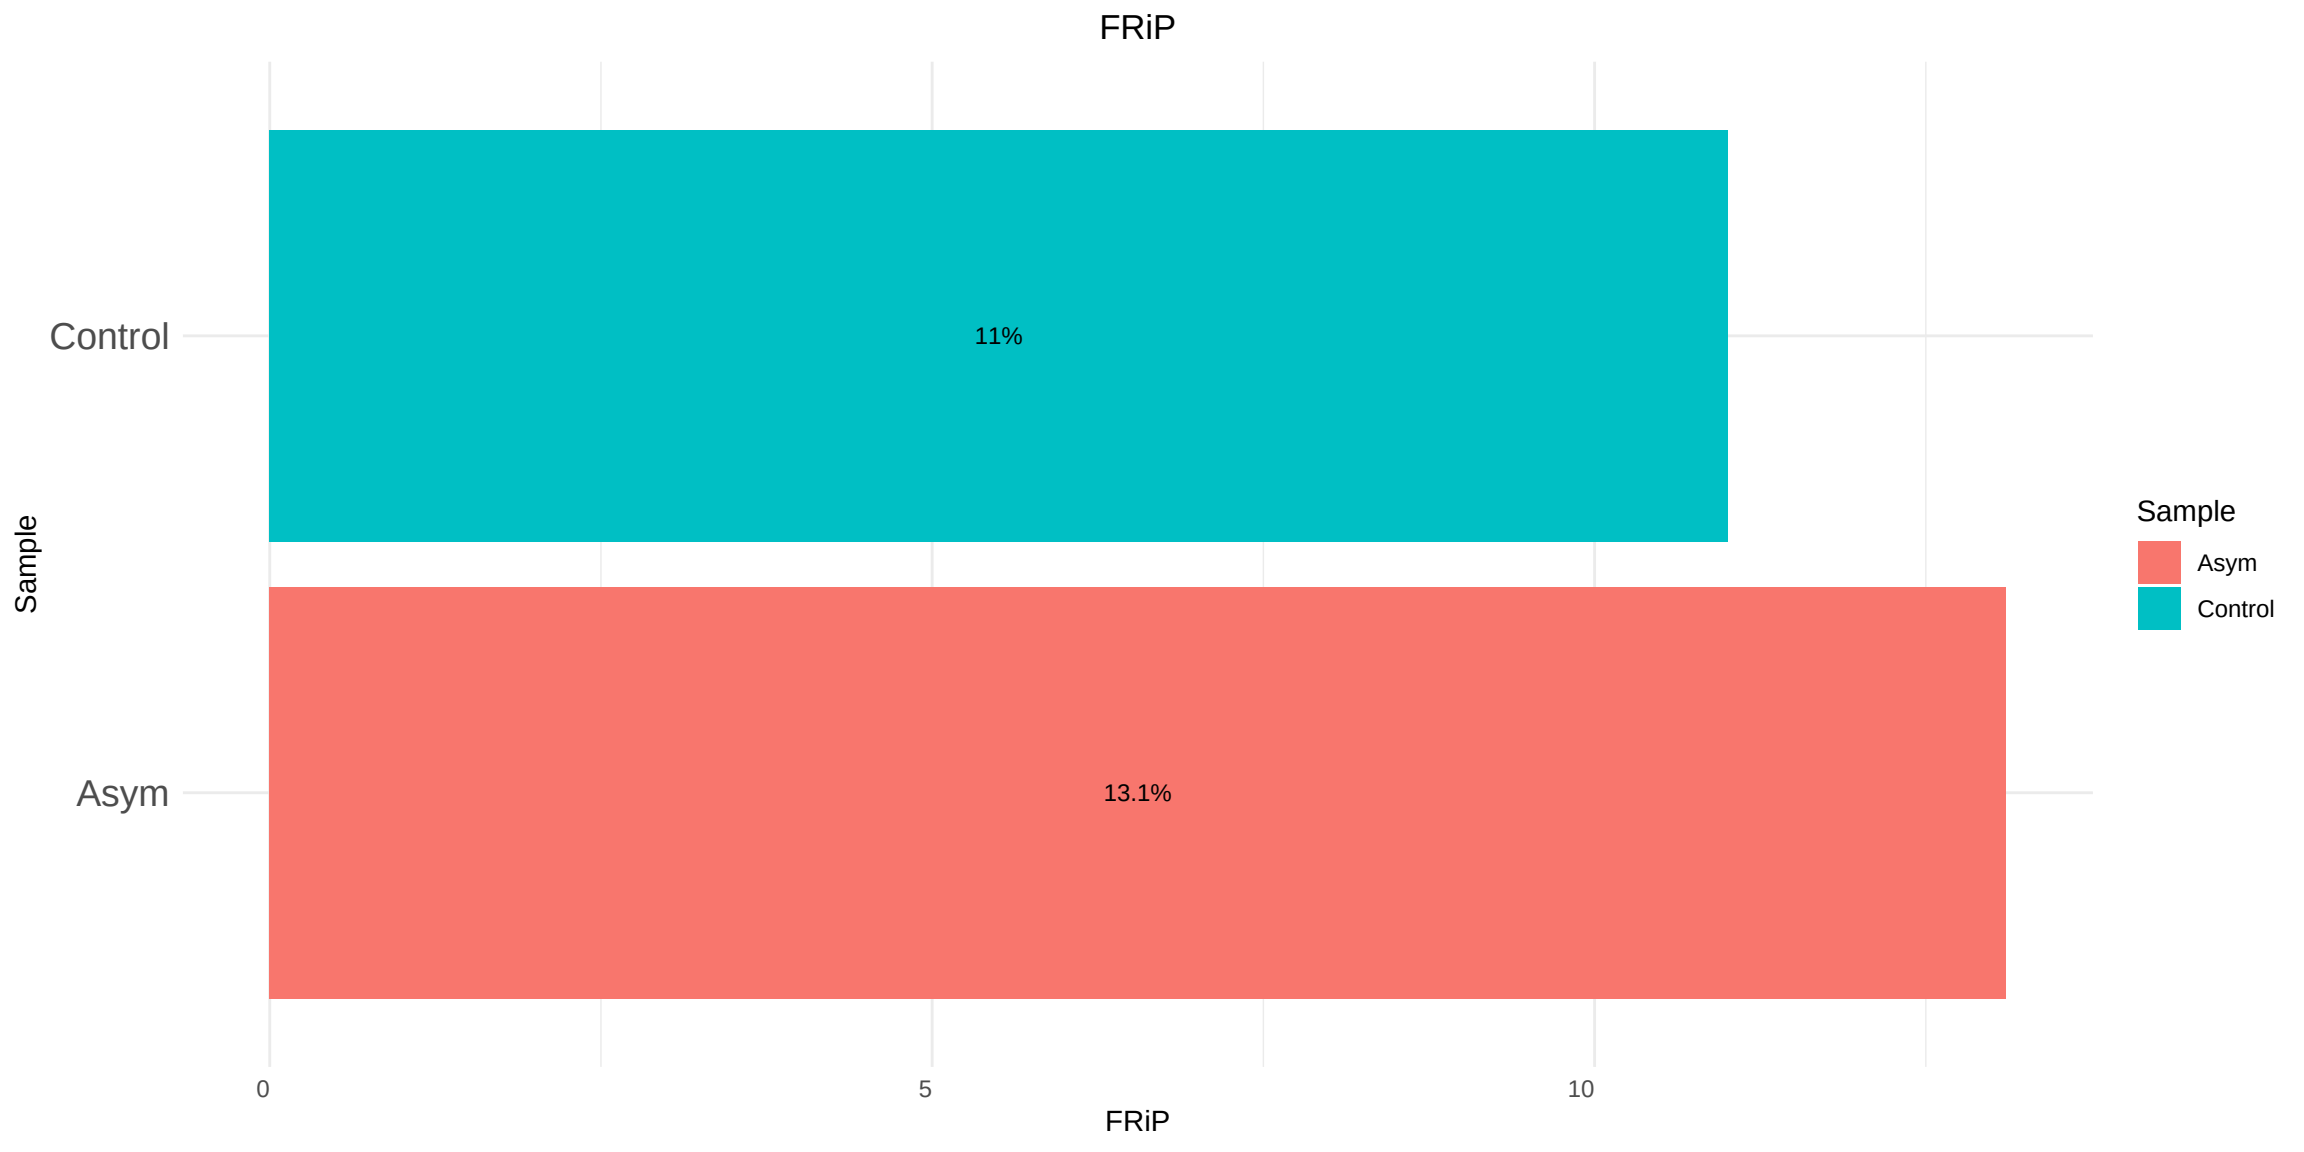
FRiP
Control
Asym
Sample
11%
13.1%
0
5
10
FRiP
Sample
Asym
Control