





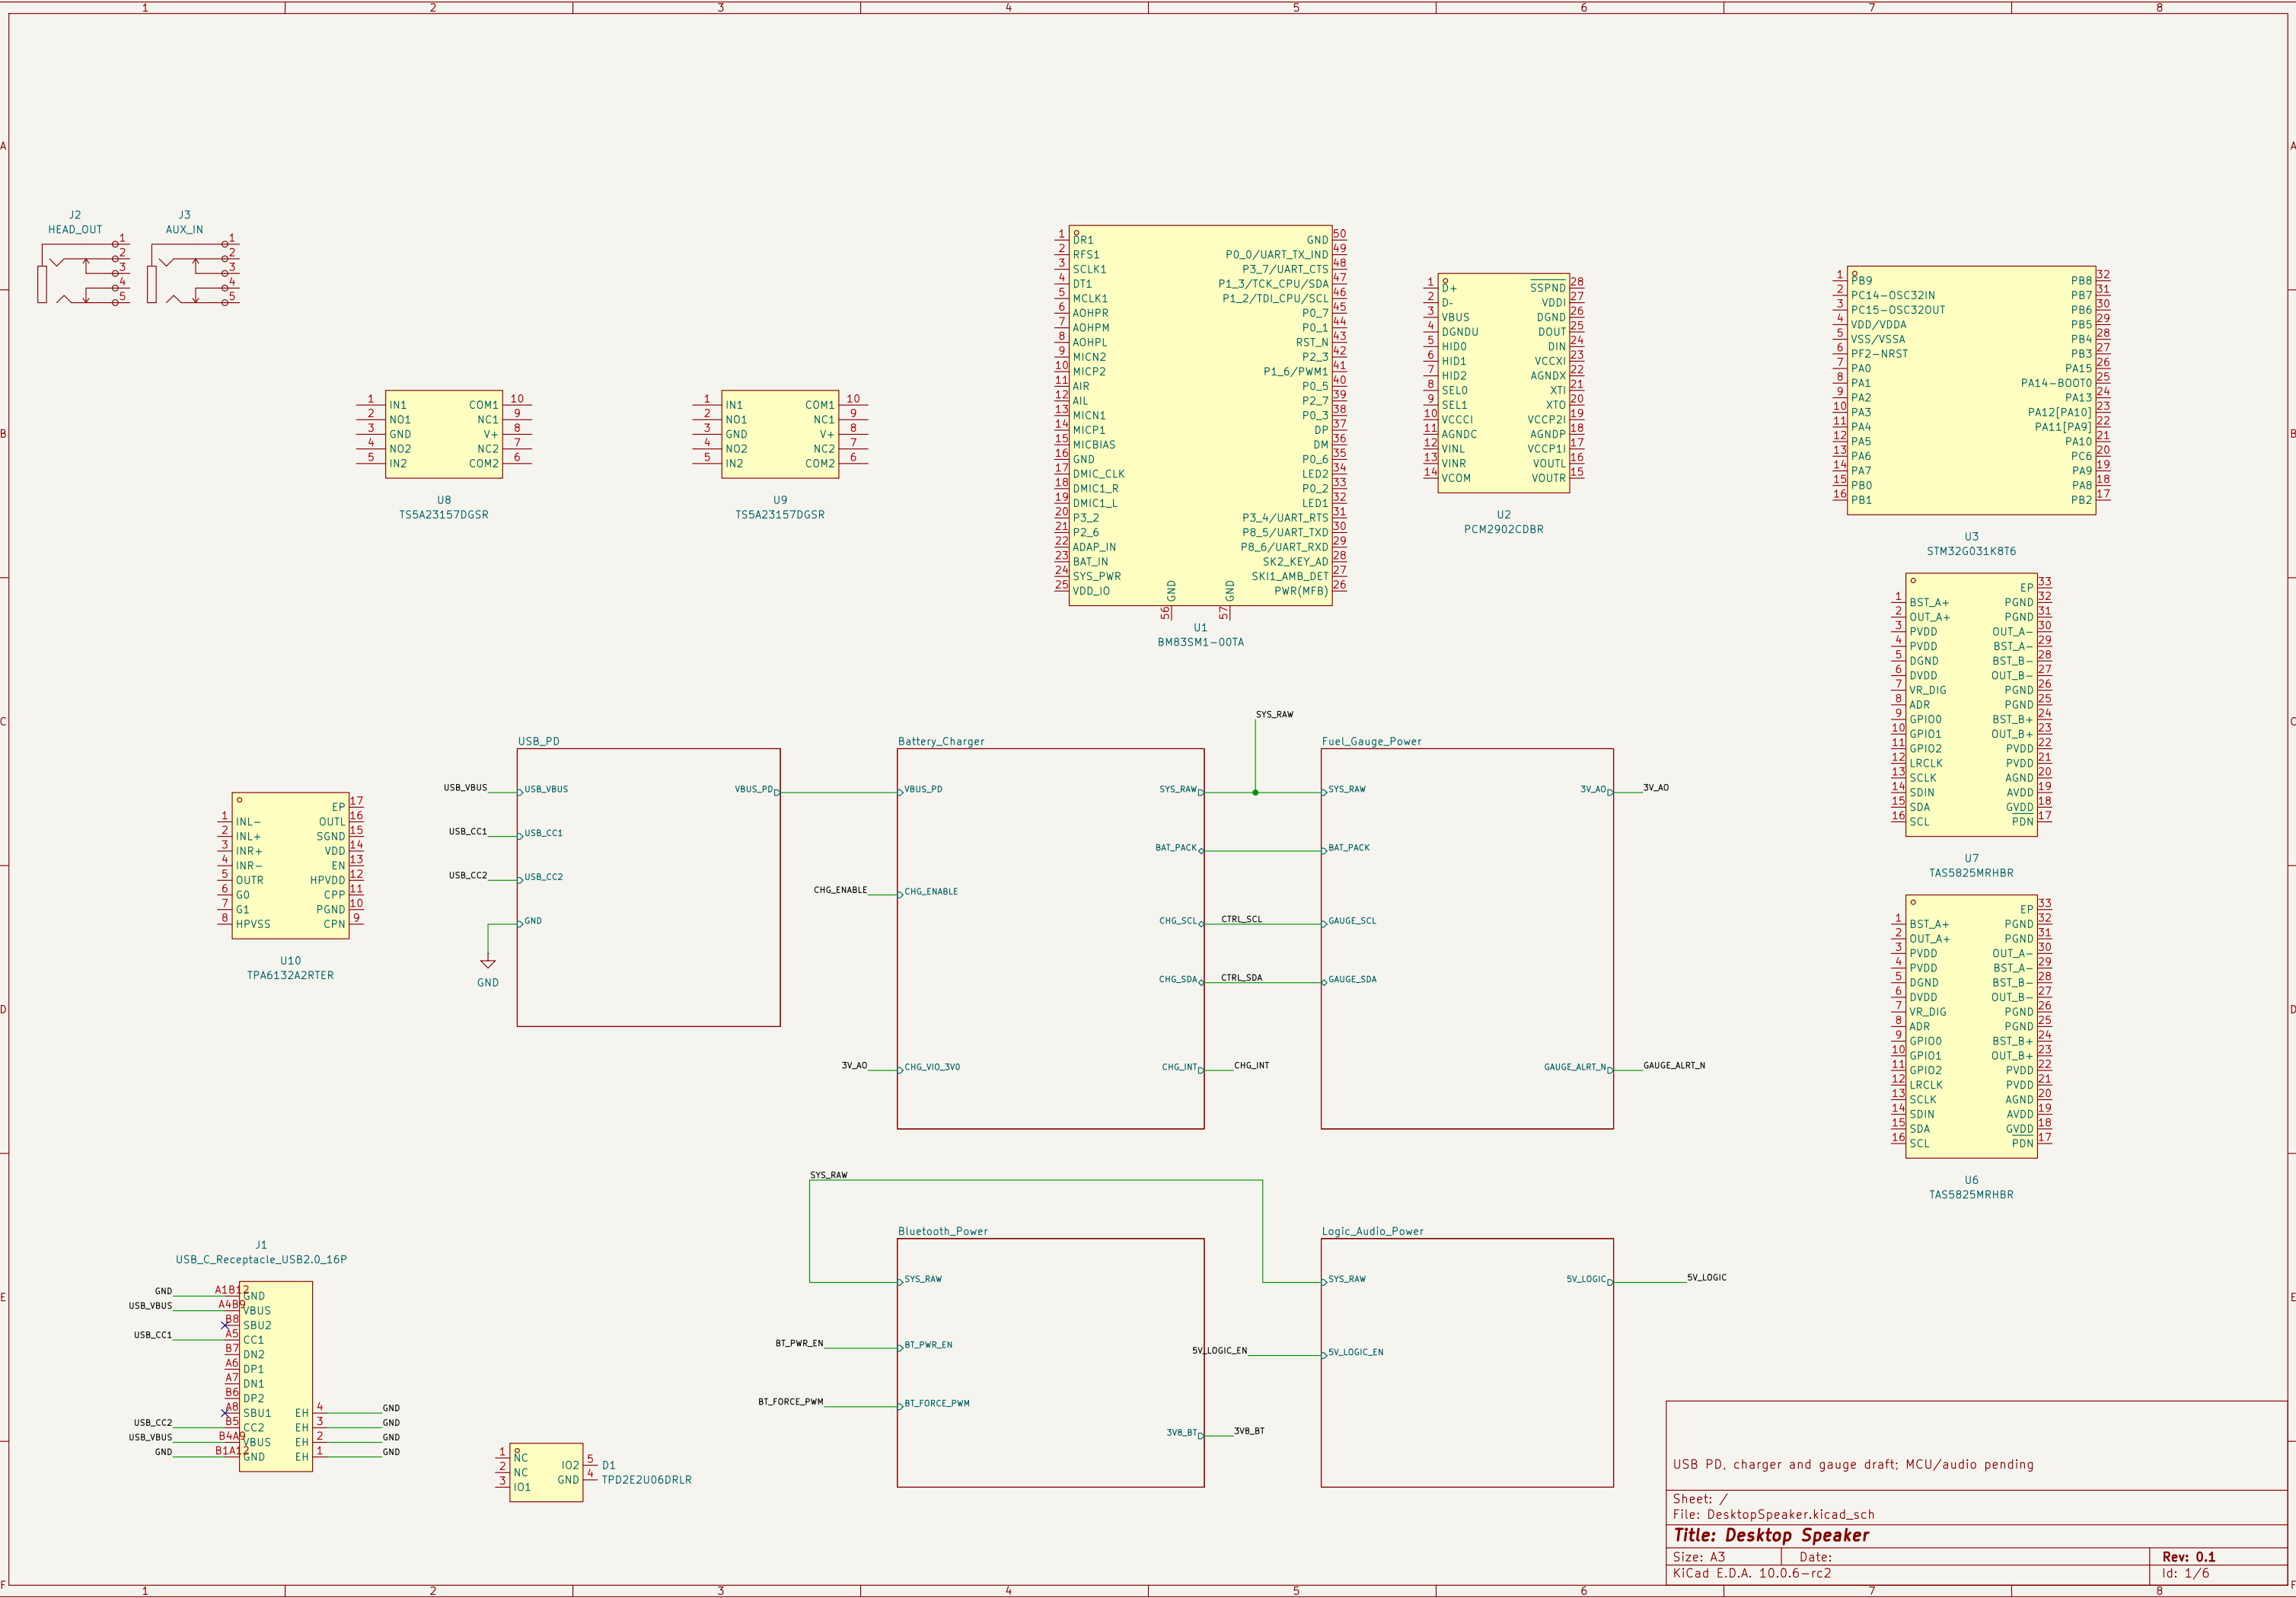

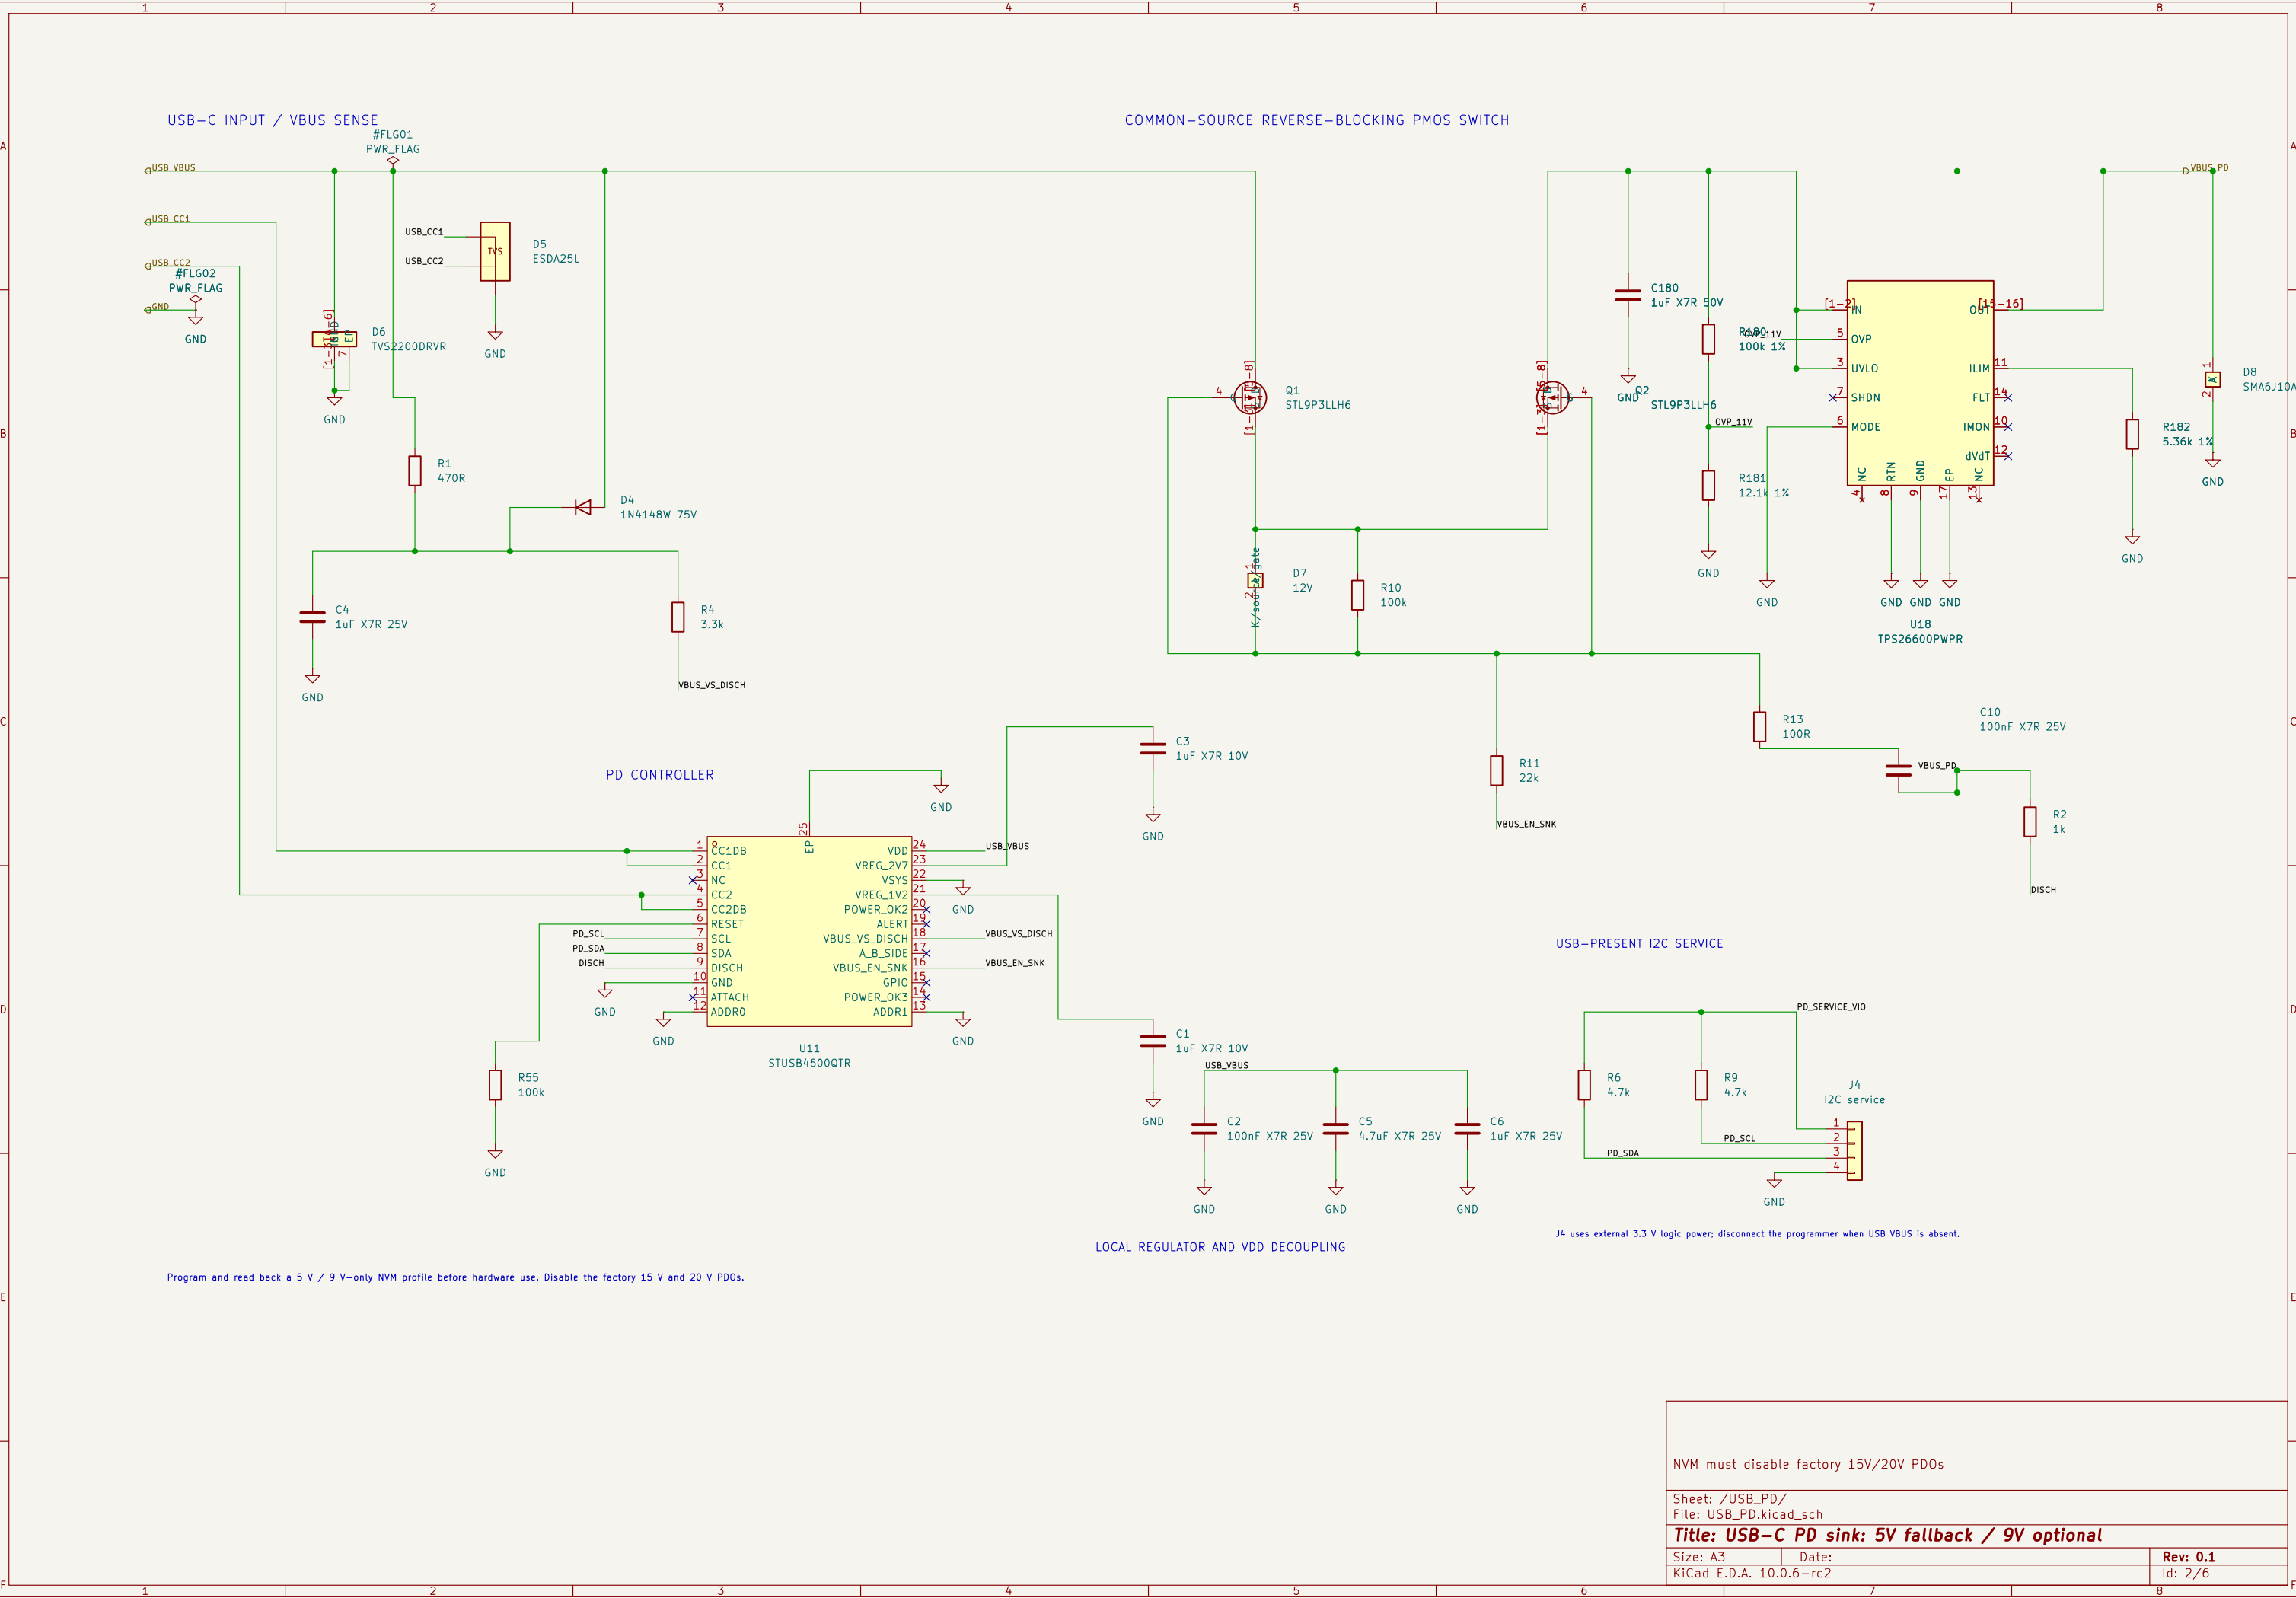

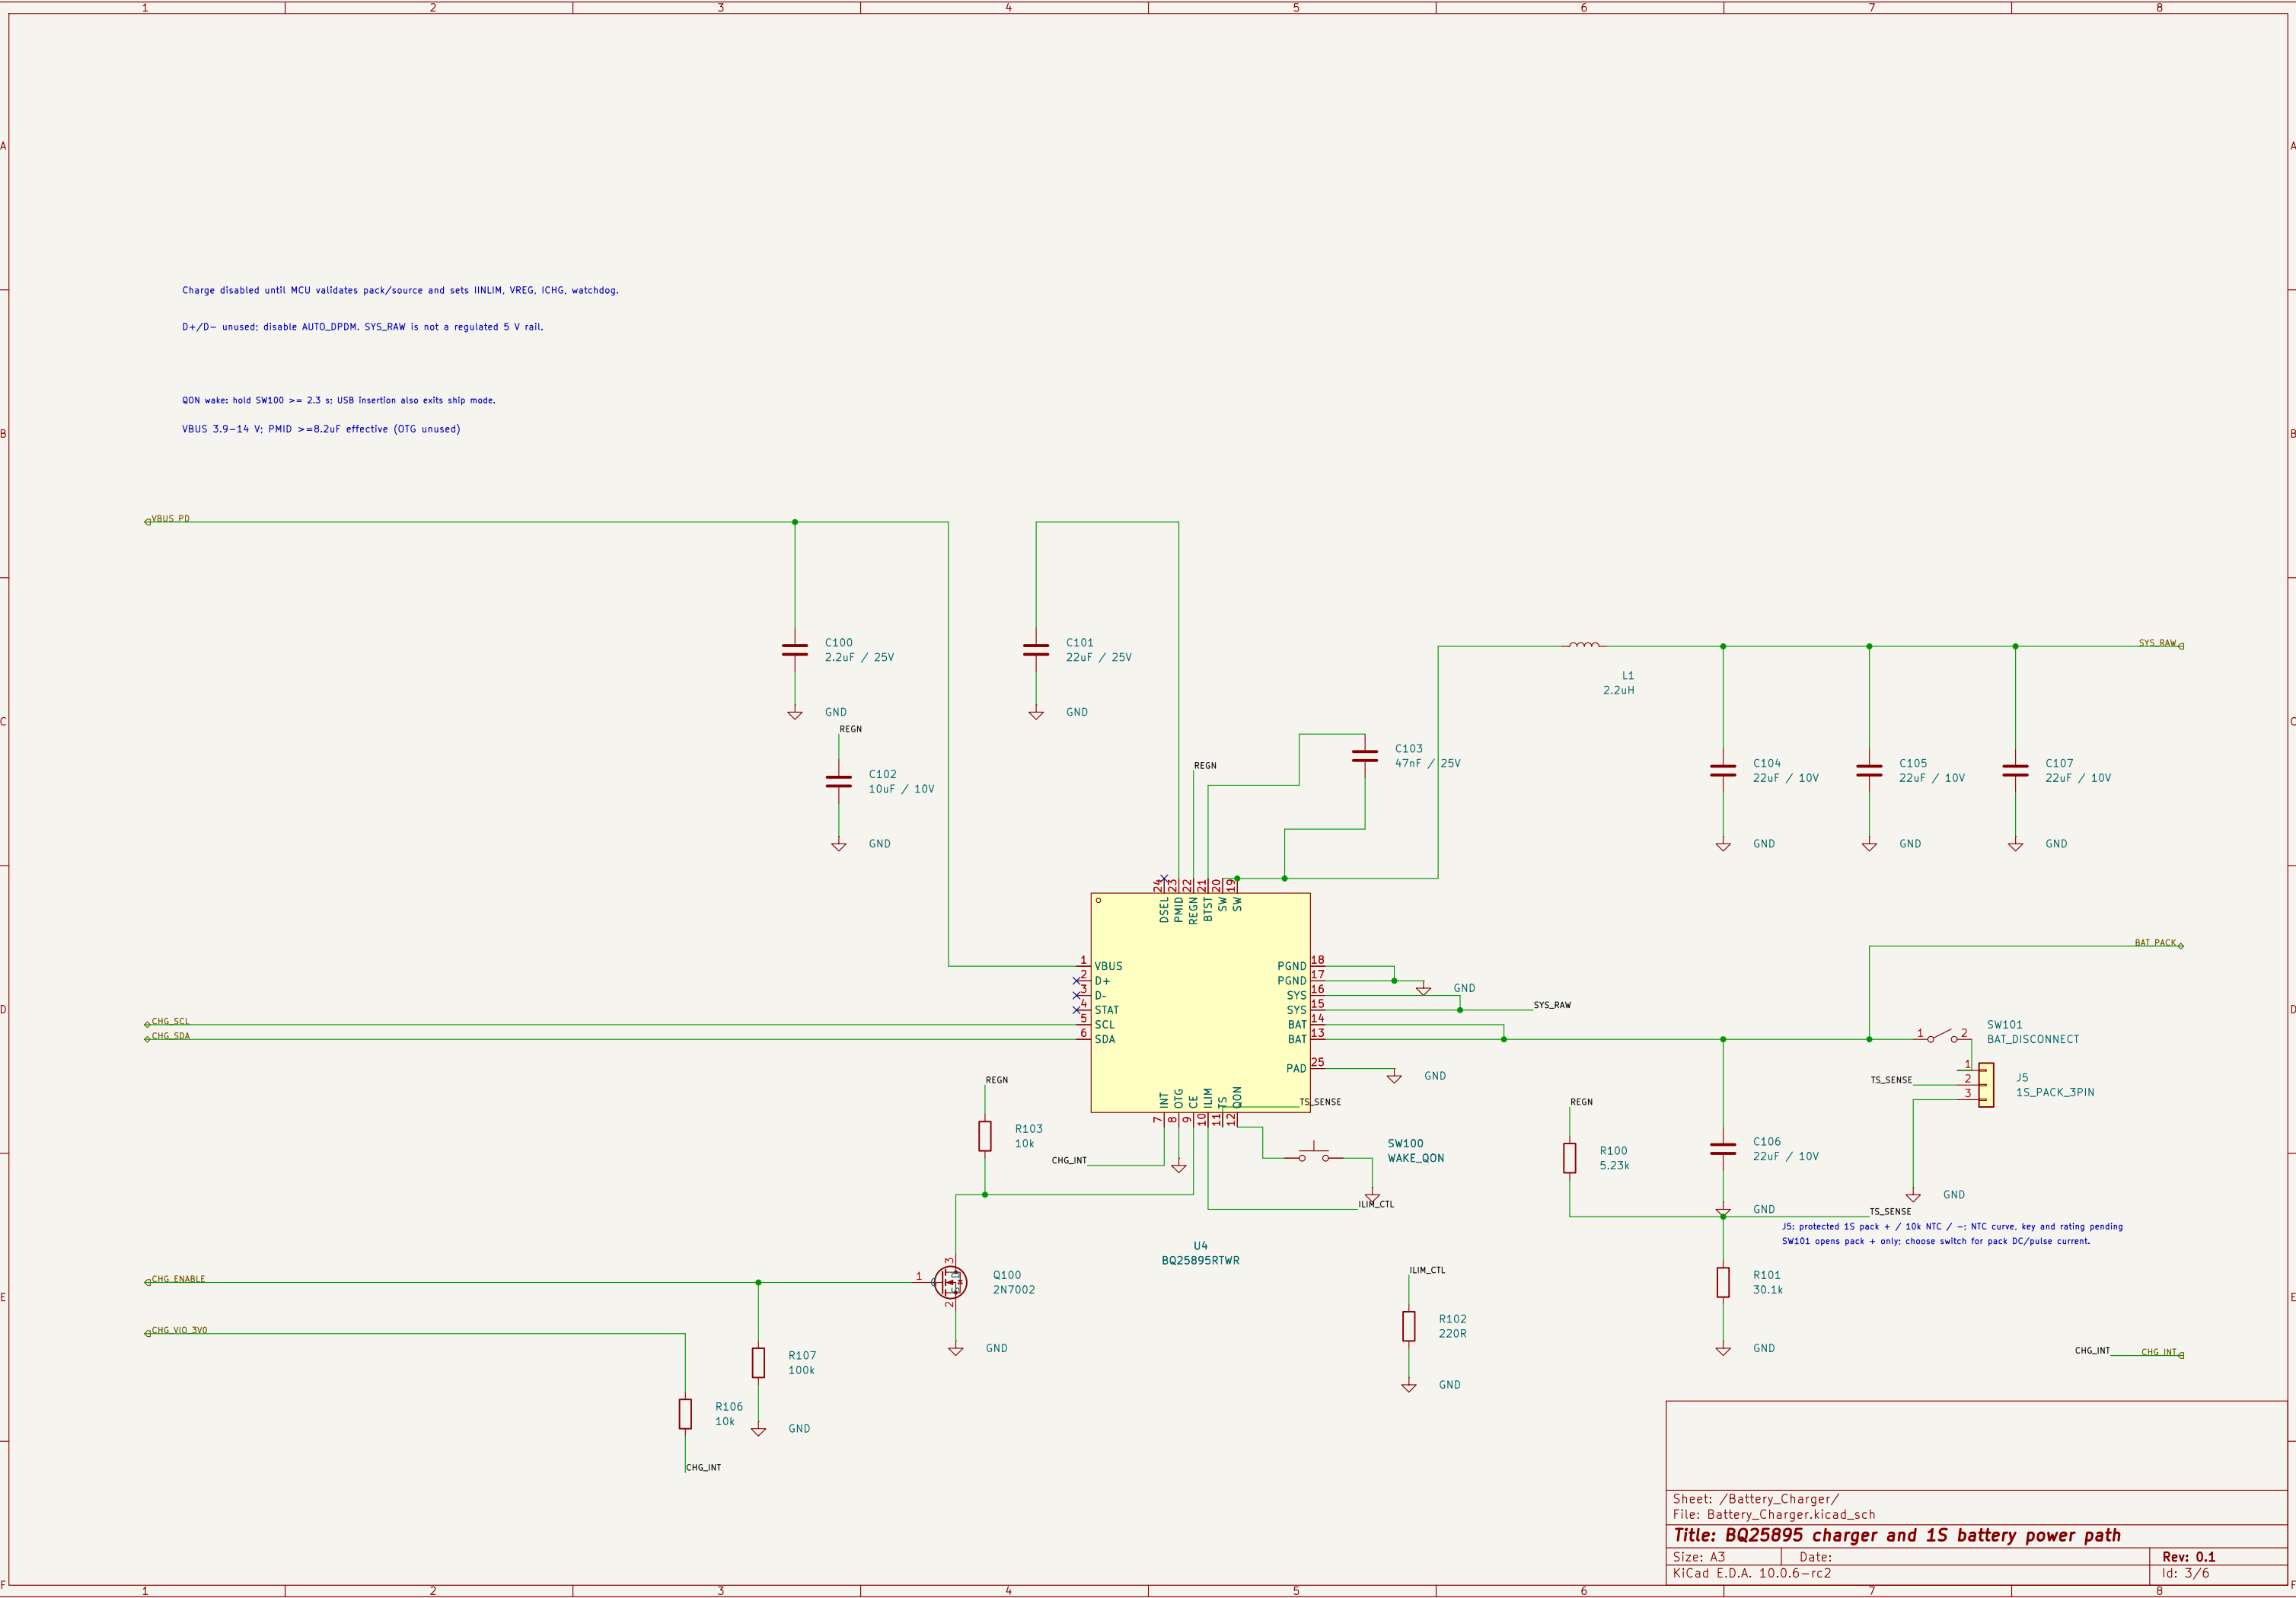

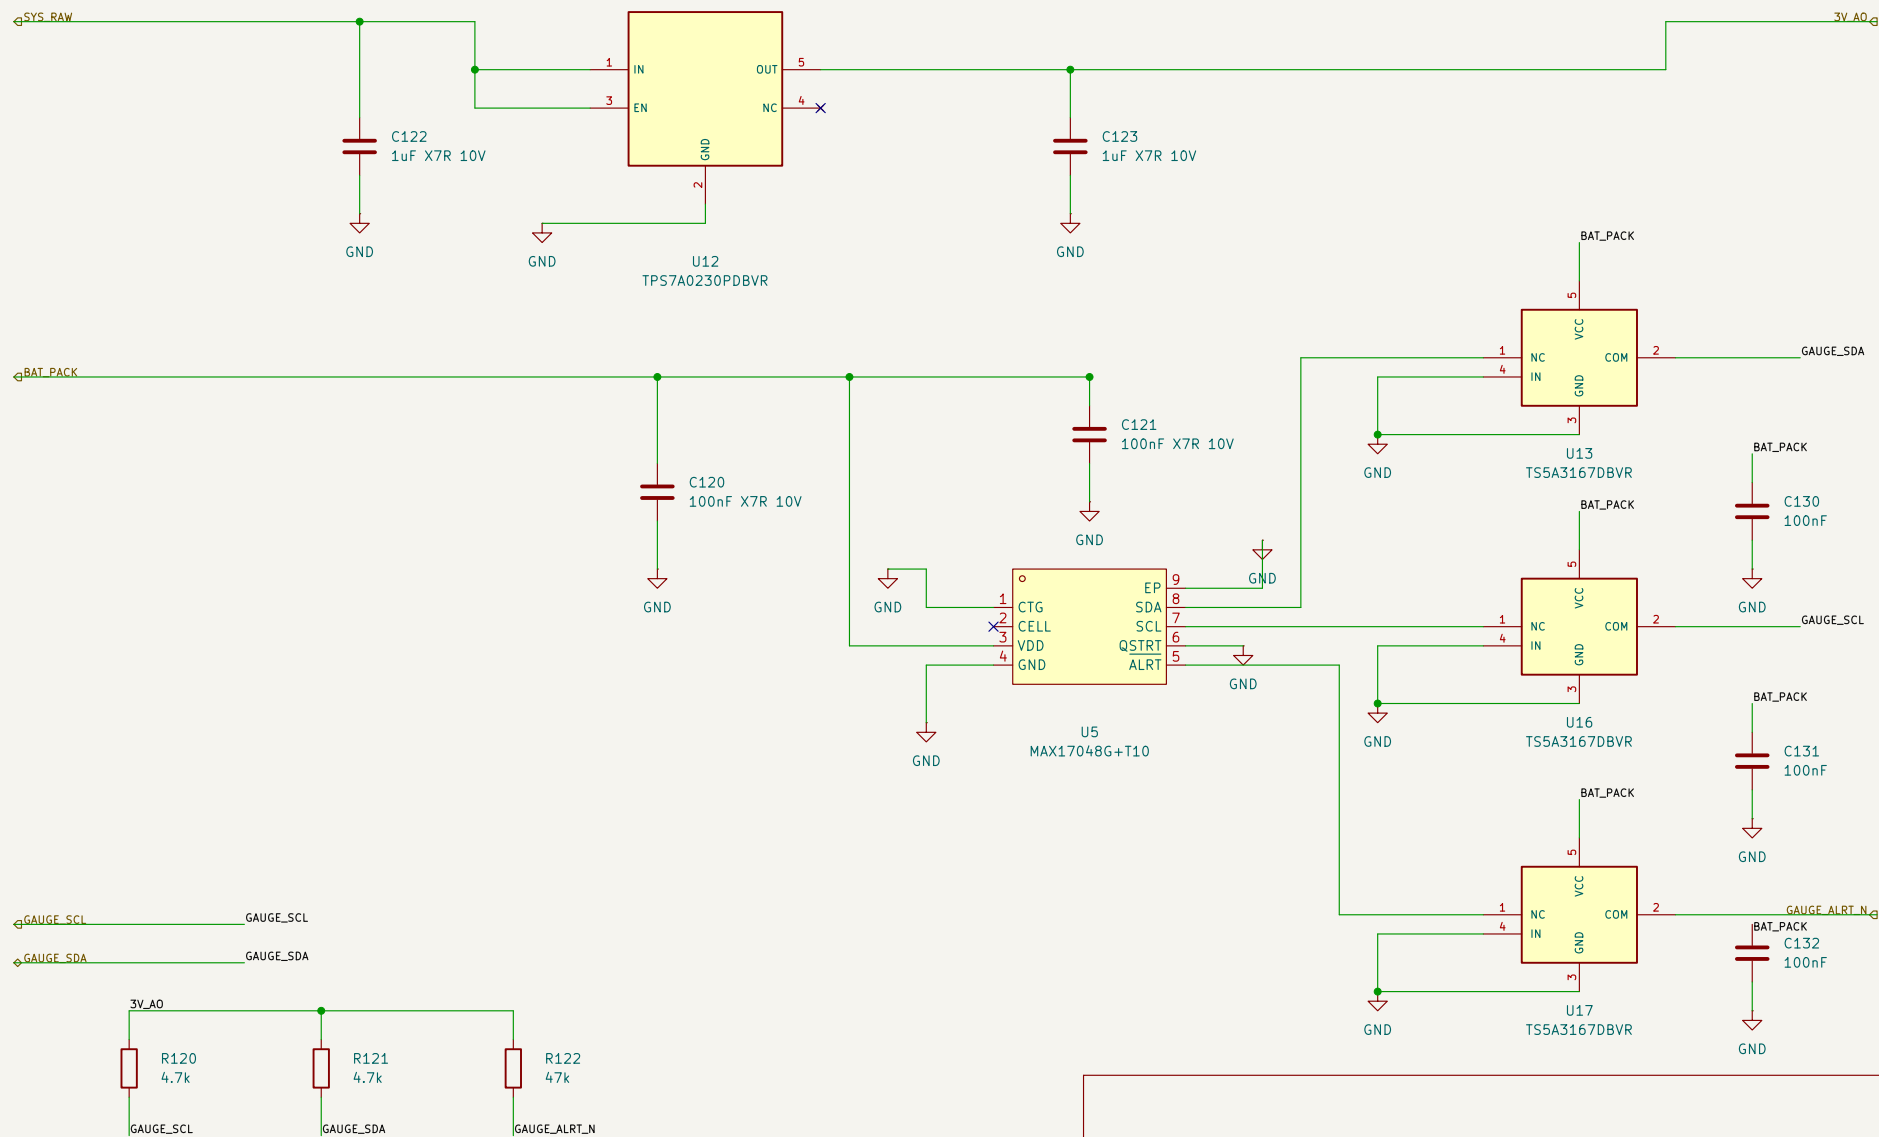

CELL pad 2 unused on MAX17048; QSTRT tied low

Gauge isolation: 3 active-low BAT-powered switches; OFF when BAT absent

Sheet: /FuelGauge_Power/
File: FuelGauge_Power.kicad_sch


Title: Fuel gauge and low-current power

Size: A4
KiCad E.D.A. 10.0.6-rc2

Date:

Rev: 0.1

Id: 4/6

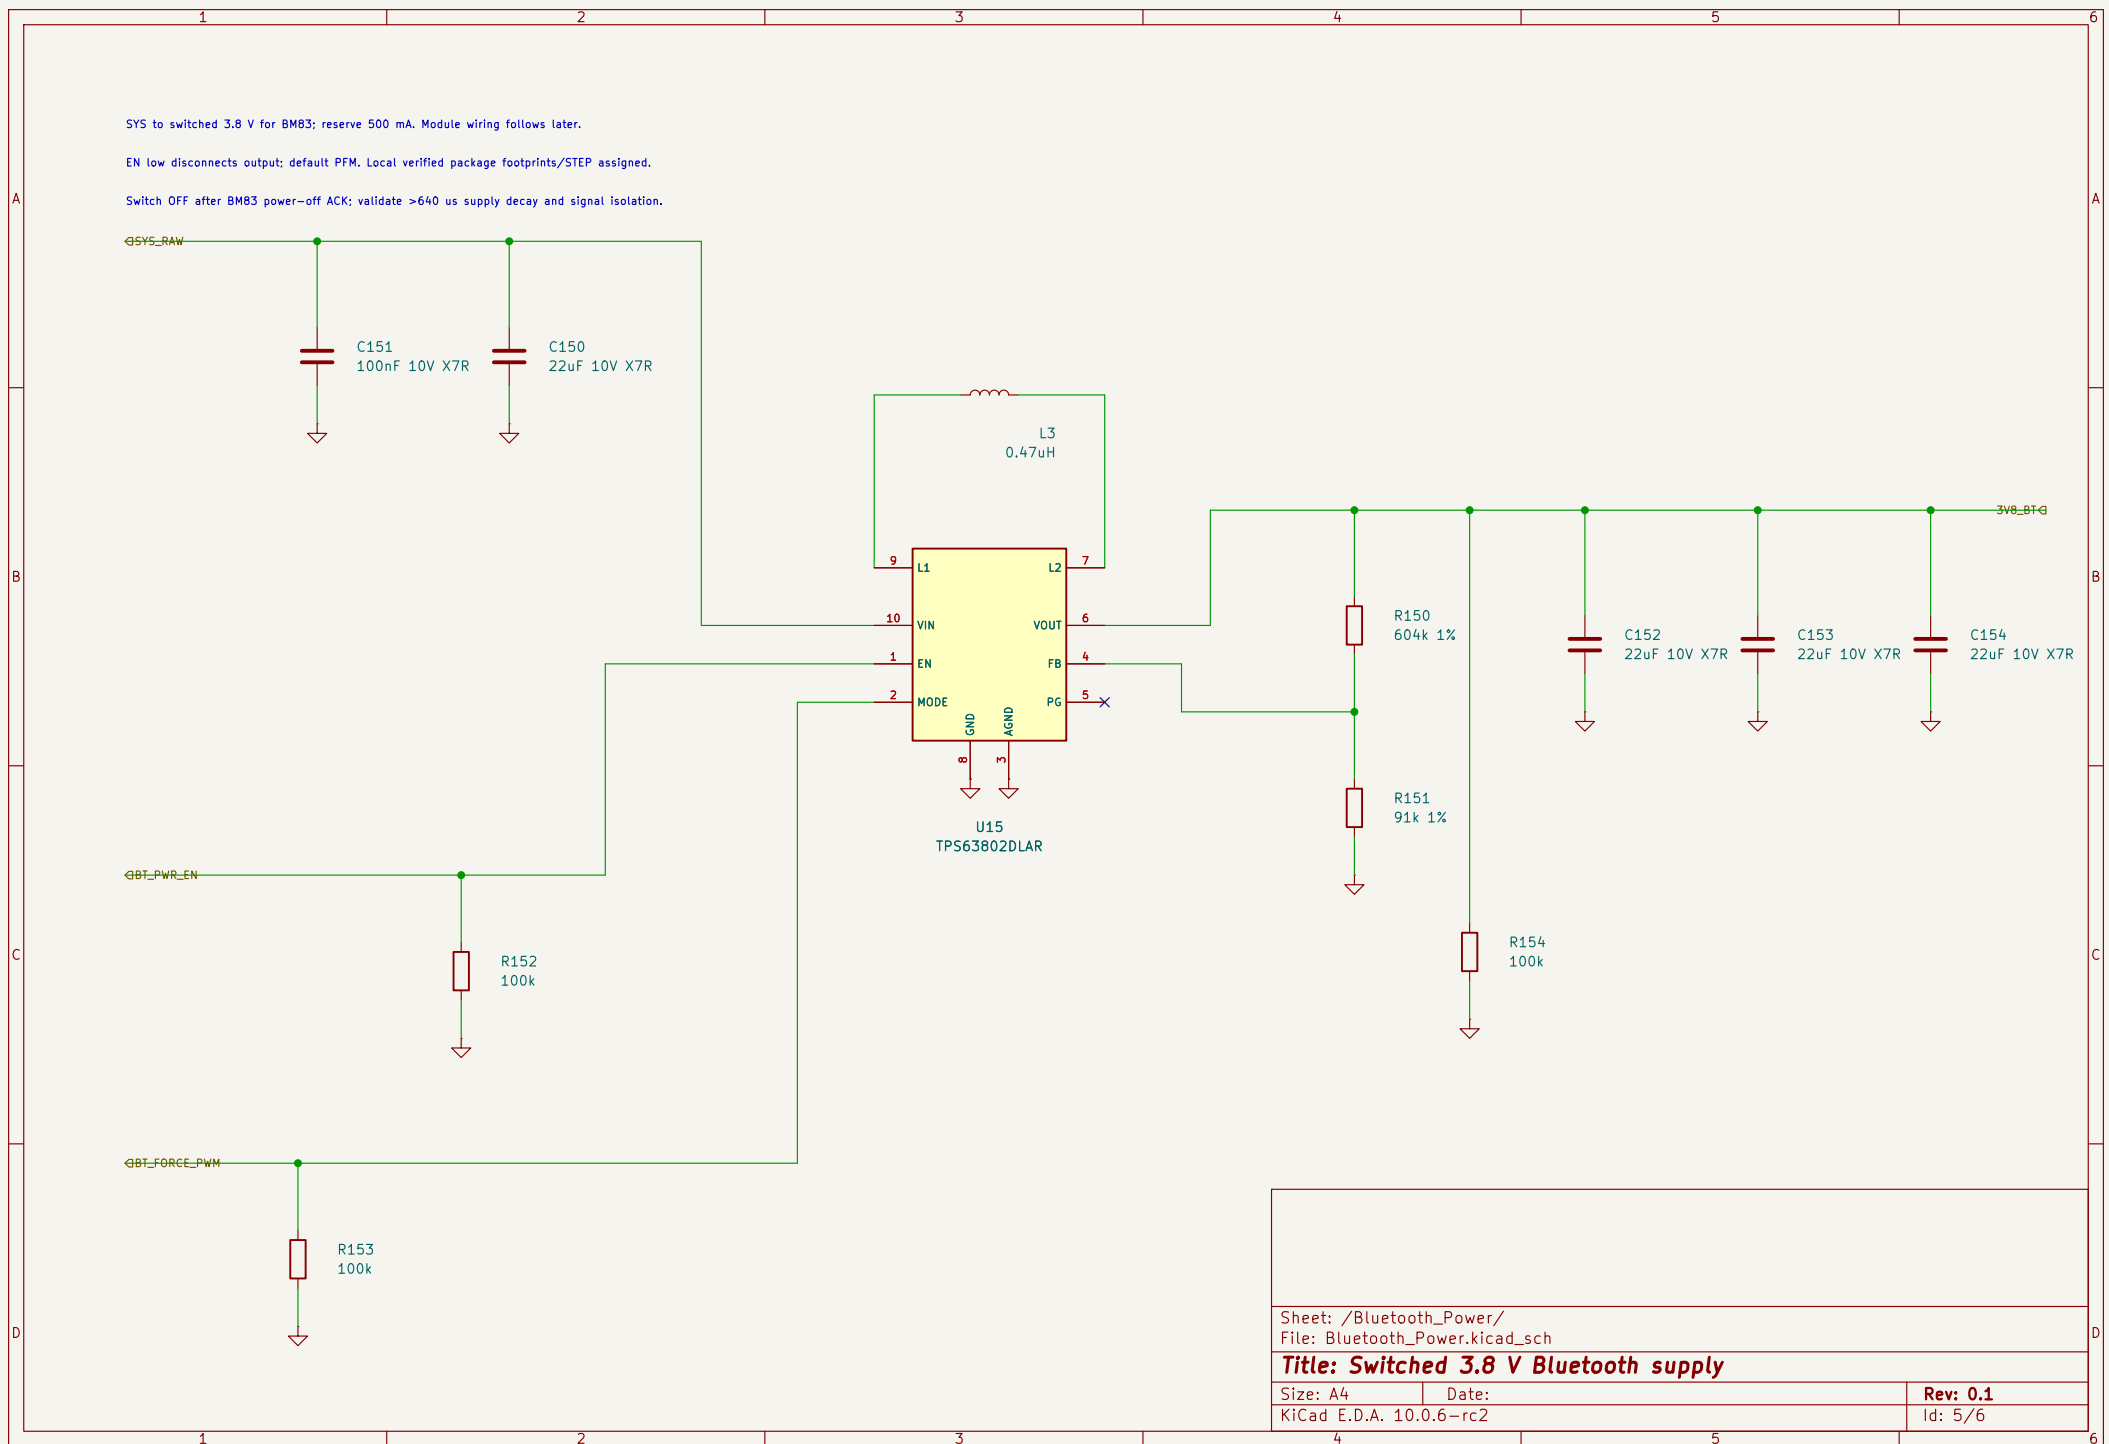

Protected 1S SYS to switched 5 V; reserve 500 mA total. Codec and other 5 V loads connect later.

EN low = true input/output disconnect. Sequence downstream loads after rail settles.

R140/R141 set about 4.95 V; C141/C142 require effective-capacitance review at 5 V.

