




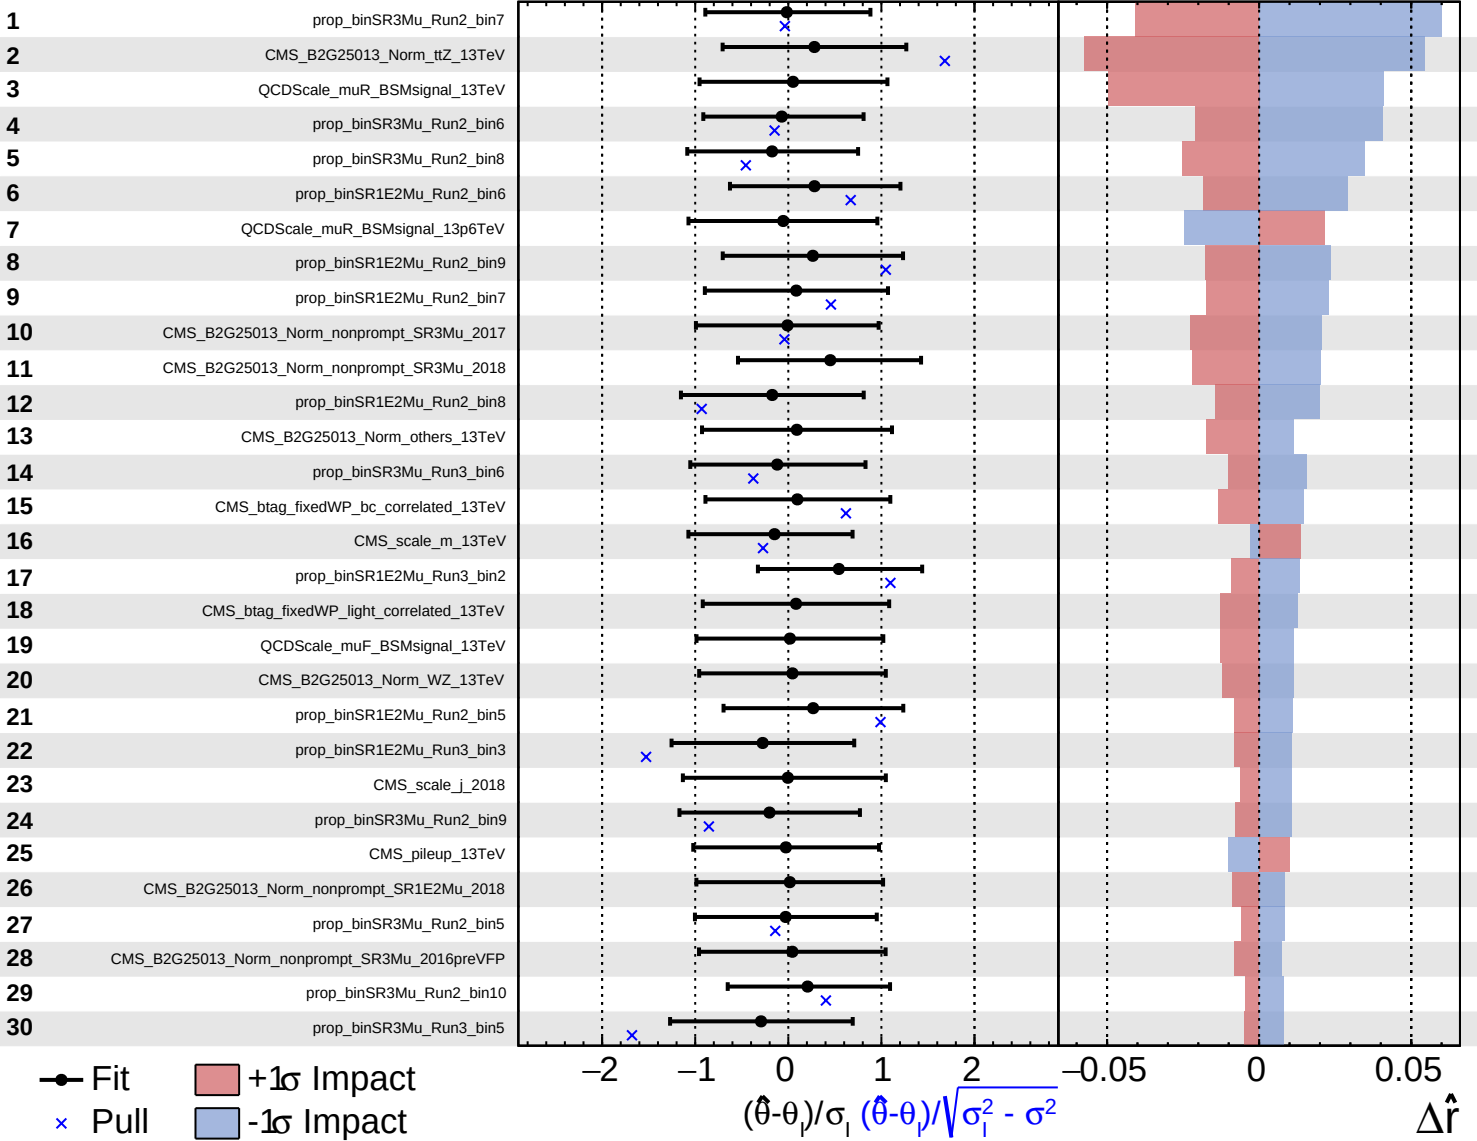


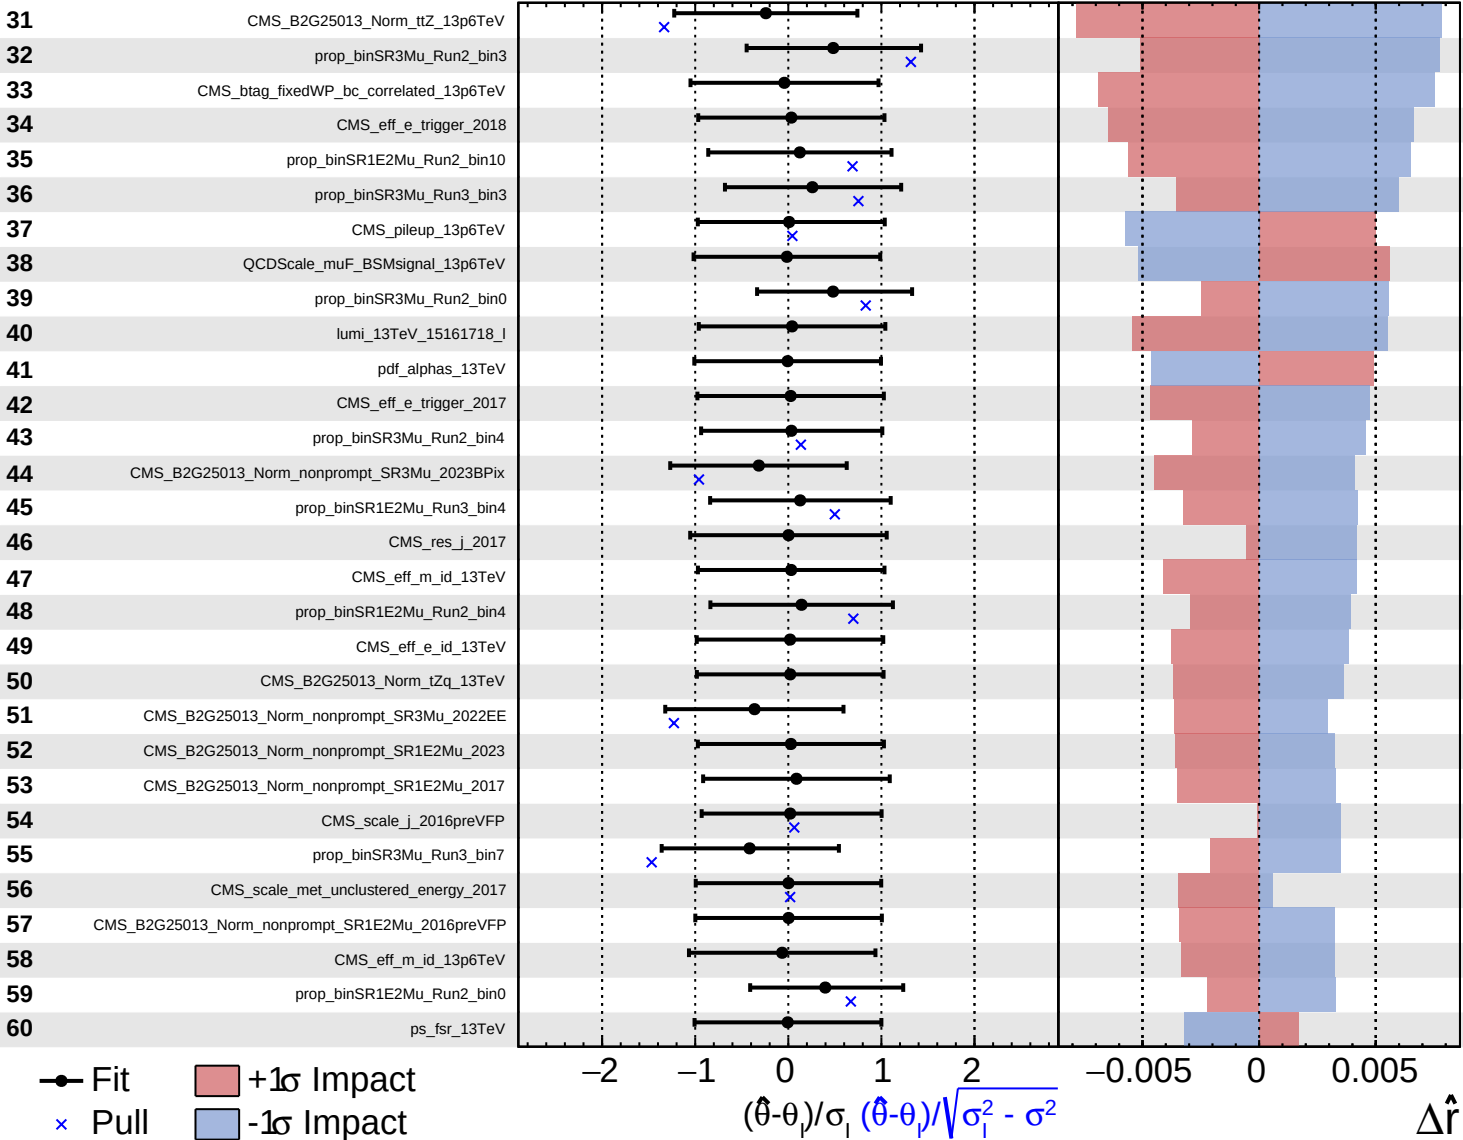


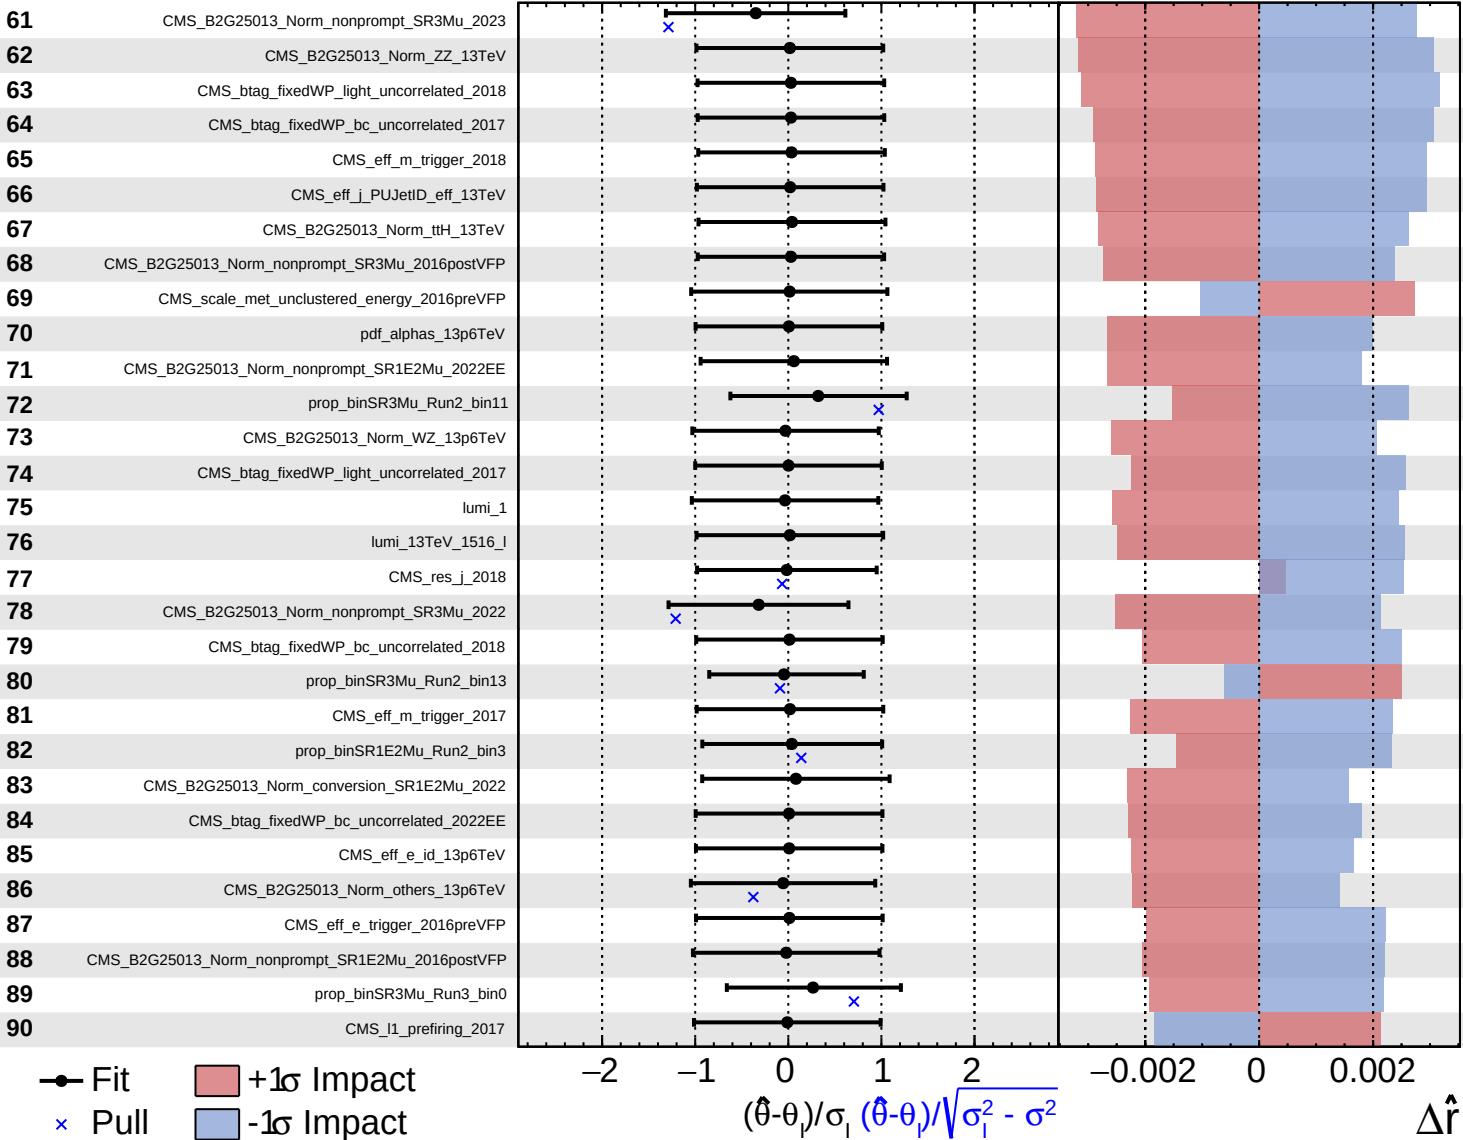


CMS Internal

$$\hat{r} = -0.12^{+0.24}_{-0.24}$$

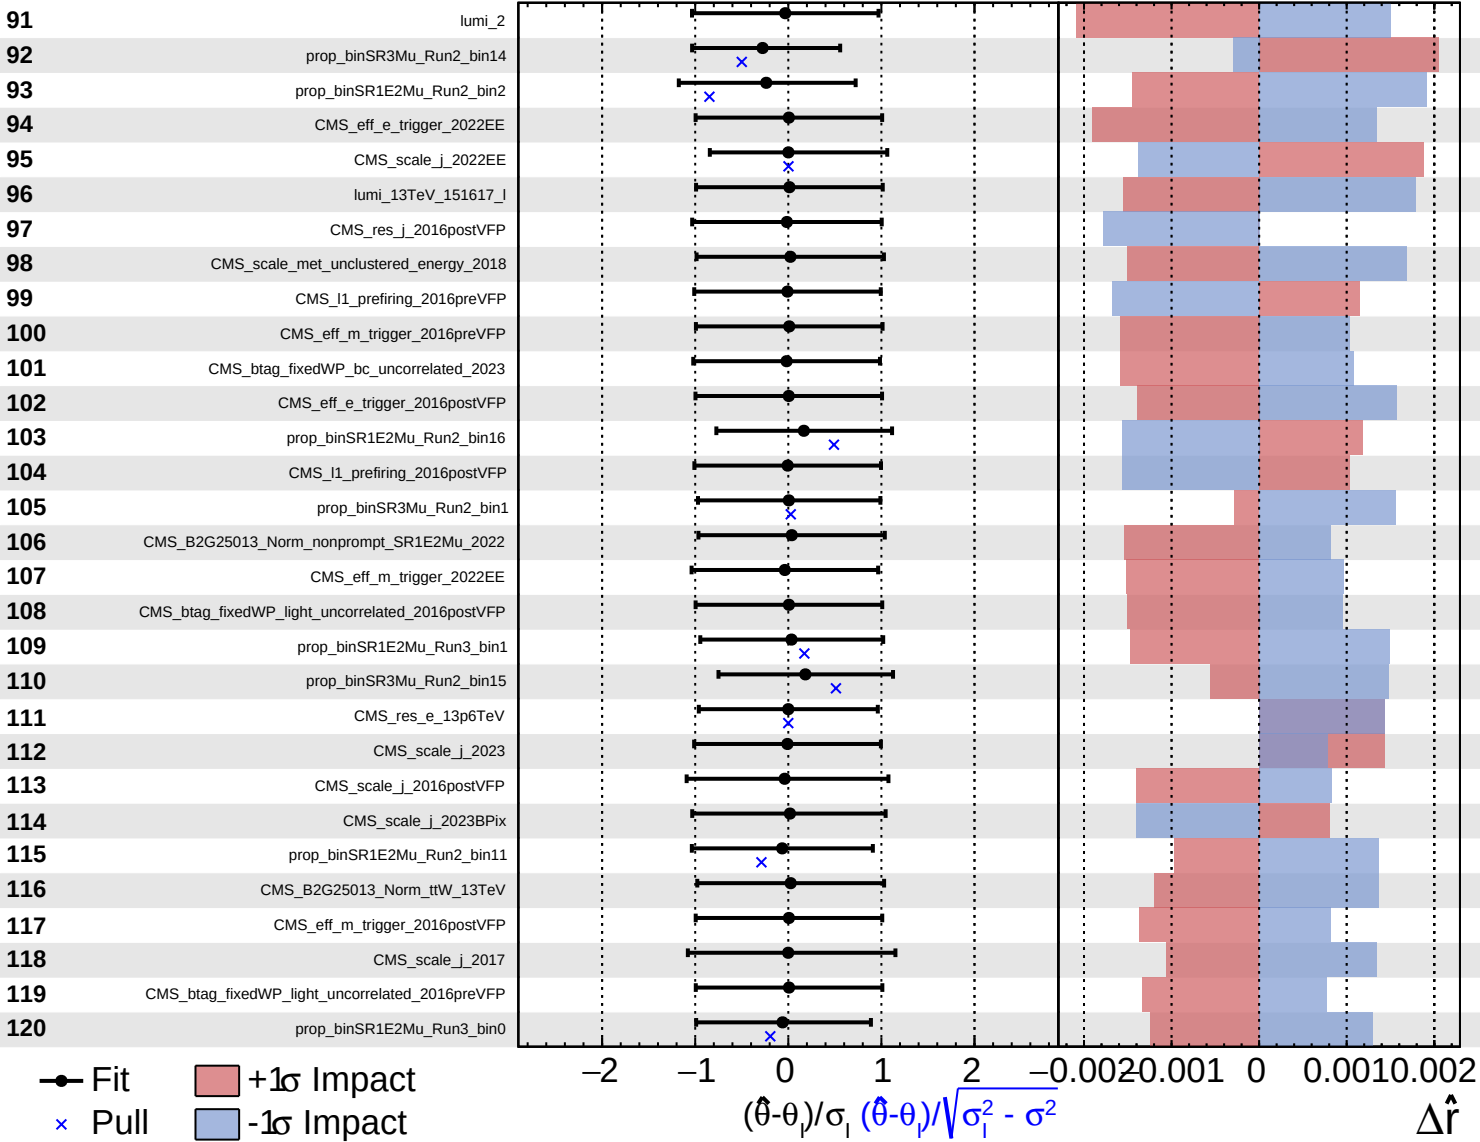

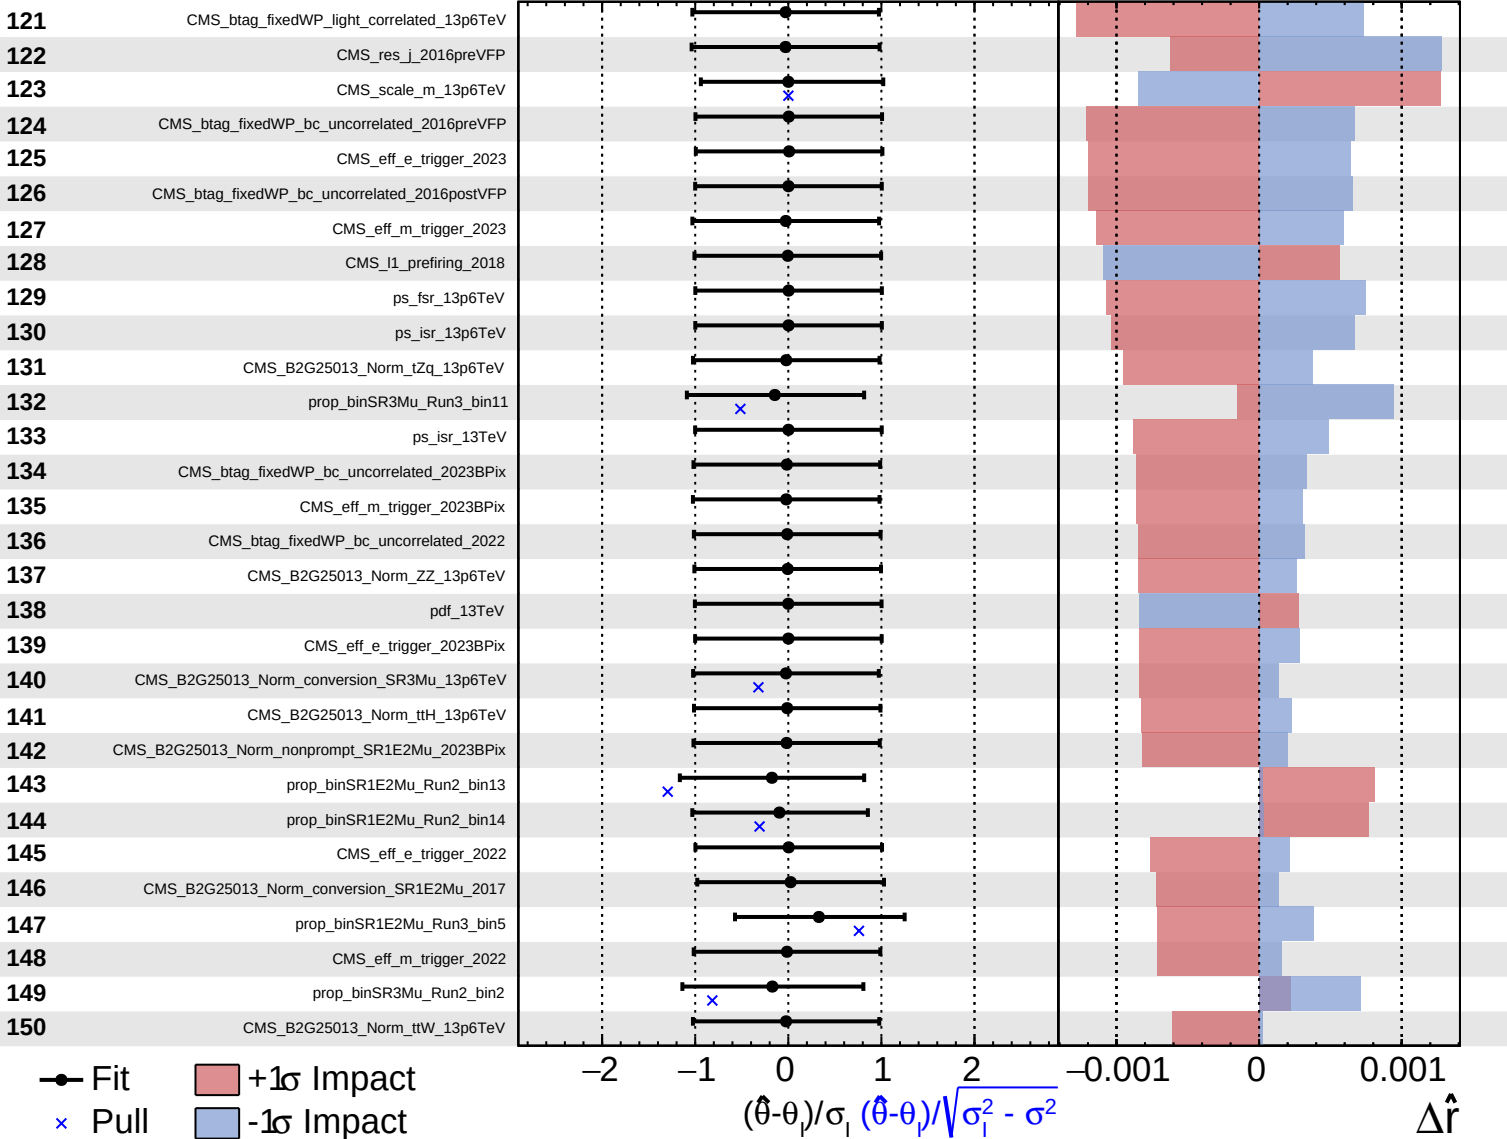

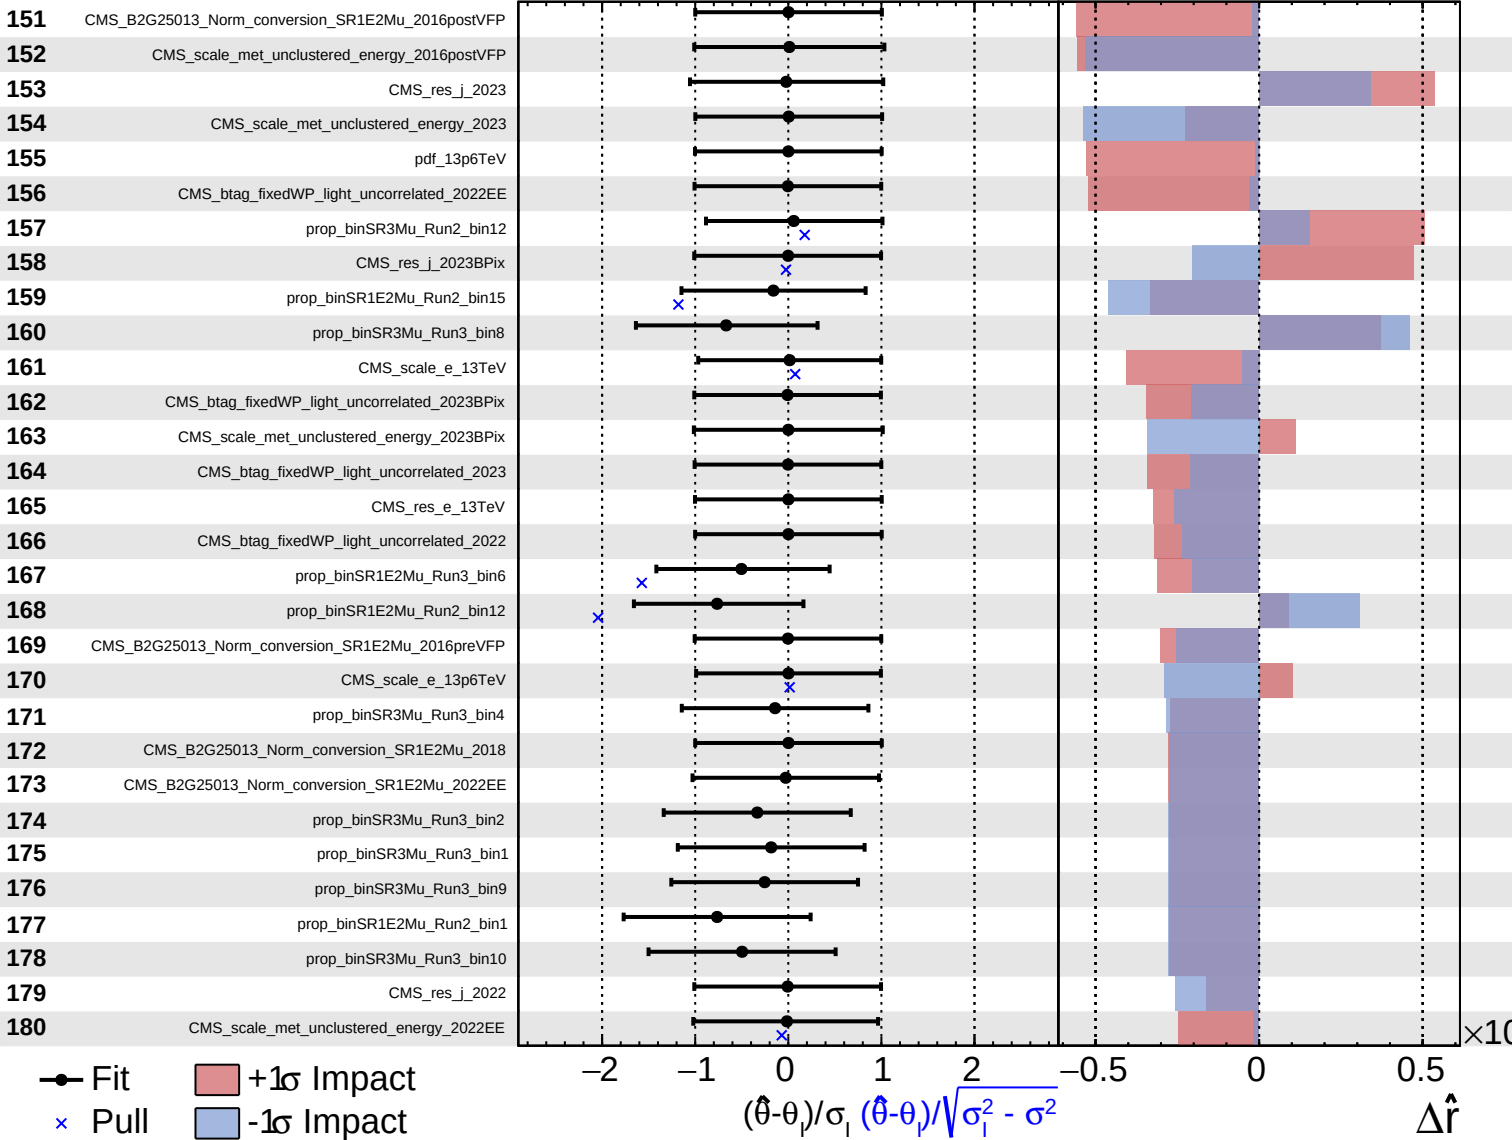

CMS Internal

$$\hat{r} = -0.12^{+0.24}_{-0.24}$$

181

CMS_res_j_2022EE

182

CMS_scale_j_2022

183

CMS_scale_met_unclustered_energy_2022

