

Report date: 2026-06-25 09:00 UTC

Company: Northbank Construction

Contracts: RVT-C-410, RVT-C-411

Executive Summary


East Wharf Regeneration report summary: Dust: 2 alert breach(es), 1 caution breach(es), status Red; Noise: 1 alert breach(es), 2 caution breach(es), status Red; Vibration: 0 alert breach(es), 1 caution breach(es), status Amber. The busiest breach period was Dust on 2026-06-20 at 09:00 UTC with 1 event(s).

Type	Status	Alerts	Cautions	Worst period
Dust	Red	2	1	2026-06-20 09:00 UTC (1)
Noise	Red	1	2	2026-06-19 07:00 UTC (1)
Vibration	Amber	0	1	2026-06-21 12:00 UTC (1)

Graphs


Dust Hourly Averages

Hourly values (ug/m3)

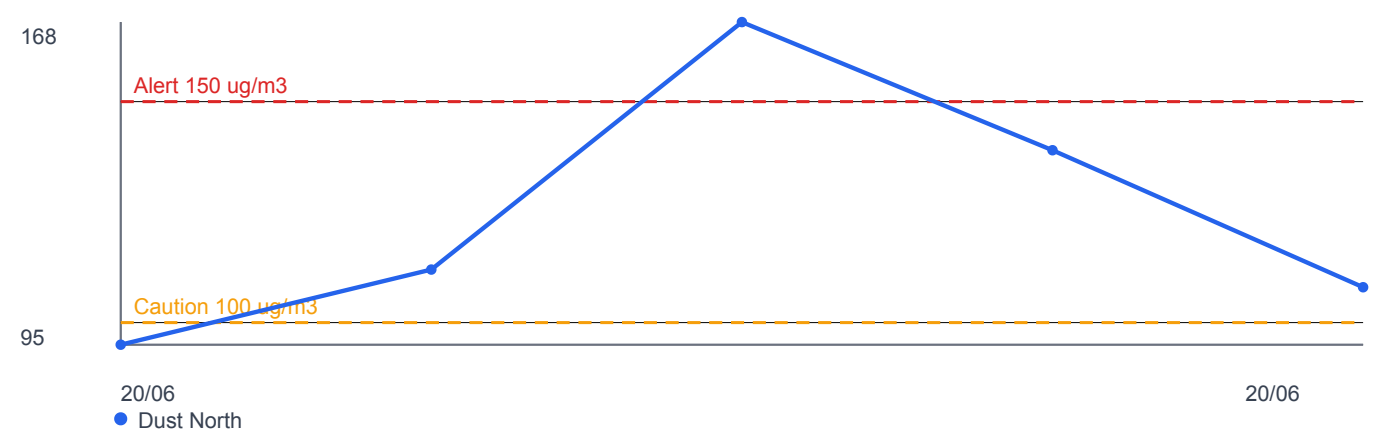


Dust Daily Averages

Daily values (ug/m3)

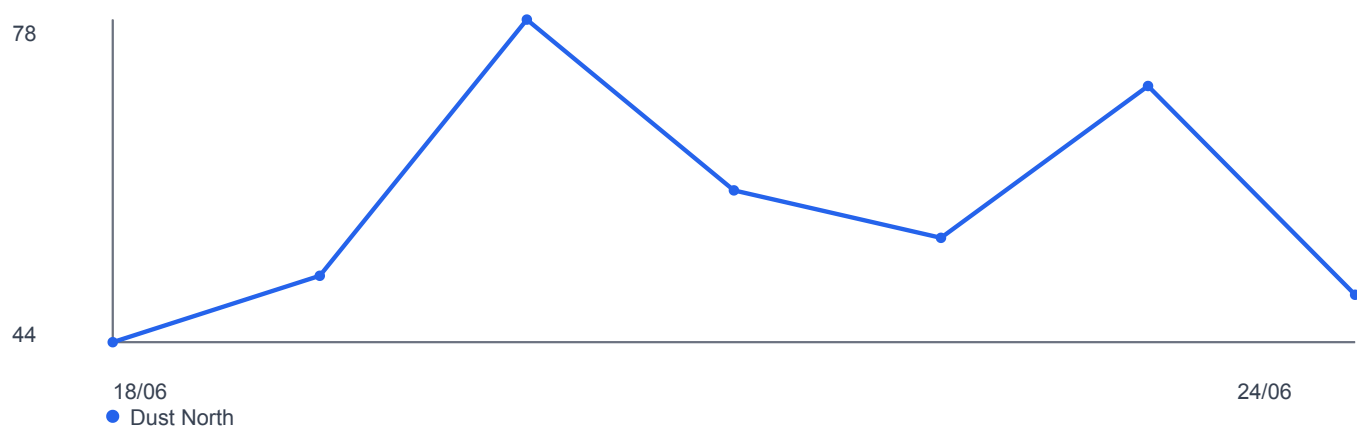


Noise Hourly Averages

Hourly values (dB)

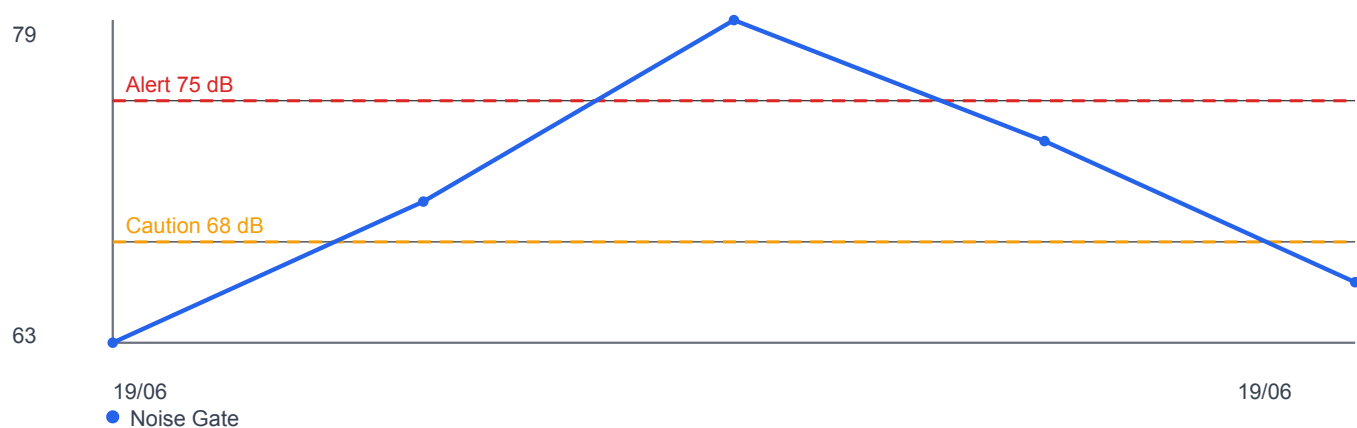


Noise Daily Averages

Daily values (dB)

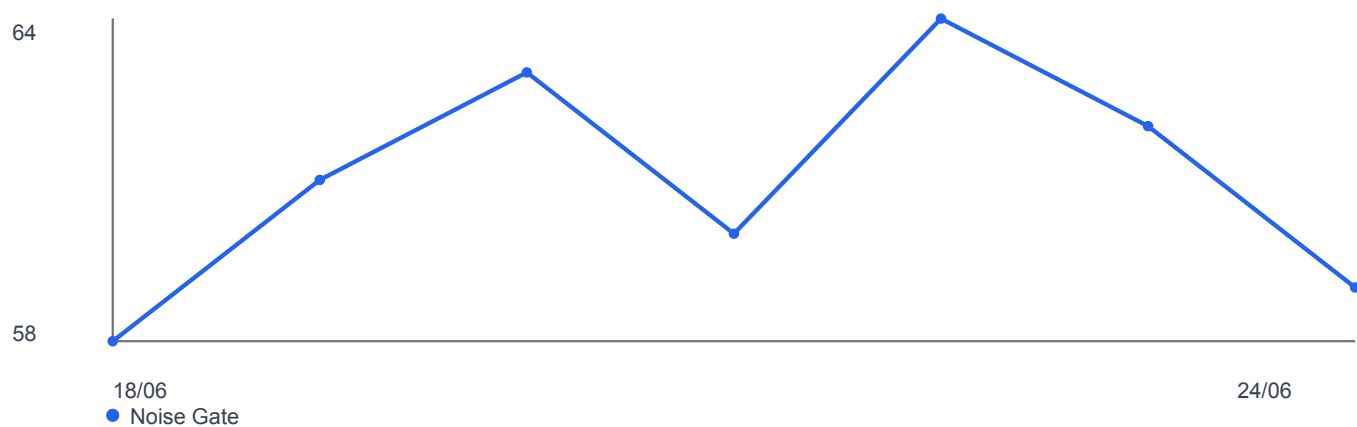


Noise Site Averages

Site values (dB)

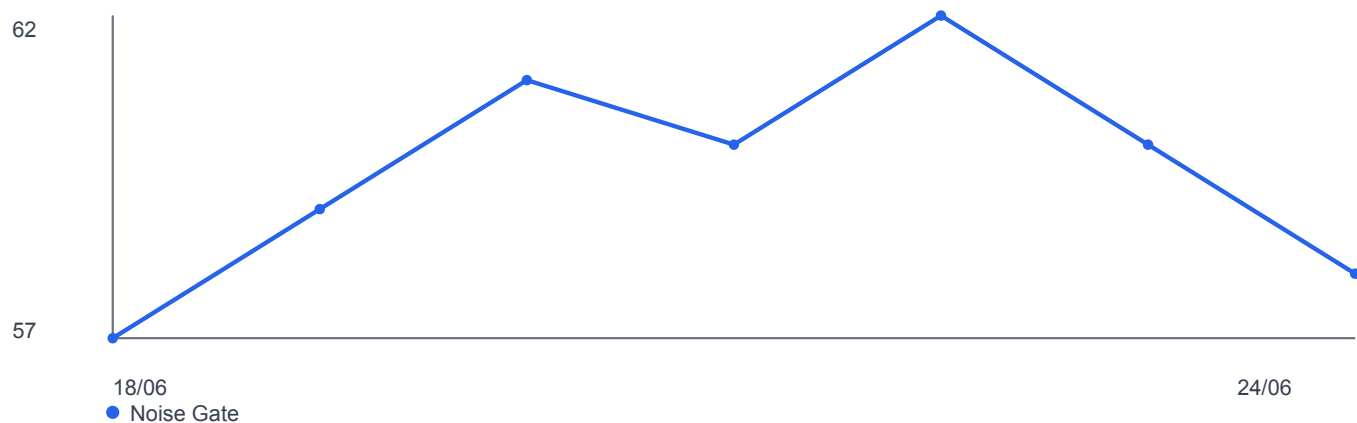

Vibration Daily Peaks

Daily Peak values (mm/s)

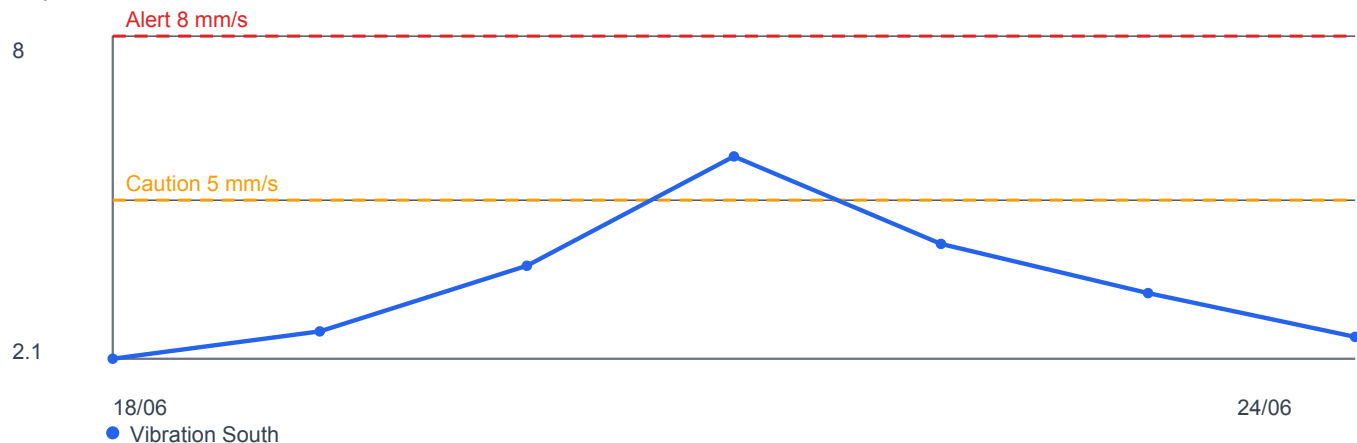

Alert Heatmaps


Dust alert intensity

Notification count by day and hour

	00	03	06	09	12	15	18	21	
20/06				1	1				
23/06						1			

Noise alert intensity

Notification count by day and hour

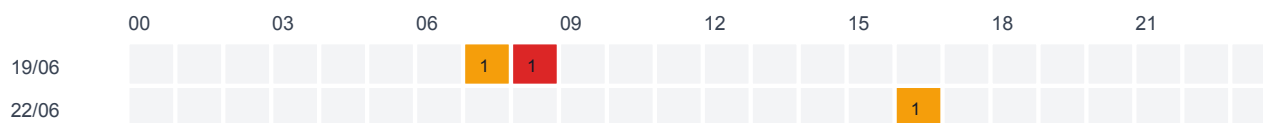

Vibration alert intensity

Notification count by day and hour



Monitors

Dust - Dust North

Serial: DUST-001

Location: North boundary

Last data: 2026-06-24 22:00 UTC

Rules: 2; Notifications: 3

Alert Rules

Rule	Threshold	Average	Triggered	Closed note
PM10 hourly	150 ug/m3	60 mins	3	Water suppression increased and haul road swept.

Caution Rules

Rule	Threshold	Average	Triggered
PM10 hourly caution	100 ug/m3	60 mins	5

Noise - Noise Gate

Serial: NOISE-004
 Location: Site gate
 Last data: 2026-06-24 23:00 UTC
 Rules: 2; Notifications: 3

Alert Rules

Rule	Threshold	Average	Triggered	Closed note
LAAeq hourly	75 dB	60 mins	2	Generator enclosure closed and idling plant shut down.

Caution Rules

Rule	Threshold	Average	Triggered
LAAeq hourly caution	68 dB	60 mins	4

Vibration - Vibration South

Serial: VIB-002
 Location: South piling mat
 Last data: 2026-06-24 20:00 UTC
 Rules: 2; Notifications: 1

Alert Rules

Rule	Threshold	Triggered
Peak vibration	8 mm/s	0

Caution Rules

Rule	Threshold	Triggered
Peak vibration caution	5 mm/s	2