

BRIGADE FAIRFIELD

INTERNAL LIGHTING - 13TH FLOOR

LIGHTING DESIGN

DRAWING LIST :

DRAWING NUMBER	SCALE	SIZE	TITLE
IL-TF-000	NTS	A1	COVER SHEET
IL-TF-101	AS	A1	INTERNAL LIGHTING - 13TH FLOOR - LUMINAIRE LOCATION
IL-TF-102	AS	A1	INTERNAL LIGHTING - 13TH FLOOR - LIGHTING CONTROL SWITCHING
IL-TF-103	NTS	A1	INTERNAL LIGHTING - 13TH FLOOR - LUMINAIRE DETAILS

GENERAL NOTES:

Do not scale off this drawing

All drawings to be read in conjunction with all other relevant document,including drawings and specifications

All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART

No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KO	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MAJUSMANIAH

CO-BRIGADE HOTEL VENTURES LIMITED

29th & 30th Floor, World Trade Center, Brigade Gateway Complex, 29/1 Dr. Rajkumar Road, Malleswaram-560055, Bangalore 560055, India

Ph: +91 80 40438000 , Fax: +91 80 40438010

LIGHTING CONSULTANT:

LIGHTING CONSULTANT

P.O.Box:50264 Dubai, U.A.E

Tel:+971 4 3975858, Fax:+971 4 3975959


LIGHTING CONSULTANT

DRAWING TITLE:







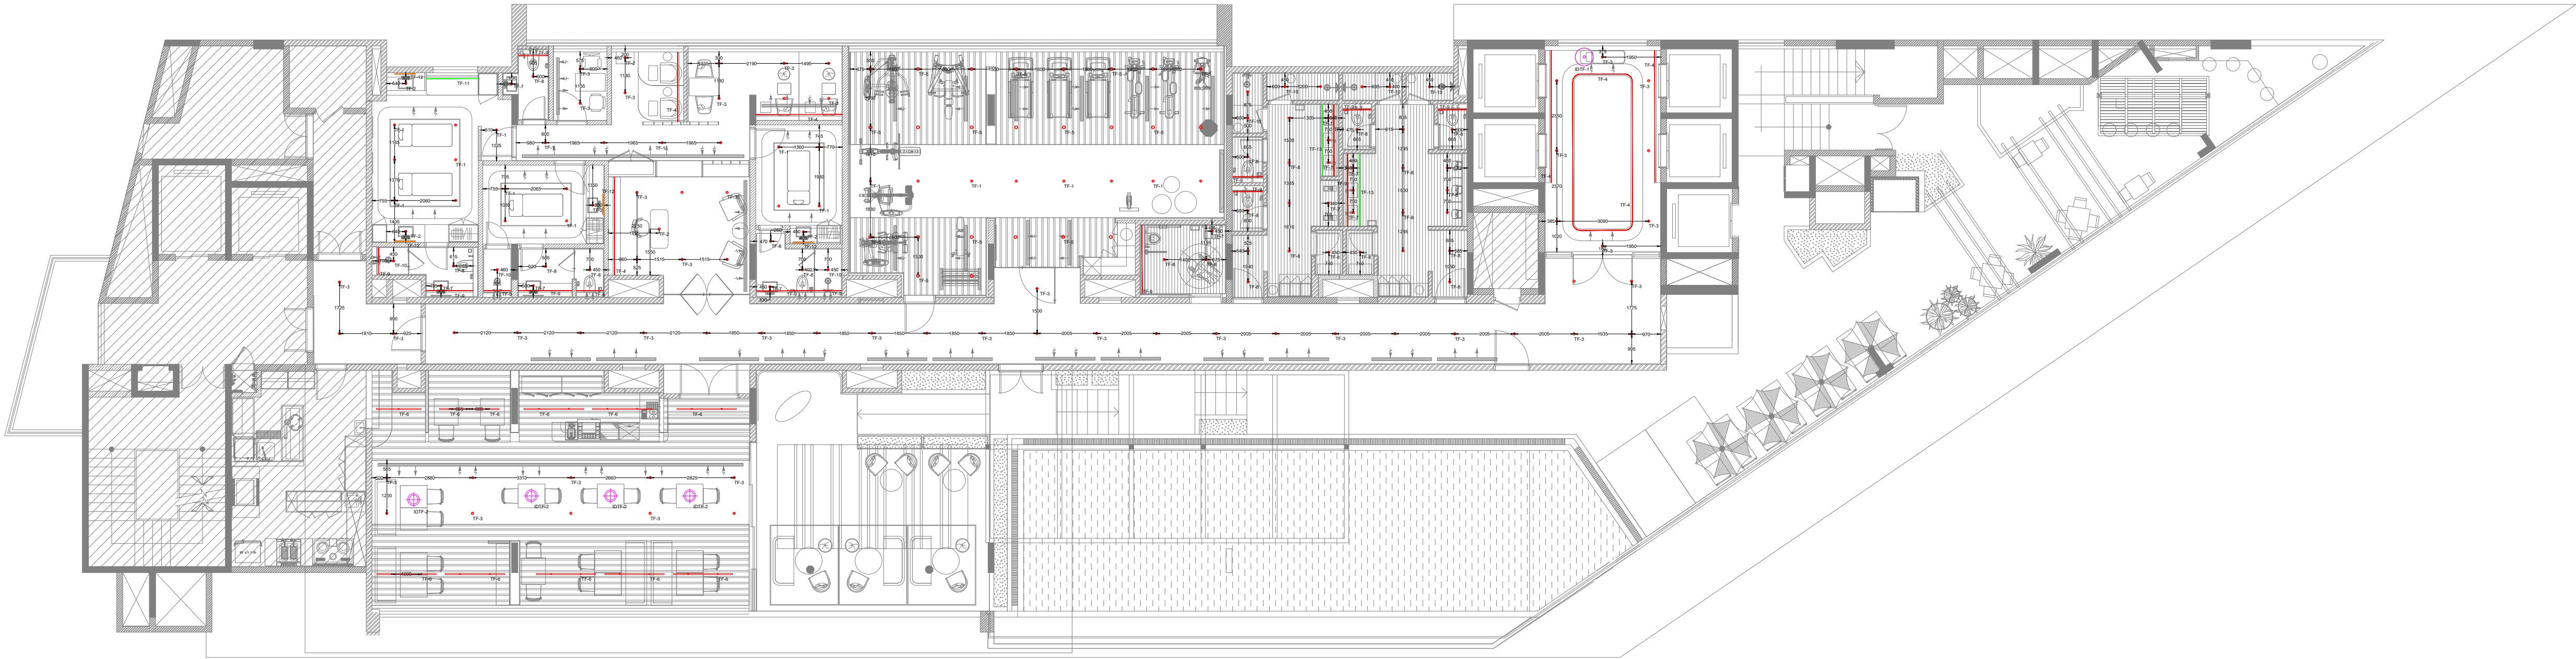






COVER SHEET

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNAPREYA	KA	RAJ	06-01-2026
JOB No.	167	SCALE (A1)	NTS
SERVEN REF.	IL-TF-000	REV NO	00



NOTE : THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE INTERIOR DESIGNERS DRAWINGS



LEGENDS:

SYMBOL	DESCRIPTION	IP RATE	CONTROL
 TF-1	7.2 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-2	5 W - LED,RECESSED CEILING DOWNLIGHT - MEDIUM BEAM - 3000K	IP20	DALI DIMMING
 TF-3	10.6 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-4	14.4 W/m - LED,LINEAR CEILING COVELIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 TF-5	10 W - LED,SURFACE MOUNTED DOWNLIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-6	10.8 W - LED,SURFACE MOUNTED TRACK LIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-7	5 W - LED,RECESSED CEILING DOWNLIGHT - MEDIUM BEAM - 3000K	IP20	ON/OFF
 TF-8	7.2 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP20	ON/OFF
 TF-9	5 W/m - LED,LINEAR CEILING COVELIGHT - DIFFUSED BEAM - 3000K	IP20	ON/OFF
 TF-10	10.6 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP54	ON/OFF
 TF-11	5 W/m - LED,LINEAR FURNITURE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 TF-12	5 W/m - LED,LINEAR MIRROR LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 TF-13	5 W/m - LED,LINEAR UNDERVANITY LIGHT - DIFFUSED BEAM - 3000K	IP20	ON/OFF

LEGENDS:

SYMBOL	DESCRIPTION	IP RATE	CONTROL
 IDTF-1	10 W - DECORATIVE TABLE LAMP - 3000K	IP20	ON/OFF
 IDTF-2	15 W - DECORATIVE PENDANT - 3000K	IP20	MAINS DIMMING

GENERAL NOTES:

Do not scale off this drawing
All drawings to be read in conjunction with all other relevant document,including drawings and specifications
All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART			
No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KO	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MR.SURINAR
CO BRIDGE HOTEL VENTURES LIMITED
29th & 30th Floor, World Trade Center,
Brigade Gateway Complex, 26/1 Dr. Rajkumar Road,
Mallakaveri- Rajajinagar, Bangalore 560055, India
Ph: +91 80 40438000 , Fax: +91 80 40438010

LIGHTING CONSULTANT:



P O Box 50264 Dubai, U.A.E
Tel:+971 4 3975858, Fax:+971 4 3975959

DRAWING TITLE:







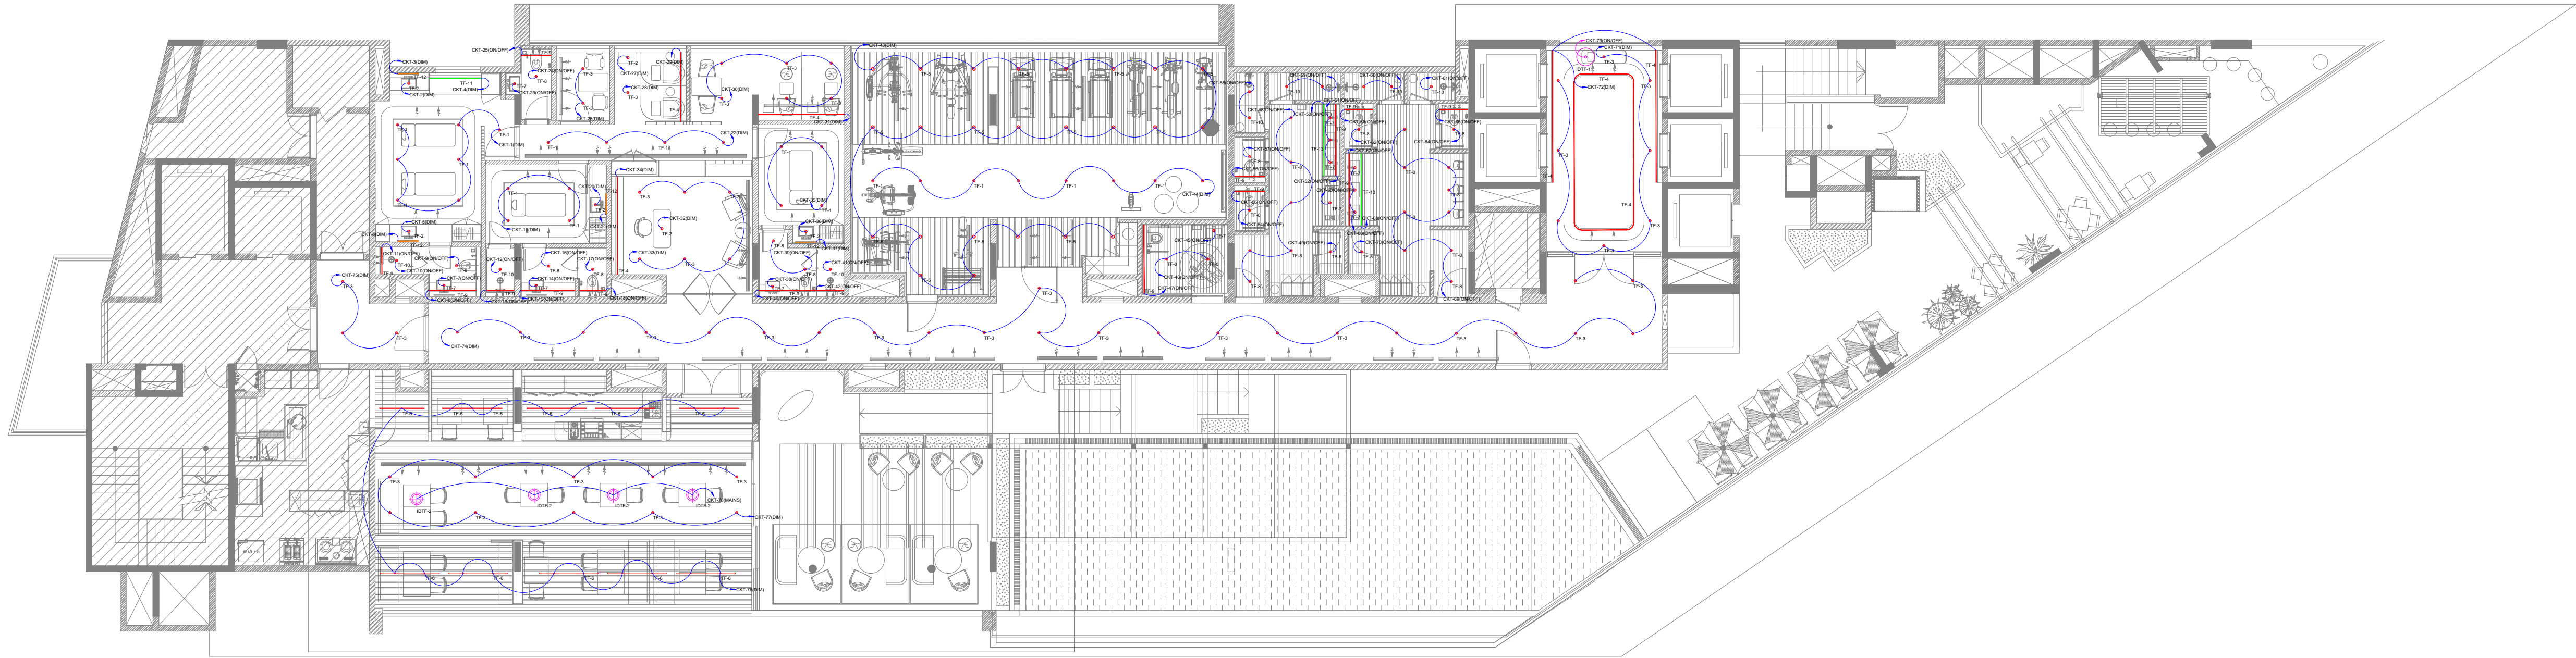






INTERNAL LIGHTING
13TH FLOOR
LUMINAIRE LOCATION

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNAPREYA	UJ	RAJ	06/01/2026
JOB No.	SCALE (A1)		REV/NO
167	1:90		
SERIAL REV.	IL-TF-101		REV/NO
			00



NOTE : THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE INTERIOR DESIGNERS DRAWINGS



LEGENDS:

SYMBOL	DESCRIPTION	IP RATE	CONTROL
 TF-1	7.2 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-2	5 W - LED,RECESSED CEILING DOWNLIGHT - MEDIUM BEAM - 3000K	IP20	DALI DIMMING
 TF-3	10.6 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-4	14.4 W/m - LED,LINEAR CEILING COVELIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 TF-5	10 W - LED,SURFACE MOUNTED DOWNLIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-6	10.8 W - LED,SURFACE MOUNTED TRACK LIGHT - WIDE BEAM - 3000K	IP20	DALI DIMMING
 TF-7	5 W - LED,RECESSED CEILING DOWNLIGHT - MEDIUM BEAM - 3000K	IP20	ON/OFF
 TF-8	7.2 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP20	ON/OFF
 TF-9	5 W/m - LED,LINEAR CEILING COVELIGHT - DIFFUSED BEAM - 3000K	IP20	ON/OFF
 TF-10	10.6 W - LED,RECESSED CEILING DOWNLIGHT - WIDE BEAM - 3000K	IP54	ON/OFF
 TF-11	5 W/m - LED,LINEAR FURNITURE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 TF-12	5 W/m - LED,LINEAR MIRROR LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 TF-13	5 W/m - LED,LINEAR UNDERVANITY LIGHT - DIFFUSED BEAM - 3000K	IP20	ON/OFF

LEGENDS:

SYMBOL	DESCRIPTION	IP RATE	CONTROL
 IDTF-1	10 W - DECORATIVE TABLE LAMP - 3000K	IP20	ON/OFF
 IDTF-2	15 W - DECORATIVE PENDANT - 3000K	IP20	MAINS DIMMING

GENERAL NOTES:

Do not scale off this drawing
All drawings to be read in conjunction with all other relevant document,including drawings and specifications
All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only.

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART			
No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KO	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MR. S. JAYARAMAN
CO BRIDGE HOTEL VENTURES LIMITED
29th & 30th Floor, World Trade Center,
Brigade Gateway Complex, 26/1 Dr. Rajkumar Road,
Mallapuram - Rajajinagar, Bangalore 560055, India
Ph: +91 80 40438000 , Fax: +91 80 40438010


LIGHTING CONSULTANT:


P O Box 50264 Dubai, U.A.E
Tel: +971 4 3975858, Fax: +971 4 3975959


DRAWING TITLE:

INTERNAL LIGHTING
13TH FLOOR
LIGHTING CONTROL SWITCHING


DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNAPREYA	UJ	RAJ	06/01/2026
JOB No.	SCALE (A1)		REV NO
167	1:90		
SHEET NO.	IL-TF-102		00

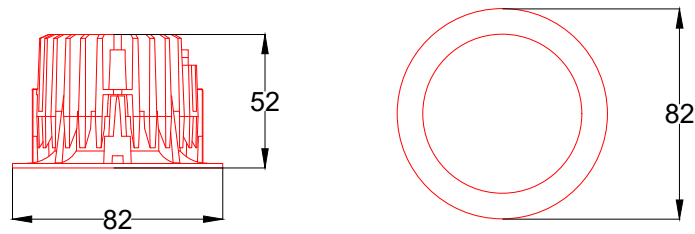


TYPE- TF-1
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 7.2W

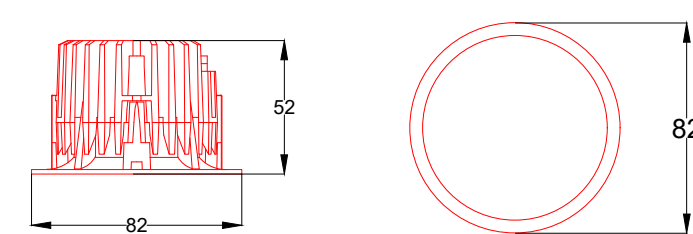


TYPE- TF-2
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 5W

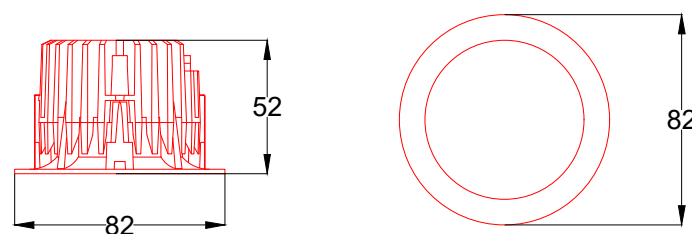


TYPE- TF-3
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 10.6W

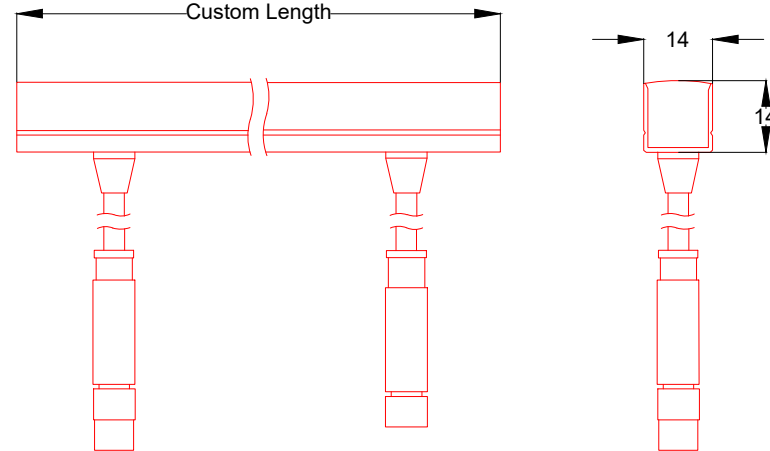


TYPE- TF-4
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 14.4W/M

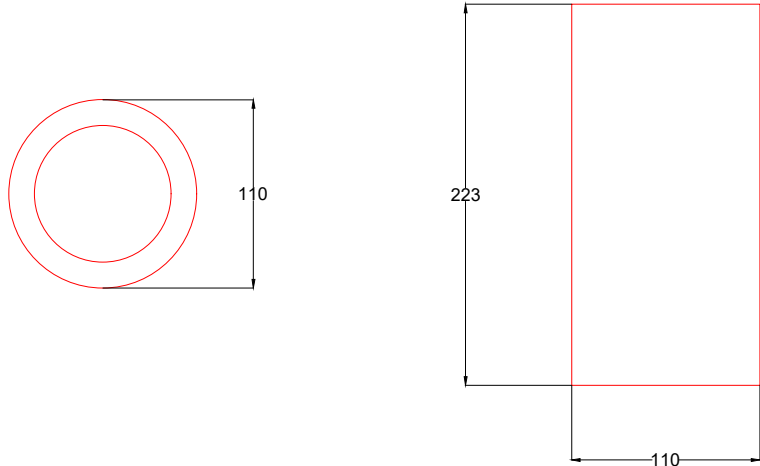


TYPE- TF-5
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 10W

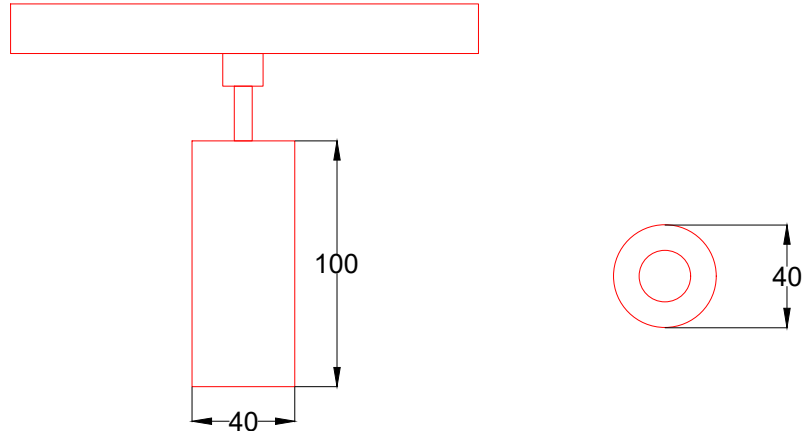


TYPE-TF-6
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 10.8W

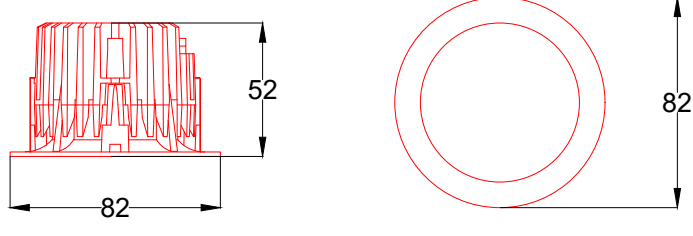


TYPE- TF-7
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION: 5W

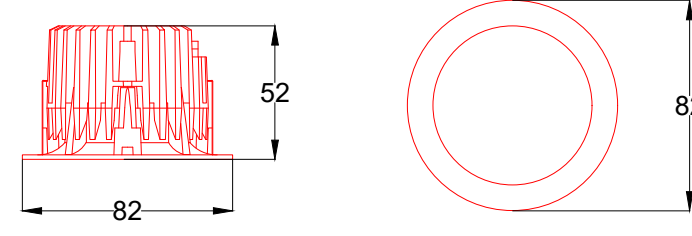


TYPE- TF-8
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION: 7.2W

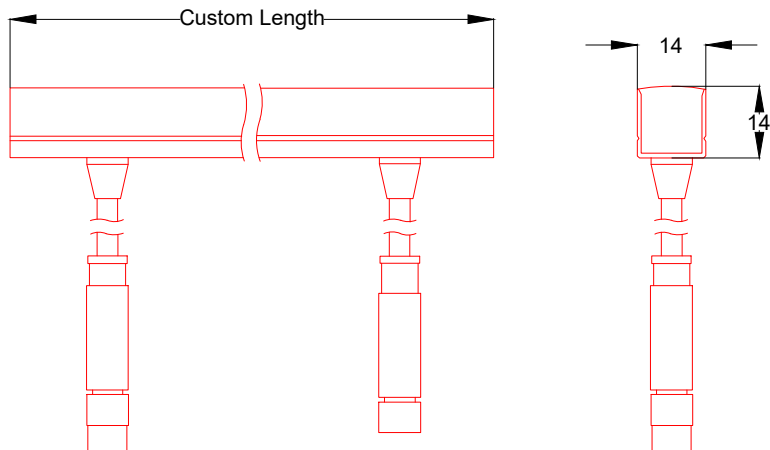


TYPE- TF-9
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION: 5W/M

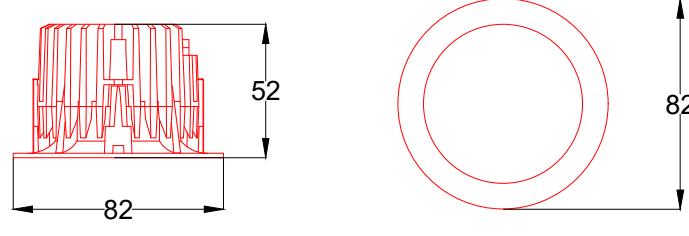


TYPE- TF-10
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1 NOS
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION: 10.6W

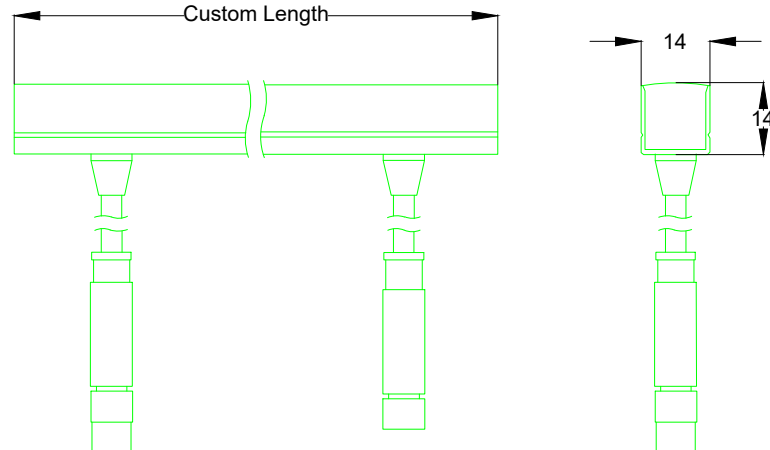

TYPE- TF-11
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 5W/M

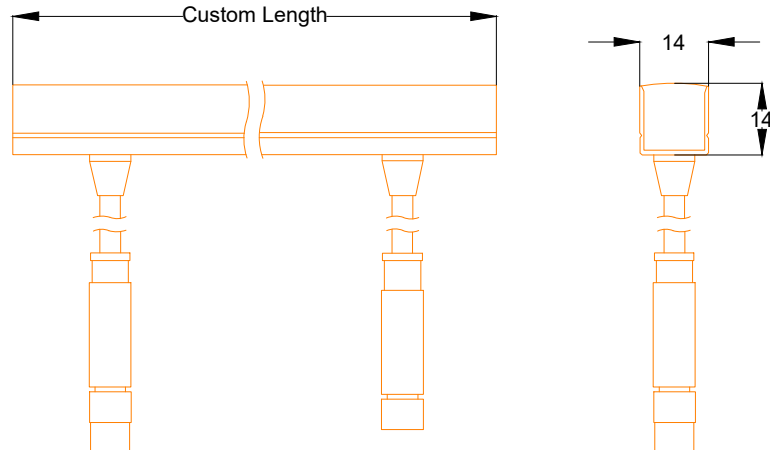

TYPE- TF-12
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION: 5W/M

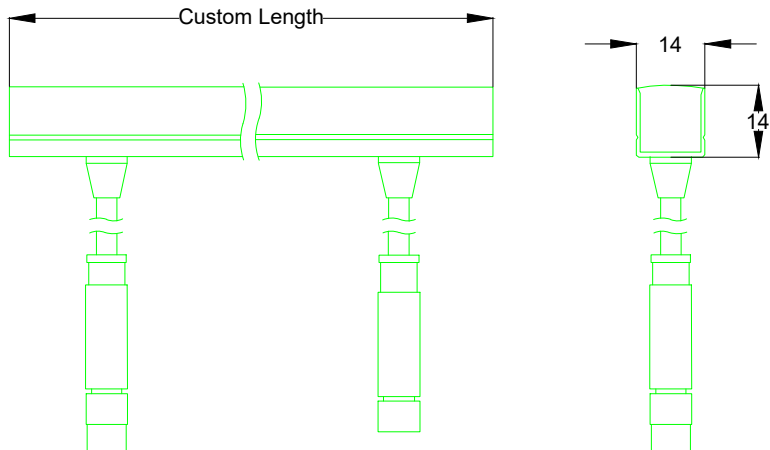

TYPE- TF-13
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION: 5W/M

GENERAL NOTES:

Do not scale off this drawing

All drawings to be read in conjunction with all other relevant document,including drawings and specifications

All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:
This Drawing is not to be issued for Tender or Construction.
If this Drawing is issued to contractors, it is for information only
Architects and Engineers drawings must be used as the basis for construction.
Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.


Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART			
No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KO	DETAIL DESIGN

PROJECT NAME:


FAIRFIELD HOTEL

CLIENTS:



M KUSHANWAR
CO BRIGADE HOTEL VENTURES LIMITED
29th & 30th Floor, World Trade Center,
Brigade Gateway Campus, 29/1 Dr. Rajkumar Road,
Mallareconam-Rajajinagar, Bangalore 560055, India.
Ph: +91 80 40436000 / Fax: +91 80 40436010

LIGHTING CONSULTANT:



P O Box 50264 Dubai, U.A.E
Tel:+971 4 3975858, Fax:+971 4 3975959

DRAWING TITLE:

INTERNAL LIGHTING
13TH FLOOR
LUMINAIRE DETAILS

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNAPREYA	SA	RAJ	06/01/2026
JOB No.	SCALE (A1)		NTS
SERVEN REF.	IL-TF-103		REV NO 00