

BRIGADE FAIRFIELD


INTERNAL LIGHTING -GROUND FLOOR

LIGHTING DESIGN

DRAWING LIST :

DRAWING NUMBER	SCALE	SIZE	TITLE
IL-GF000	NTS	A1	COVER SHEET
IL-GF101	AS	A1	INTERNAL LIGHTING - LUMINAIRE LOCATION
IL-GF102	AS	A1	INTERANAL LIGHTING - LIGHTING CONTROL SWITCHING
IL-GF103	NTS	A1	INTERNAL LIGHTING - LUMINAIRE DETAILS

NOTE : THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE INTERIOR DESIGNERS DRAWINGS

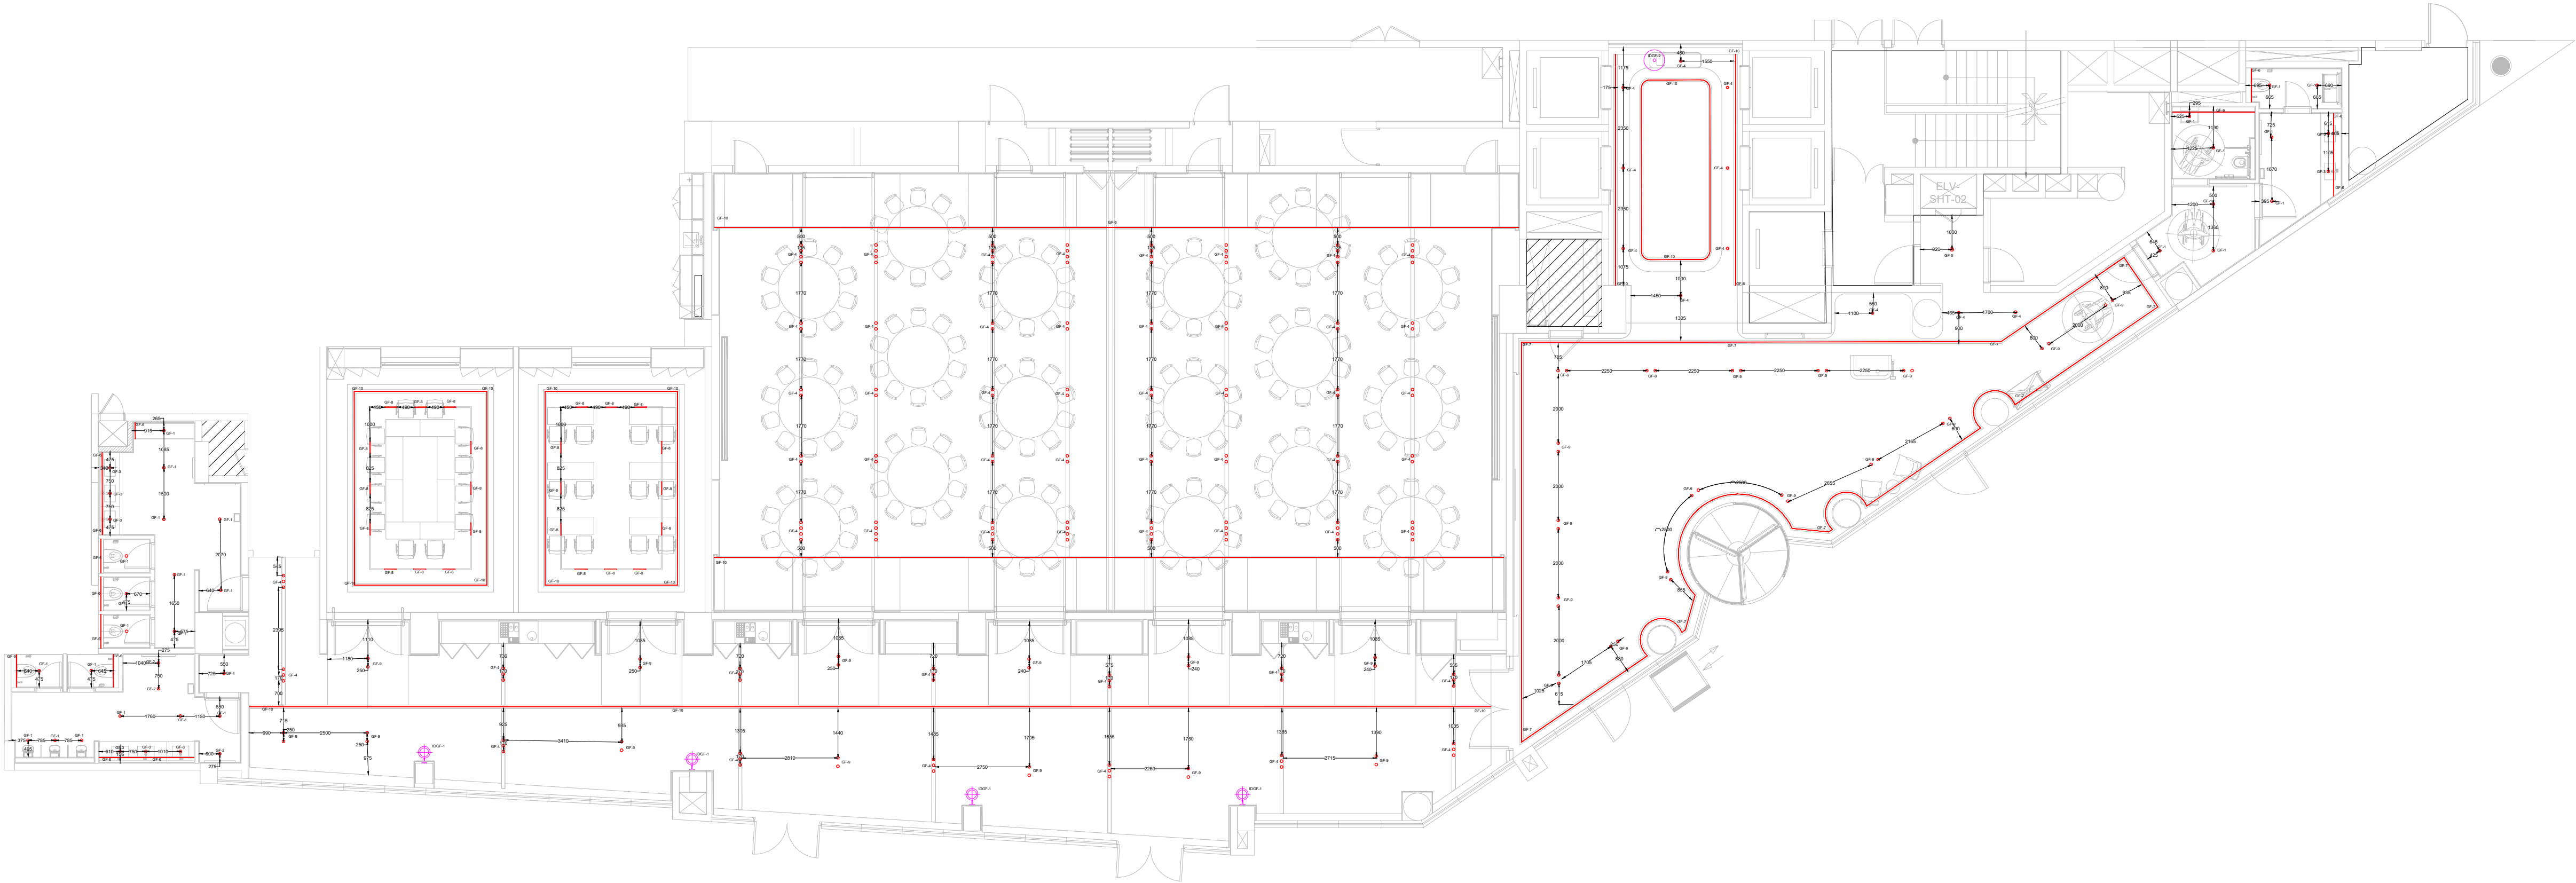

LEGENDS:

SYMBOL	DESCRIPTION	IP RATING	CONTROL
	GF-1 5W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP54	ON/OFF
	GF-2 5W-RECESSED CEILING ADJUSTABLE DOWNLIGHT- WIDE BEAM-3000K	IP20	ON/OFF
	GF-3 5W-RECESSED CEILING DOWNLIGHT- MEDIUM BEAM-3000K	IP20	ON/OFF
	GF-4 10.6W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
	GF-5 10.7W-RECESSED CEILING DOWNLIGHT- MEDIUM BEAM-3000K	IP20	DALI DIMMING
	GF-6 9.6W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	ON/OFF
	GF-7 14.4W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
	GF-8 12.6W/M - LED - RECESSED LINEAR TRACK LIGHT - MEDIUM BEAM - 3000K	IP20	DALI DIMMING
	GF-9 10.6W-RECESSED CEILING TWIN DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
	GF-10 9.6W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING

LEGENDS:

SYMBOL	DESCRIPTION	CONTROL
	IDGF-1 10W - WALL SCONCE- 3000K	ON/OFF
	IDGF-2 10W - TABLE LAMP- 3000K	ON/OFF

GENERAL NOTES:

Do not scale off this drawing

All drawings to be read in conjunction with all other relevant document,including drawings and specifications

All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART

No.	DATE	INITIALS	REV. DETAILS
01	31-12-2025	KR	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MR.SUBRAMAN

CO BRIGADE HOTEL VENTURES LIMITED

29th & 30th Floor, World Trade Center, Brigade Gateway Campus, 29/1 Dr Rajawade Road, Malleswaram-Bangalore, Bangalore 560055, India

Ph: +91 80 40438002 , Fax: +91 80 40438010

LIGHTING CONSULTANT:

P.O.Box:50264 Dubai, U.A.E


Tel:+971 4 3975858, Fax:+971 4 3975959

DRAWING TITLE:

INTERNAL LIGHTING
GROUND FLOOR-
LUMINAIRE LOCATION

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNANARAI	NA	RAJ	31-12-2025
JOB No.	167	SCALE (A1)	1:80
SERVEN NO.	IL-GF-101	REV NO	00

NOTE : THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE INTERIOR DESIGNERS DRAWINGS

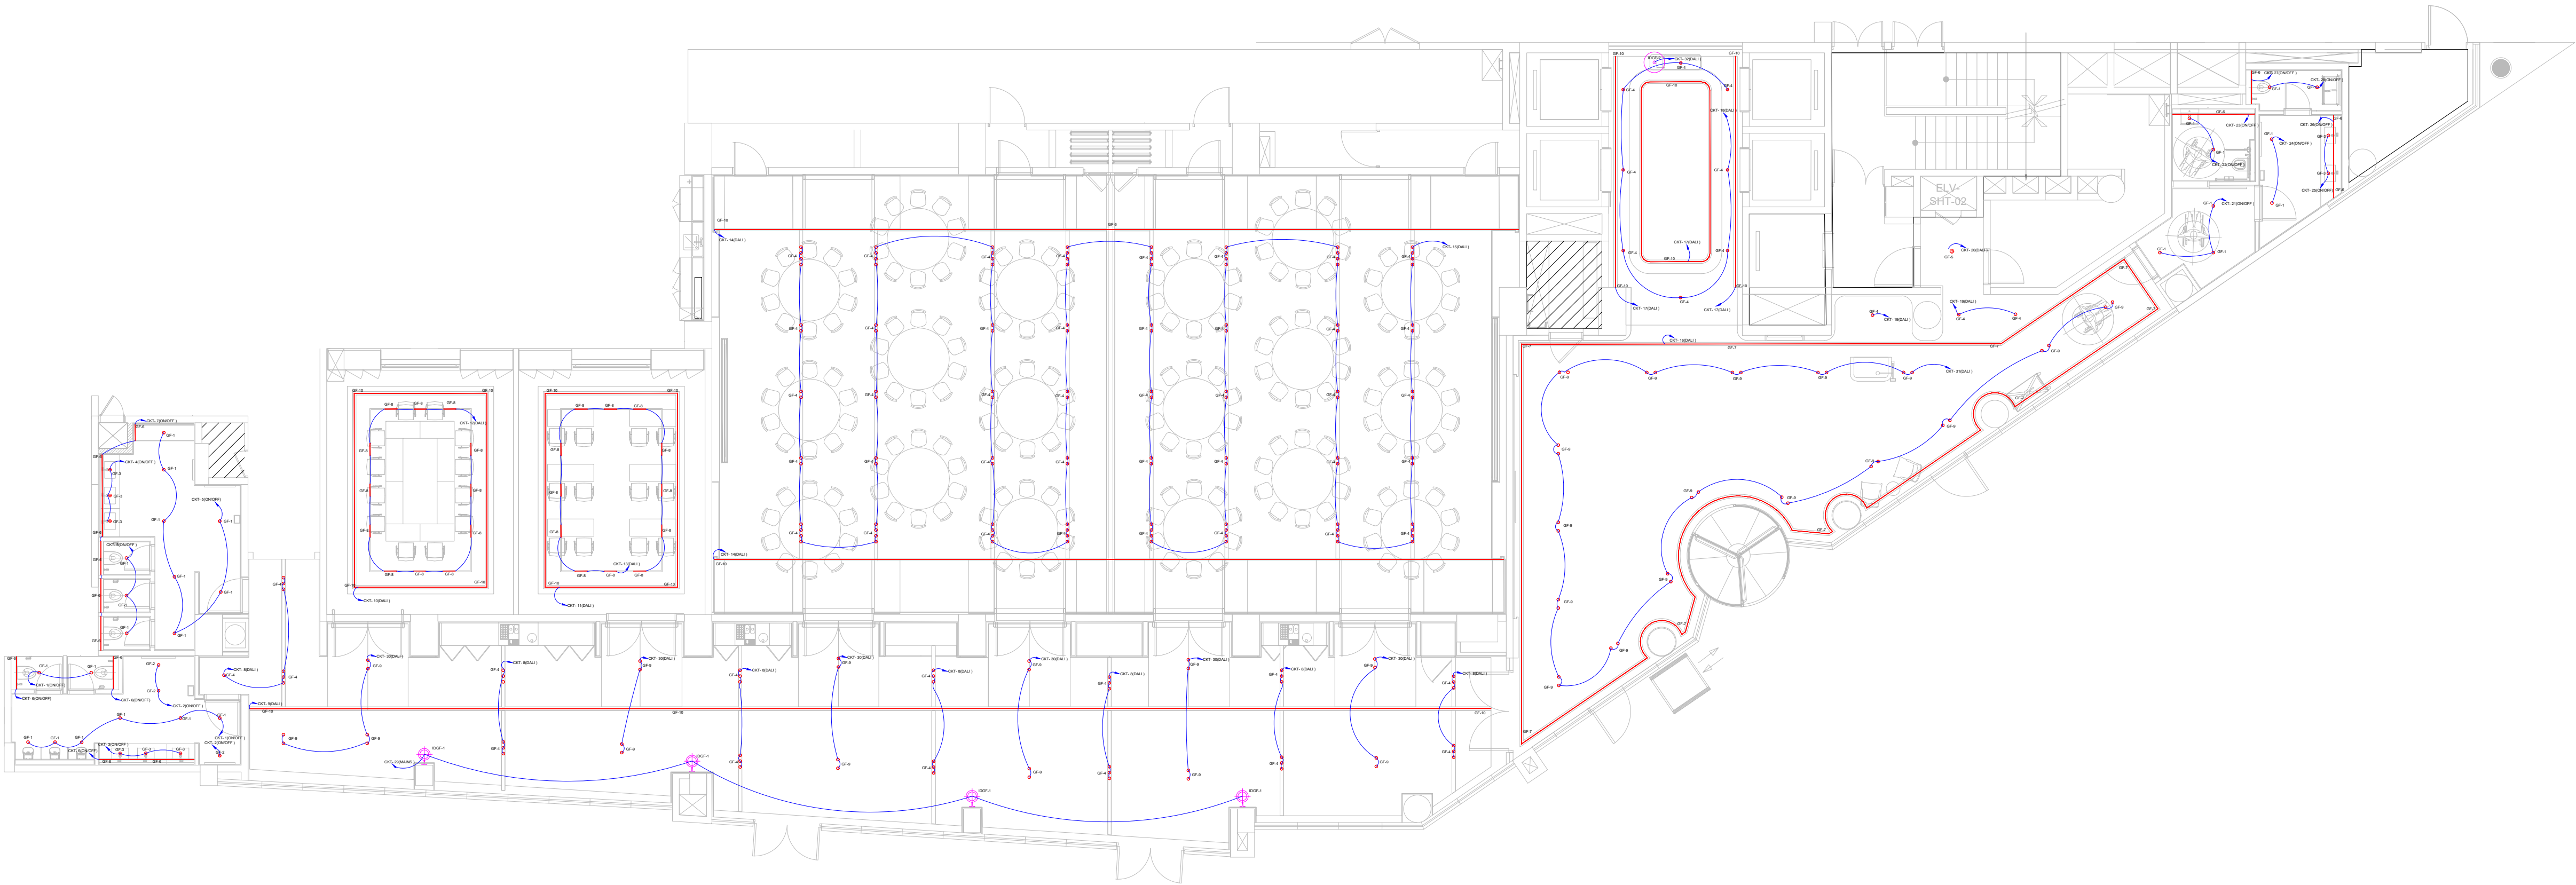

LEGENDS:

SYMBOL		DESCRIPTION	IP RATING	CONTROL
	GF-1	5W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP54	ON/OFF
	GF-2	5W-RECESSED CEILING ADJUSTABLE DOWNLIGHT- WIDE BEAM-3000K	IP20	ON/OFF
	GF-3	5W-RECESSED CEILING DOWNLIGHT- MEDIUM BEAM-3000K	IP20	ON/OFF
	GF-4	10.6W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
	GF-5	10.7W-RECESSED CEILING DOWNLIGHT- MEDIUM BEAM-3000K	IP20	DALI DIMMING
	GF-6	9.6W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	ON/OFF
	GF-7	14.4W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
	GF-8	12.6W/M - LED - RECESSED LINEAR TRACK LIGHT - MEDIUM BEAM - 3000K	IP20	DALI DIMMING
	GF-9	10.6W-RECESSED CEILING TWIN DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
	GF-10	9.6W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING

LEGENDS:

SYMBOL	DESCRIPTION	CONTROL
	IDGF-1 10W - WALL SCONCE- 3000K	ON/OFF
	IDGF-2 10W - TABLE LAMP- 3000K	ON/OFF

GENERAL NOTES:

Do not scale off this drawing
All drawings to be read in conjunction with all other relevant document,including drawings and specifications
All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only.

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART

No.	DATE	INITIALS	REV. DETAILS
01	31-12-2025	KR	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MAJESHANAN
CO BRIGADE HOTEL VENTURES LIMITED
29th & 30th Floor, World Trade Center,
Brigade Gateway Campus, 29/1 Dr. Rajkumar Road,
Mallamangalam, Bangalore, 560055, India
Ph: +91 80 40438002 , Fax: +91 80 40438010


LIGHTING CONSULTANT:

P.O.Box:50264 Dubai, U.A.E
Tel:+971 4 3975858, Fax:+971 4 3975959


DRAWING TITLE:

INTERNAL LIGHTING
GROUND FLOOR-
LIGHTING CONTROL SWITCHING


DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNANAN	TA	RAJ	31/12/2025
JOB No.	167	SCALE (A1)	1:80
SERVENR REP.	IL-GF-102	REV NO	00

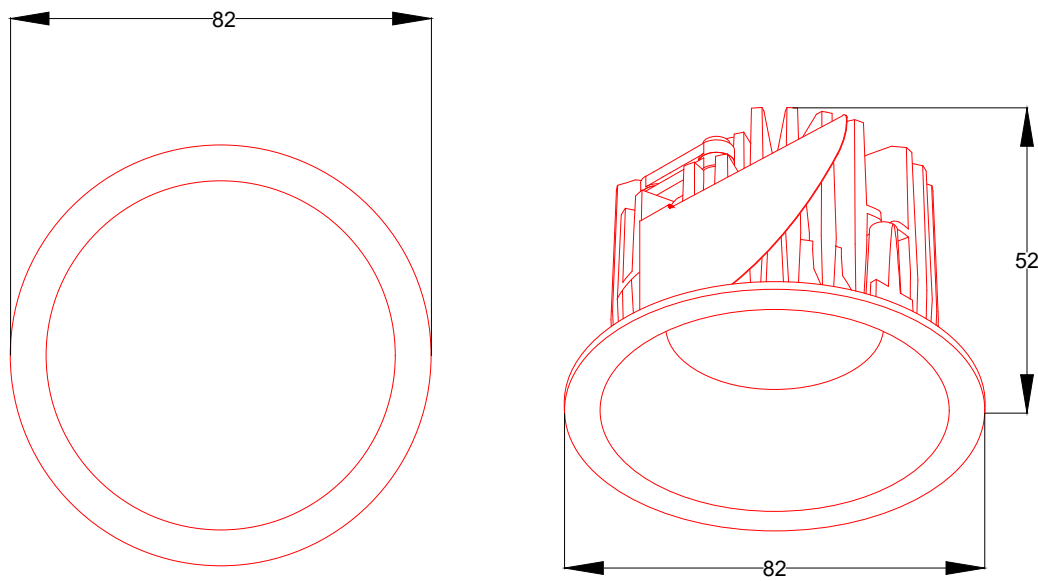


TYPE- GF-1
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION:5W

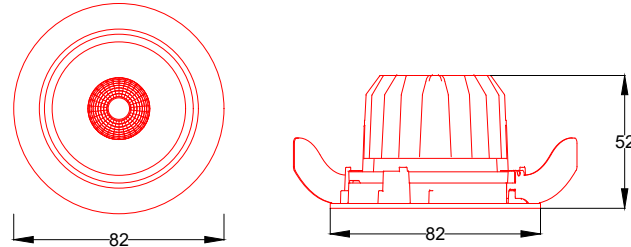


TYPE- GF-2
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION:5W

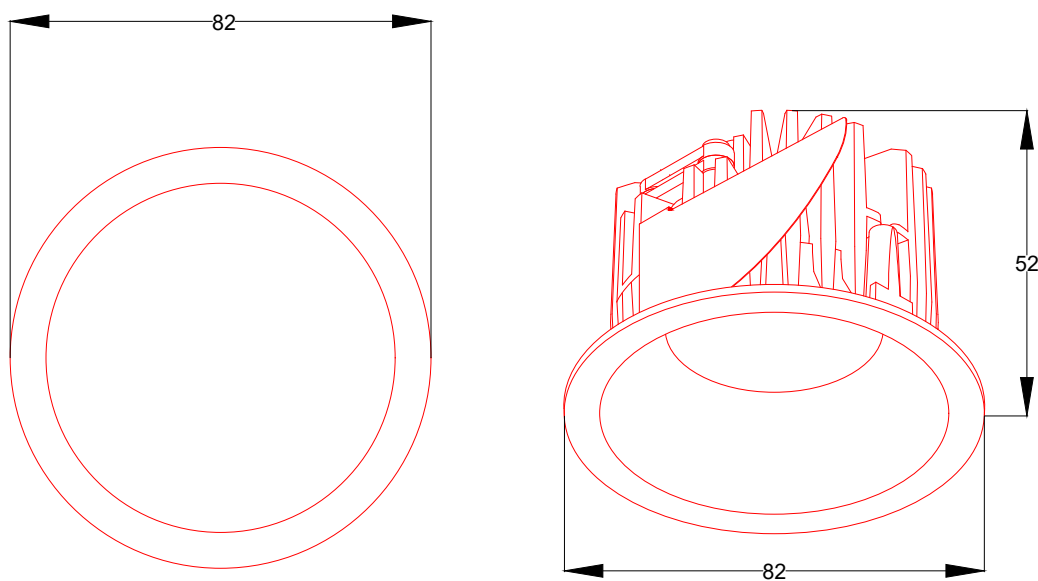


TYPE- GF-3
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION:5W

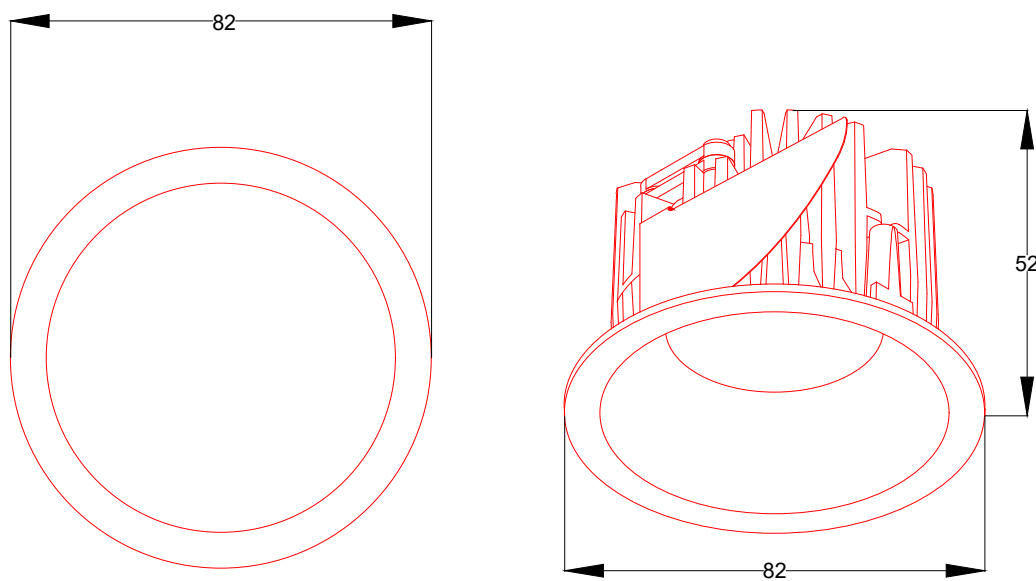


TYPE- GF-4
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:10W

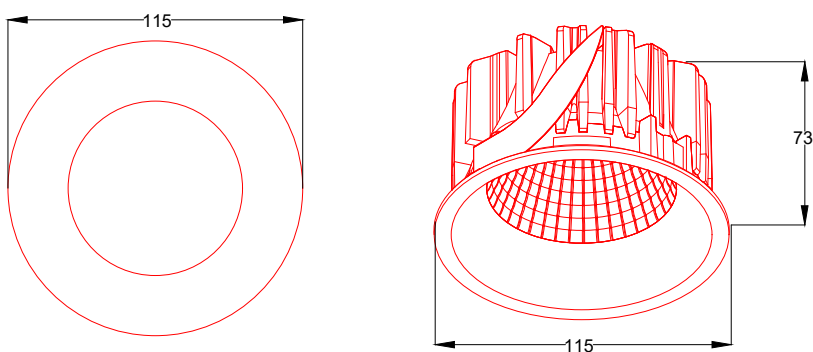


TYPE- GF-5
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:10.5W

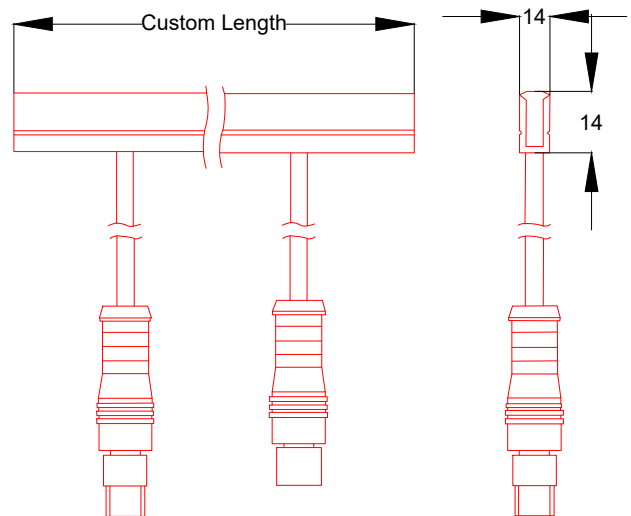


TYPE- GF-6
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :AS PER LENGTH
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION:9.6W/M

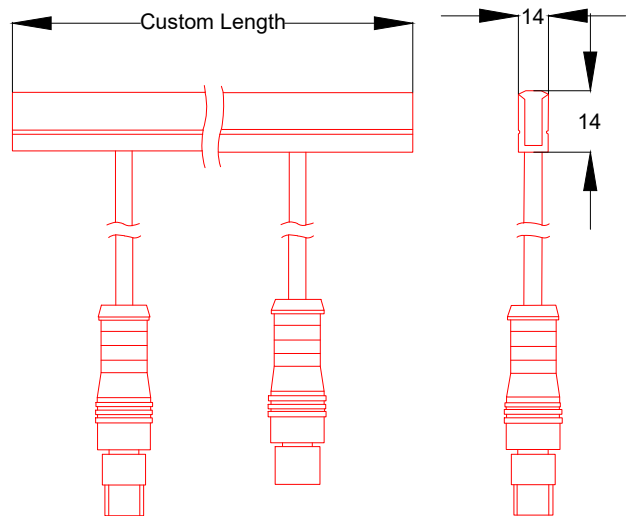


TYPE- GF-7
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:14.4W/M

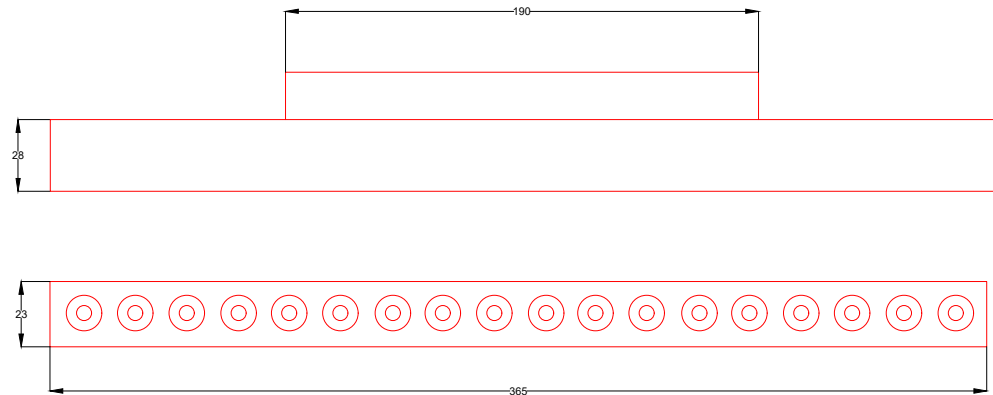

TYPE- GF-8
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:12.6W/M

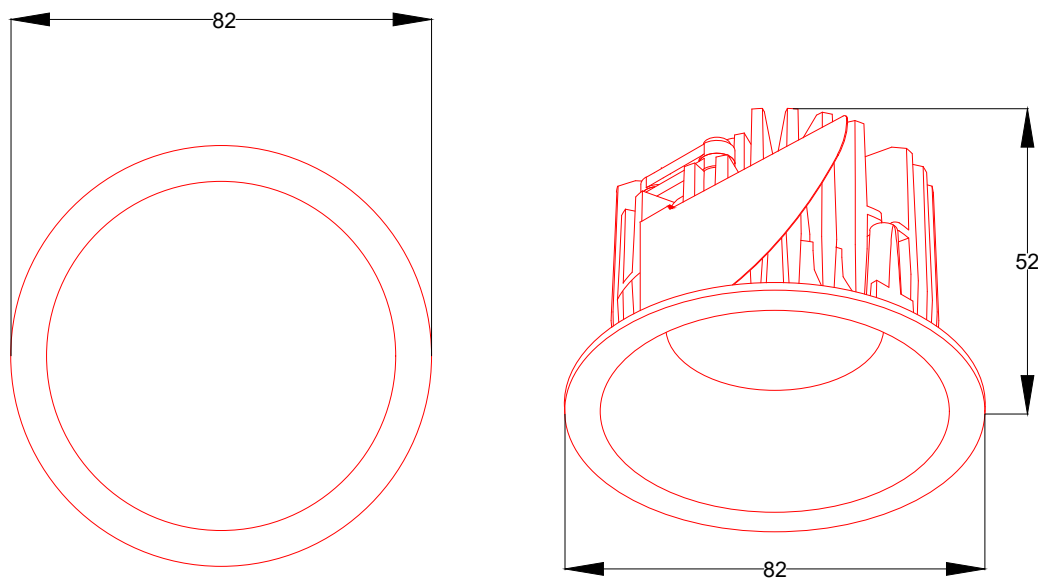

TYPE- GF-9
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:10.6W/M

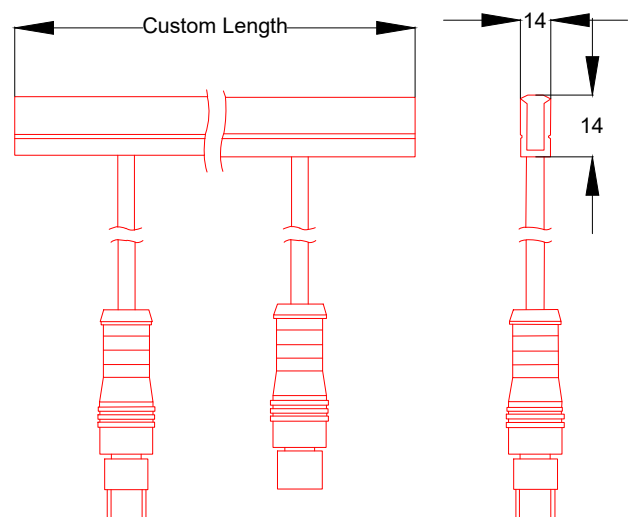

TYPE- GF-10
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:9.6W/M

GENERAL NOTES:

Do not scale off this drawing
All drawings to be read in conjunction with all other relevant document,including drawings and specifications
All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only.

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART

No.	DATE	INITIALS	REV. DETAILS
01	31-12-2025	KR	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MR. JAYARAM
CO BRIGADE HOTEL VENTURES LIMITED
29th & 30th Floor, World Trade Center,
Brigade Gateway Complex, 49/1 Dr. Rajkumar Road,
Madduram-Post, Bangalore 560055, India.
Ph: +91 83 40438000 ; Fax: +91 83 40438010

LIGHTING CONSULTANT:


P.O.Box:50264 Dubai, U.A.E
Tel:+971 4 3975858, Fax:+971 4 3975959

DRAWING TITLE:

INTERNAL LIGHTING
GROUND FLOOR
LUMINAIRE DETAILS

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNAN	NA	NA	31-12-2025
JOB NO.	167	SCALE (A1)	NTS
SHEET NO.	IL-GF-103	REV NO.	00