

BRIGADE FAIRFIELD


INTERNAL LIGHTING - FOURTH FLOOR

LIGHTING DESIGN





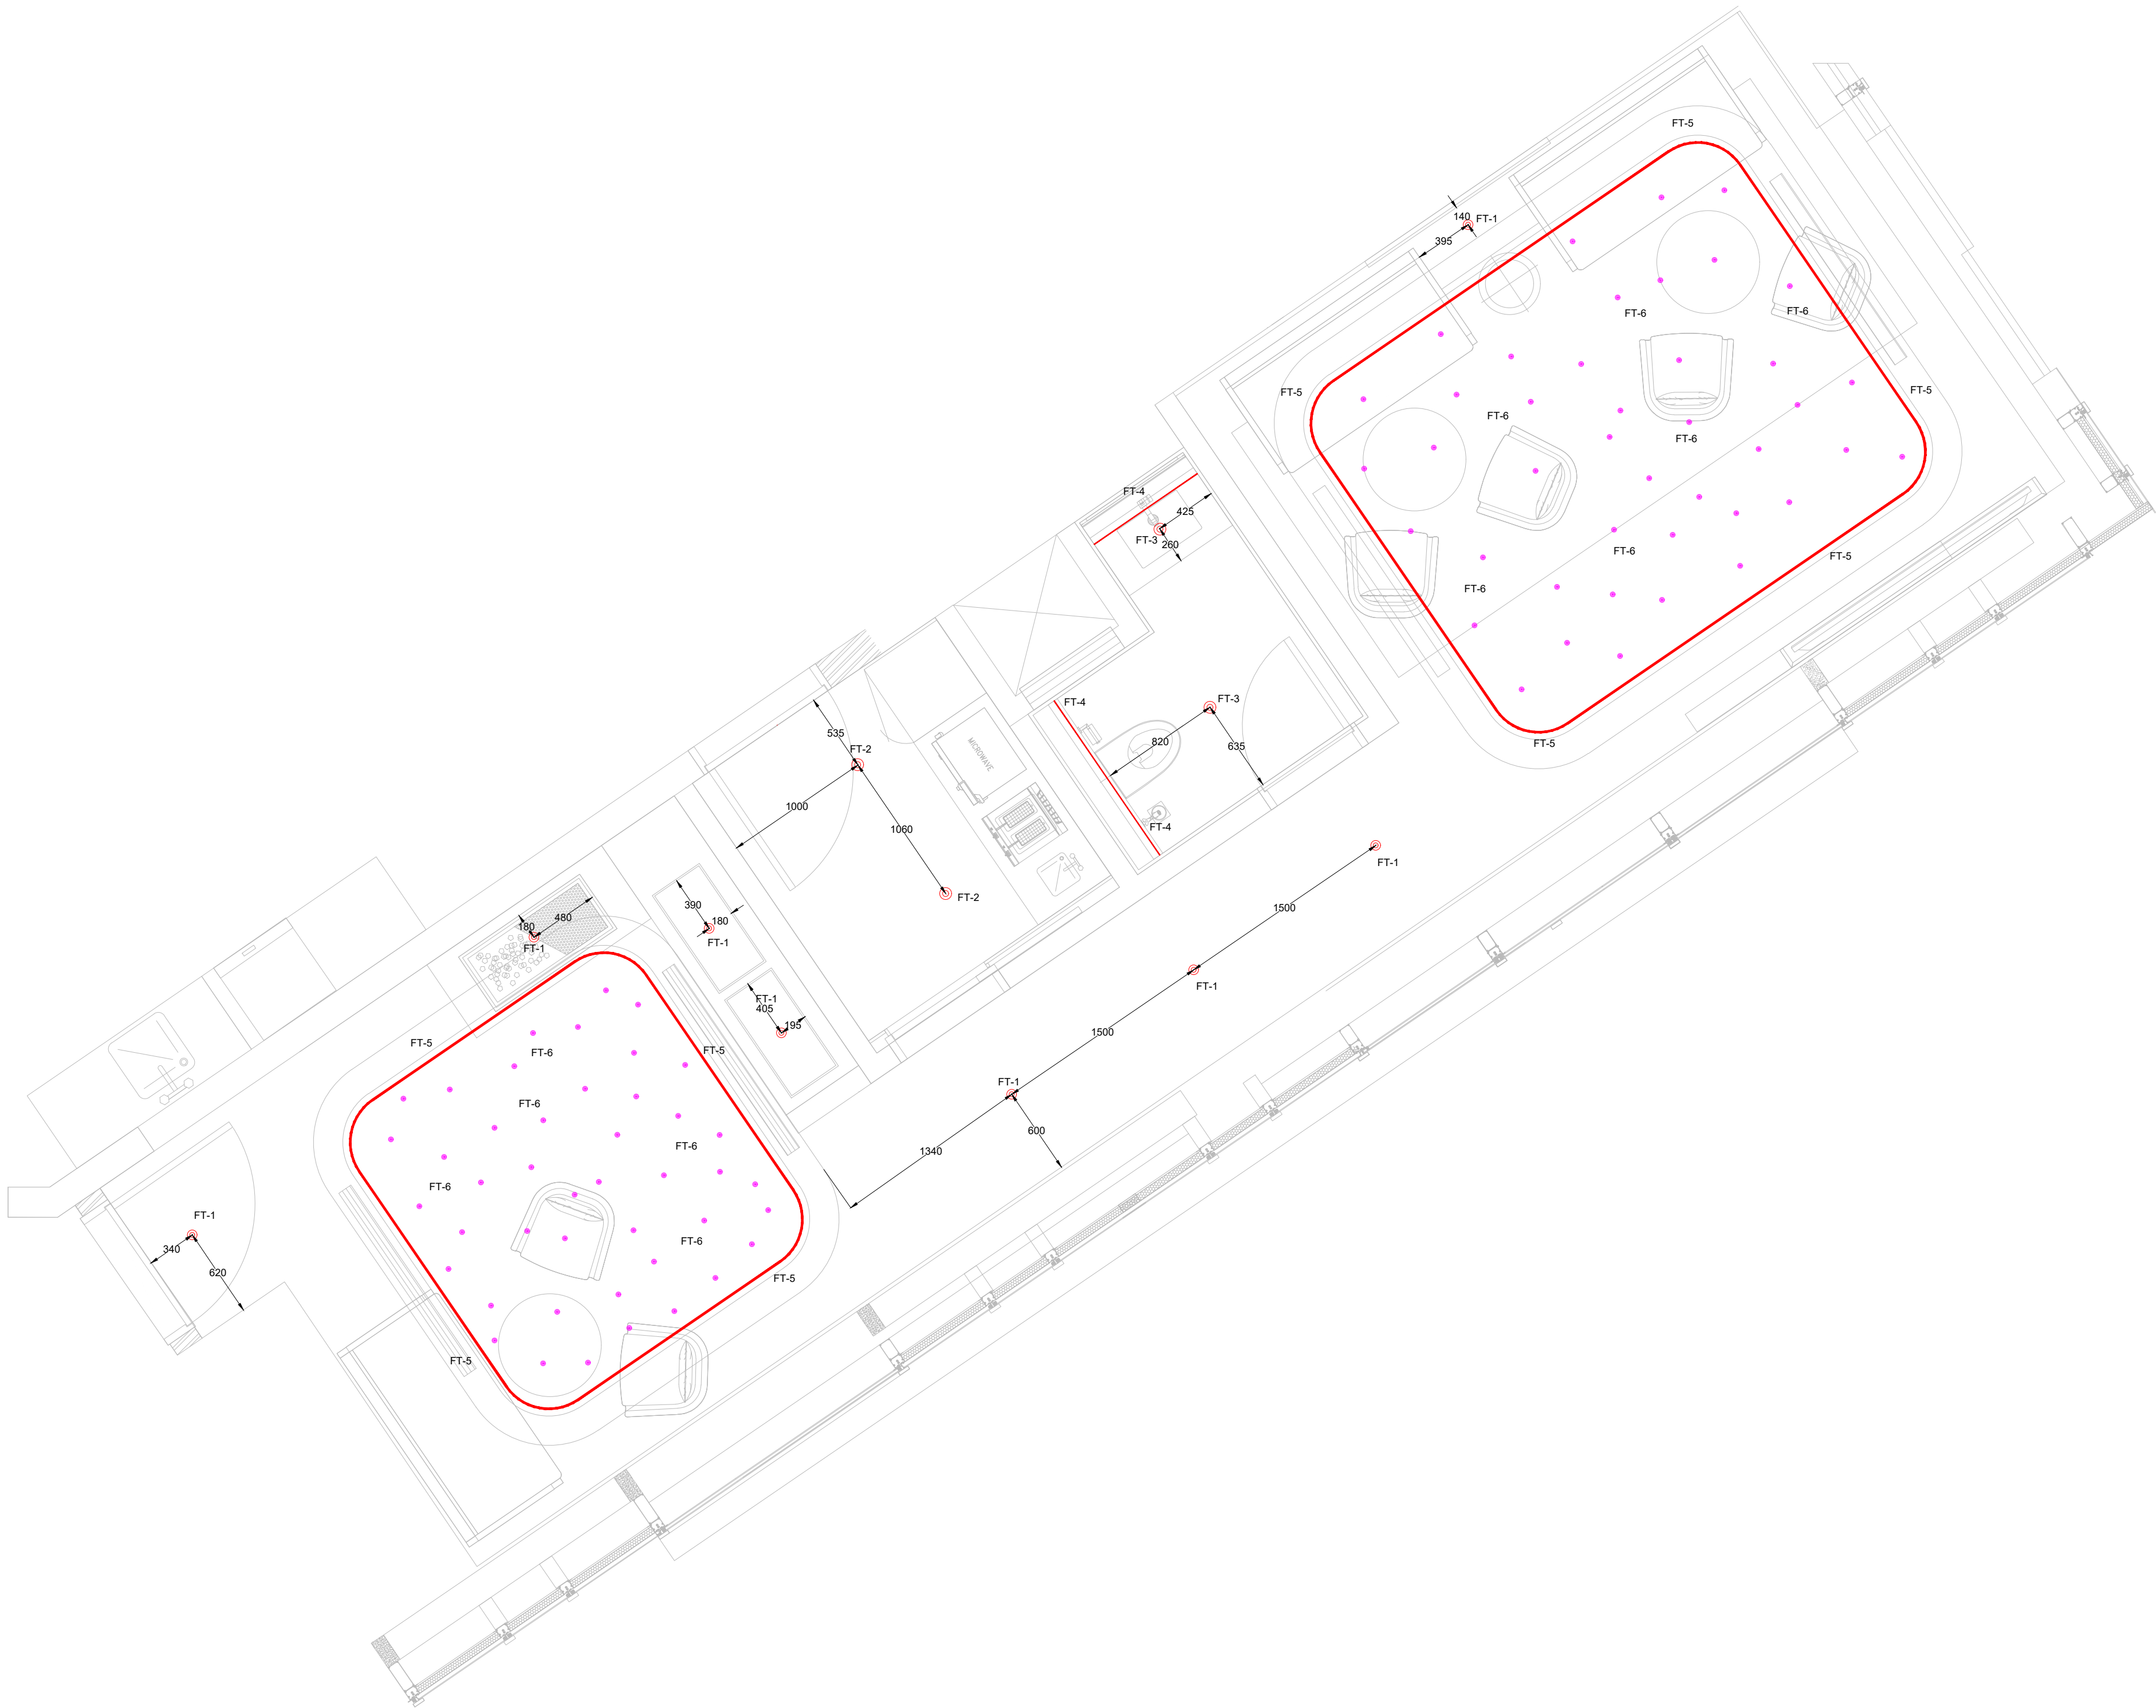

DRAWING LIST :

DRAWING NUMBER	SCALE	SIZE	TITLE
IL-FT-000	NTS	A1	COVER SHEET
IL-FT-101	AS	A1	INTERNAL LIGHTING - FOURTH FLOOR - LUMINAIRE LOCATION
IL-FT-102	AS	A1	INTERNAL LIGHTING - FOURTH FLOOR - LIGHTING CONTROL SWITCHING
IL-FT-103	NTS	A1	INTERNAL LIGHTING - FOURTH FLOOR - LUMINAIRE DETAILS

NOTE : THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE INTERIOR DESIGNERS DRAWINGS



LEGENDS:

SYMBOL	DESCRIPTION	IP RATING	CONTROL
 FT-1	6.5W-RECESSED CEILING ADJUSTABLE DOWNLIGHT- WIDE FLOOD-3000K	IP20	DALI DIMMING
 FT-2	10.6W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
 FT-3	5 W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
 FT-4	5 W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 FT-5	14.4W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
 FT-6	150W - LED - FIBRE OPTIC LIGHT - 3000K	IP20	DALI DIMMING

GENERAL NOTES:

Do not scale off this drawing

All drawings to be read in conjunction with all other relevant document,including drawings and specifications

All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART


No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KR	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

M/S JOSHANAM




CO BRIGADE HOTEL VENTURES LIMITED

29th & 30th Floor, World Trade Center, Brigade Gateway Campus, 29/1 Dr. Rajkumar Road, Mahanagar-560055, Bangalore 560055, India

Ph: +91 80 40438000 , Fax: +91 80 40438010

LIGHTING CONSULTANT:



Left Chennai

LIGHTING CONSULTANTS

P.O.Box:50264 Dubai, U.A.E


Tel:+971 4 3975858, Fax:+971 4 3975959

DRAWING TITLE:

INTERNAL LIGHTING
FOURTH FLOOR-
LUMINAIRE LOCATION

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNANAM	UJ	RAJ	06/01/2026
JOB No.	167	SCALE (A1)	1:20
SERVEN REF.	IL-FT-101	REV NO	00

NOTE : THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE INTERIOR DESIGNERS DRAWINGS

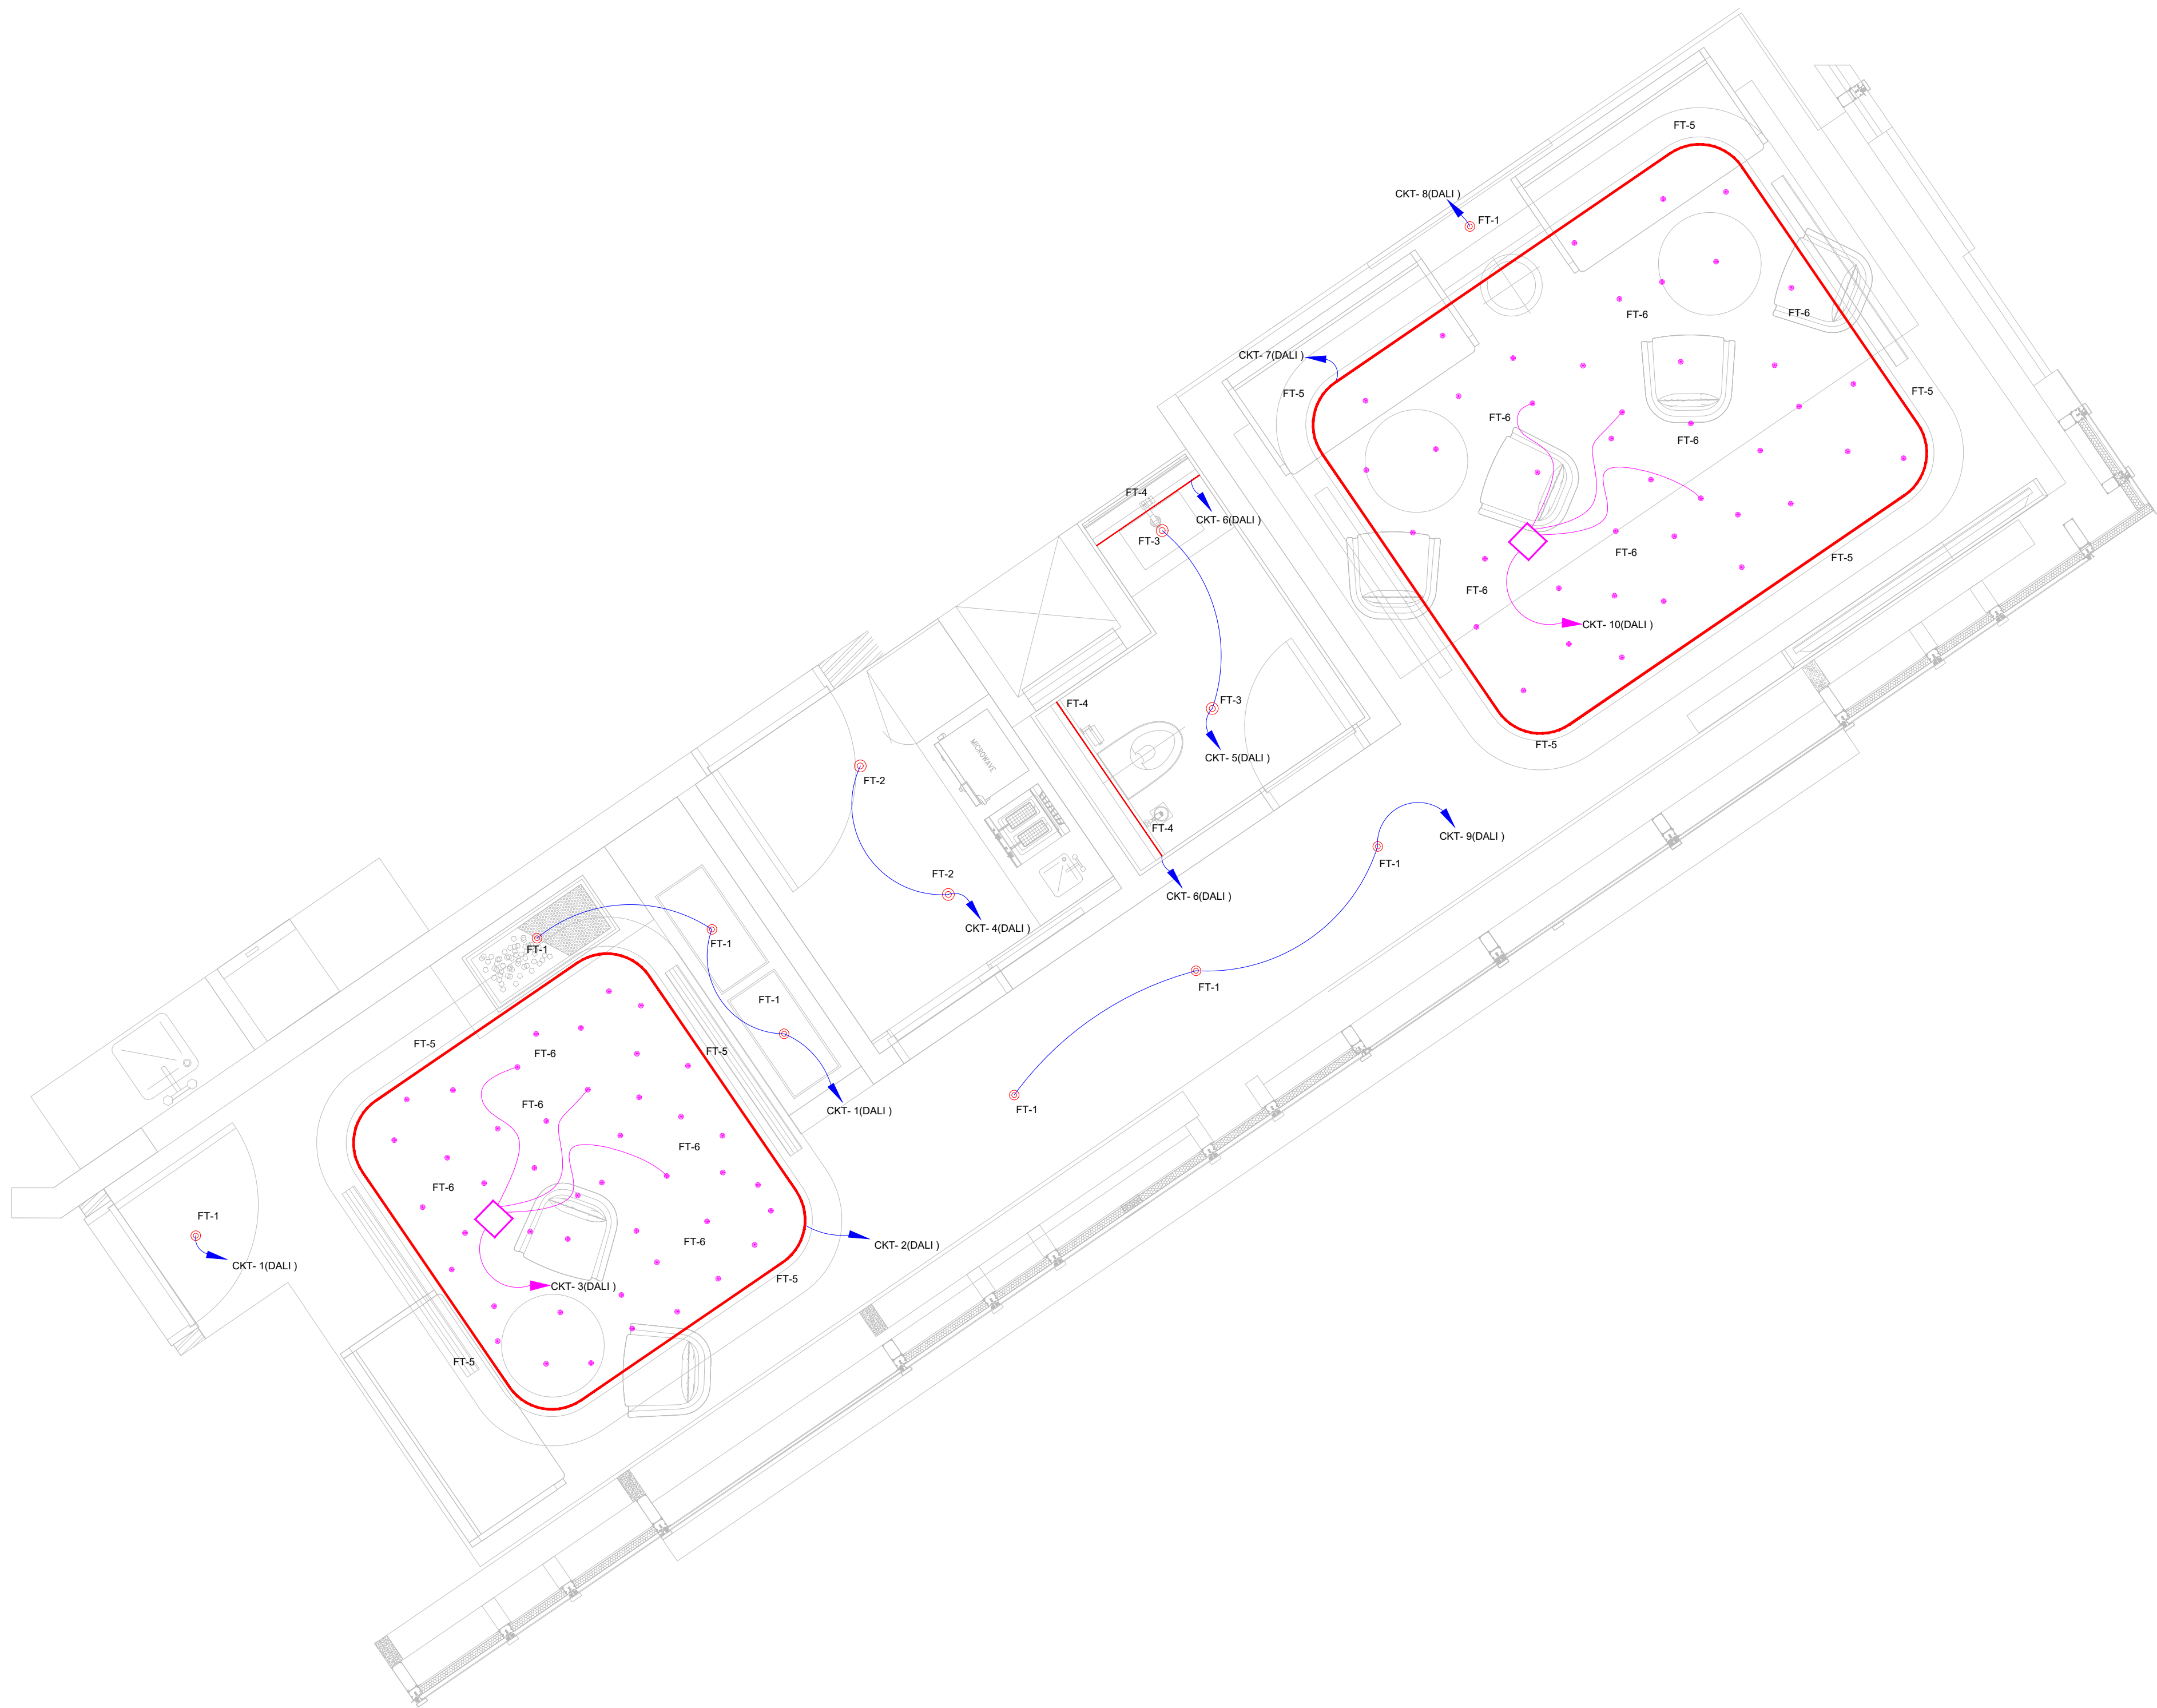

LEGENDS:

SYMBOL		DESCRIPTION	IP RATING	CONTROL
	FT-1	6.5W-RECESSED CEILING ADJUSTABLE DOWNLIGHT- WIDE FLOOD-3000K	IP20	DALI DIMMING
	FT-2	10.6W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
	FT-3	5 W-RECESSED CEILING DOWNLIGHT- WIDE BEAM-3000K	IP20	DALI DIMMING
	FT-4	5 W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
	FT-5	14.4W/M - LED - LINEAR CEILING COVE LIGHT - DIFFUSED BEAM - 3000K	IP20	DALI DIMMING
	FT-6	150W - LED - FIBRE OPTIC LIGHT - 3000K	IP20	DALI DIMMING

GENERAL NOTES:

Do not scale off this drawing
All drawings to be read in conjunction with all other relevant document,including drawings and specifications
All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART			
No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KR	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MR. JOSHAWAR
CO BRIGADE HOTEL VENTURES LIMITED
29th & 30th Floor, World Trade Center,
Brigade Gateway Complex, 26/1 Dr. Rajkumar Road,
Mallareddy- Rajajinagar, Bangalore 560055, India
Ph: +91 80 40438000 , Fax: +91 80 40438010


LIGHTING CONSULTANT:

P.O.Box:50264 Dubai, U.A.E
Tel:+971 4 3975858, Fax:+971 4 3975959


DRAWING TITLE:

INTERNAL LIGHTING
FOURTH FLOOR-
LIGHTING CONTROL SWITCHING


DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNANARAI	SA	RAJ	06/01/2026
JOB No.	167	SCALE (A1)	1:20
SERVEN NO.	IL-FT-102	REV NO.	00

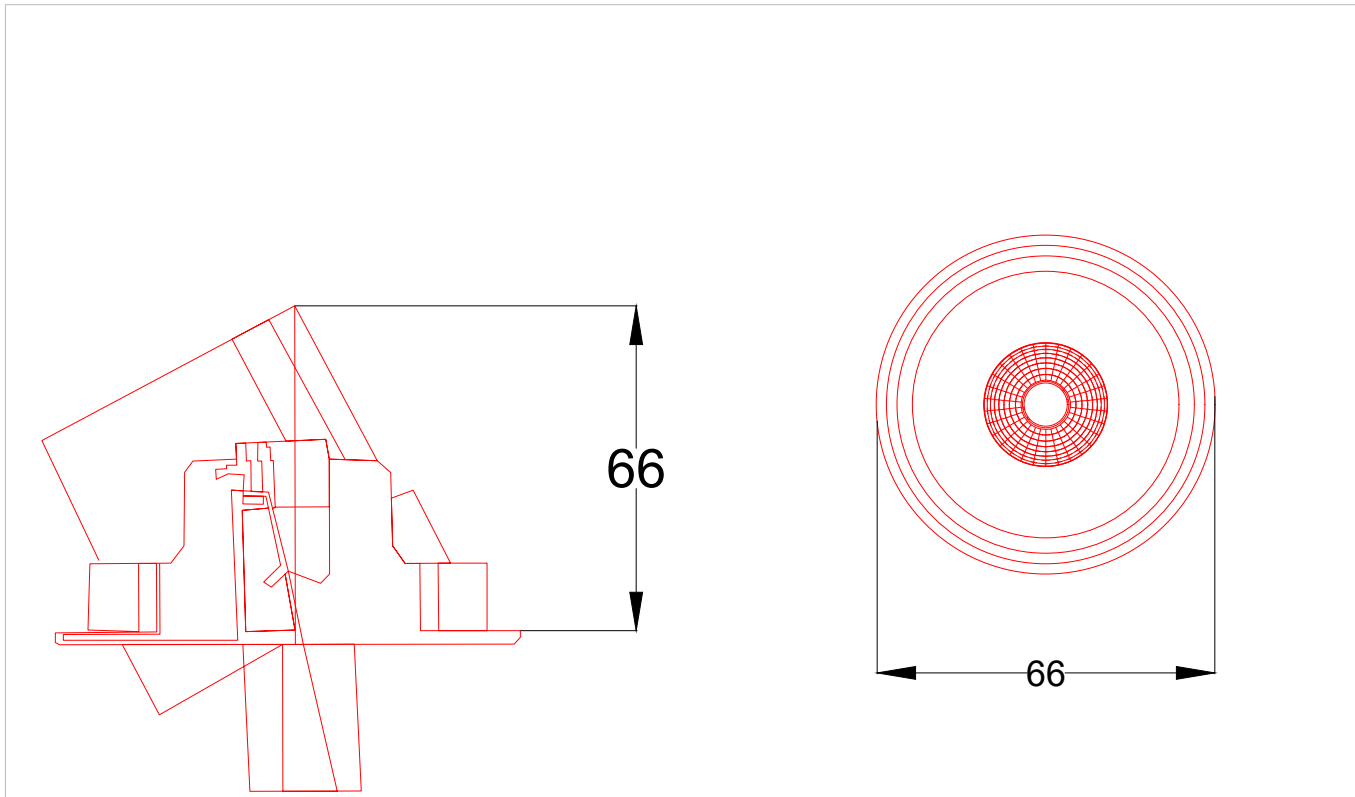


TYPE- FT-1
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:6.5W

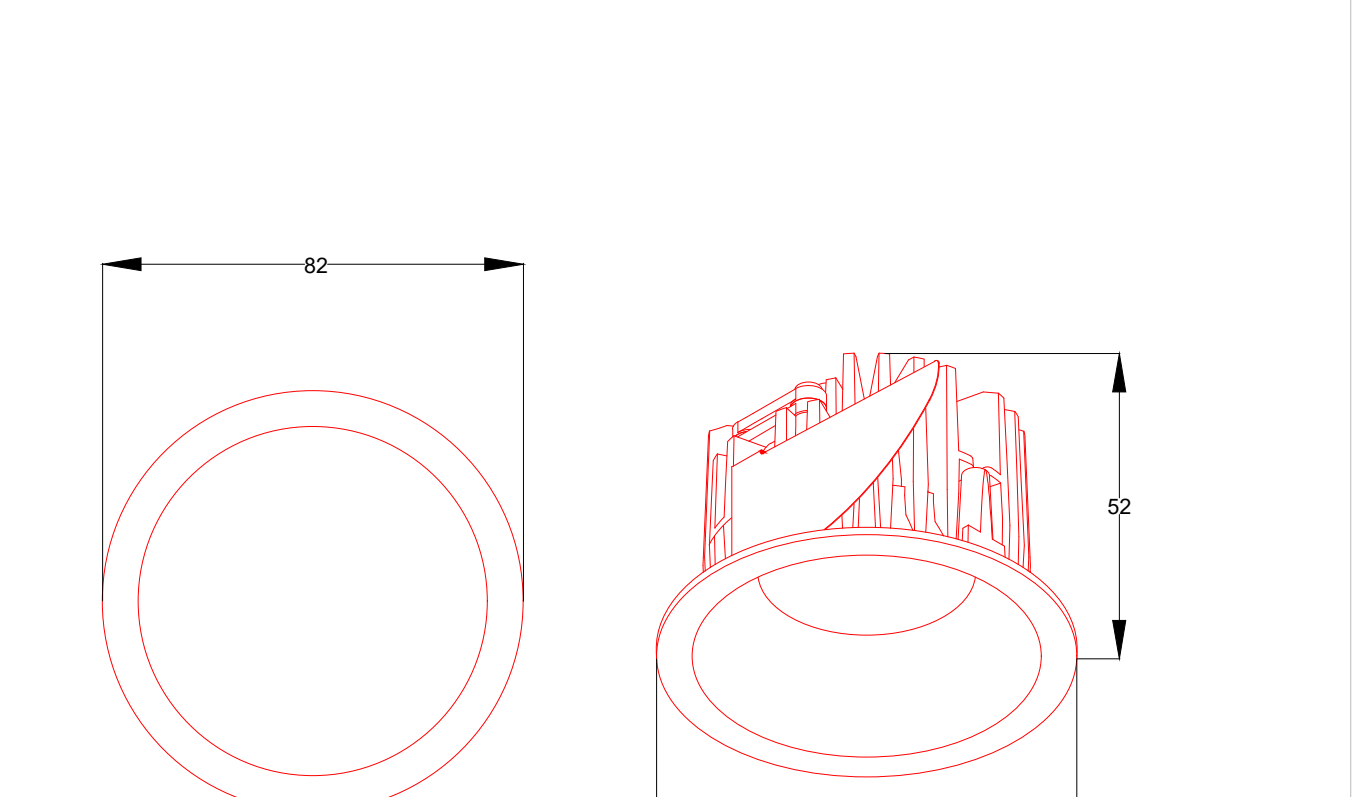


TYPE- FT-2
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:10.6W

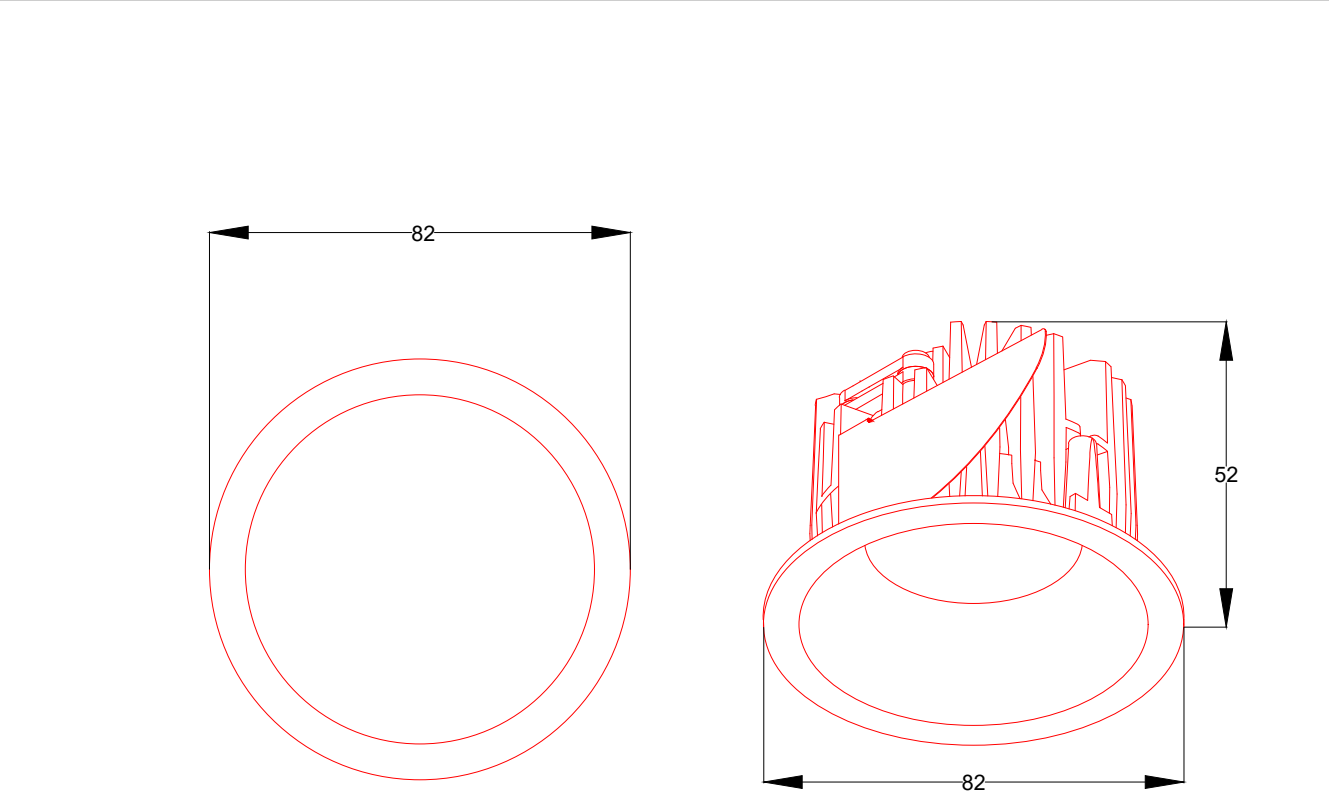


TYPE- FT-3
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :1
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:5W

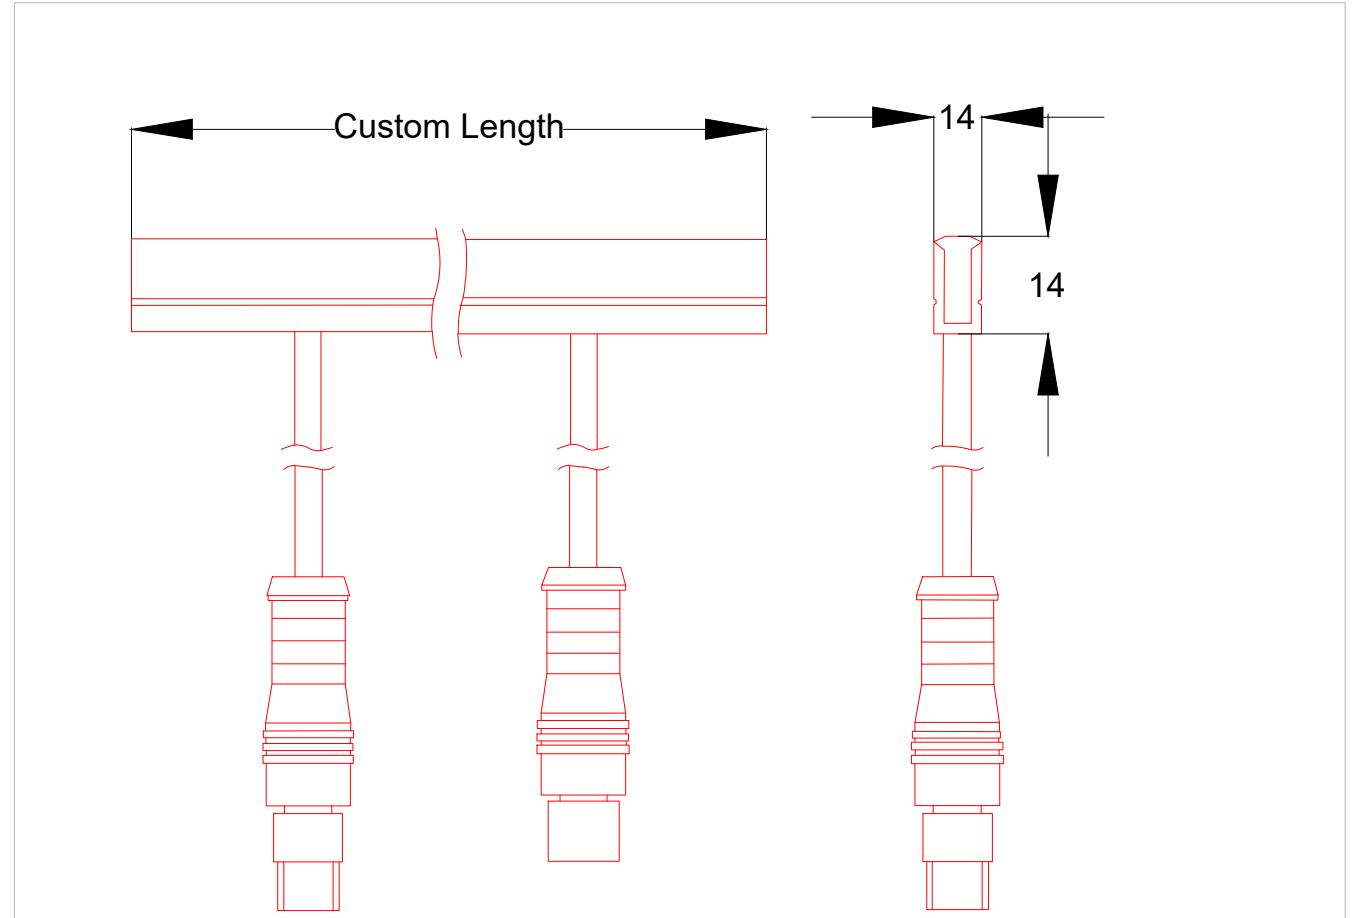

TYPE- FT-4
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS :AS PER LENGTH
CONTROL SYSTEM : ON/OFF
TOTAL POWER CONSUMPTION:5W/M

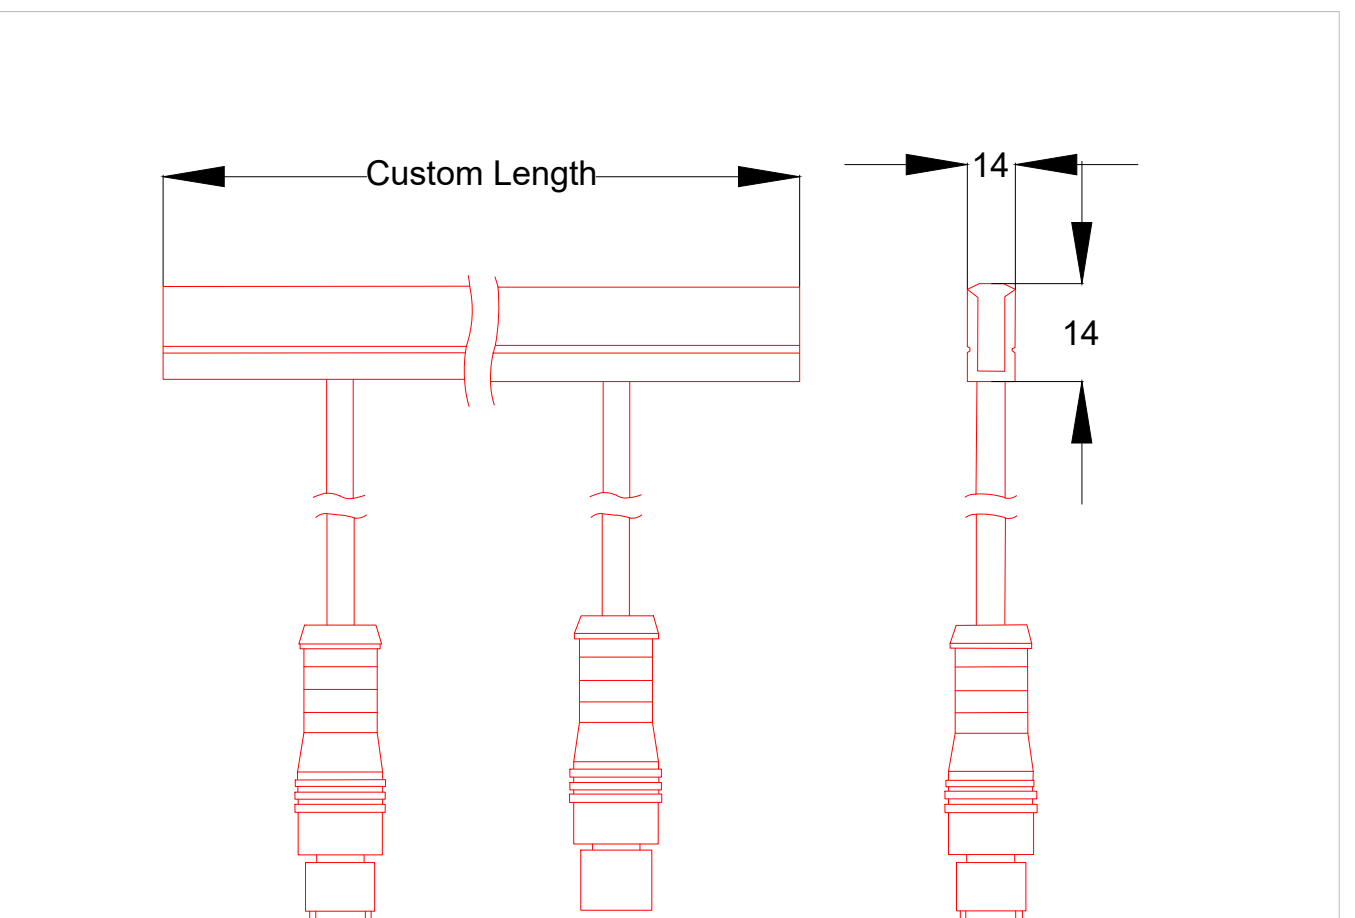

TYPE- FT-5
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : AS PER LENGTH
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:14.4W/M

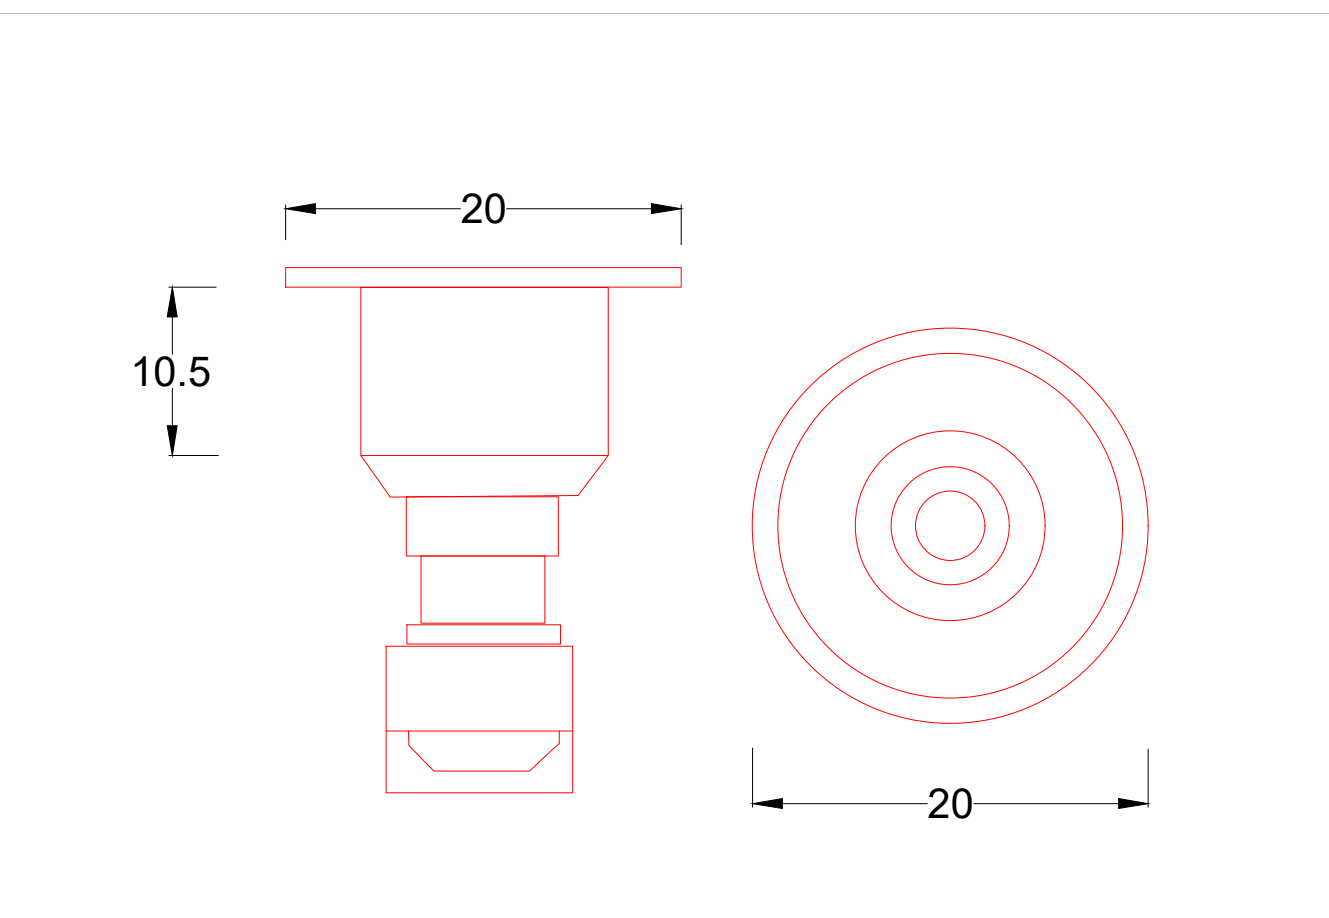

TYPE- FT-6
COLOR TEMPERATURE :3000K
LAMP : LED
NO. OF LAMPS : 1Nos
CONTROL SYSTEM : DALI DIMMING
TOTAL POWER CONSUMPTION:150W

GENERAL NOTES:

Do not scale off this drawing

All drawings to be read in conjunction with all other relevant document,including drawings and specifications

All dimensions to be checked on site prior to commencing installation or construction

All luminaire positions to be confirmed by lighting designer prior to commencement of installation.

All works to be carried out in accordance with such standards,Building and IEE regulations,mandatory and statutory regulations and codes of practice as are deemed to apply in respective country.

Important:

This Drawing is not to be issued for Tender or Construction.

If this Drawing is issued to contractors, it is for information only

Architects and Engineers drawings must be used as the basis for construction.

Circuit diagram indicated in this drawings are purely based on lighting control sequence. They are not to be treated as conduit layer of the power distribution to the lighting fixtures.

Conduits,cables, relays and associated electrical equipment design and installation to be coordinated by electrical contractor/consultant.

DRAWING REFERENCE CHART


No.	DATE	INITIALS	REV. DETAILS
01	06-01-2026	KR	DETAIL DESIGN

PROJECT NAME:

FAIRFIELD HOTEL

CLIENTS:

MAJID MURWAN




BRIGADE GROUP

C/O BRIGADE HOTEL VENTURES LIMITED

29th & 30th Floor, World Trade Center, Binzok Cemetery Complex, 20/1 Dr. Rajaguru Road, Marumamangudi, Bangalore 560025, India.

Ph: +91 80 40438000 / Fax: +91 80 40438010

LIGHTING CONSULTANT:



P.O.Box:50264 Dubai, U.A.E

Tel:+971 4 3975858, Fax:+971 4 3975959

DRAWING TITLE:

INTERNAL LIGHTING
FOURTH FLOOR-
LUMINAIRE DETAILS

DRAWN BY	JOB CAPTAIN	CHECKED BY	DATE
KRISHNAKISHAN	SA	RAJ	06/01/2026
JOB No.	167	SCALE (A1)	NTS
SHEET NO.	IL-FT-103	REV NO.	00