Automatización Mantenimiento y Construcción S.A. de C.V.
Av. siglo 21 #50
Condominio industrial siglo 21
Tlajomulco de zuñiga, Jalisco, México.
C.P. 45640
Tel. (+52) 333-120-1000

PEGATRON

Manufacturer (Company)	Automatización Mantenimiento y Construcción S.A. de C.V.
Project name	NV9X CP
Station name	ST 60
Production order	973
Company/Client	Pegatron

Electrical data

Phases	3+N+GND
Frequency (Hz)	60 Hz
Voltage (V)	230V
Current (A)	21 Amp

Pneumatic data

Pressure (Bar)	6 - 8 Bar

Created	08/12/2025
Modified	25/05/2026

Number of pages 83

Table Of Contents

Assignment	Page	Page Description	Date
	1	Front Page	25/05/2026
	1	Table Of Contents	25/05/2026
	1.a	Table Of Contents	25/05/2026
	1.b	Table Of Contents	25/05/2026
	1.c	Table Of Contents	25/05/2026
	1	Structure Identification	25/05/2026
	2	PLC Signals	25/05/2026
	3	PLC Signals	25/05/2026
	4	PLC Signals	25/05/2026
=LAYOUT +GC		Control Cabinet	
	1	Control plate visualization	25/05/2026
=BOM			
	1	Component List	25/05/2026
	1.a	Component List	25/05/2026
	1.b	Component List	25/05/2026
	1.c	Component List	25/05/2026
	1.d	Component List	25/05/2026
	1.e	Component List	25/05/2026
	1.f	Component List	25/05/2026
	1.g	Component List	25/05/2026
	1.h	Component List	25/05/2026
	1.i	Component List	25/05/2026
	1.j	Component List	25/05/2026
=220VCA +GC		Control Cabinet	
	1	Main supply power cabinet	19/05/2026
	2	220 VAC Miniature circuit breakers connections	19/05/2026
	3	Terminal connections	19/05/2026
	3.a	Terminal connections	28/03/2026

Table Of Contents

Assignment	Page	Page Description	Date
=220VCA +GC		Control Cabinet	
	4	Power supply connections	28/03/2026
=220VCA +SST		Station structure	
	1	CPU and monitor connections	28/03/2026
	2	220 Outlet connections	19/05/2026
	3	Robot controller connections	19/05/2026
=110VCA +GC		Control Cabinet	
	1	110 VAC Fuses connections	19/05/2026
=110VCA +SST		Station structure	
	1	110 VAC Fan connections	16/02/2026
	2	Station luminary connections	16/02/2026
	3	110 VAC Outlet connections	10/12/2025
=24VCD +GC		Control Cabinet	
	1	24 VDC Miniature circuit breakers connections	16/02/2026
	2	24 VDCFuses connections	19/05/2026
	2.a	24 VDCFuses connections	19/05/2026
	3	24 VDC Terminals connections	19/05/2026
	4	0 VDC Terminals connections	27/03/2026
	5	Programmable logic controller connections	19/05/2026
	5.a	PLC/Digital inputs connections	19/05/2026
	5.b	PLC/Digital inputs connections	28/03/2026
	5.d	PLC/Digital outputs connections	28/03/2026
	5.e	PLC/Digital outputs connections	19/05/2026
	5.f	Programmable logic controller connections	19/05/2026
	5.g	PLC/Digital inputs connections	03/01/2026
	5.h	PLC/Digital inputs connections	16/02/2026
	5.i	PLC/Digital outputs connections	03/01/2026
	5.j	PLC/Digital outputs connections	16/02/2026
	6	Safety terminal connections	19/05/2026

Table Of Contents

Assignment	Page	Page Description	Date
=24VCD +GC		Control Cabinet	
	6.a	Safety terminal connections	19/05/2026
	7	Safety relay connections SR1	19/05/2026
	7.a	Safety relay connections SR2	19/05/2026
	8	Power relay connections	27/03/2026
	8.a	Power relay connections	27/03/2026
	8.b	Power relay connections	19/05/2026
	8.c	Power relay connections	19/05/2026
	8.d	Power relay connections	19/05/2026
	9	Rele connections KS1	19/05/2026
	9.a	Rele connections KS2	19/05/2026
	10	Vision system controller connections	19/05/2026
	11	Master I/O Link	27/03/2026
	11.a	IO-Link Master 1 (PNIO/MOD)	27/03/2026
	11.b	IO-Link Master 1 (PNIO/MOD)	27/03/2026
	12	Ethernet switch connections	28/03/2026
	12.a	Ethernet switch connections	28/03/2026
=24VCD +GO		Operation Cabinet	
	1	Buttons	19/05/2026
	2	Operation interface onnections	19/05/2026
=24VCD +SST		Station structure	
	1	Interlock connections	25/05/2026
	3	Signal turret connections	27/03/2026
	4	Start process button connections	27/03/2026
	5	Camera connections	28/03/2026
	7	Code reader connections	16/02/2026
	8	IO-Link I/O Hub 1	28/03/2026
	8.a	IO-Link I/O Hub 1	19/05/2026
	8.b	IO-Link I/O Hub 1	25/05/2026

Table Of Contents

Assignment	Page	Page Description	Date
=24VCD +SST		Station structure	
	10	DB9 connections	25/05/2026
	11	Robot controller connections	19/05/2026
=24VCD +PN		Pneumatic Plate	
	1	Mantenance unit connections	19/05/2026
	2	Solenoid connections	19/05/2026
=PNEU(Pneumatics) +SST		Station structure	
	1	Maintenance unit connections	19/05/2026
	2	Valve terminal connections	19/05/2026
	2.a	Valve terminal connections	28/03/2026
	3	Cylinders connections	27/03/2026

Structure Identifier Overview

Full Designation	Labeling	Structure Description
=LAYOUT	Higher-level function	Component Distribution
=BOM	Higher-level function	Materials list
=220VCA	Higher-level function	Voltage at 220V
=110VCA	Higher-level function	Voltage at 110V
=24VCD	Higher-level function	Voltage at 24V DC
=220VAC	Higher-level function	Voltage at 220 VAC
=24VDC	Higher-level function	Voltage at 24V DC
=PNEU(Pneumatics)	Higher-level function	
=110VAC	Higher-level function	Voltage at 110 VAC
=NEUM	Higher-level function	Neumática
+GC	Mounting location:	Control Cabinet
+GO	Mounting location:	Operation Cabinet
+SST	Mounting location:	Station structure
+OC	Mounting location:	Operation Cabinet
+ESTR	Mounting location:	Estructura de estación
+PN	Mounting location:	Pneumatic Plate
+CC	Mounting location:	Control Cabinet
+LCNV	Mounting location:	Transportador inferior
+TC	Mounting location:	Transportador superior
&FRONT PAGE	Document type	Front Page
&TABLE OF CONTENTS	Document type	Table Of Contents
&INF	Document type	Project Information

PLC Address Summary


Connection Point	Sign/Laber	Data Type	Plc Signal Description	Variable Type
Y10	Y10	BOOL	Green light -OTB2	Digital output
Y16	Y16	BOOL	Available	Digital output
Y11	Y11	BOOL	Bypass Interlock	Digital output
Y12	Y12	BOOL	48+ Voltage	Digital output
Y13	Y13	BOOL	48- Voltage	Digital output
24V	1015	BOOL	Common positive	COM
Y17	Y17	BOOL	Available	Digital output
Y15	Y15	BOOL	=	Digital output
Y14	Y14	BOOL	=	Digital output
24V	1009	BOOL	Common positive	COM
Y0	Y00	BOOL	ON/OFF-LF1 K1	Digital output
Y6	Y06	BOOL	Green light -OTB1	Digital output
Y7	Y07	BOOL	Red light -OTB2	Digital output
Y1	Y01	BOOL	Activate green led light SL1	Digital output
Y2	Y02	BOOL	Activate yellow led light SL1	Digital output
Y3	Y03	BOOL	Activate red led light SL1	Digital output
Y5	Y05	BOOL	Red light -OTB1	Digital output
	NC	BOOL	Not connect	NC
y04	Y04	BOOL	Activate light siren SL1	Digital output
24V	1003	BOOL	Common positive	COM
X14	X14	BOOL	Available	Digital input
X13	X13	BOOL	=	Digital input
X12	X12	BOOL	=	Digital input
X11	X11	BOOL	=	Digital input
X10	X10	BOOL	Maintenance unit	Digital input
X16	X16	BOOL	Available	Digital input
0V	3004	BOOL	Common negative	COM

PLC Address Summary

Connection Point	Sign/Laber	Data Type	Plc Signal Description	Variable Type
NC	NC	BOOL	Not connect	Digital input
X15	X15	BOOL	Available	Digital input
X17	X17	BOOL	=	Digital input
X2	X02	BOOL	PB1 / Start button	Digital input
X3	X03	BOOL	PB2 / Reset button	Digital input
X4	X04	BOOL	Open/close interlock 1	Digital input
X1	X01	BOOL	Interlock safety cicuit	Digital input
X0	X00	BOOL	Emergency stop circuit Safety relay SR1	Digital input
X5	X05	BOOL	Open/close interlock 2	Digital input
X6	X06	BOOL	Start processs button 1	Digital input
0V	3003	BOOL	Common negative	COM
NC	NC	BOOL	Not connect	Digital input
X7	X07	BOOL	Start processs button 2	Digital input
02	I0.2	BOOL	Available	Digital input
03	I0.3	BOOL	=	Digital input
04	I0.4	BOOL	=	Digital input
01	I0.1	BOOL	Interlock safety circuit	Digital input
00	I0.0	BOOL	Emergency stop circuit Safety relay SR1	Digital input
05	I0.5	BOOL	Available	Digital input
06	I0.6	BOOL	=	Digital input
07	I0.7	BOOL	=	Digital input
10	I1.0	BOOL	=	Digital input
11	I1.1	BOOL	=	Digital input
12	I1.2	BOOL	=	Digital input
09	I0.9	BOOL	=	Digital input
08	I0.8	BOOL	=	Digital input
13	I1.3	BOOL	=	Digital input

PLC Address Summary

Connection Point	Sign/Laber	Data Type	Plc Signal Description	Variable Type
COM	3017	BOOL	Common negative	Digital input
01	O0.1	BOOL	Available	Digital output
02	O0.2	BOOL	=	Digital output
03	O0.3	BOOL	=	Digital output
04	O0.4	BOOL	=	Digital output
00	O0.0	BOOL	=	Digital output
05	O0.5	BOOL	=	Digital output
06	O0.6	BOOL	=	Digital output
07	O0.7	BOOL	=	Digital output
09	O0.9	BOOL	=	Digital output
CO (0V)	3018	BOOL	Common negative	Digital output
08	O0.8	BOOL	Available	Digital output

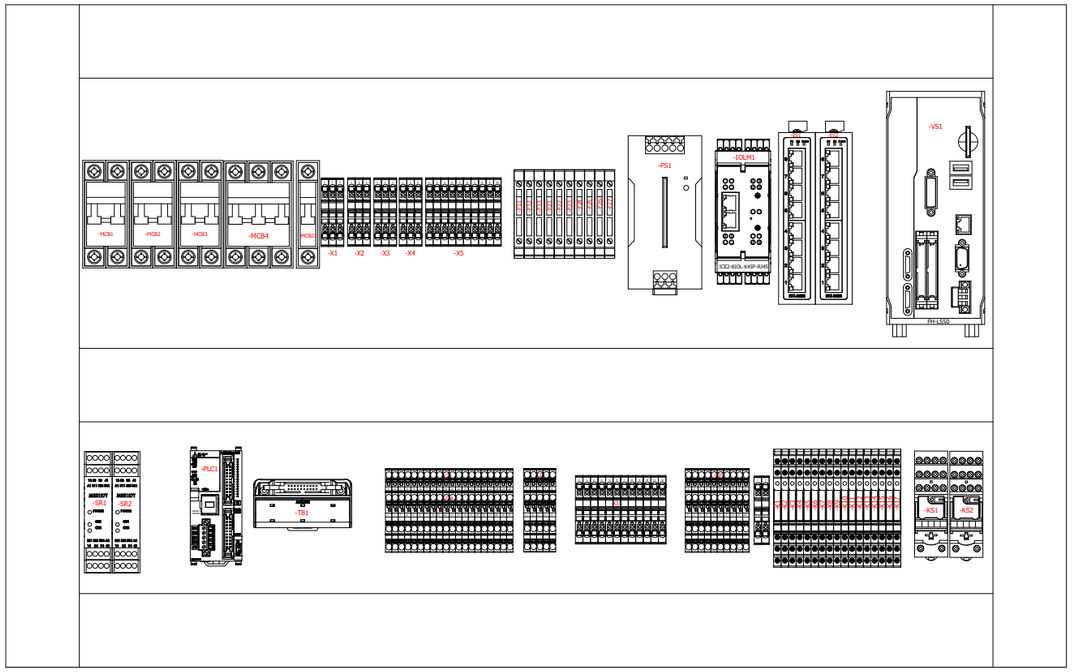
-MCB1
-MCB2
-MCB3
-MCB4
-MCB5
-X1
-X2
-X3
-X4
-X5
-PS1
-IOLM1
-VS1
-PLC1
-TB1
-SR1
-SR2
-KS1
-KS2

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
SH202-C2	01	Miniature circuit breaker	SH202-C2	ABB	
SH202-C4	01	Miniature circuit breaker	SH202-C4	ABB	
SH202-C6	01	Miniature circuit breaker	SH202-C6	ABB	
SH203-C10	01	Miniature circuit breaker	SH203-C10	ABB	
SH201-C10	01	Miniature circuit breaker	SH201-C10	ABB	
1492-P4	12	Terminal block	1492-P4	Allen Bradley	
MSR1227TP	02	Safety relay	MSR1227TP	Allen Bradley	

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
R125-4S	18	Test probe	R125-4S	Asixxsix	
CH20-HP020-1R	02	Terminal Block Connector	CH20-HP020-1R	Autonics	
AFS-H20	02	Terminal block	AFS-H20	Autonics	
5492C	01	Multimeter	5492C	BK Precision	
1737	01	Power supply	1737	BK Precision	
BCS003K	02	Capacitive proximity detectors	BCS D50OO02-YPC25C-EV02	Balluff	
75029	02	Touch button	VTBP6GRLQ	Banner	



Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
47812	02	Cordset	MQDC1-515	Banner	
DBS-R9045R	01	Circular light	DBS-R9045R	Danbes	
DPSF05A-E1	17	Power relay	DPSF05A-E1	Degson	
E2020H	01	Monitor	E2020H	Dell	
OptiPlex 7000	01	PC	OptiPlex 7000	Dell	
ESV-LK32	01	Valve Manifold	ESV-LK32	EMC	
263467	01	Emergency stop push button	M22-PVT	Eaton	


Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
216378	03	NC contact element	M22-K01	Eaton	
216374	03	Mounting clamp	M22-A	Eaton	
216376	03	NA Contact element	M22-K10	Eaton	
216596	01	Green push button	M22-D-G	Eaton	
216598	01	Yellow push button	M22-D-Y	Eaton	
081438	01	Main switch	P1-32/EA/SVB	Eaton	
174014	02	Safety switch	CTS-C1-BR-CC-FLX-AP-VSA	Euchner	

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
167919	02	Actuator	A-FLX-D-0C	Euchner	
574334	06	Proximity sensor	SMT-8M-A-PS-24V-E-0,3-M8D	Festo	
547860	01	Proximity Sensor	SMT-8G-PS-24V-E-0,3Q-M8D	Festo	
547860	01	Proximity Sensor	SMT-8G-PS-24V-E-0,3Q-M8D	Festo	
574323	01	Connection cable	NEBU-M12G5-E-10-Q8N-M12G5	Festo	
532447	02	Linear actuator	DGC-25-200	Festo	
170913	01	Guided cylinder	DFM-16-80-P-A-KF	Festo	

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
560216	01	Parallel clamp	HGPT-40-A-B	Festo	
94.74	02	Relay base	94.74	Finder	
55.34.9.024.0040	02	General purpose relay	55.34.9.024.0040	Finder	
LD001-6	01	Led luminary	LD001-6	ILLUX	
GSK-100-1204	18	Test probe	GSK-100-1204	Ingun	
OP-87360	01	Ethernet cable	OP-87360	Keyence	
LR-ZB250CP	03	Laser sensor	LR-ZB250CP	Keyence	

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
PZ-M32	01	Photoelectric sensor	PZ-M32	Keyence	
SR-X100	01	Code reader	SR-X100	Keyence	
OP-87225	01	Control cable	OP-87225	Keyence	
LM16JC1MS	01	Camera lens	LM16JC1MS	Kowa	
MT5C3AL-3	01	Signal turret	MT5C3AL-3	Menics	
FX5UC-32MT/DSS	01	Programmable logic controller	FX5UC-32MT/DSS	Mitsubishi	
GS2107-WTBD-N	01	Human machine interface	GS2107-WTBD-N	Mitsubishi	


Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
EC06	01	Scara robot	EC06	Nachi	
CFDS-0000F	01	Robot controller	CFDS-0000F	Nachi	
FD19TP-FSJNE	01	Teach pendant	FD19TP-FSJNE	Nachi	
S8VK-C24024	01	Power supply	S8VK-C24024	Omron	
FZ-VS3 10M	01	Camera cable	FZ-VS3 10M	Omron	
NX1P2-9024DT	01	Programmable logic controller	NX1P2-9024DT	Omron	
FH-L550	01	Vision system controller	FH-L550	Omron	

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
FH-SM05R	01	Camera	FH-SM05R	Omron	
70114053	02	Ethernet switch	ICRL2-U-8RJ45-DIN	Pepperl+Fuchs	
313335	01	I/O Hub	ICA-16DI-G60A-IO	Pepperl+Fuchs	
300755	01	Female cordset	V15L-G-5M-PUR-U	Pepperl+Fuchs	
221645	08	Distributor Y	V1S-T-V3	Pepperl+Fuchs	
70108832	01	IO-Link master (PNIO/MOD)	ICE3-8IOL-K45P-RJ45	Pepperl+fuchs	
3036026	05	Double-deck ground terminal	STTB 2,5-PE	Phoenix Contact	

Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
3004100	10	Fuse Terminal	UK5-HESI	Phoenix Contact	
3210567	25	Double deck terminal	PTTB 2.5	Phoenix Contact	
AC30-N03CG-Z-A	01	Maintenance unit	AC30-N03CG-Z-A	SMC	
FEUR 1	10	European type fuse	FEUR 1	Steren	
905-120	01	Polarized contact	905-120	Steren	
VNG-117M	01	Metal fan of 6”	VNG-117M	Steren	
360-070	01	EtherNet port	360-070	Steren	


Sum list of items

Order Number	Amount	Designation	Type Number	Marker	Image
I08H005	01	Inductive Sensor	I08H005	Wenglor	


WATCH OUT!



When disconnecting the main switch there is still voltage

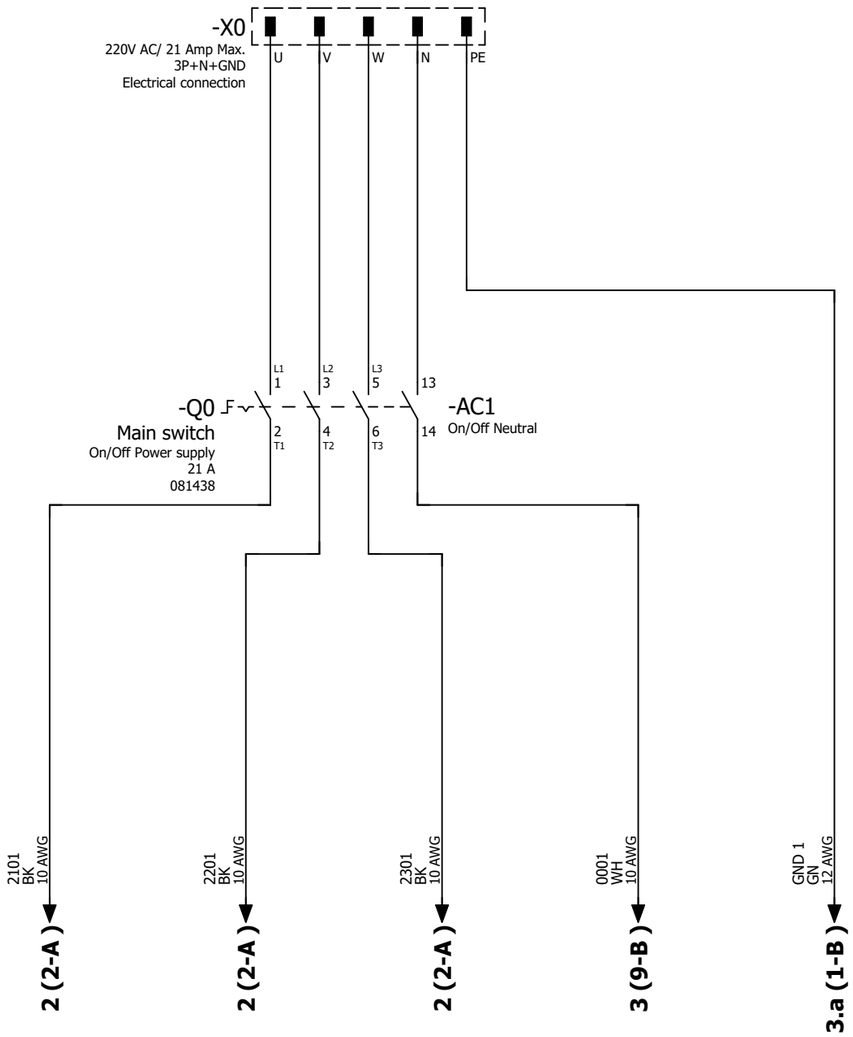


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name		Facility 220VCA
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Main supply power cabinet		Mounting location GC
		Revision	0	Station name			Sheet 1
		Responsible	EPLAN	ST 60			Page 22 / 83

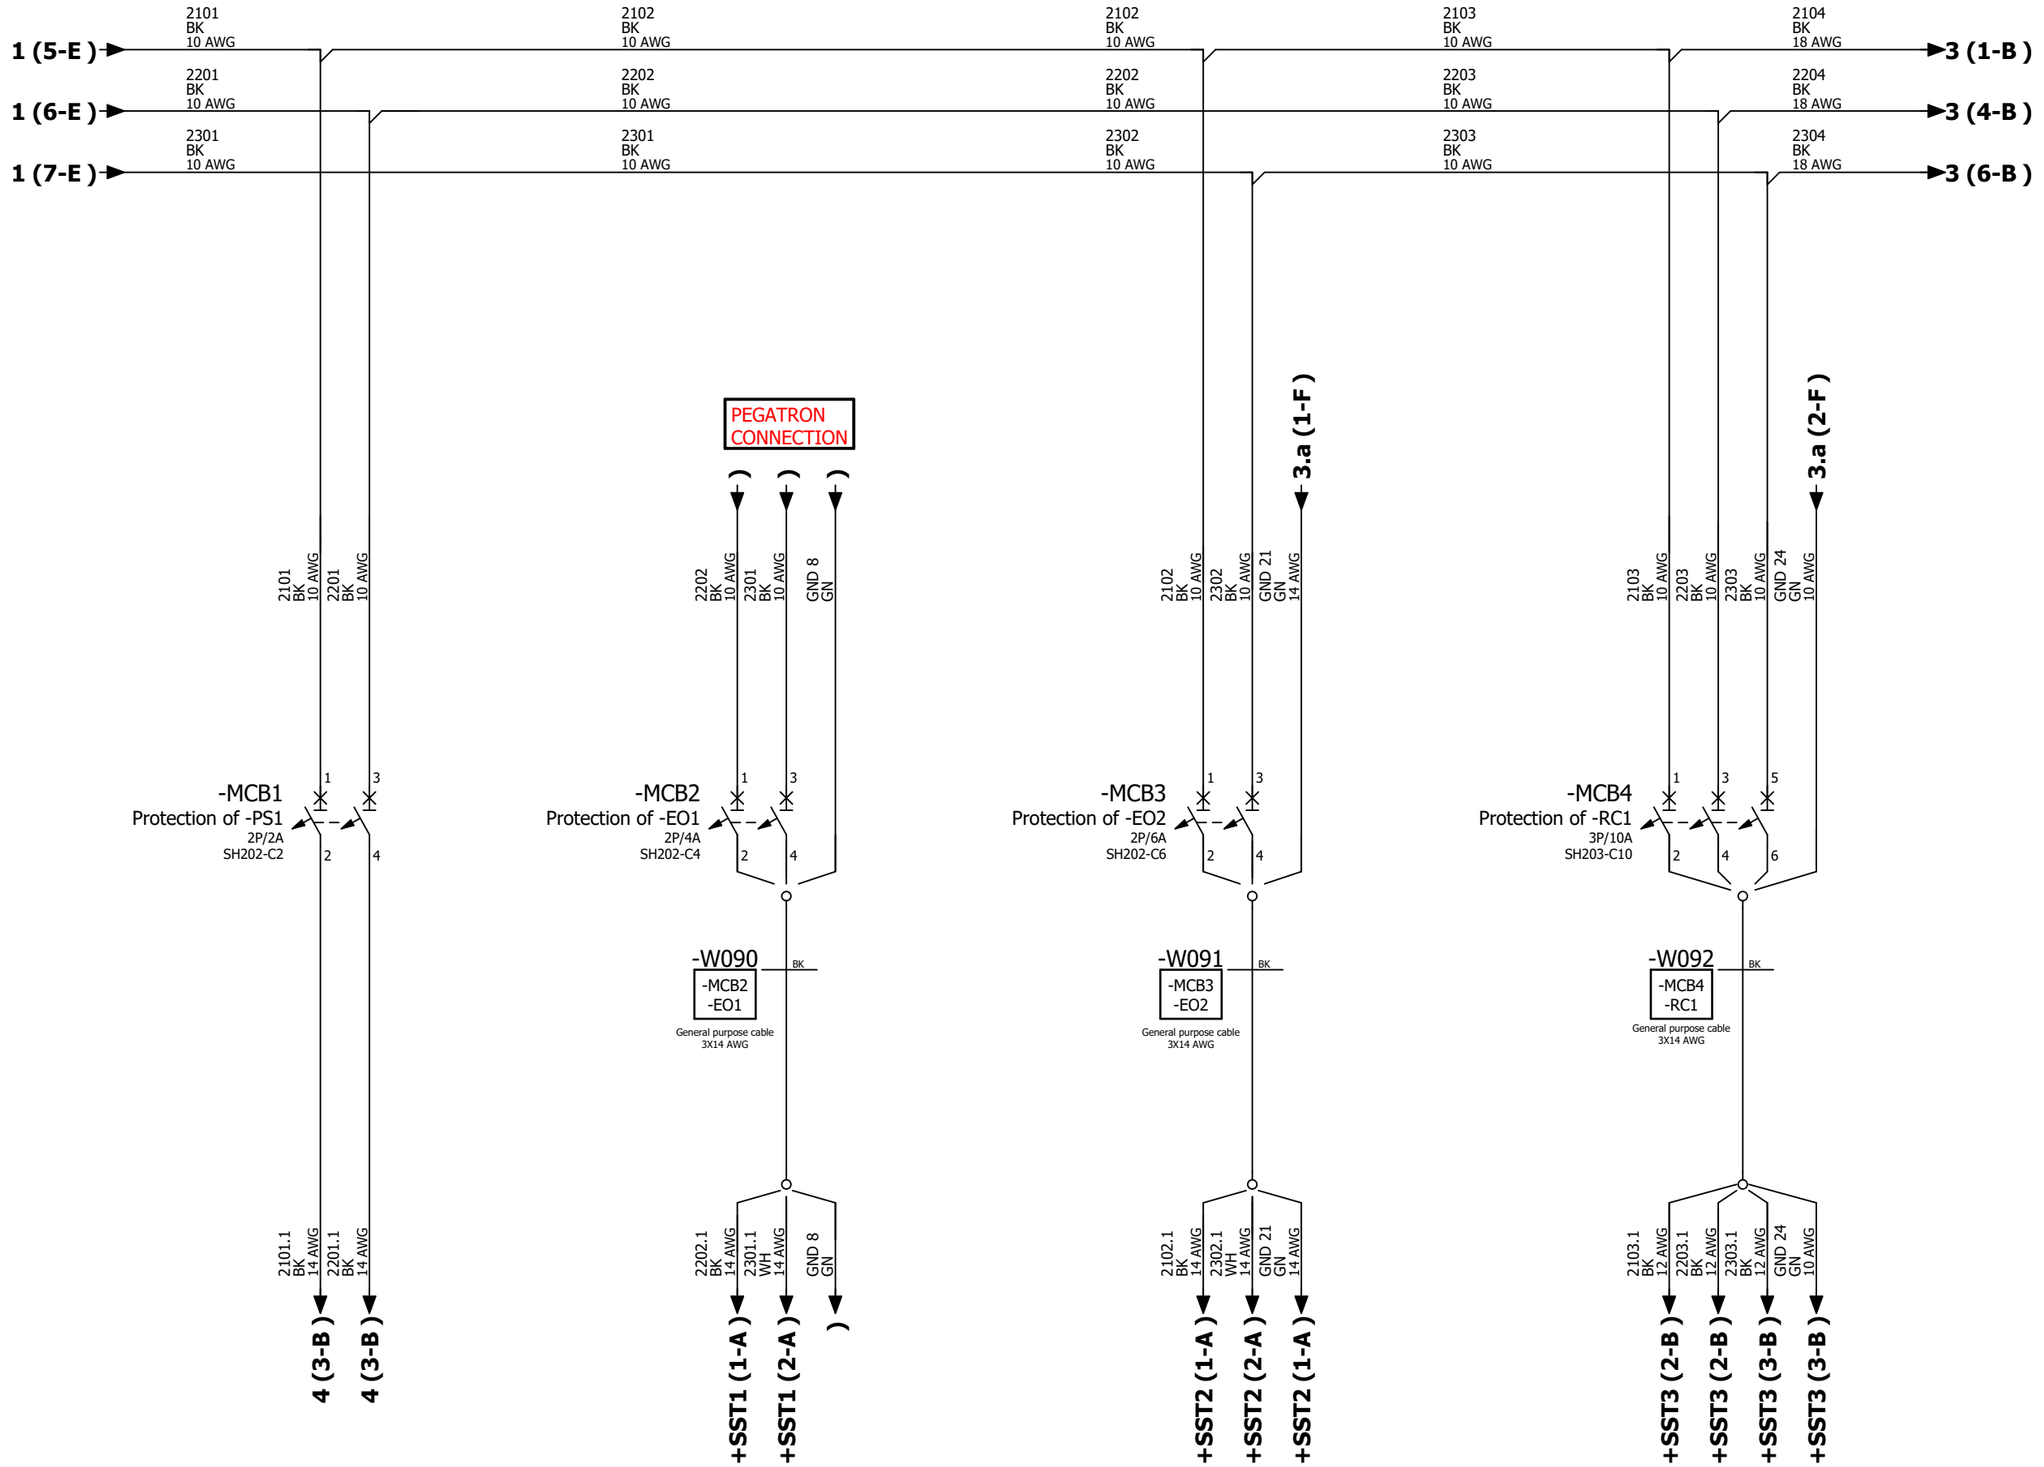


Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.


O.P. 973	Created	08/12/2025	Project's name: NV9X CP
Client: Pegatron	Modified	19/05/2026	Station name: ST 60
PEGATRON	Revision	0	Page name: 220 VAC Miniature circuit breakers connections
	Responsible	EPLAN	

Facility	220VCA
Mounting location	GC
Sheet	2
Page	23 / 83

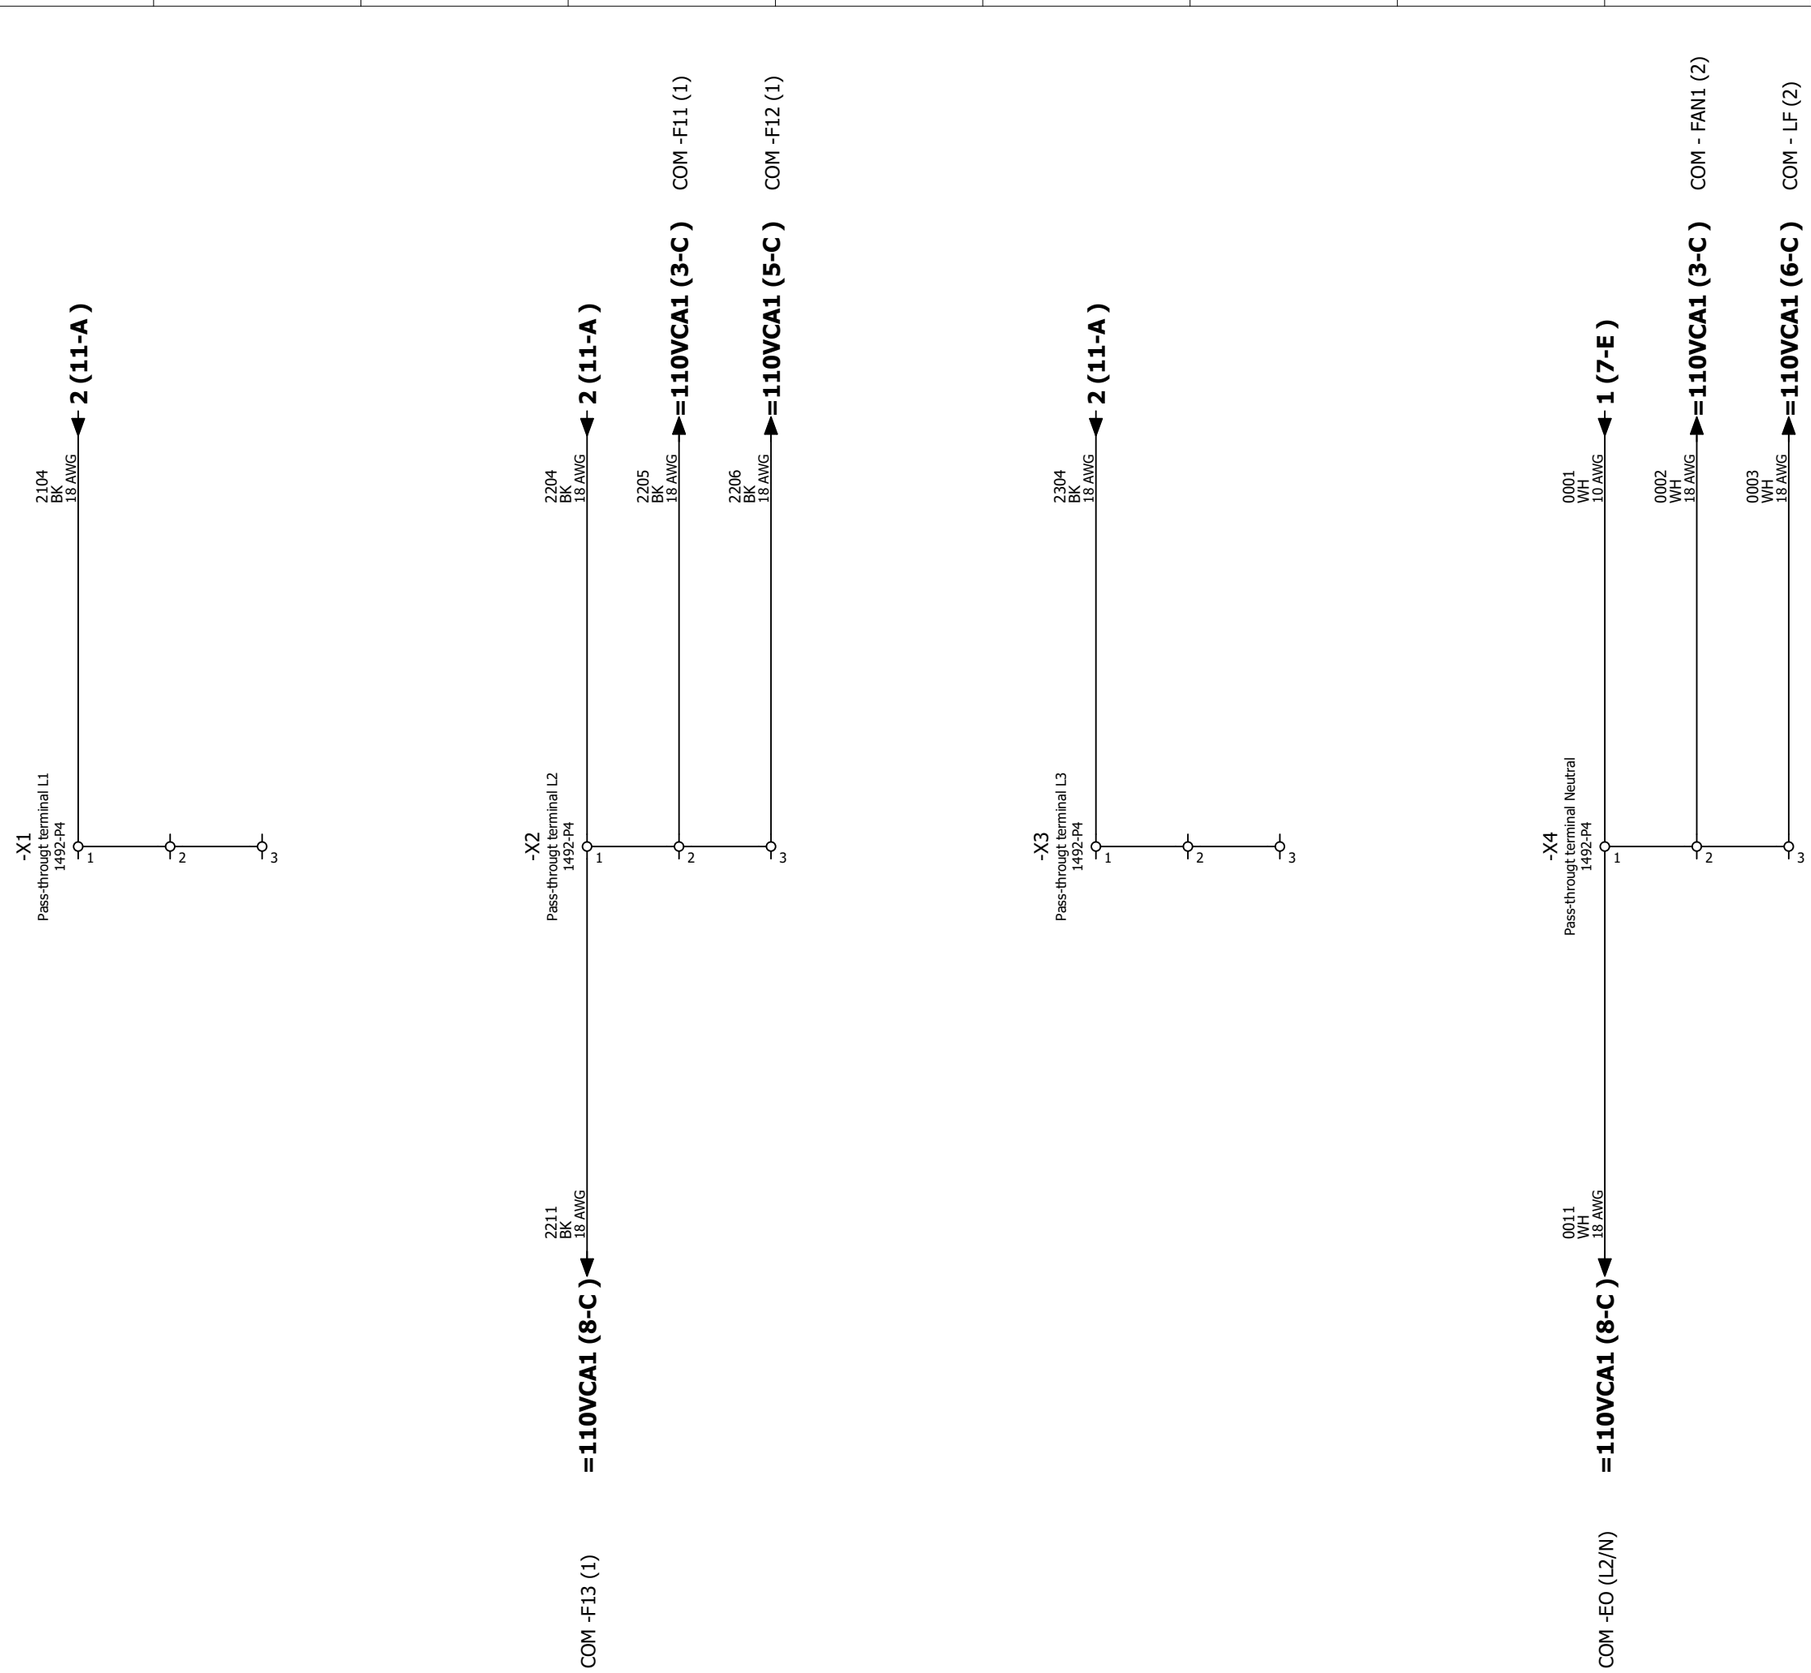

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 220VCA
		Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Terminal connections	Mounting location GC
			Revision	0	Station name		Sheet 3
			Responsible	EPLAN	ST 60		Page 24 / 83

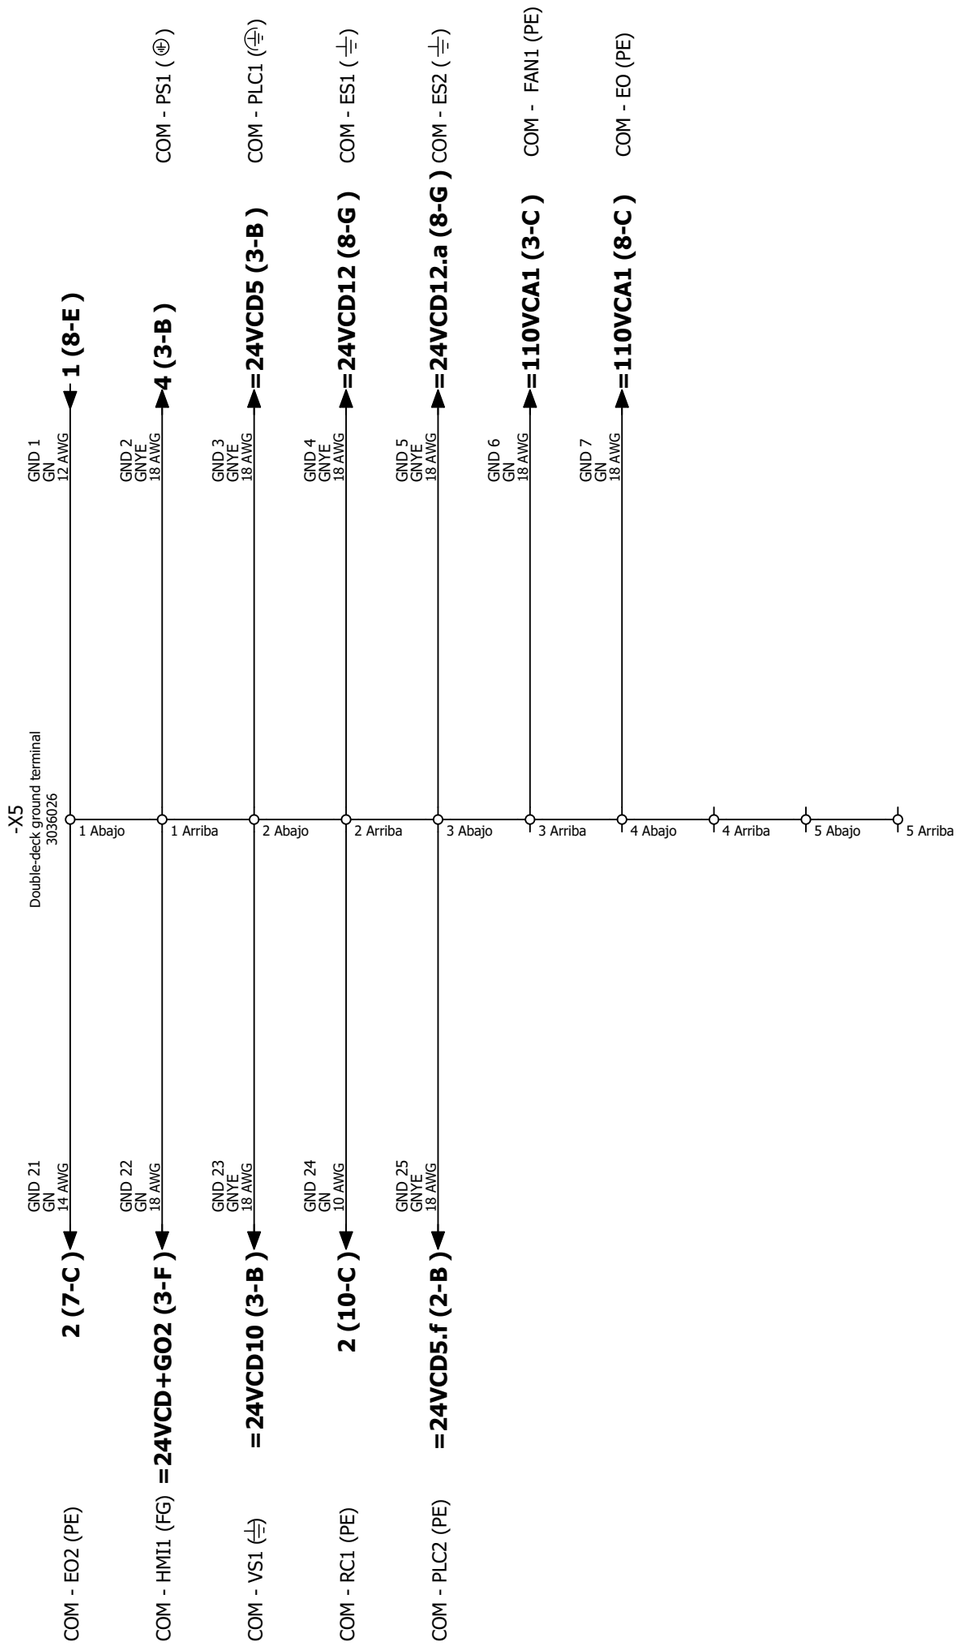
-X5
Double-deck ground terminal
3036026
1 Abajo
1 Arriba
2 Abajo
2 Arriba
3 Abajo
3 Arriba
4 Abajo
4 Arriba
5 Abajo
5 Arriba
GND 1
GN
12 AWG
1 (8-E)
COM - PS1 ( )
GND 2
GNYE
18 AWG
4 (3-B)
COM - PLC1 ( )
GND 3
GNYE
18 AWG
=24VCD5 (3-B)
COM - ES1 ( )
GND 4
GNYE
18 AWG
=24VCD12 (8-G)
COM - ES2 ( )
GND 5
GNYE
18 AWG
=24VCD12.a (8-G)
COM - FAN1 (PE)
GND 6
GN
18 AWG
=110VCA1 (3-C)
COM - EO (PE)
GND 7
GN
18 AWG
=110VCA1 (8-C)
GND 21
GN
14 AWG
2 (7-C)
COM - EO2 (PE)
GND 22
GN
18 AWG
=24VCD+GO2 (3-F)
COM - HMI1 (FG)
GND 23
GNYE
18 AWG
=24VCD10 (3-B)
COM - VS1 ( )
GND 24
GN
10 AWG
2 (10-C)
COM - RC1 (PE)
GND 25
GNYE
18 AWG
=24VCD5.f (2-B)
COM - PLC2 (PE)

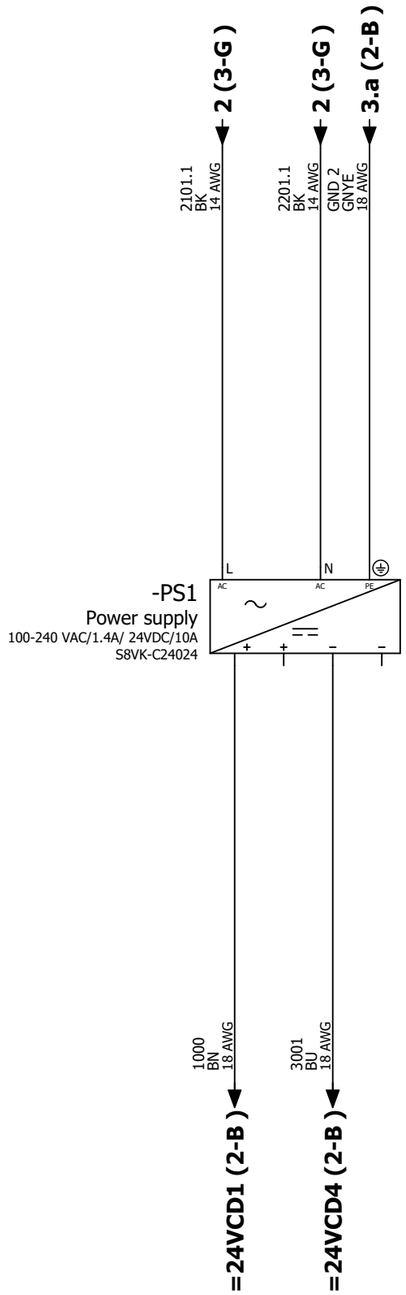


Automatización,
Mantenimiento y Construcción
Condominio Industrial Siglo 21,
Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	08/12/2025	Project's name
Client: Pegatron	Modified	28/03/2026	NV9X CP
	Revision	0	Station name
	Responsible	EPLAN	ST 60


Page name: Power supply connections

Facility	220VCA
Mounting location	GC
Sheet	4
Page	26 / 83

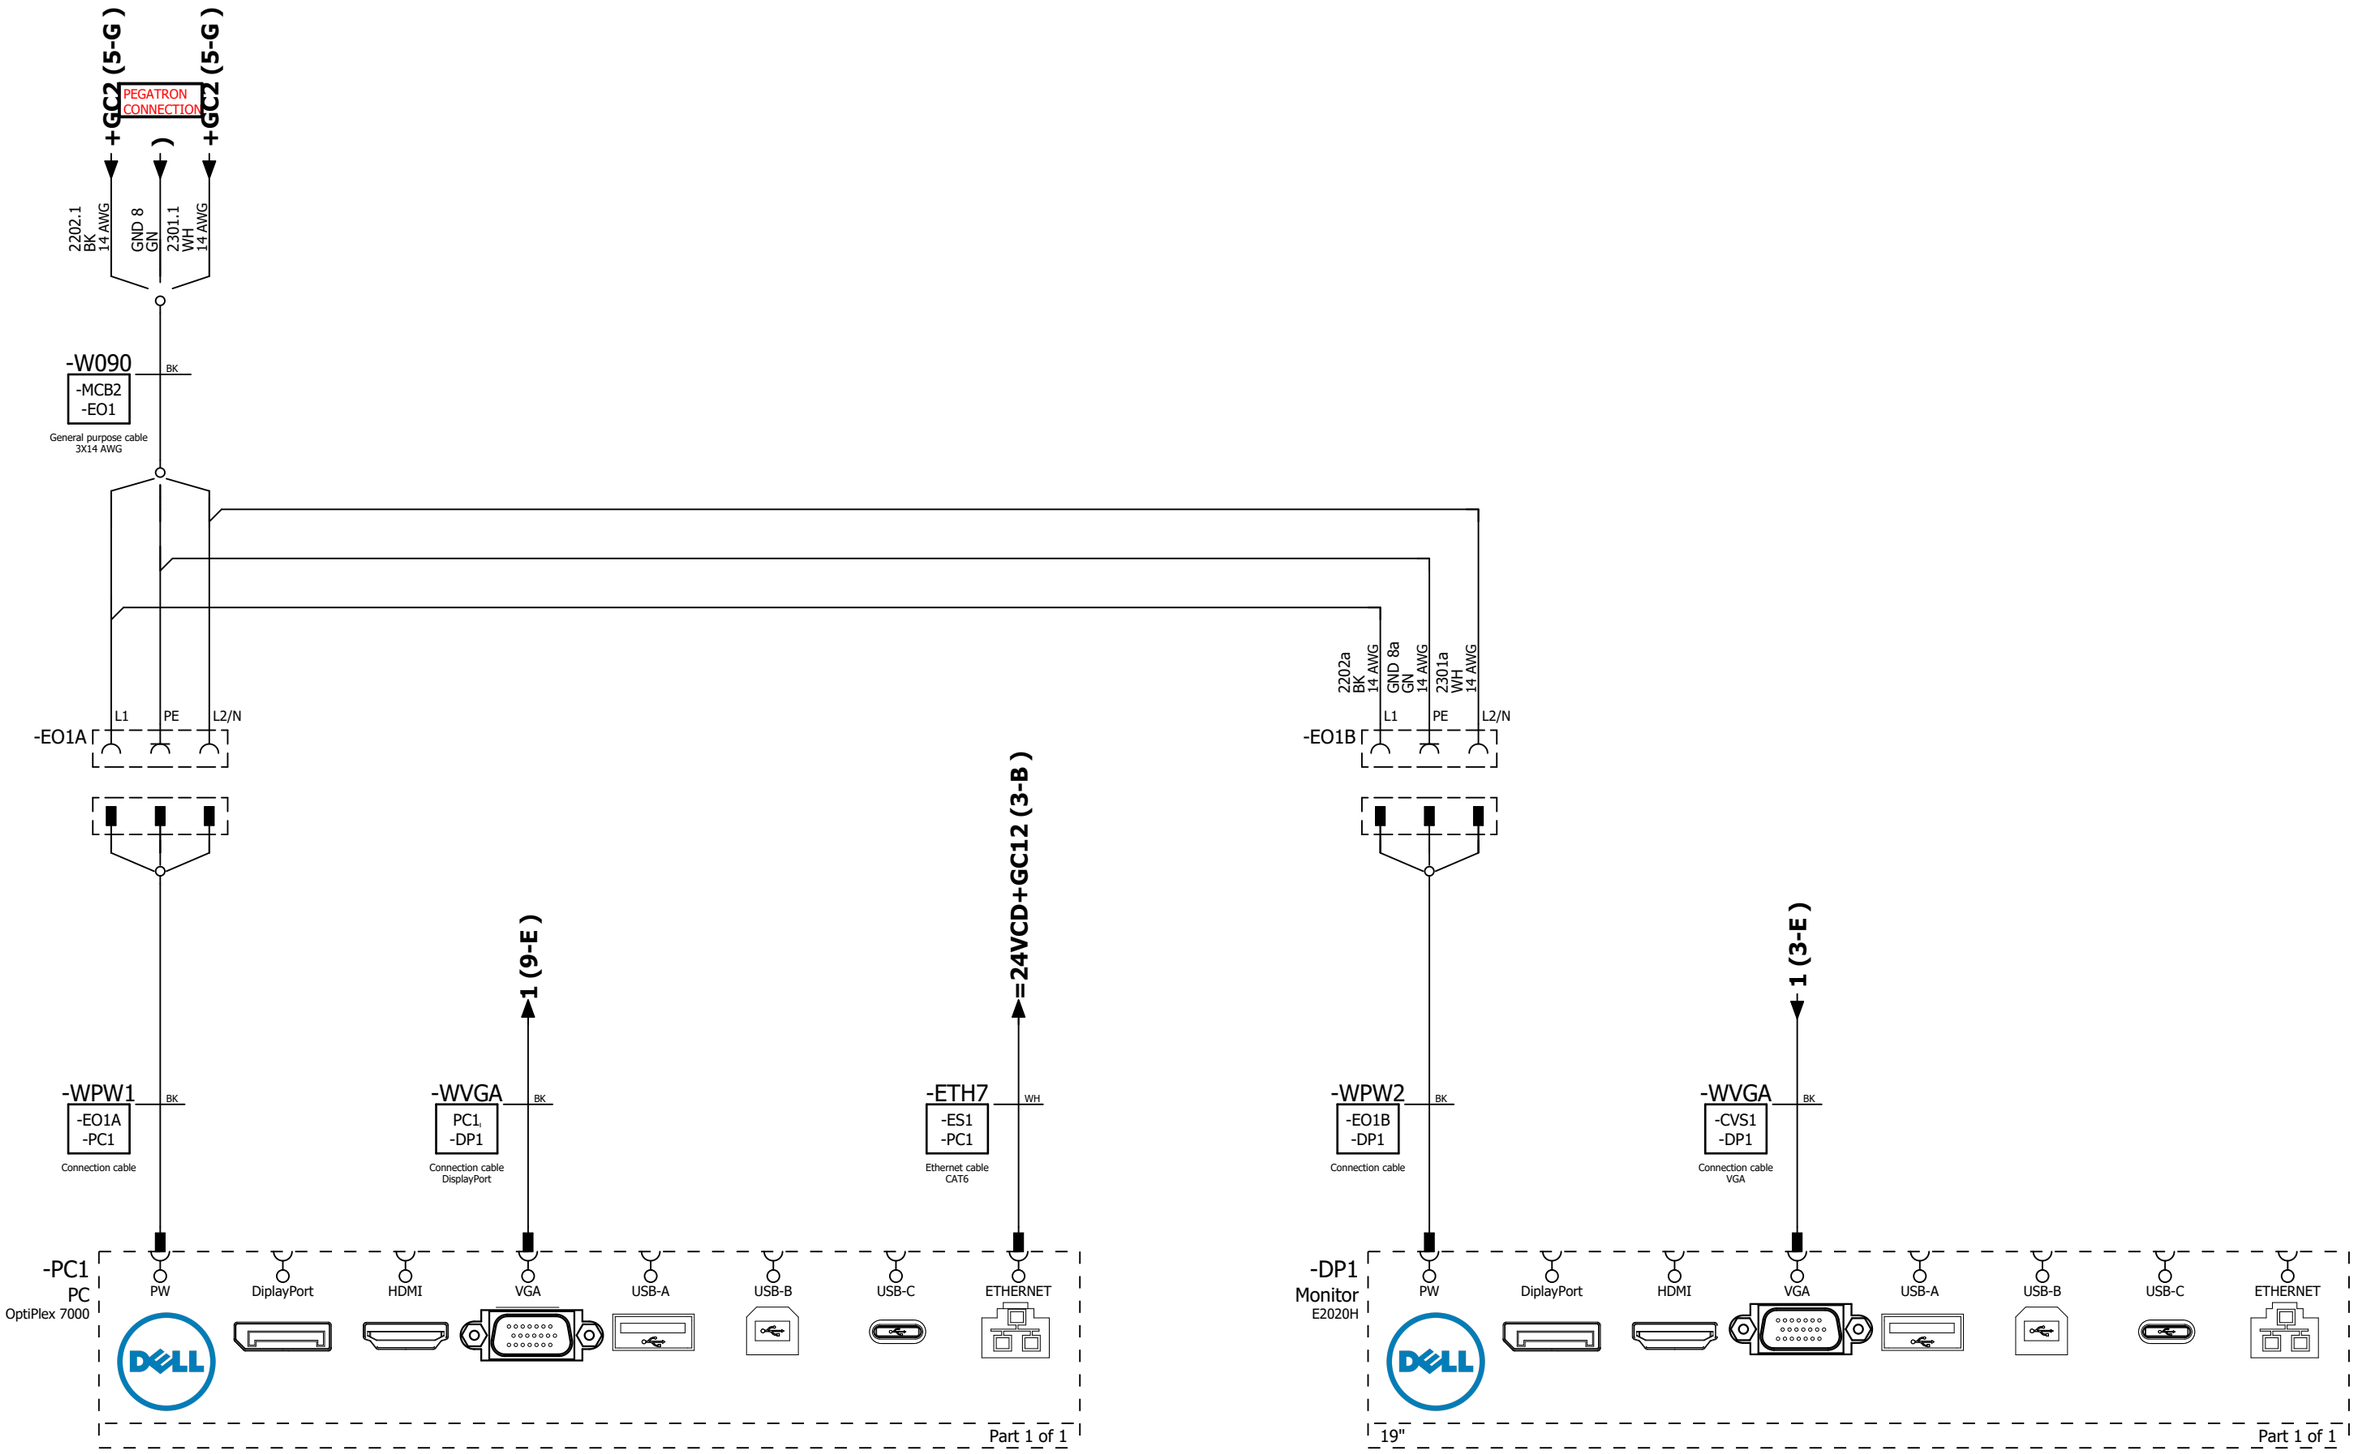



Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name
	Client: Pegatron PEGATRON	Modified	28/03/2026	NV9X CP	CPU and monitor connections
		Revision	0	Station name	
		Responsible	EPLAN	ST 60	

Facility	220VCA
Mounting location	SST
Sheet	1
Page	27 / 83

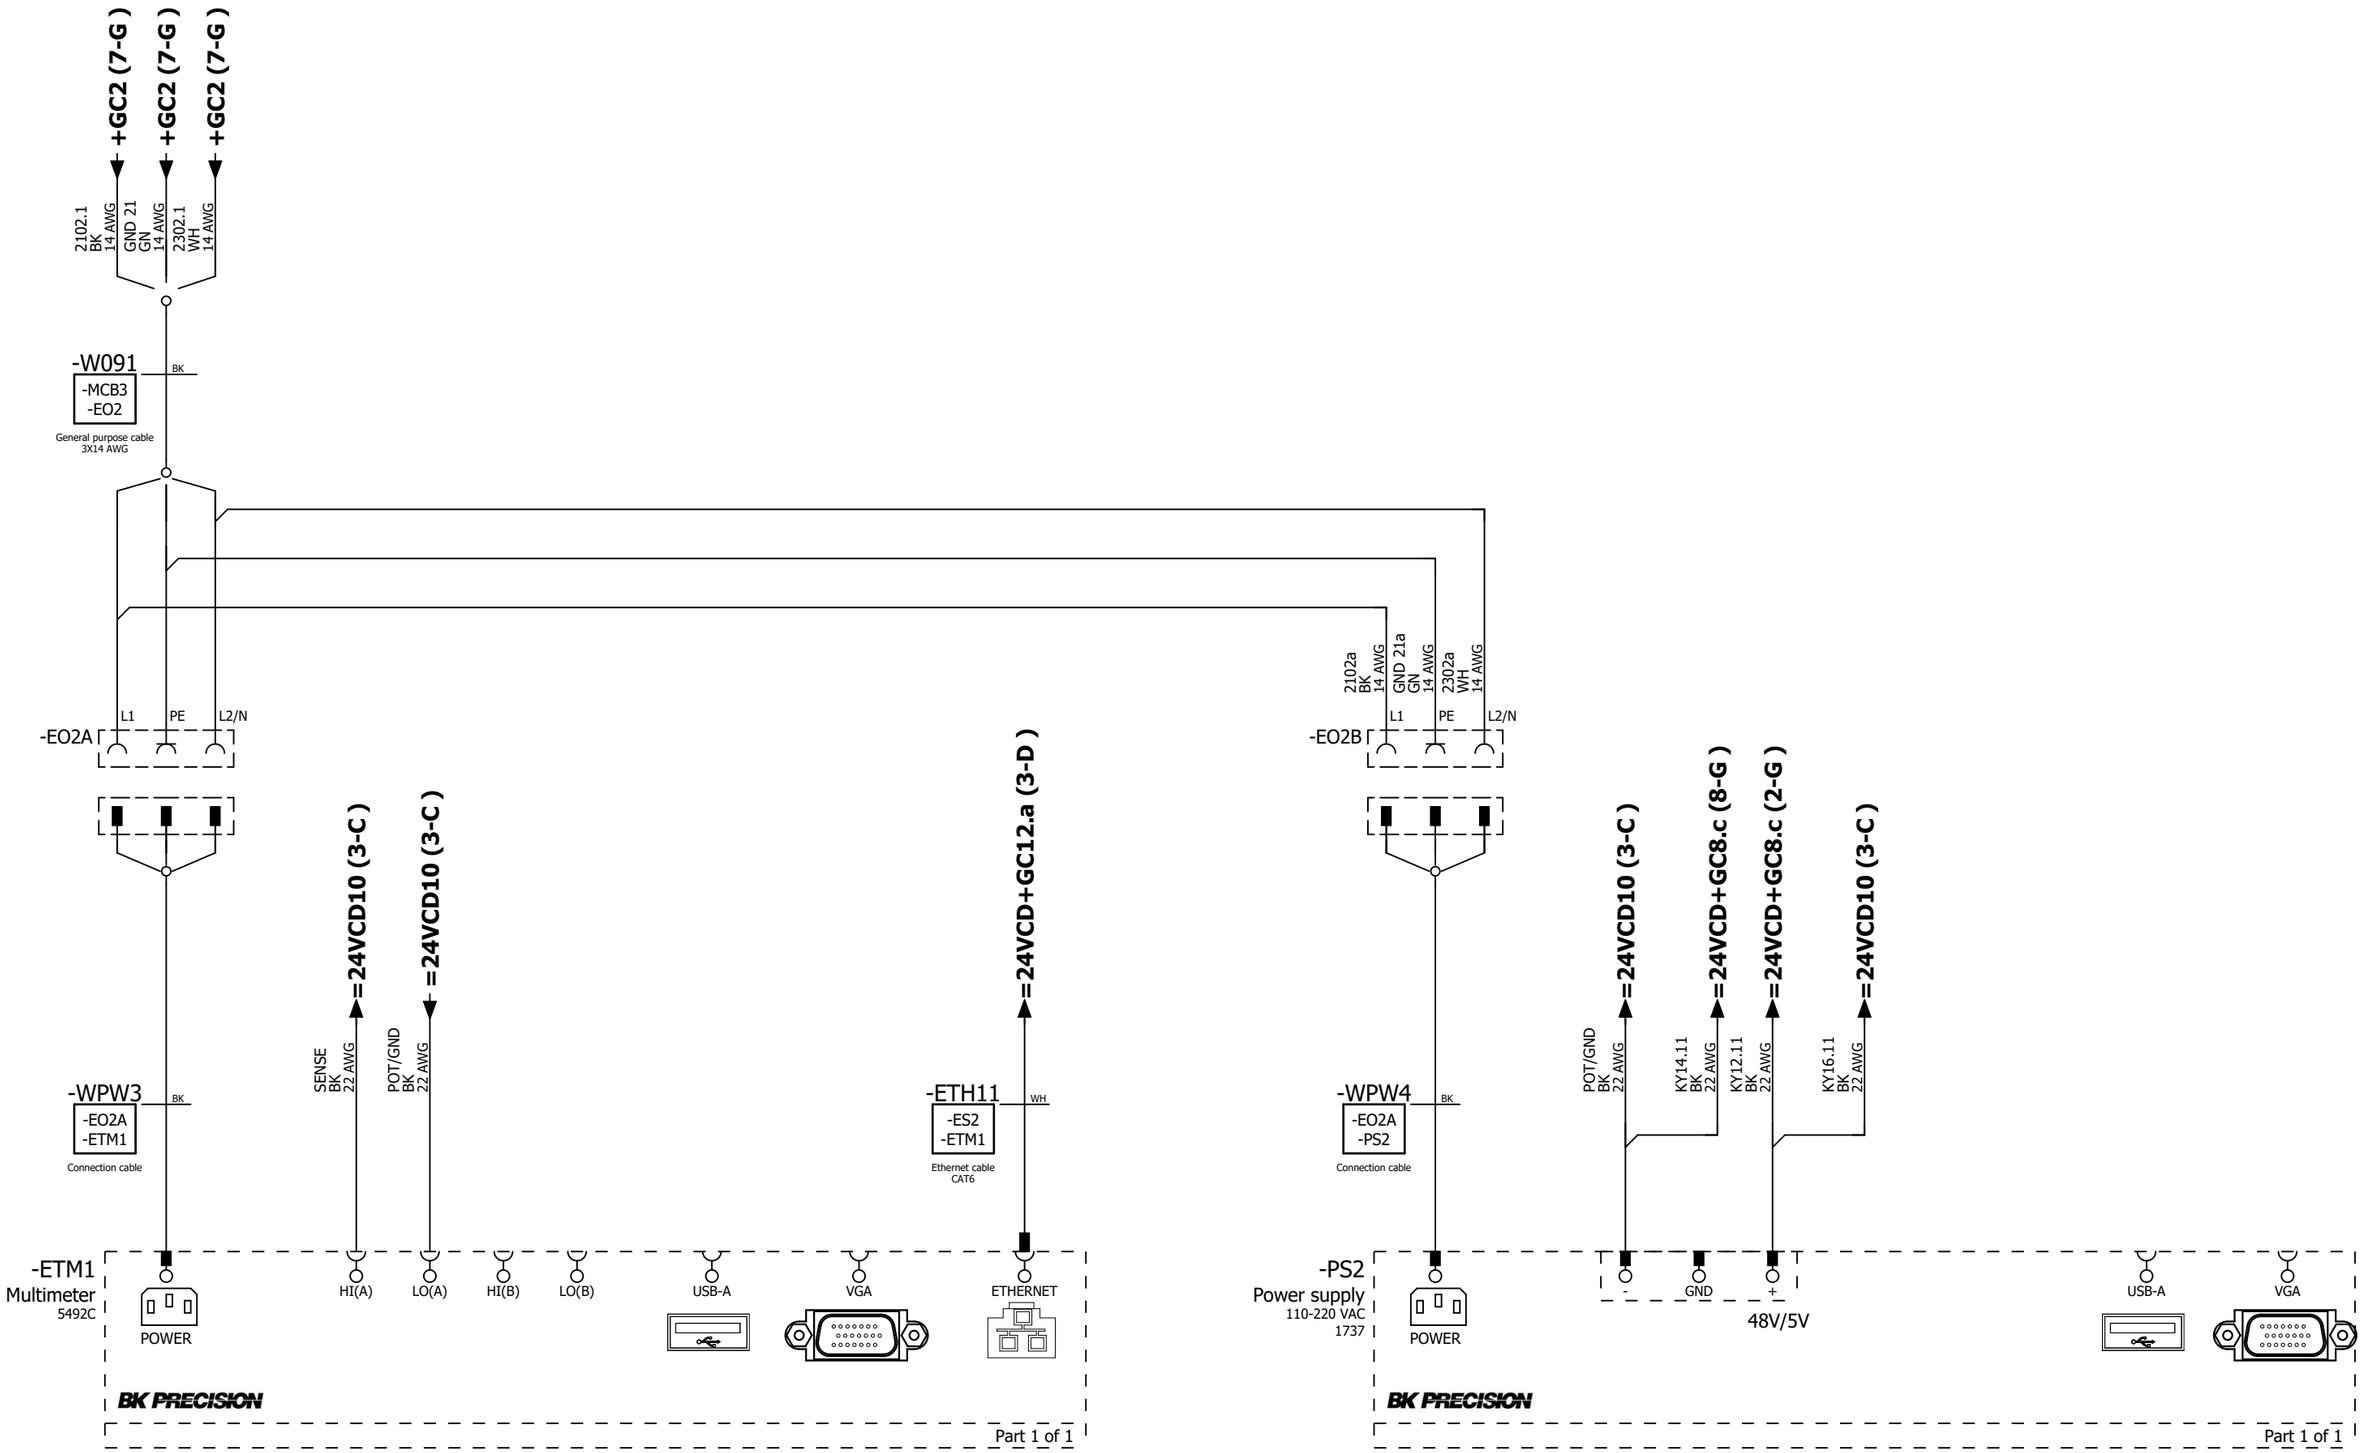


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 220VCA
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	220 Outlet connections	Mounting location SST
		Revision	0	Station name		Sheet 2
		Responsible	EPLAN	ST 60		Page 28 / 83

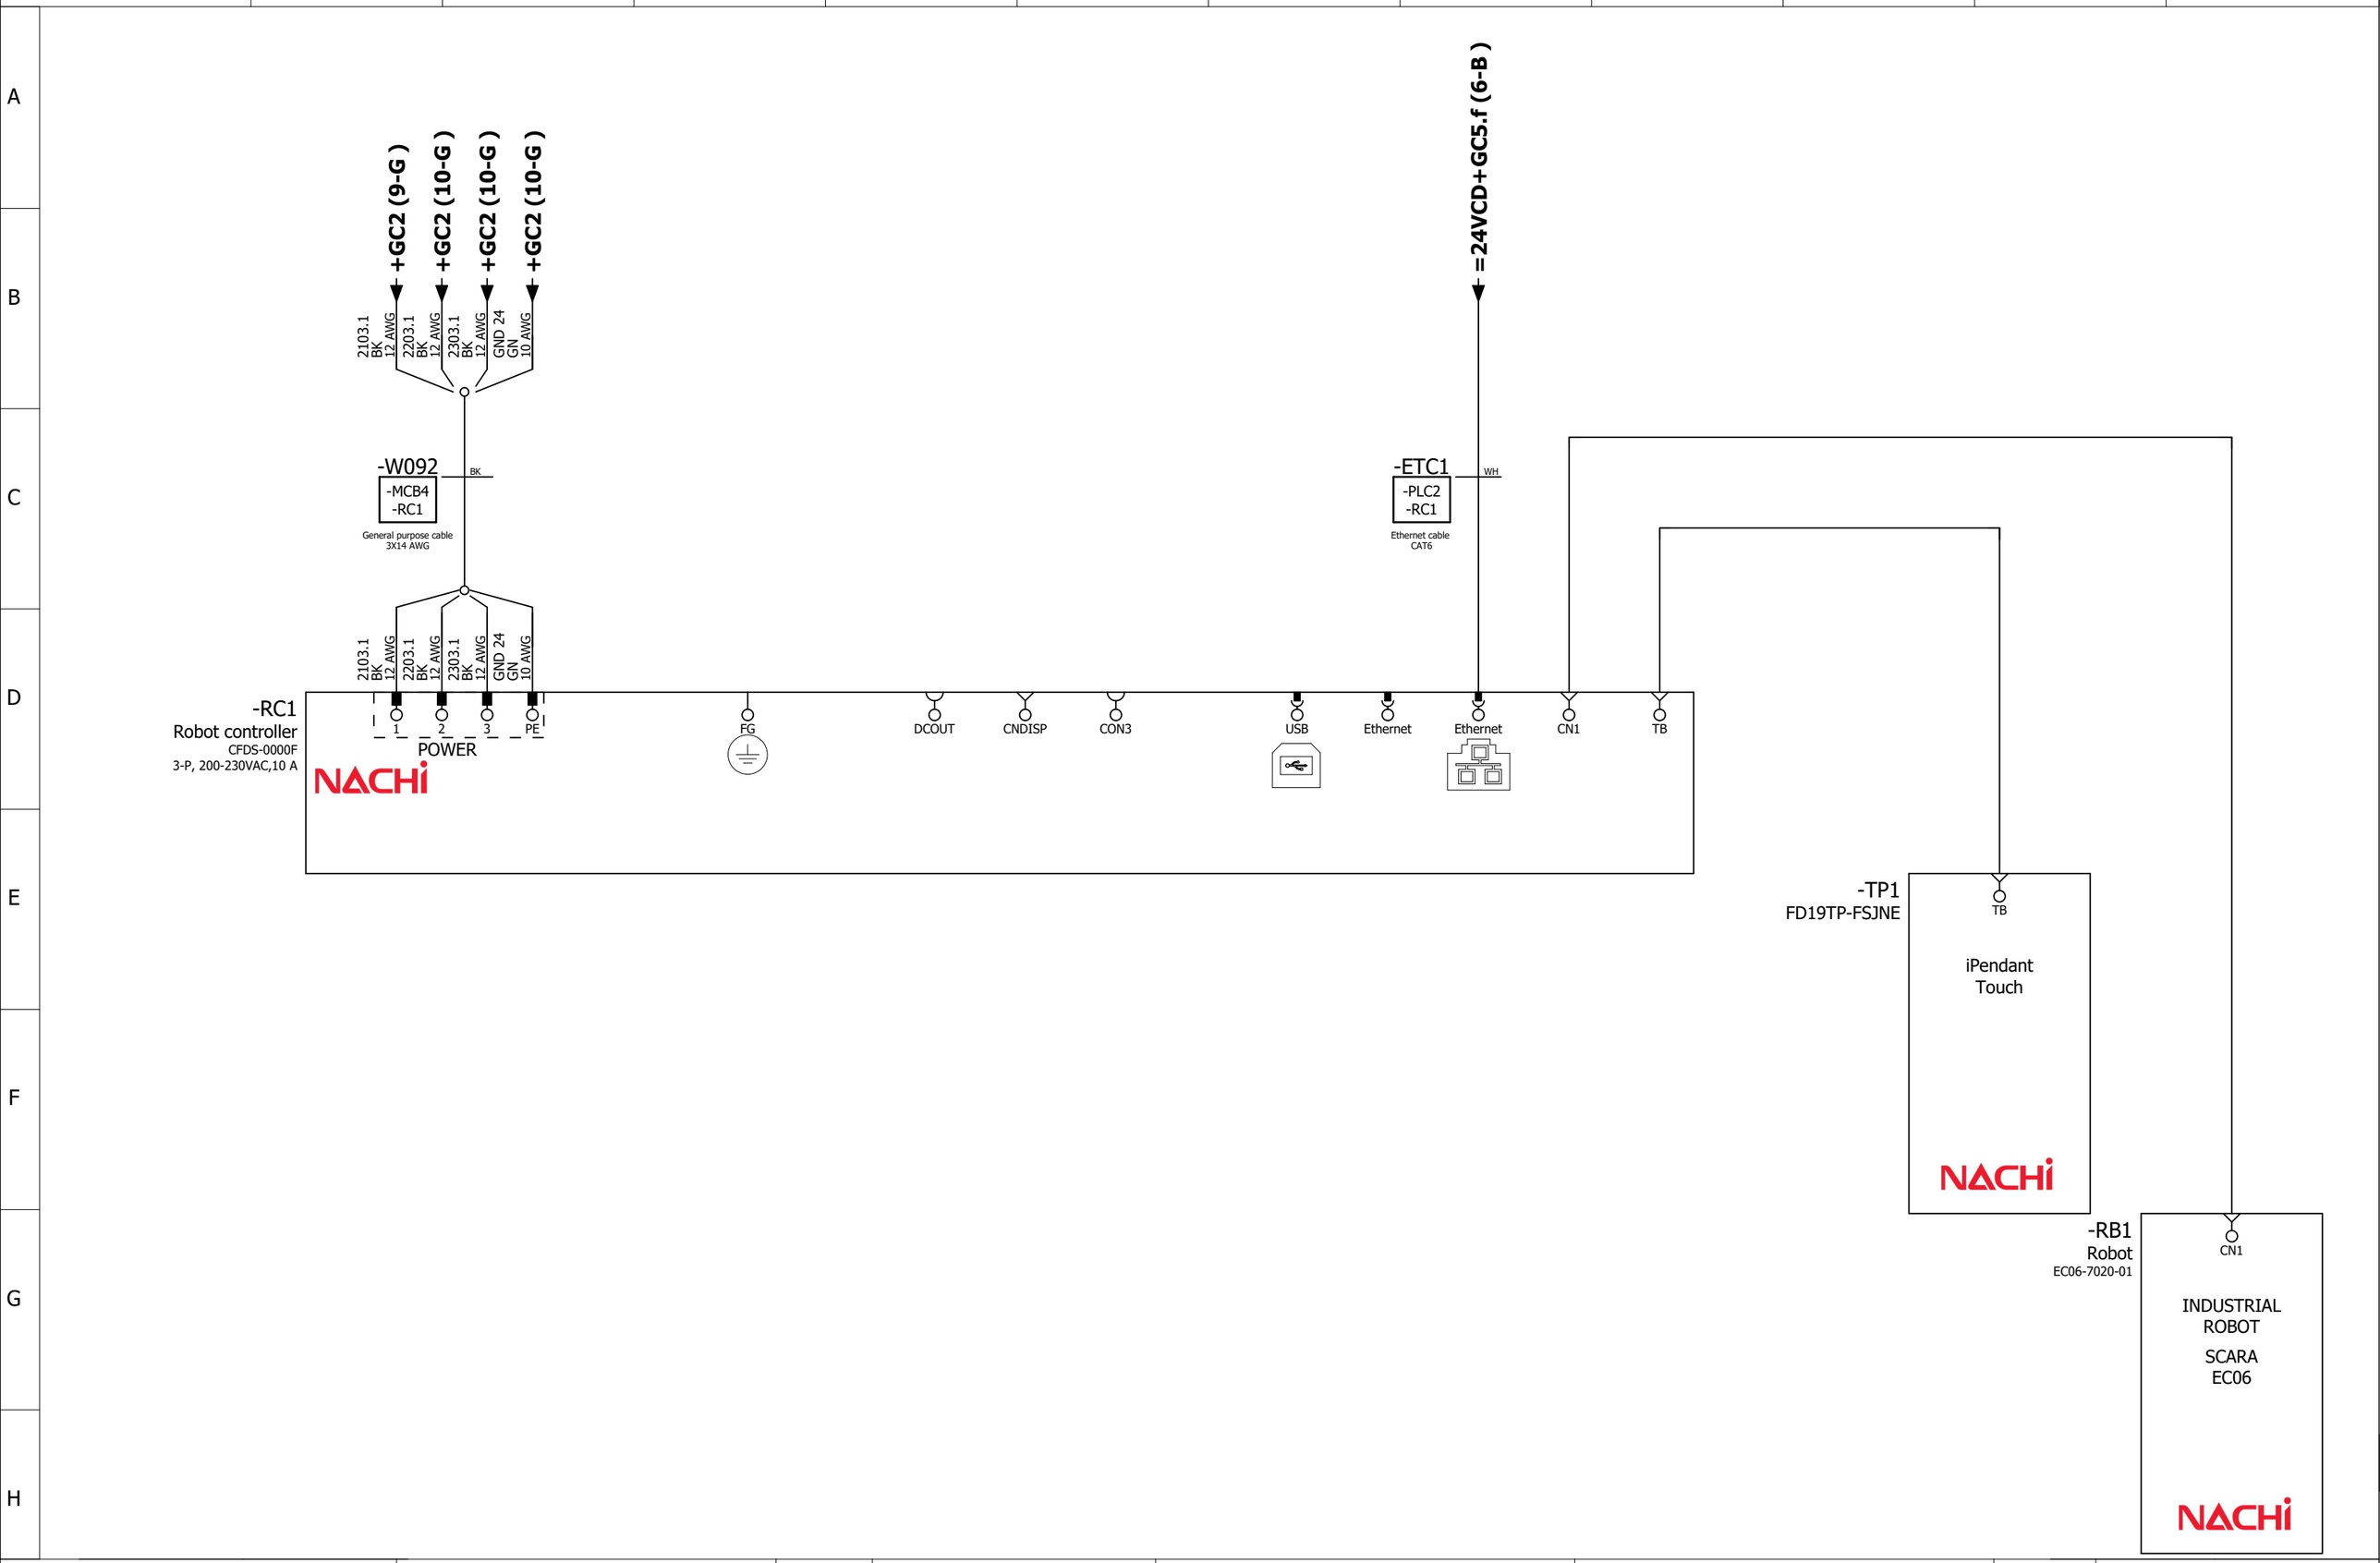

+GC2 (9-G)
+GC2 (10-G)
+GC2 (10-G)
+GC2 (10-G)
=24VCD+GC5.f (6-B)
2103.1 BK 12 AWG
2203.1 BK 12 AWG
2303.1 BK 12 AWG
GND 24 GN 10 AWG
-W092
BK
-MCB4
-RC1
General purpose cable
3X14 AWG
-ETC1
WH
-PLC2
-RC1
Ethernet cable
CAT6
-RC1
Robot controller
CFDS-0000F
3-P, 200-230VAC,10 A
POWER
1
2
3
PE
FG
DCOUT
CNDISP
CON3
USB
Ethernet
Ethernet
CN1
TB
-TP1
FD19TP-FSJNE
TB
iPendant
Touch
-RB1
Robot
EC06-7020-01
CN1
INDUSTRIAL
ROBOT
SCARA
EC06

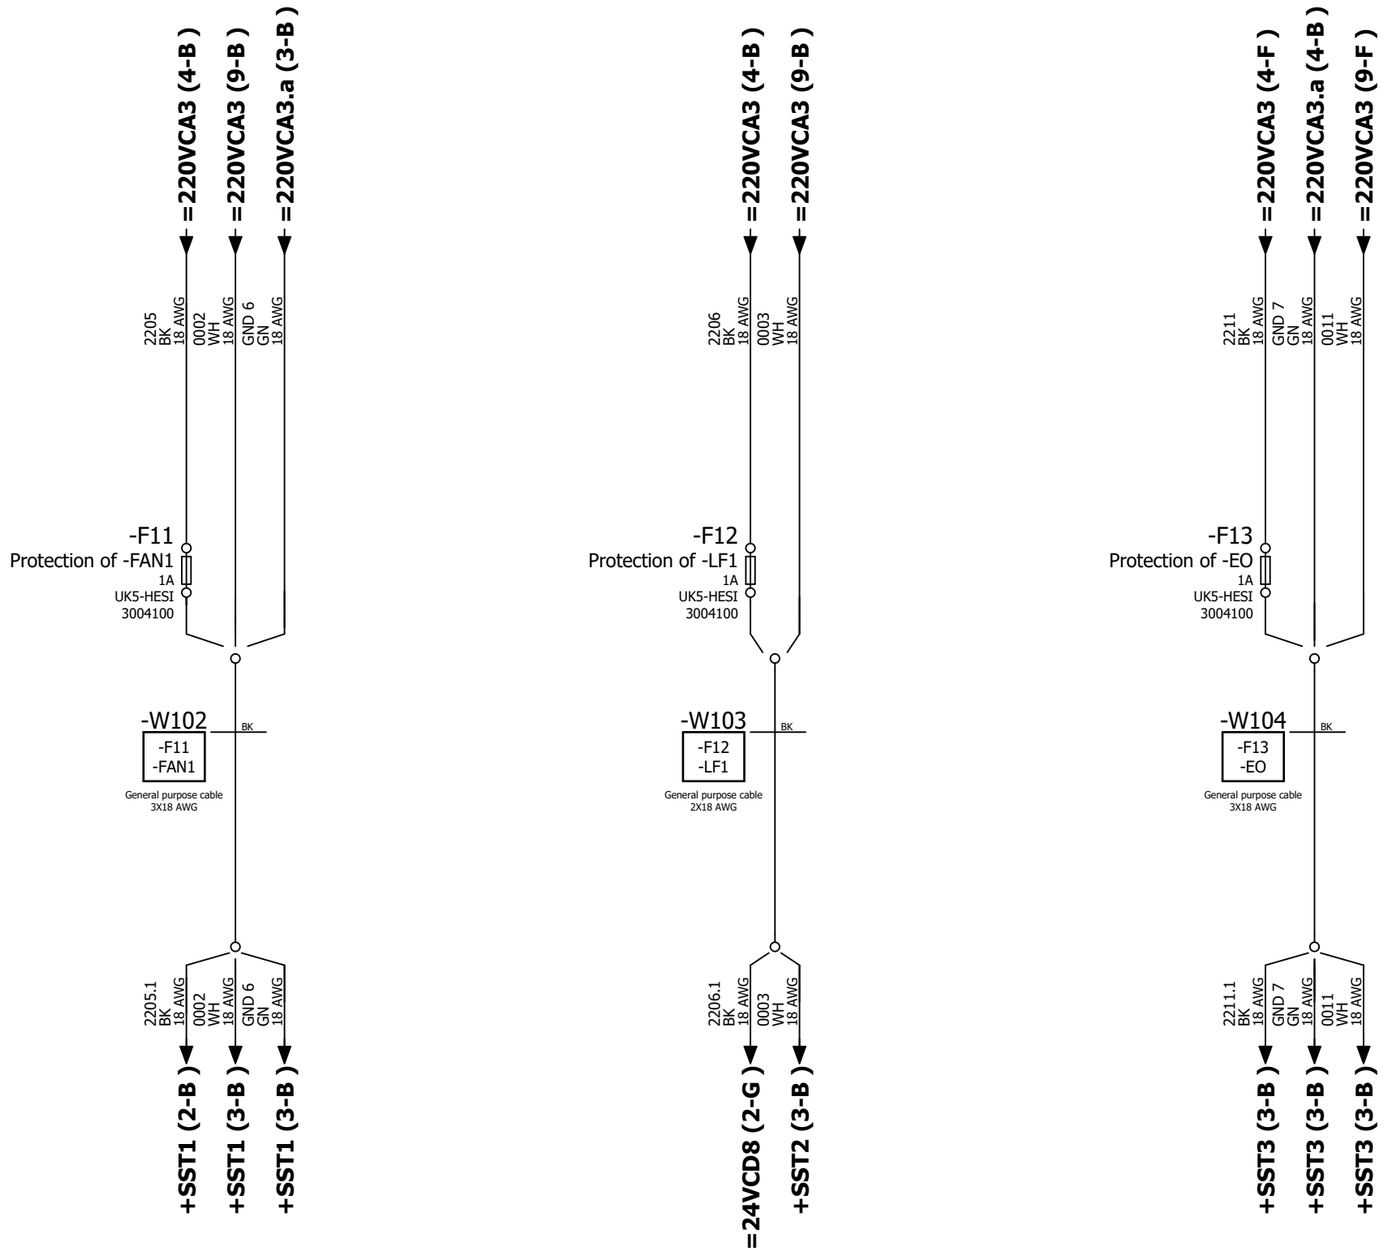


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 110VCA
		Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	110 VAC Fuses connections	Mounting location GC
			Revision	0	Station name		Sheet 1
			Responsible	EPLAN	ST 60		Page 30 / 83

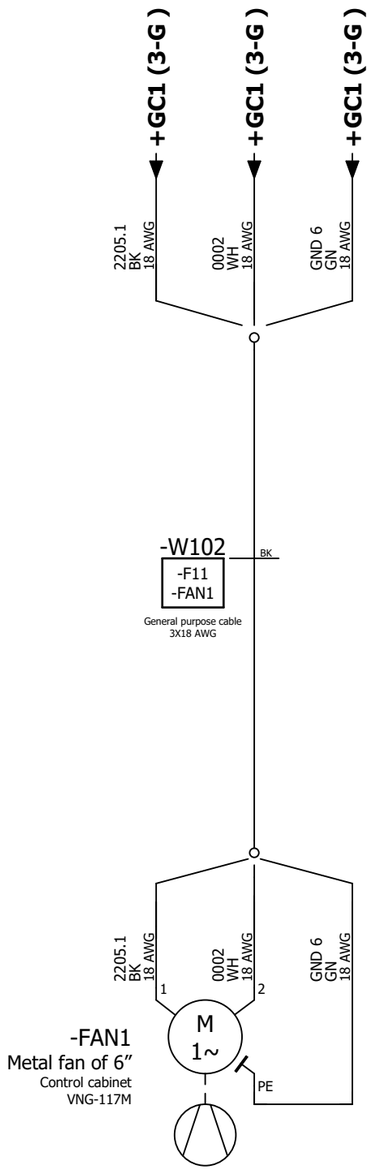


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project’s name	Page name	Facility 110VCA
		Client: Pegatron PEGATRON	Modified	16/02/2026	NV9X CP	110 VAC Fan connections	Mounting location SST
			Revision	0	Station name		Sheet 1
			Responsible	EPLAN	ST 60		Page 31 / 83

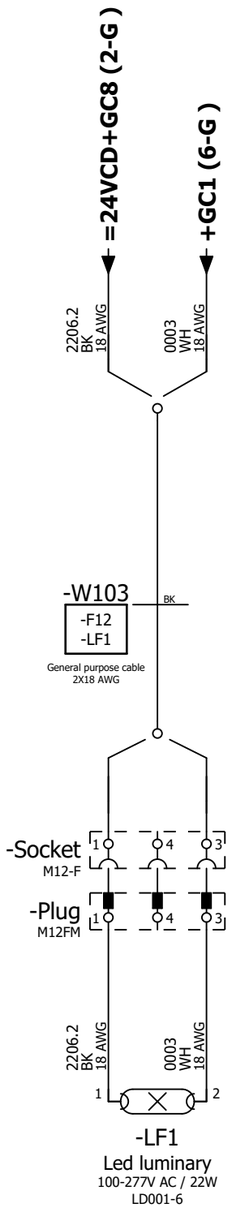


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 110VCA
		Client: Pegatron PEGATRON	Modified	16/02/2026	NV9X CP	Station luminary connections	Mounting location SST
			Revision	0	Station name		Sheet 2
			Responsible	EPLAN	ST 60		Page 32 / 83

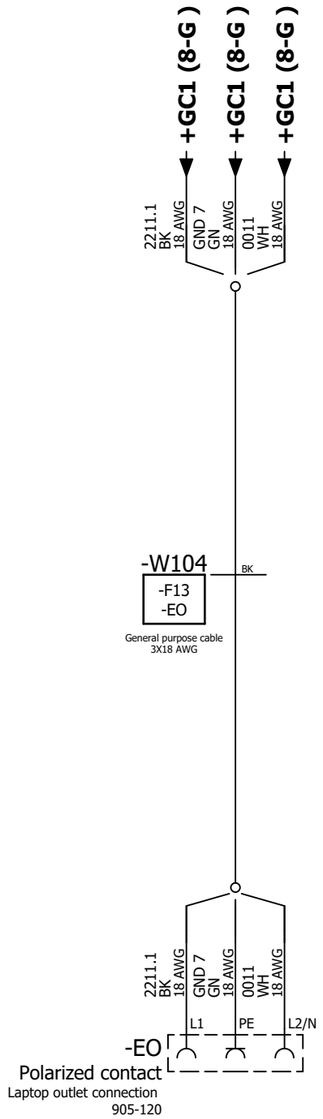


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 110VCA
		Client: Pegatron PEGATRON	Modified	10/12/2025	NV9X CP	110 VAC Outlet connections	Mounting location SST
			Revision	0	Station name		Sheet 3
			Responsible	EPLAN	ST 60		Page 33 / 83

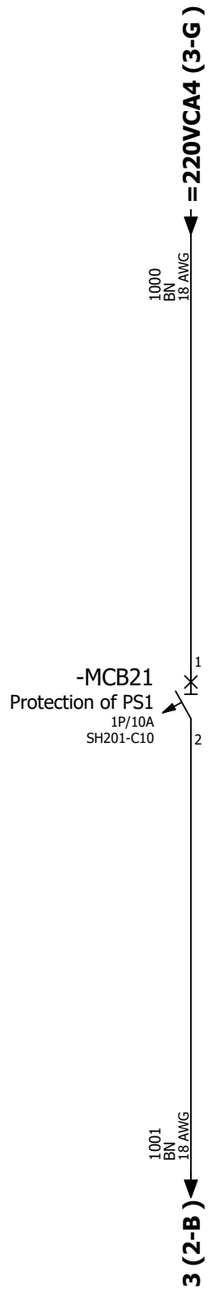


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name		Facility 24VCD
	Client: Pegatron PEGATRON	Modified	16/02/2026	NV9X CP	24 VDC Miniature circuit breakers connections		Mounting location GC
		Revision	0	Station name			Sheet 1
		Responsible	EPLAN	ST 60			Page 34 / 83

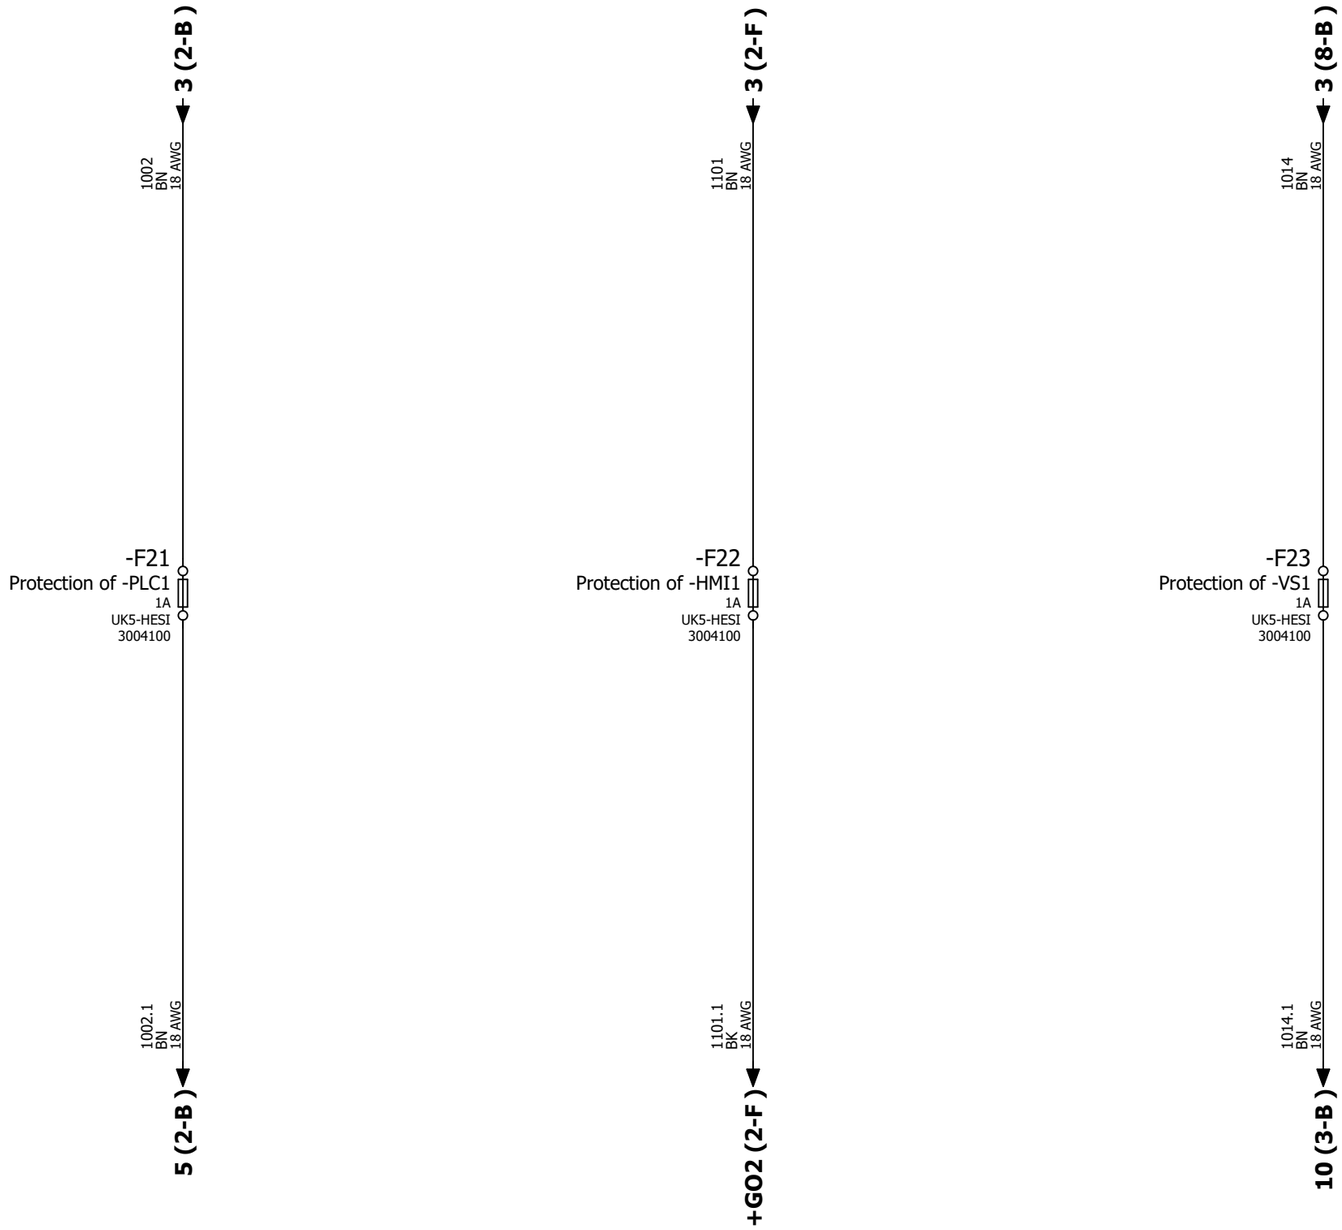



Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	24 VDCFuses connections	Mounting location GC
			Revision	0	Station name		Sheet 2
			Responsible	EPLAN	ST 60		Page 35 / 83

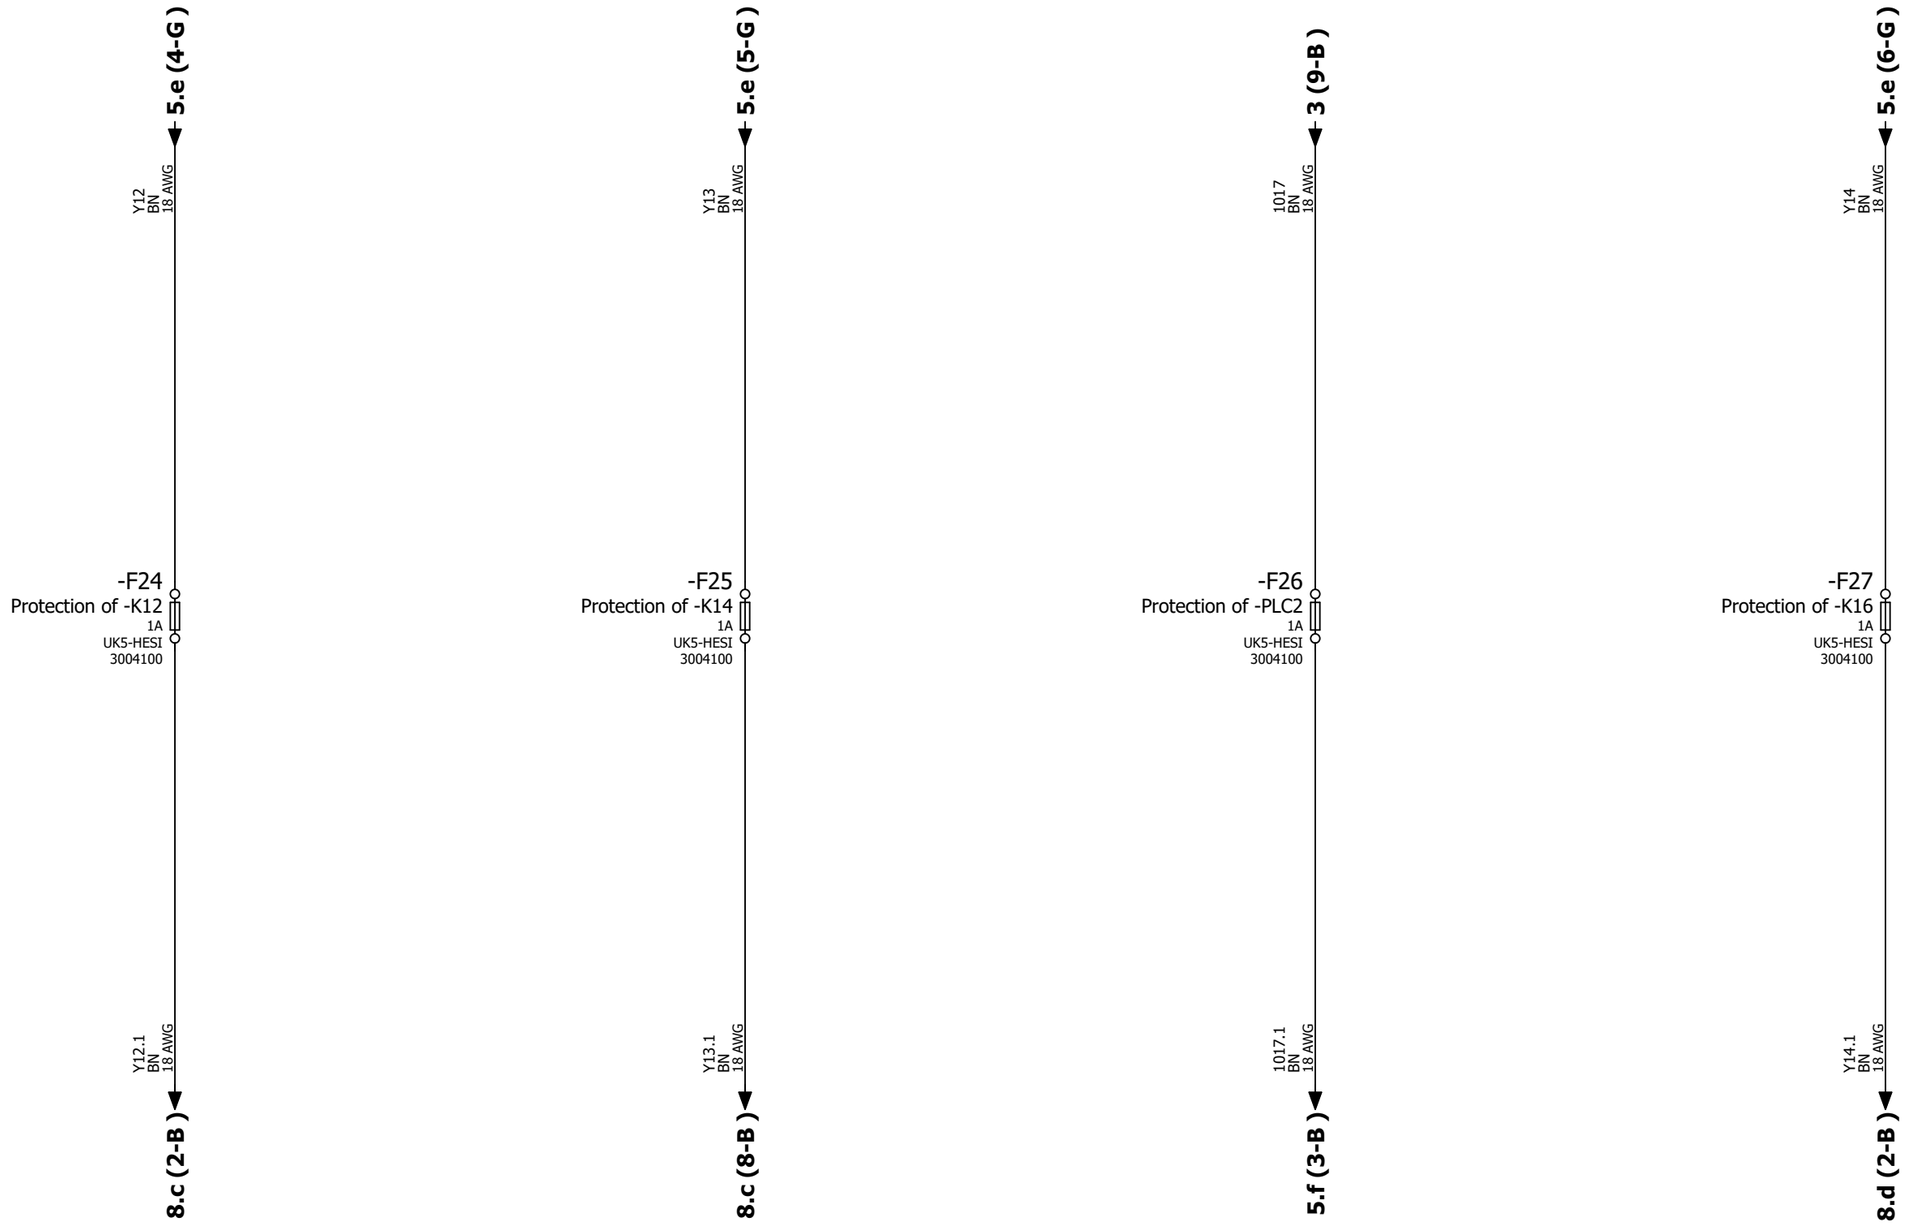

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	11/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	24 VDCFuses connections	Mounting location GC
			Revision	0	Station name		Sheet 2.a
			Responsible	EPLAN	ST 60		Page 36 / 83

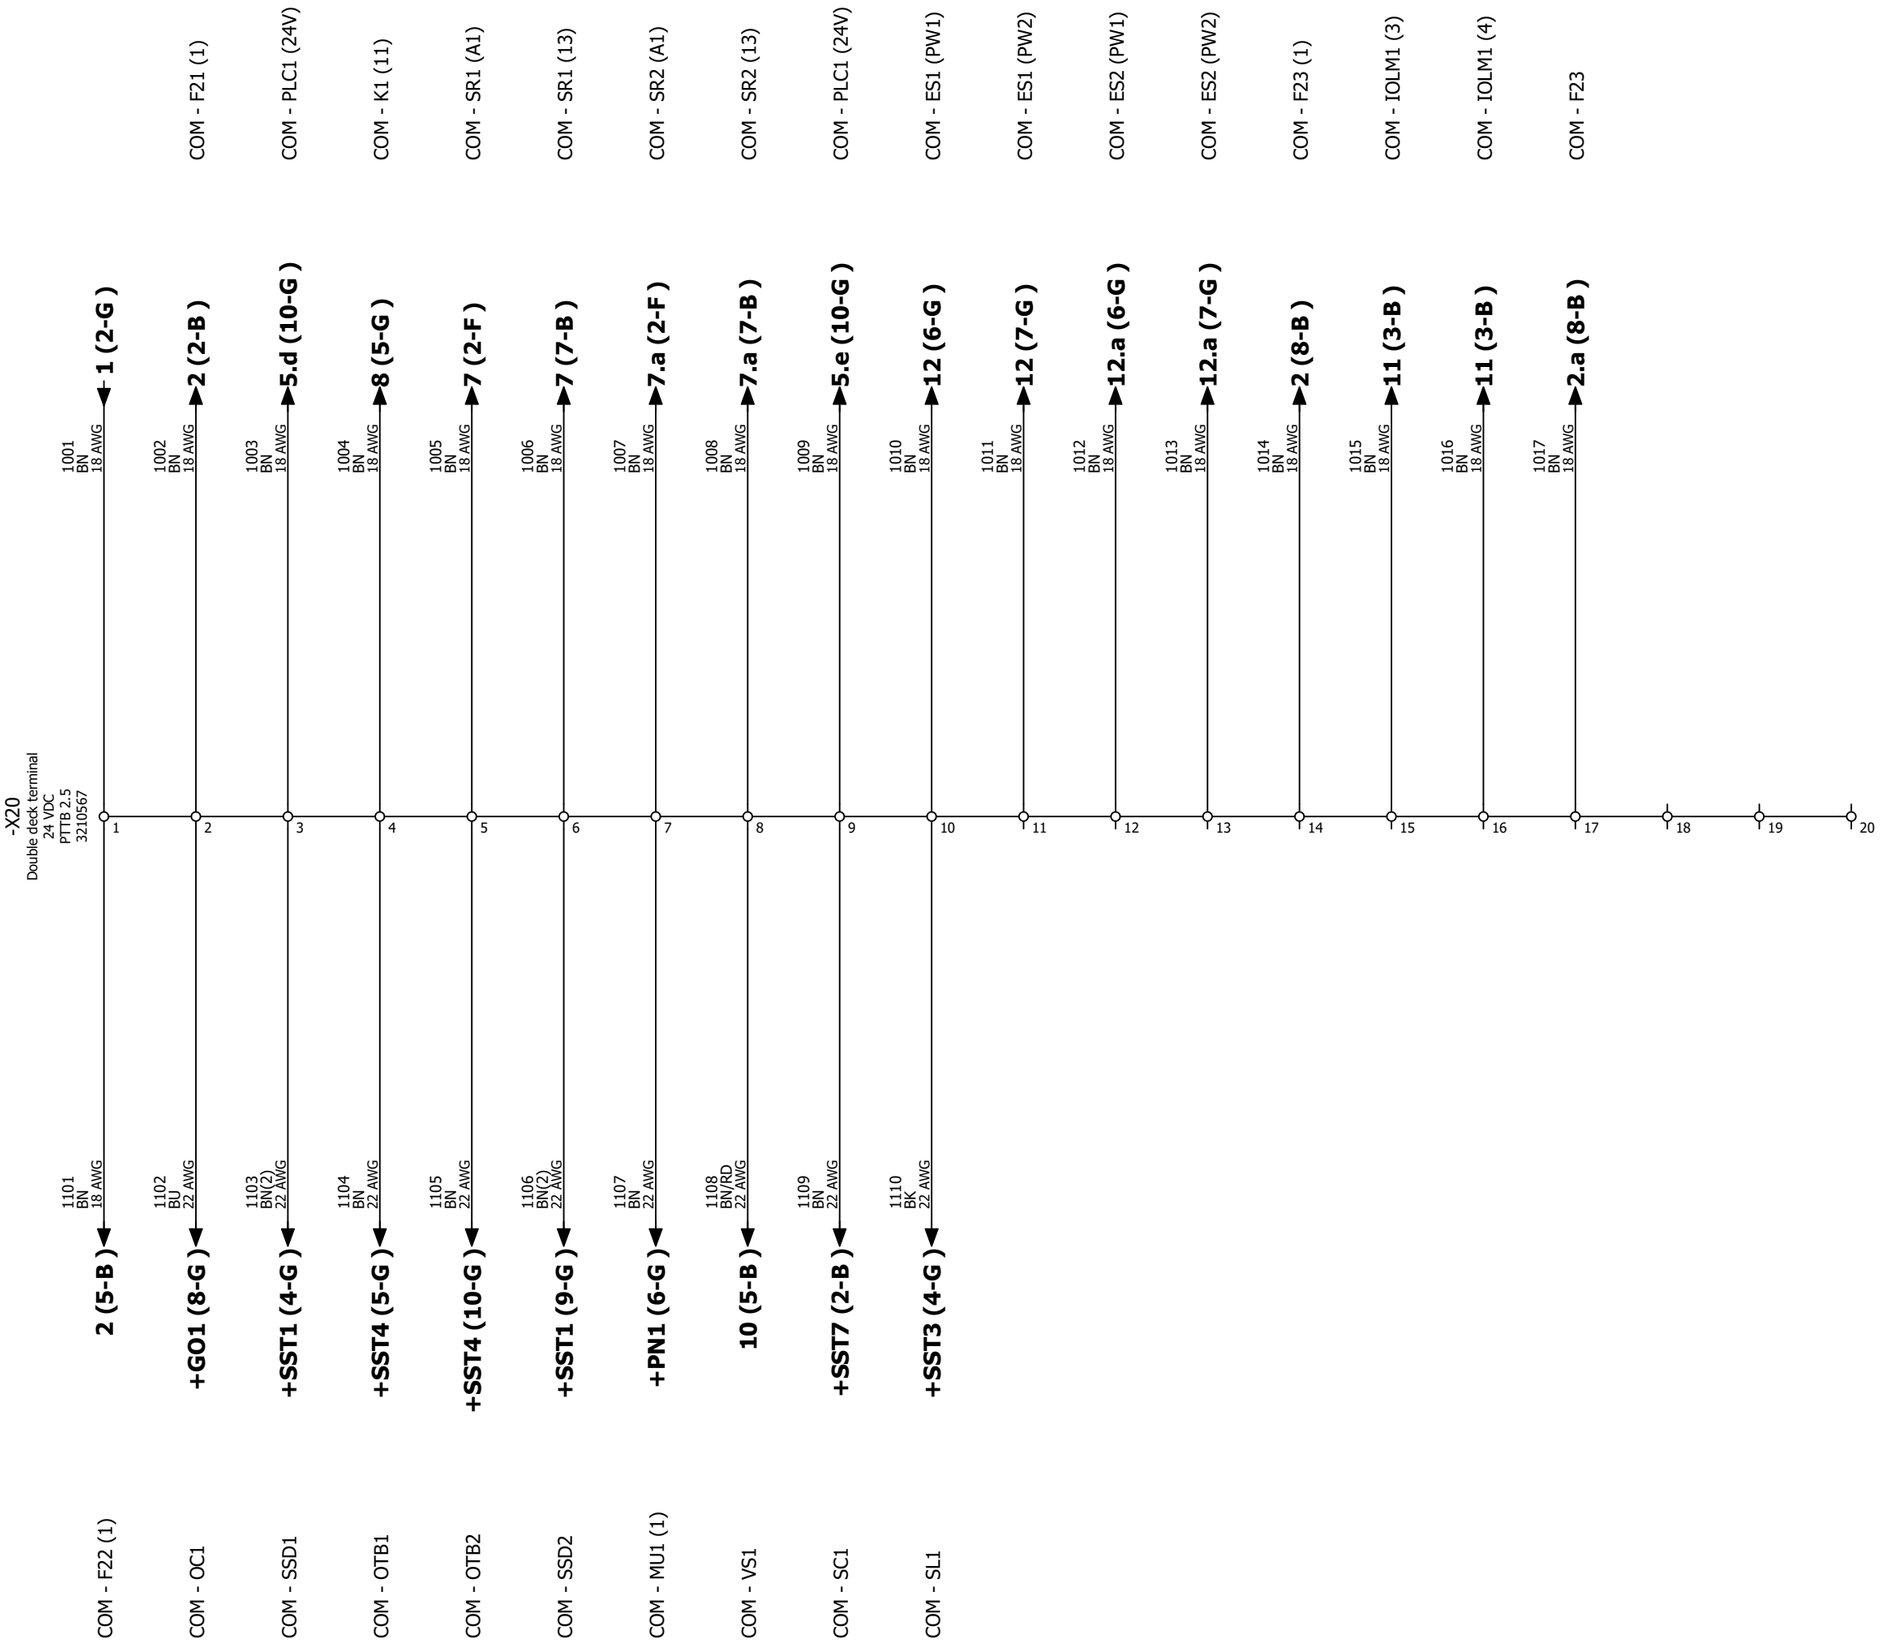

-X20
Double deck terminal
24 VDC
PTTB 2.5
3210567
1001 BN 18 AWG
1002 BN 18 AWG
1003 BN 18 AWG
1004 BN 18 AWG
1005 BN 18 AWG
1006 BN 18 AWG
1007 BN 18 AWG
1008 BN 18 AWG
1009 BN 18 AWG
1010 BN 18 AWG
1011 BN 18 AWG
1012 BN 18 AWG
1013 BN 18 AWG
1014 BN 18 AWG
1015 BN 18 AWG
1016 BN 18 AWG
1017 BN 18 AWG
1101 BN 18 AWG
1102 BU 22 AWG
1103 BN(2) 22 AWG
1104 BN 22 AWG
1105 BN 22 AWG
1106 BN(2) 22 AWG
1107 BN 22 AWG
1108 BN/RD 22 AWG
1109 BN 22 AWG
1110 BK 22 AWG
1 (2-G)
2 (2-B)
5.d (10-G)
8 (5-G)
7 (2-F)
7 (7-B)
7.a (2-F)
7.a (7-B)
5.e (10-G)
12 (6-G)
12 (7-G)
12.a (6-G)
12.a (7-G)
2 (8-B)
11 (3-B)
11 (3-B)
2.a (8-B)
2 (5-B)
+GO1 (8-G)
+SST1 (4-G)
+SST4 (5-G)
+SST4 (10-G)
+SST1 (9-G)
+PN1 (6-G)
10 (5-B)
+SST7 (2-B)
+SST3 (4-G)
COM - F21 (1)
COM - PLC1 (24V)
COM - K1 (11)
COM - SR1 (A1)
COM - SR1 (13)
COM - SR2 (A1)
COM - SR2 (13)
COM - PLC1 (24V)
COM - ES1 (PW1)
COM - ES1 (PW2)
COM - ES2 (PW1)
COM - ES2 (PW2)
COM - F23 (1)
COM - IOLM1 (3)
COM - IOLM1 (4)
COM - F23
COM - F22 (1)
COM - OC1
COM - SSD1
COM - OTB1
COM - OTB2
COM - SSD2
COM - MU1 (1)
COM - VS1
COM - SC1
COM - SL1

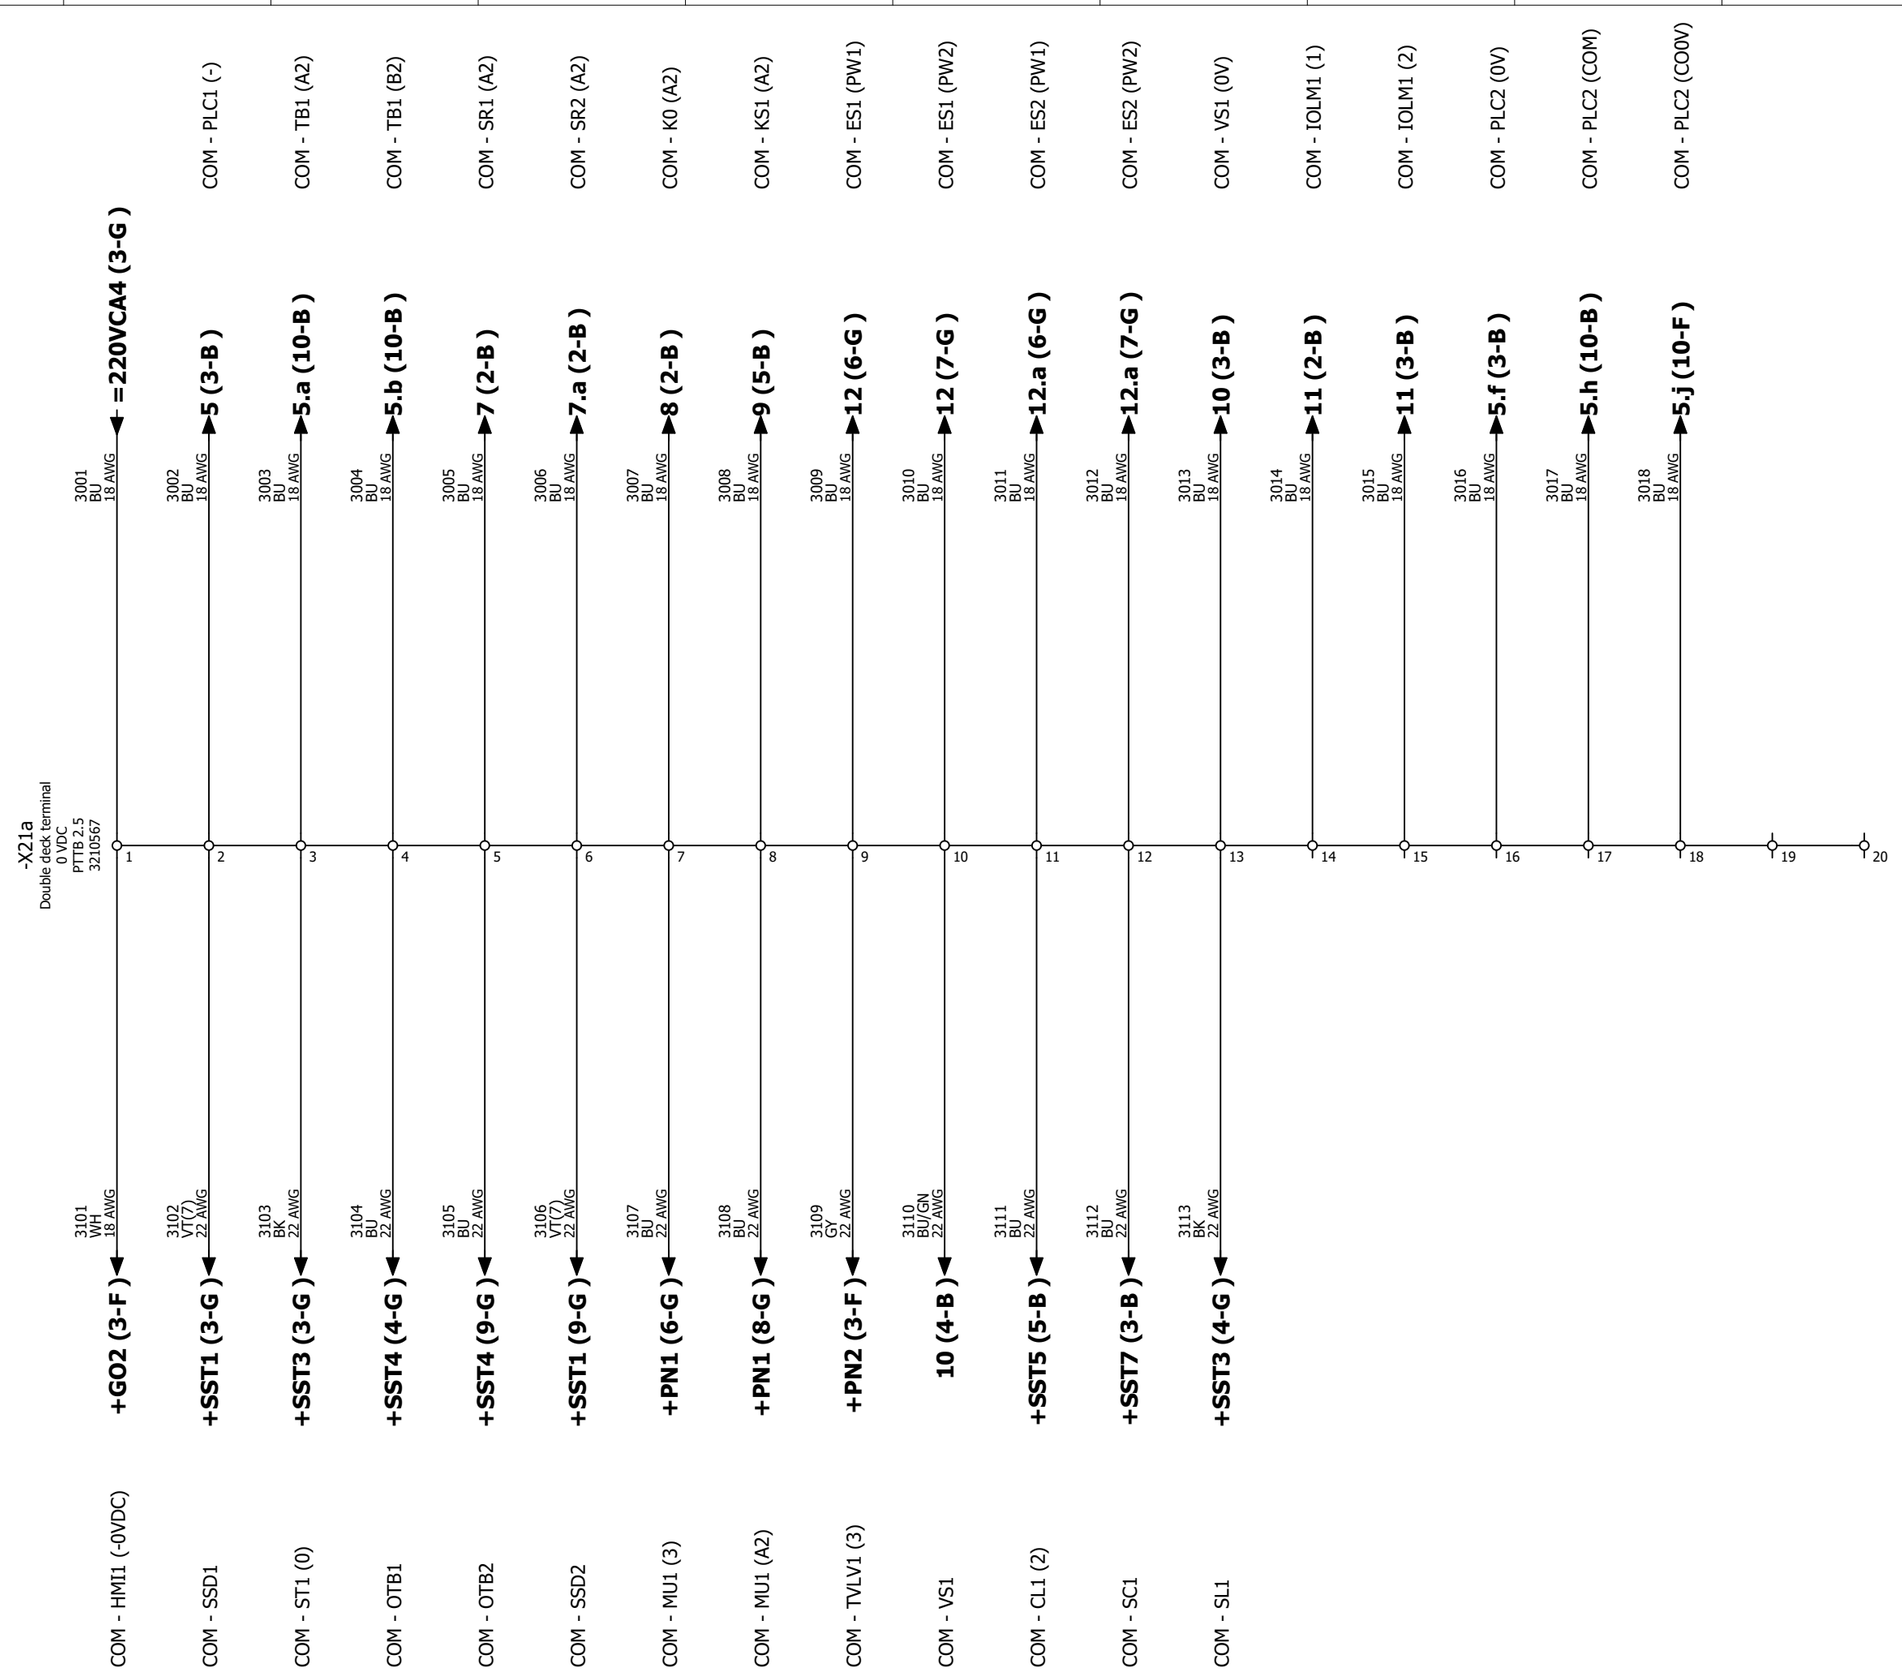

-X21a
Double deck terminal
0 VDC
PTTB 2.5
3210567
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20
3001 BU 18 AWG
3002 BU 18 AWG
3003 BU 18 AWG
3004 BU 18 AWG
3005 BU 18 AWG
3006 BU 18 AWG
3007 BU 18 AWG
3008 BU 18 AWG
3009 BU 18 AWG
3010 BU 18 AWG
3011 BU 18 AWG
3012 BU 18 AWG
3013 BU 18 AWG
3014 BU 18 AWG
3015 BU 18 AWG
3016 BU 18 AWG
3017 BU 18 AWG
3018 BU 18 AWG
=220VCA4 (3-G)
5 (3-B)
5.a (10-B)
5.b (10-B)
7 (2-B)
7.a (2-B)
8 (2-B)
9 (5-B)
12 (6-G)
12 (7-G)
12.a (6-G)
12.a (7-G)
10 (3-B)
11 (2-B)
11 (3-B)
5.f (3-B)
5.h (10-B)
5.j (10-F)
COM - PLC1 (-)
COM - TB1 (A2)
COM - TB1 (B2)
COM - SR1 (A2)
COM - SR2 (A2)
COM - K0 (A2)
COM - KS1 (A2)
COM - ES1 (PW1)
COM - ES1 (PW2)
COM - ES2 (PW1)
COM - ES2 (PW2)
COM - VS1 (0V)
COM - IOLM1 (1)
COM - IOLM1 (2)
COM - PLC2 (0V)
COM - PLC2 (COM)
COM - PLC2 (COOV)
3101 WH 18 AWG
3102 VT(7) 22 AWG
3103 BK 22 AWG
3104 BU 22 AWG
3105 BU 22 AWG
3106 VT(7) 22 AWG
3107 BU 22 AWG
3108 BU 22 AWG
3109 GY 22 AWG
3110 BU/GN 22 AWG
3111 BU 22 AWG
3112 BU 22 AWG
3113 BK 22 AWG
+GO2 (3-F)
+SST1 (3-G)
+SST3 (3-G)
+SST4 (4-G)
+SST4 (9-G)
+SST1 (9-G)
+PN1 (6-G)
+PN1 (8-G)
+PN2 (3-F)
10 (4-B)
+SST5 (5-B)
+SST7 (3-B)
+SST3 (4-G)
COM - HMI1 (-0VDC)
COM - SSD1
COM - ST1 (0)
COM - OTB1
COM - OTB2
COM - SSD2
COM - MU1 (3)
COM - MU1 (A2)
COM - TVLV1 (3)
COM - VS1
COM - CL1 (2)
COM - SC1
COM - SL1

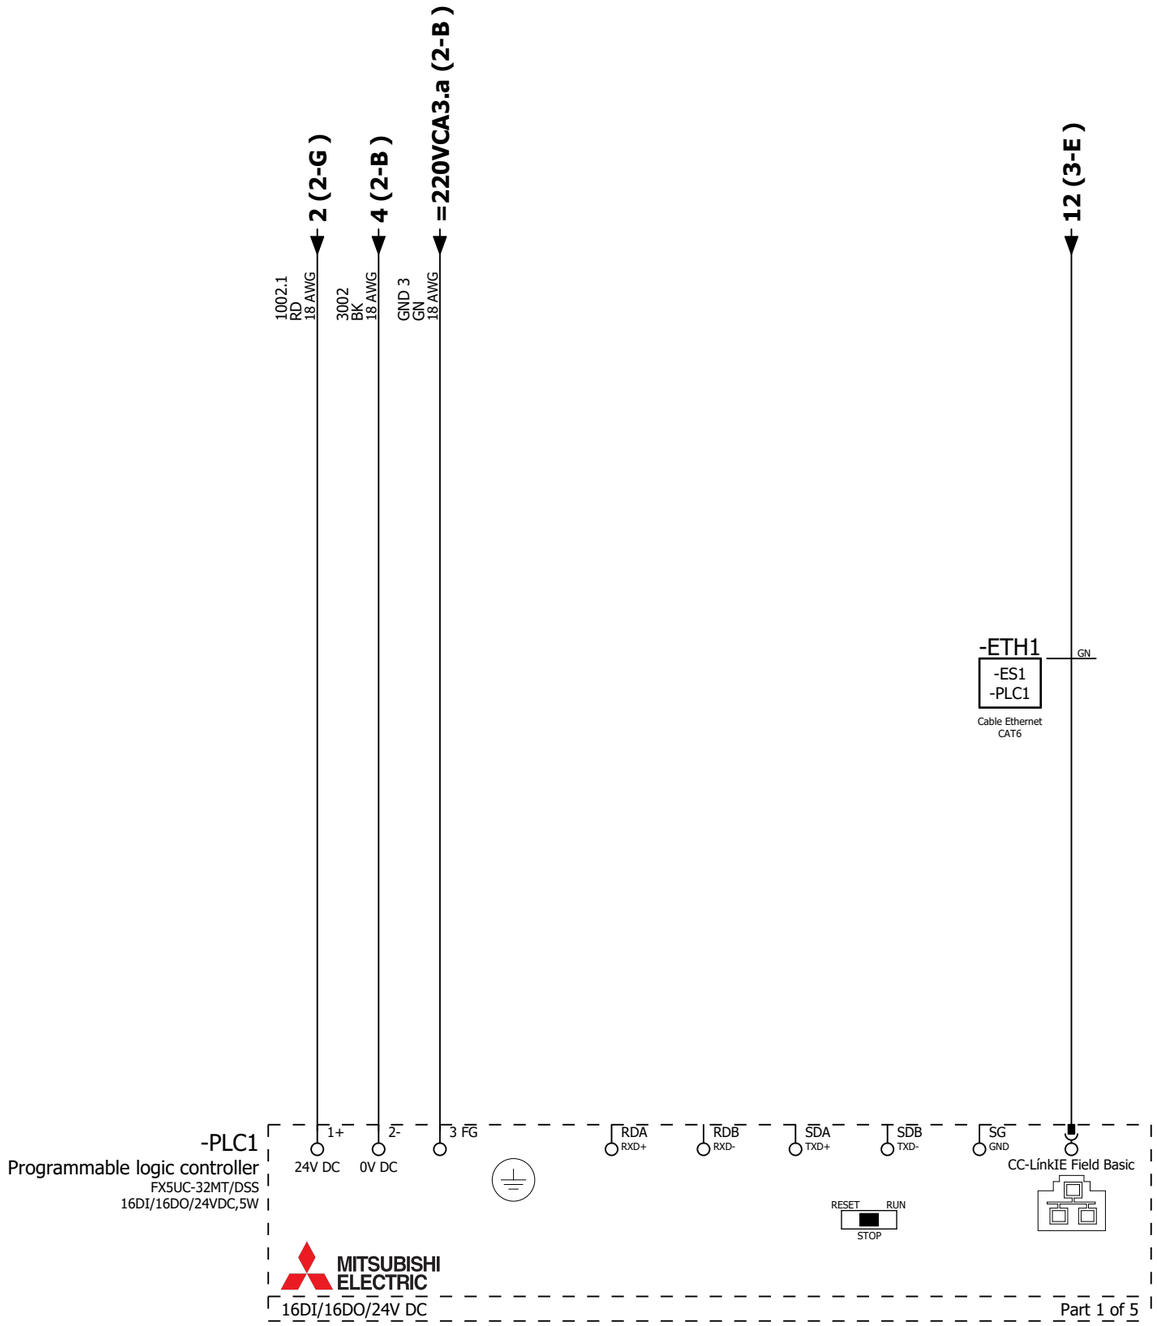

Automatyco®
Automatización,
Mantenimiento y Construcción
Condominio Industrial Siglo 21,
Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
Client: Pegatron	Modified	19/05/2026	NV9X CP	Programmable logic controller connections	Mounting location GC
PEGATRON	Revision	0	Station name		Sheet 5
	Responsible	EPLAN	ST 60		Page 39 / 83

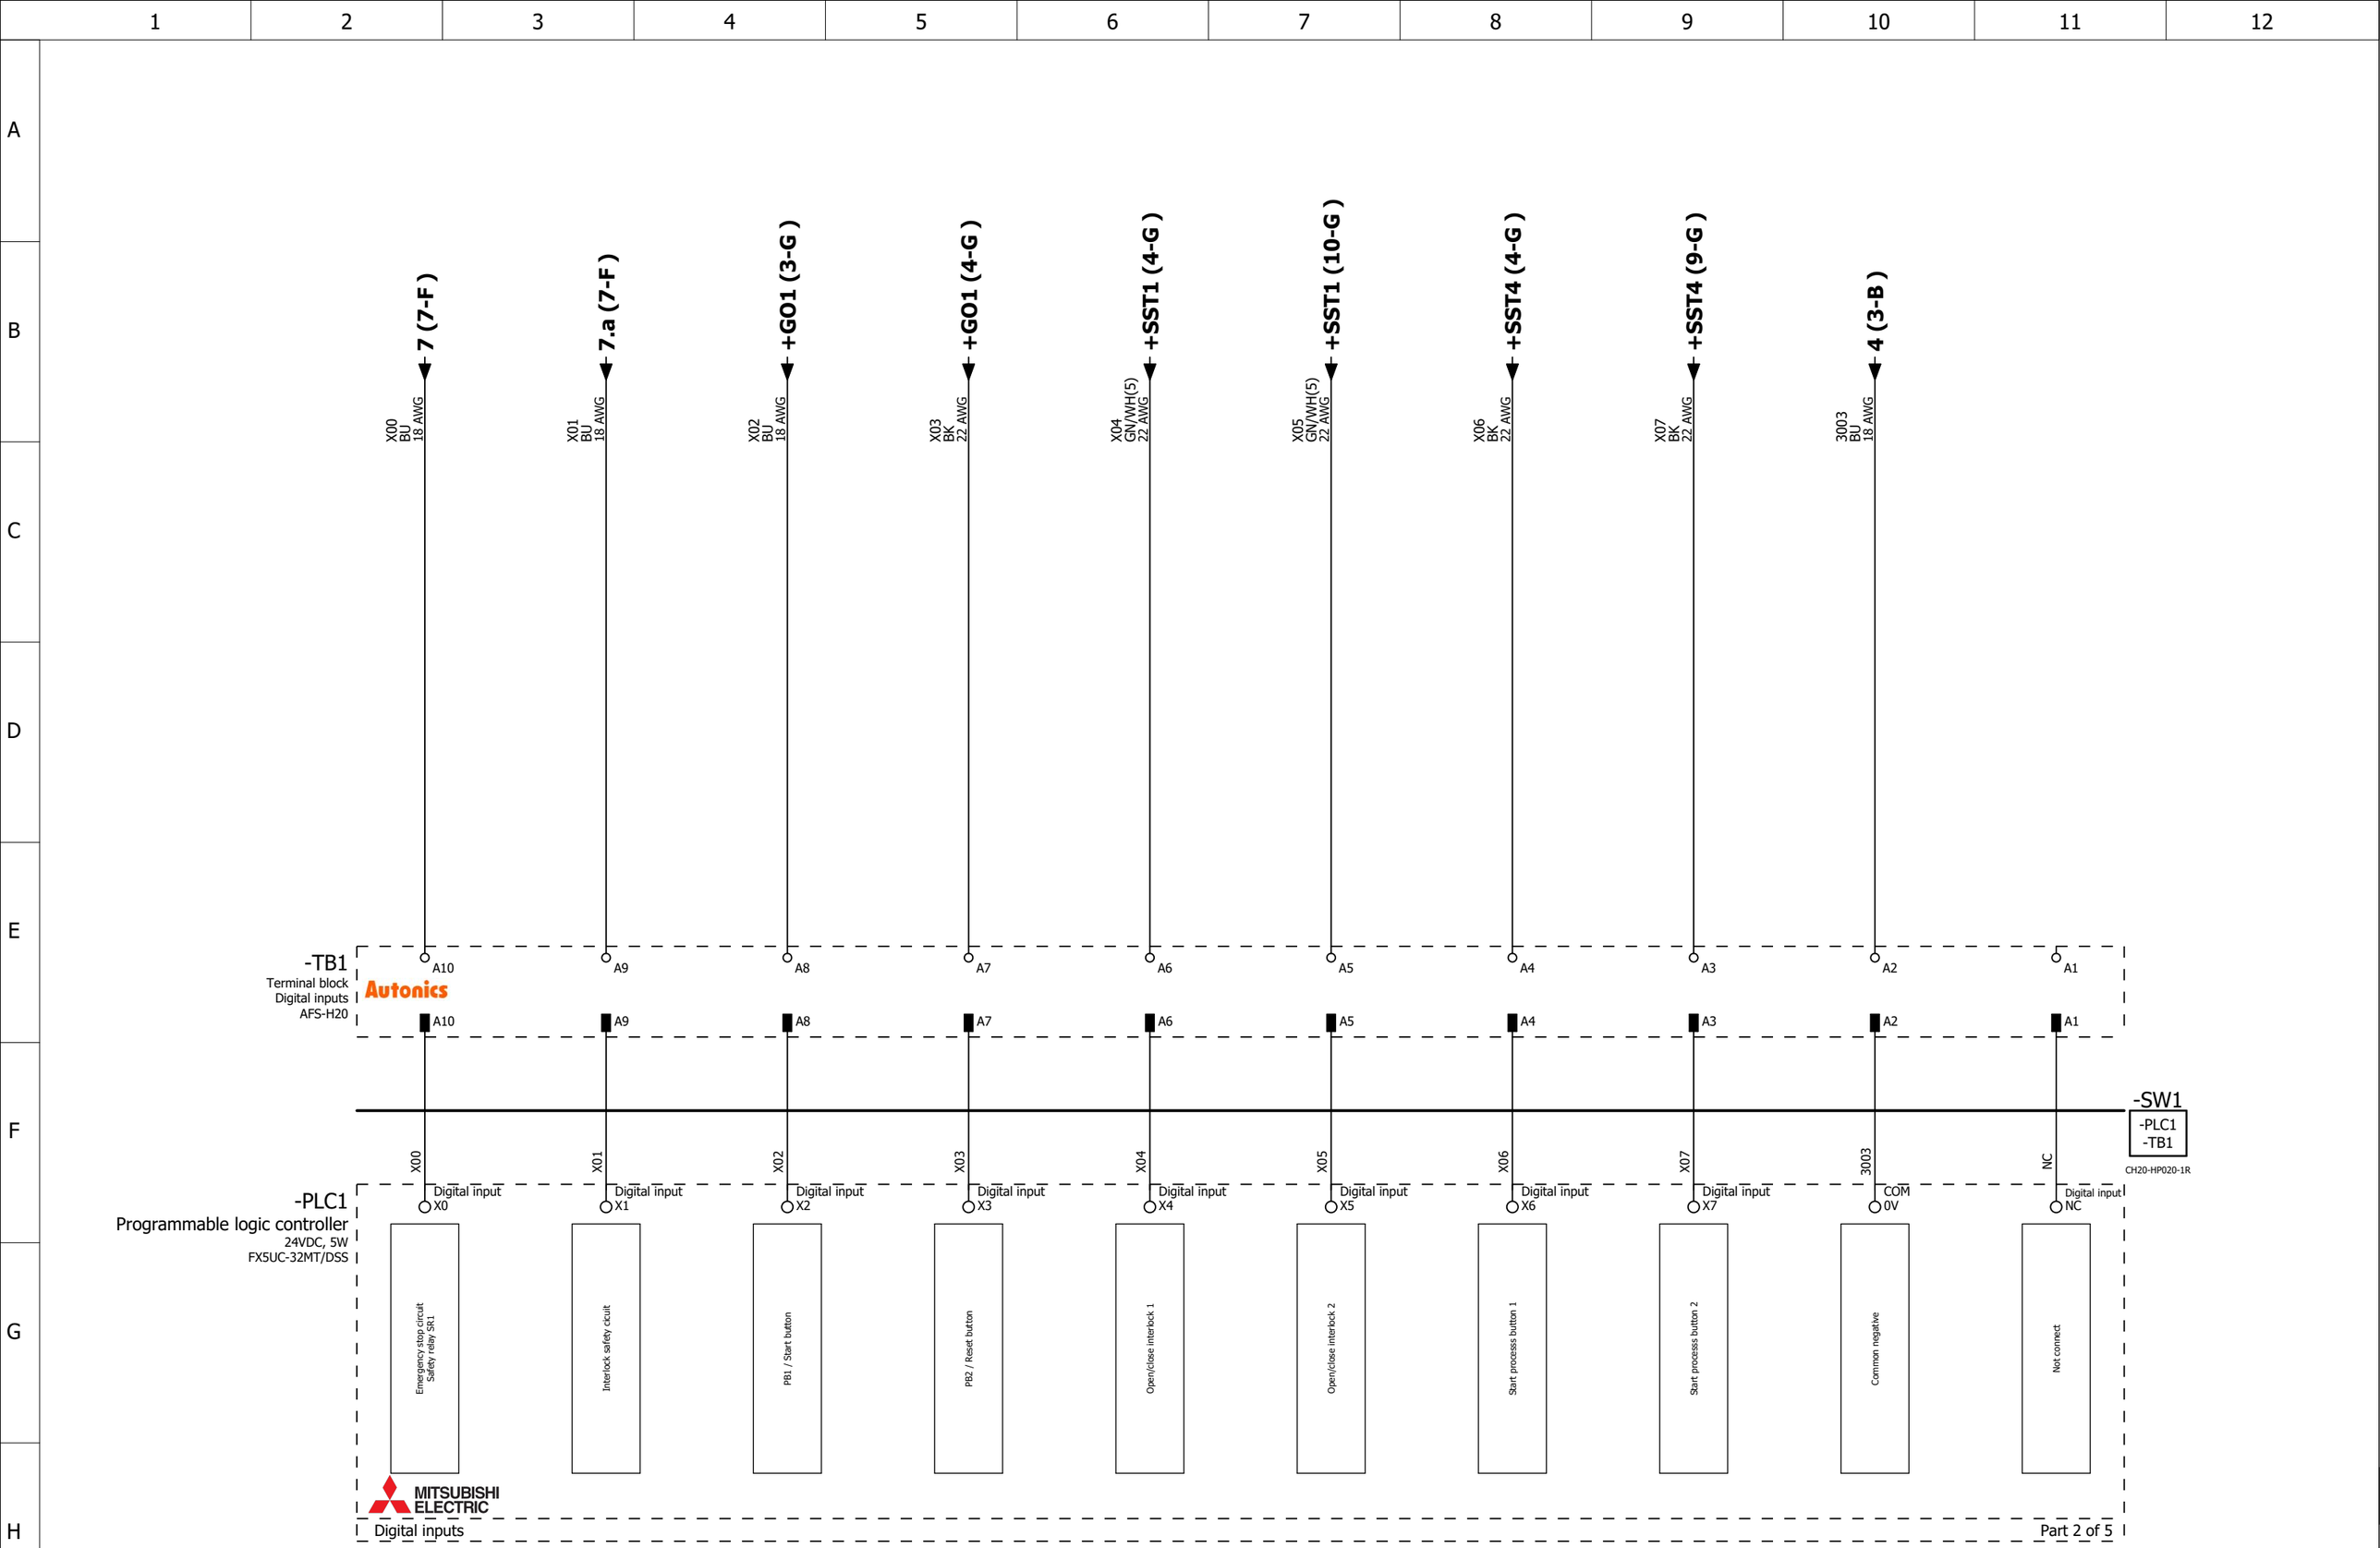
7 (7-F)
7.a (7-F)
+GO1 (3-G)
+GO1 (4-G)
+SST1 (4-G)
+SST1 (10-G)
+SST4 (4-G)
+SST4 (9-G)
4 (3-B)
X00 BU 18 AWG
X01 BU 18 AWG
X02 BU 18 AWG
X03 BK 22 AWG
X04 GN/WH(5) 22 AWG
X05 GN/WH(5) 22 AWG
X06 BK 22 AWG
X07 BK 22 AWG
3003 BU 18 AWG
-TB1
Terminal block
Digital inputs
AFS-H20
Autonics
A10 A9 A8 A7 A6 A5 A4 A3 A2 A1
-SW1
-PLC1
-TB1
CH20-HP020-1R
X00 X01 X02 X03 X04 X05 X06 X07 3003 NC
-PLC1
Programmable logic controller
24VDC, 5W
FX5UC-32MT/DSS
Digital input X0
Digital input X1
Digital input X2
Digital input X3
Digital input X4
Digital input X5
Digital input X6
Digital input X7
COM 0V
Digital input NC
Emergency stop circuit
Safety relay SR1
Interlock safety cicuit
PB1 / Start button
PB2 / Reset button
Open/close interlock 1
Open/close interlock 2
Start processs button 1
Start processs button 2
Common negative
Not connect
MITSUBISHI ELECTRIC
Digital inputs
Part 2 of 5

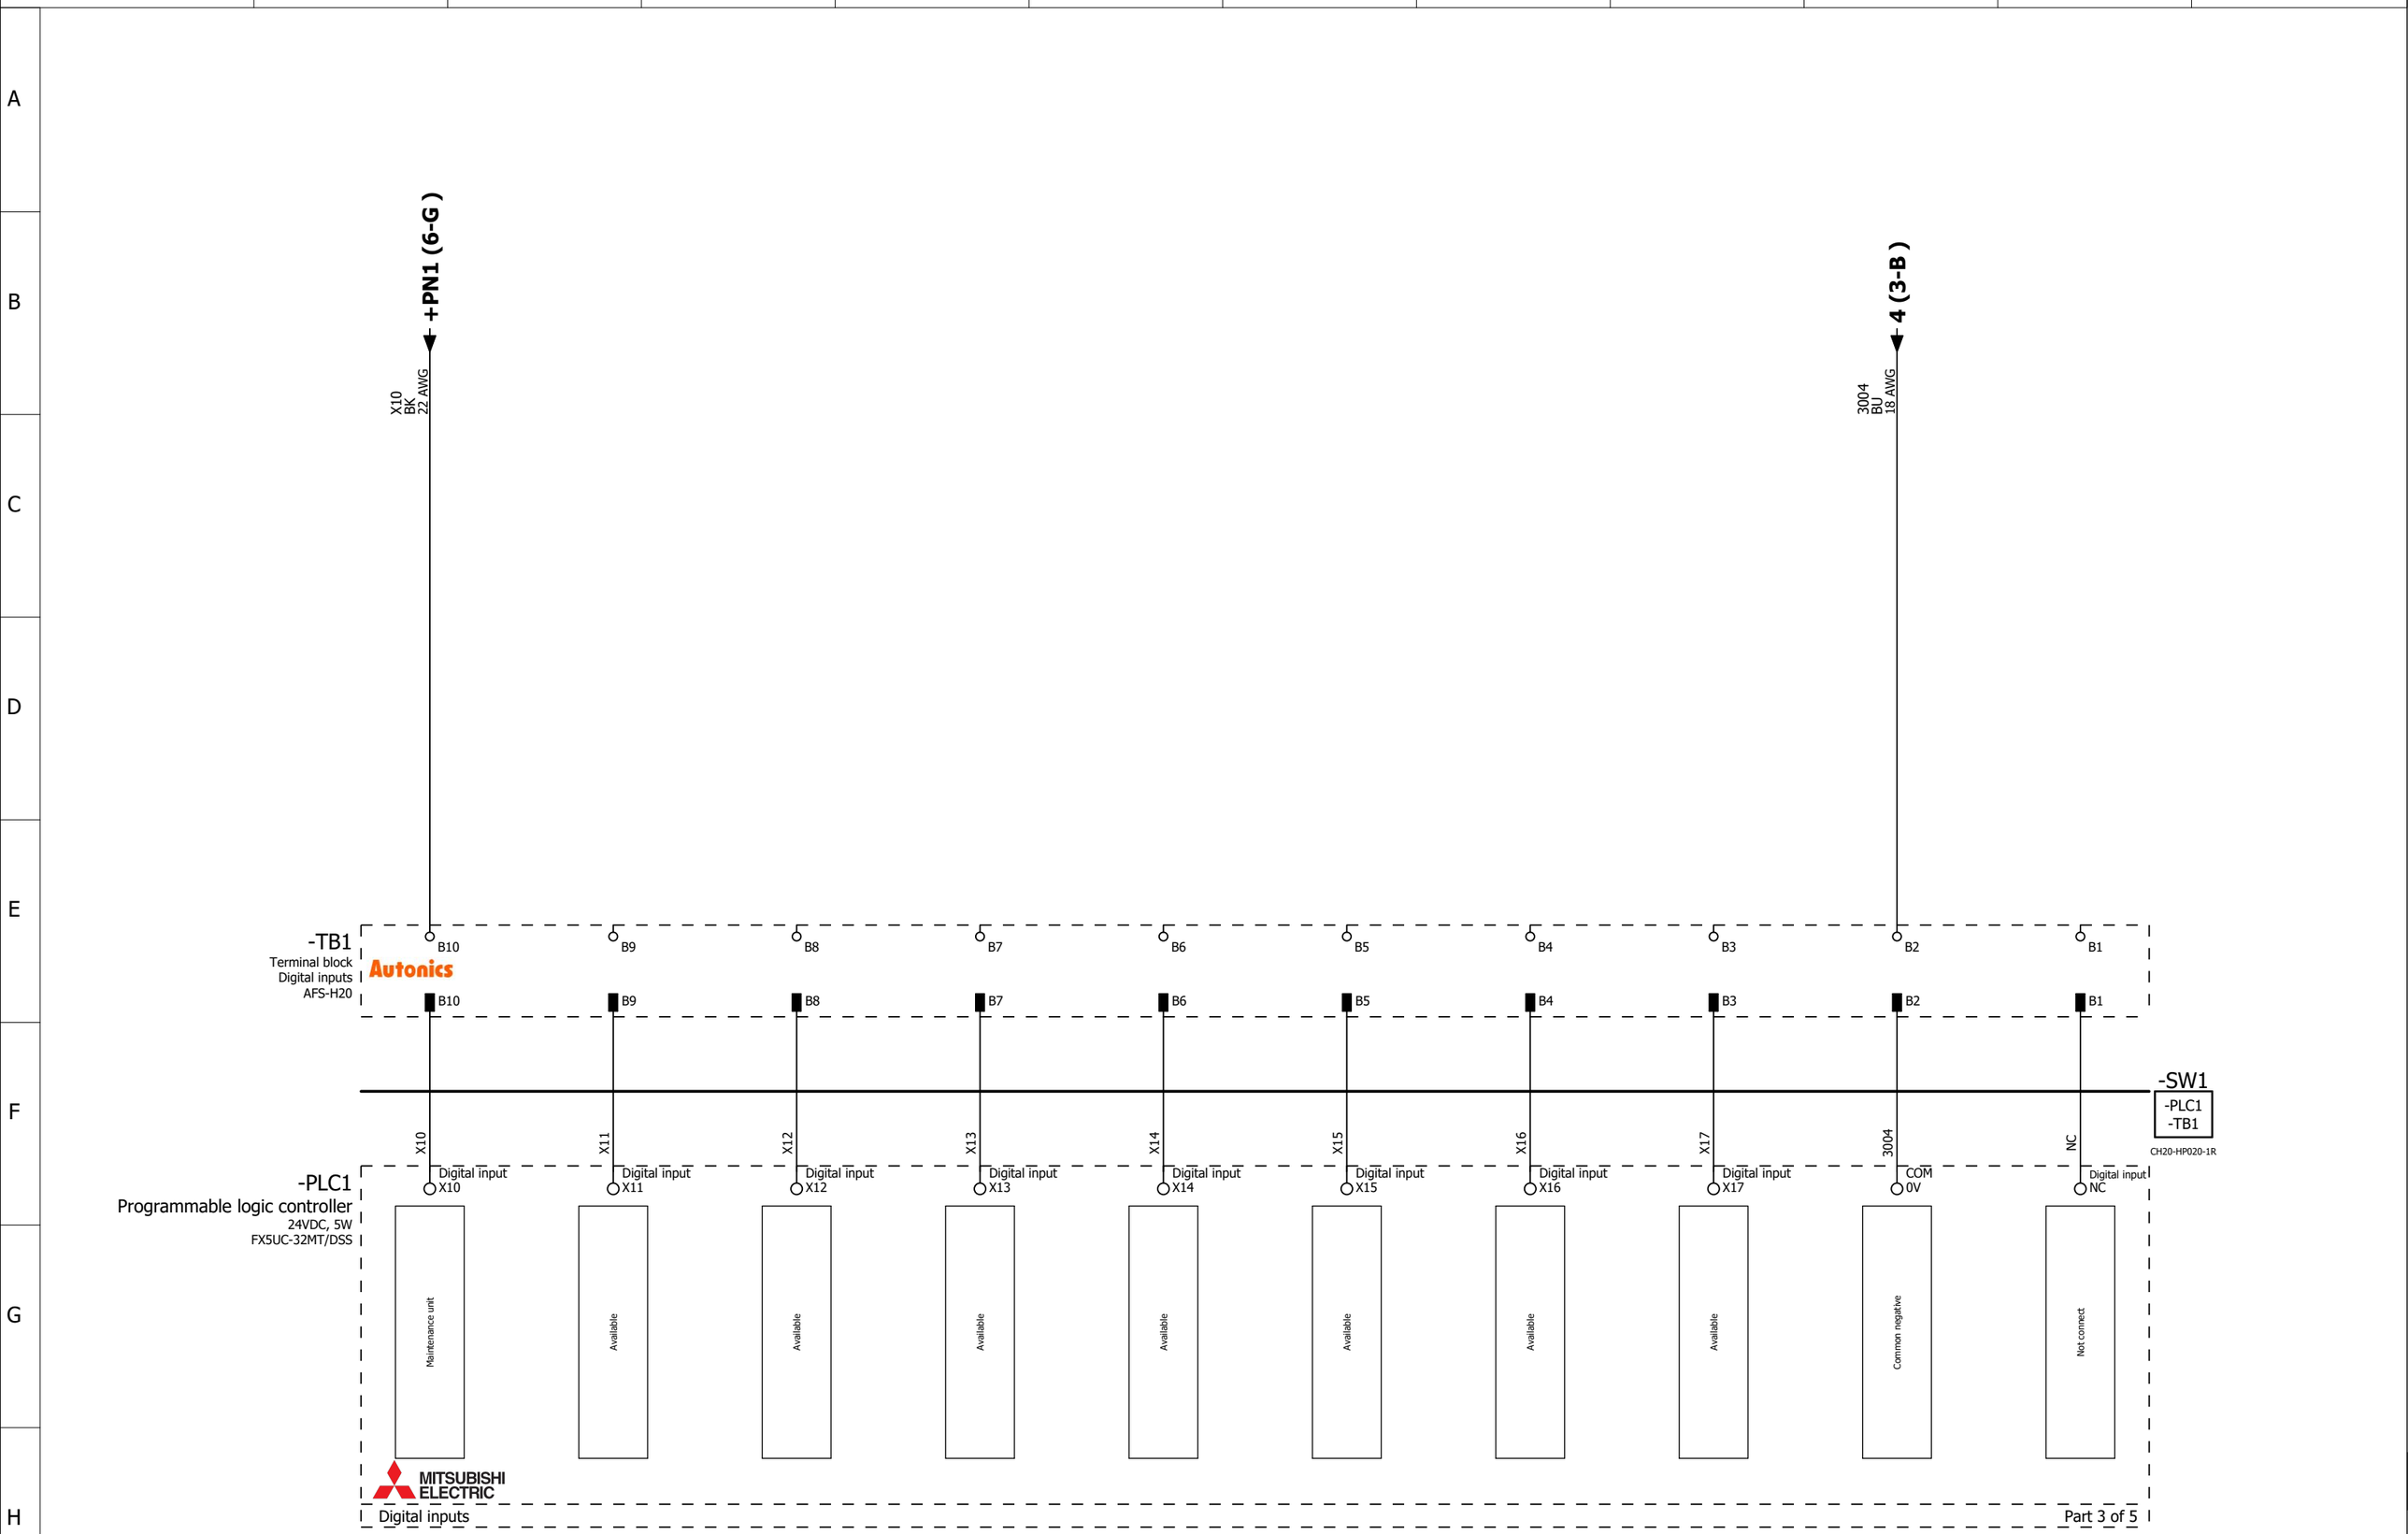
+PN1 (6-G)
X10
BK
22 AWG
4 (3-B)
3004
BU
18 AWG
-TB1
Terminal block
Digital inputs
AFS-H20
Autonics
B10
B9
B8
B7
B6
B5
B4
B3
B2
B1
-SW1
-PLC1
-TB1
CH20-HP020-1R
-PLC1
Programmable logic controller
24VDC, 5W
FX5UC-32MT/DSS
X10
X11
X12
X13
X14
X15
X16
X17
3004
NC
Digital input
COM
0V
Maintenance unit
Available
Common negative
Not connect
MITSUBISHI ELECTRIC
Digital inputs
Part 3 of 5

-PLC1
Programmable logic controller
24VDC, 5W
FX5UC-32MT/DSS

Digital outputs

Part 4 of 5


Y0	Y1	Y2	Y3	y04	Y5	Y6	Y7	24V	NC
Digital output	Digital output	Digital output	Digital output	Digital output	Digital output	Digital output	Digital output	COM	
ON/OFF-LF1 K1	Activate green led light SL1	Activate yellow led light SL1	Activate red led light SL1	Activate light siren SL1	Red light -OTB1	Green light -OTB1	Red light -OTB2	Common positive	Not connect
Y00	Y01	Y02	Y03	Y04	Y05	Y06	Y07	1003	NC

-SW1
-PLC1
Connection cable


Y00 BN 18 AWG	Y01 BN 18 AWG	Y02 BN 18 AWG	Y03 BN 18 AWG	Y04 BN 18 AWG	Y05 BN 18 AWG	Y06 BN 18 AWG	Y07 BN 18 AWG	1003 BN 18 AWG
8 (2-B)	8 (5-B)	8 (8-B)	8 (11-B)	8.a (2-B)	8.a (5-B)	8.a (8-B)	8.a (11-B)	3 (3-B)

Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
Client: Pegatron	Modified	28/03/2026	NV9X CP	PLC/Digital outputs connections	Mounting location GC
PEGATRON	Revision	0	Station name		Sheet 5.d
	Responsible	EPLAN	ST 60		Page 42 / 83

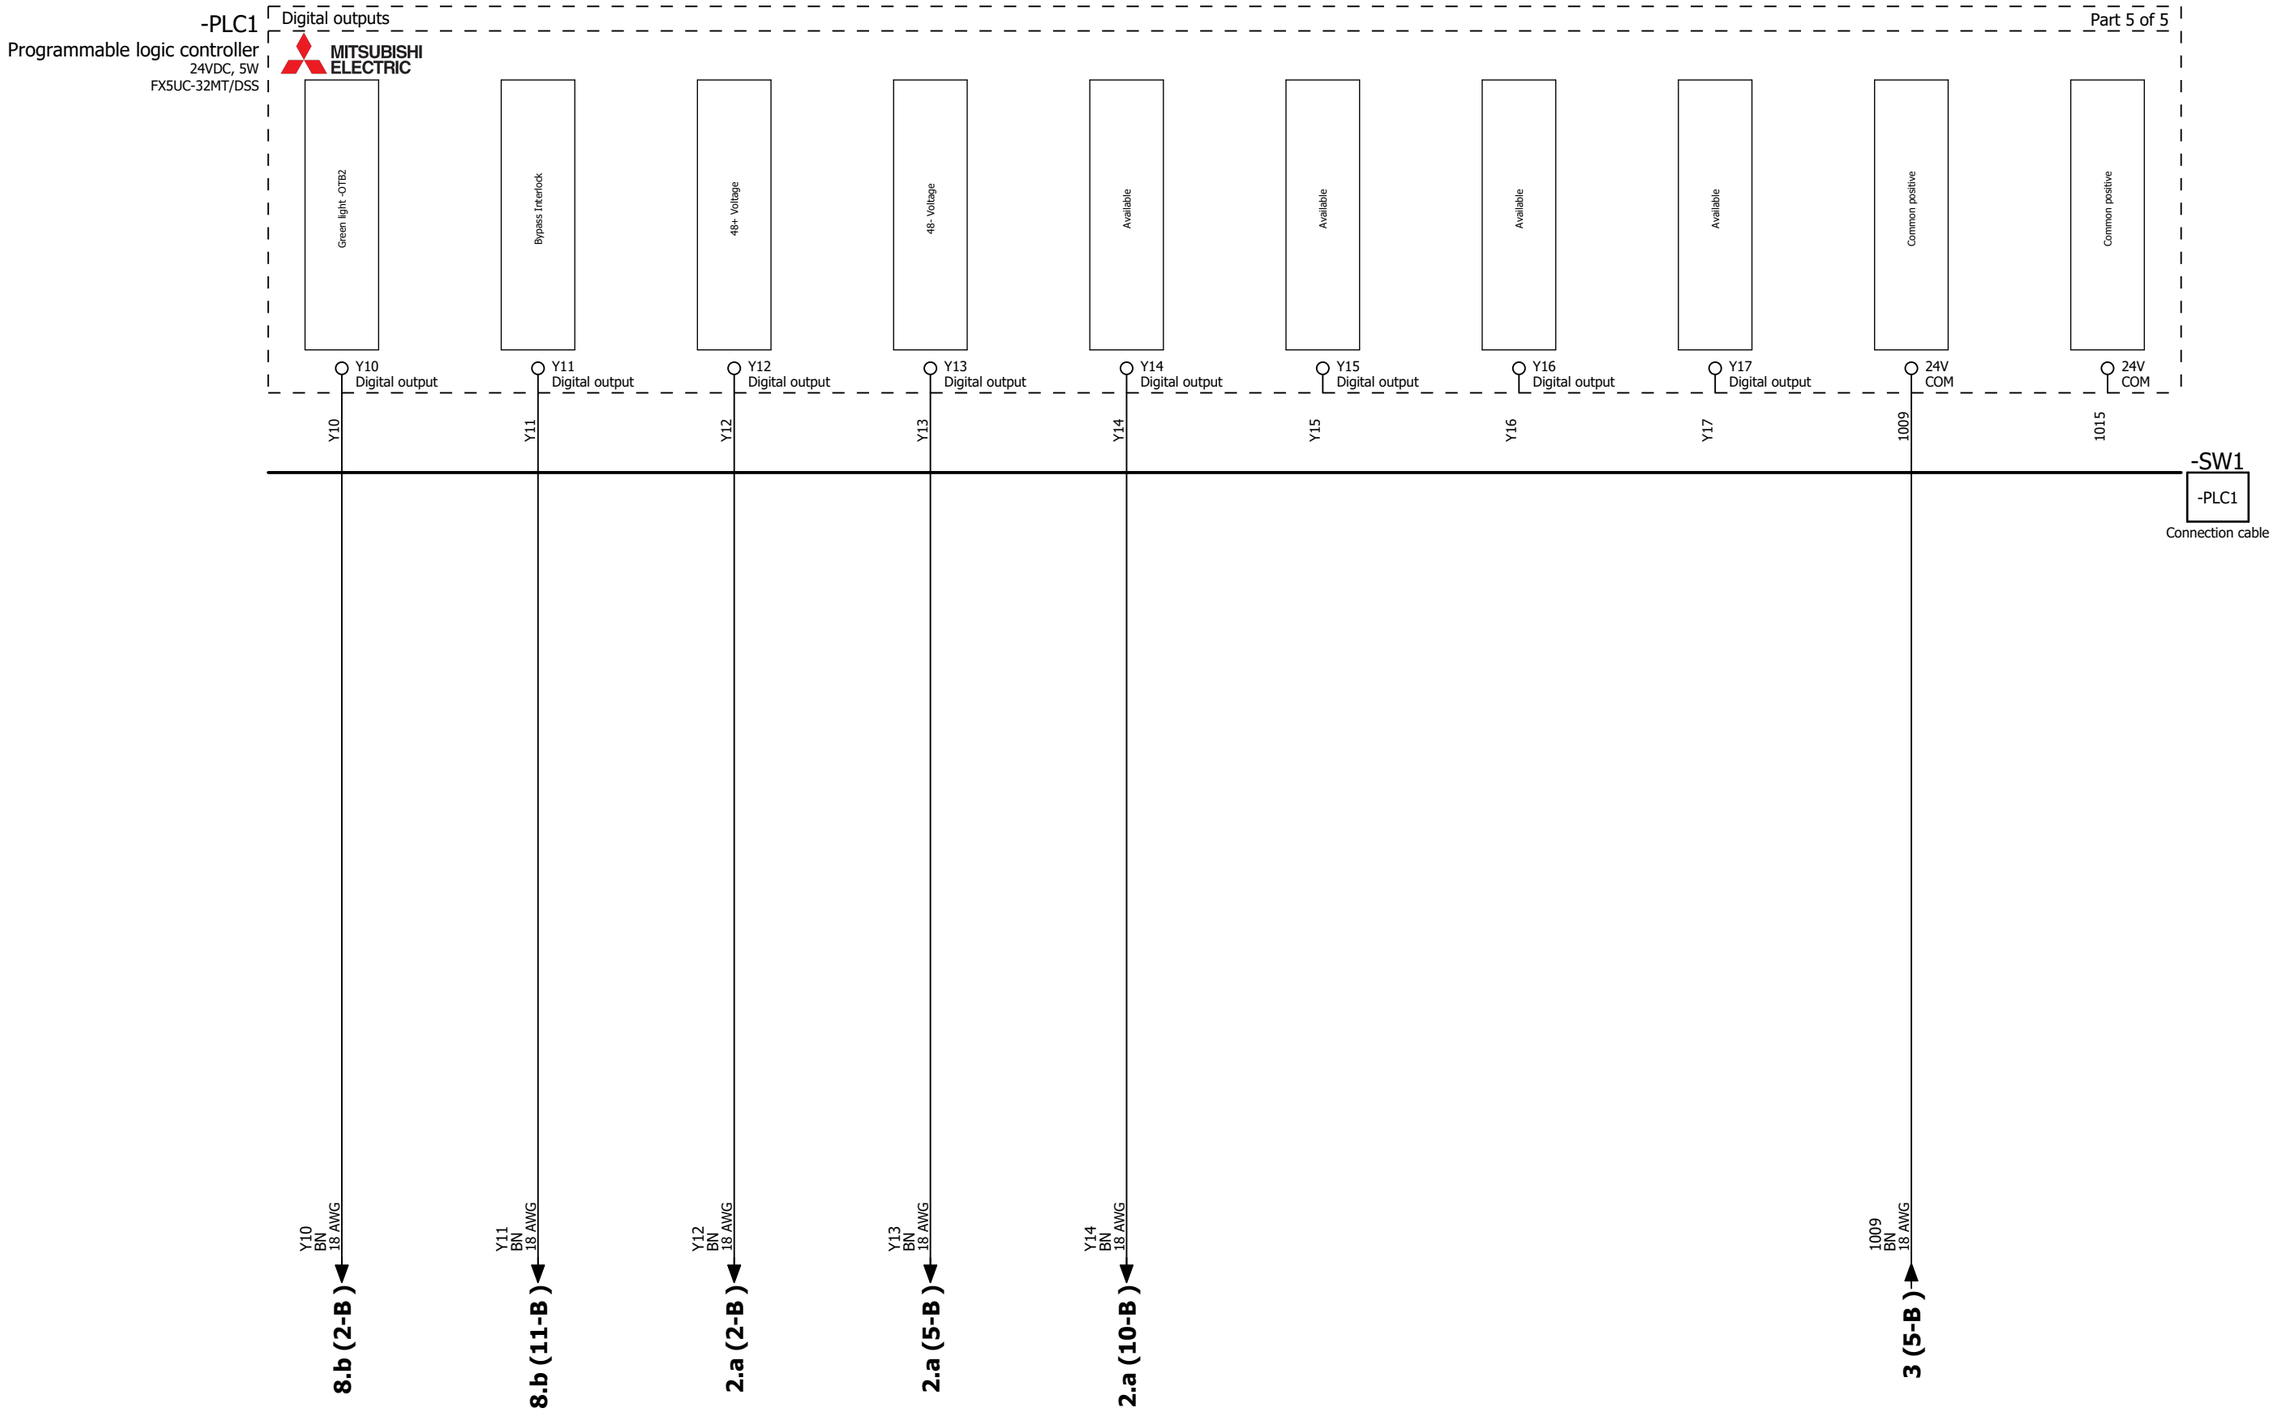


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	PLC/Digital outputs connections	Mounting location GC
		Revision	0	Station name		Sheet 5.e
		Responsible	EPLAN	ST 60		Page 43 / 83

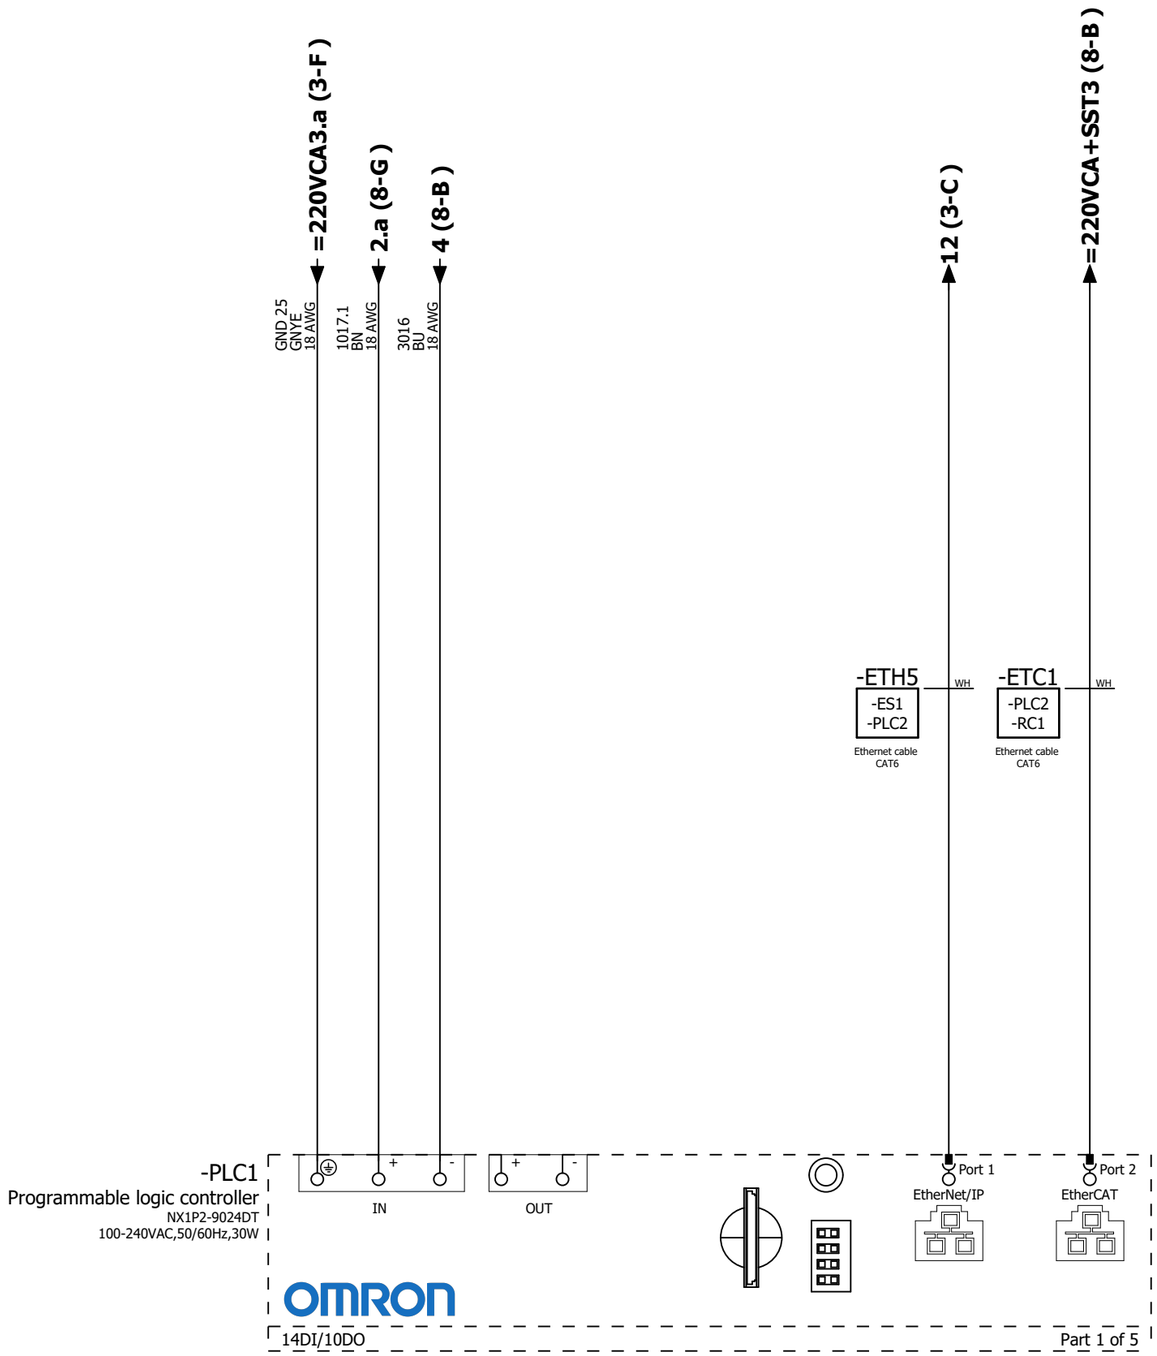


Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	30/12/2025	Project's name	Page name	Facility 24VCD
Client: Pegatron	Modified	19/05/2026	NV9X CP	Programmable logic controller connections	Mounting location GC
PEGATRON	Revision	0	Station name		Sheet 5.f
	Responsible	EPLAN	ST 60		Page 44 / 83

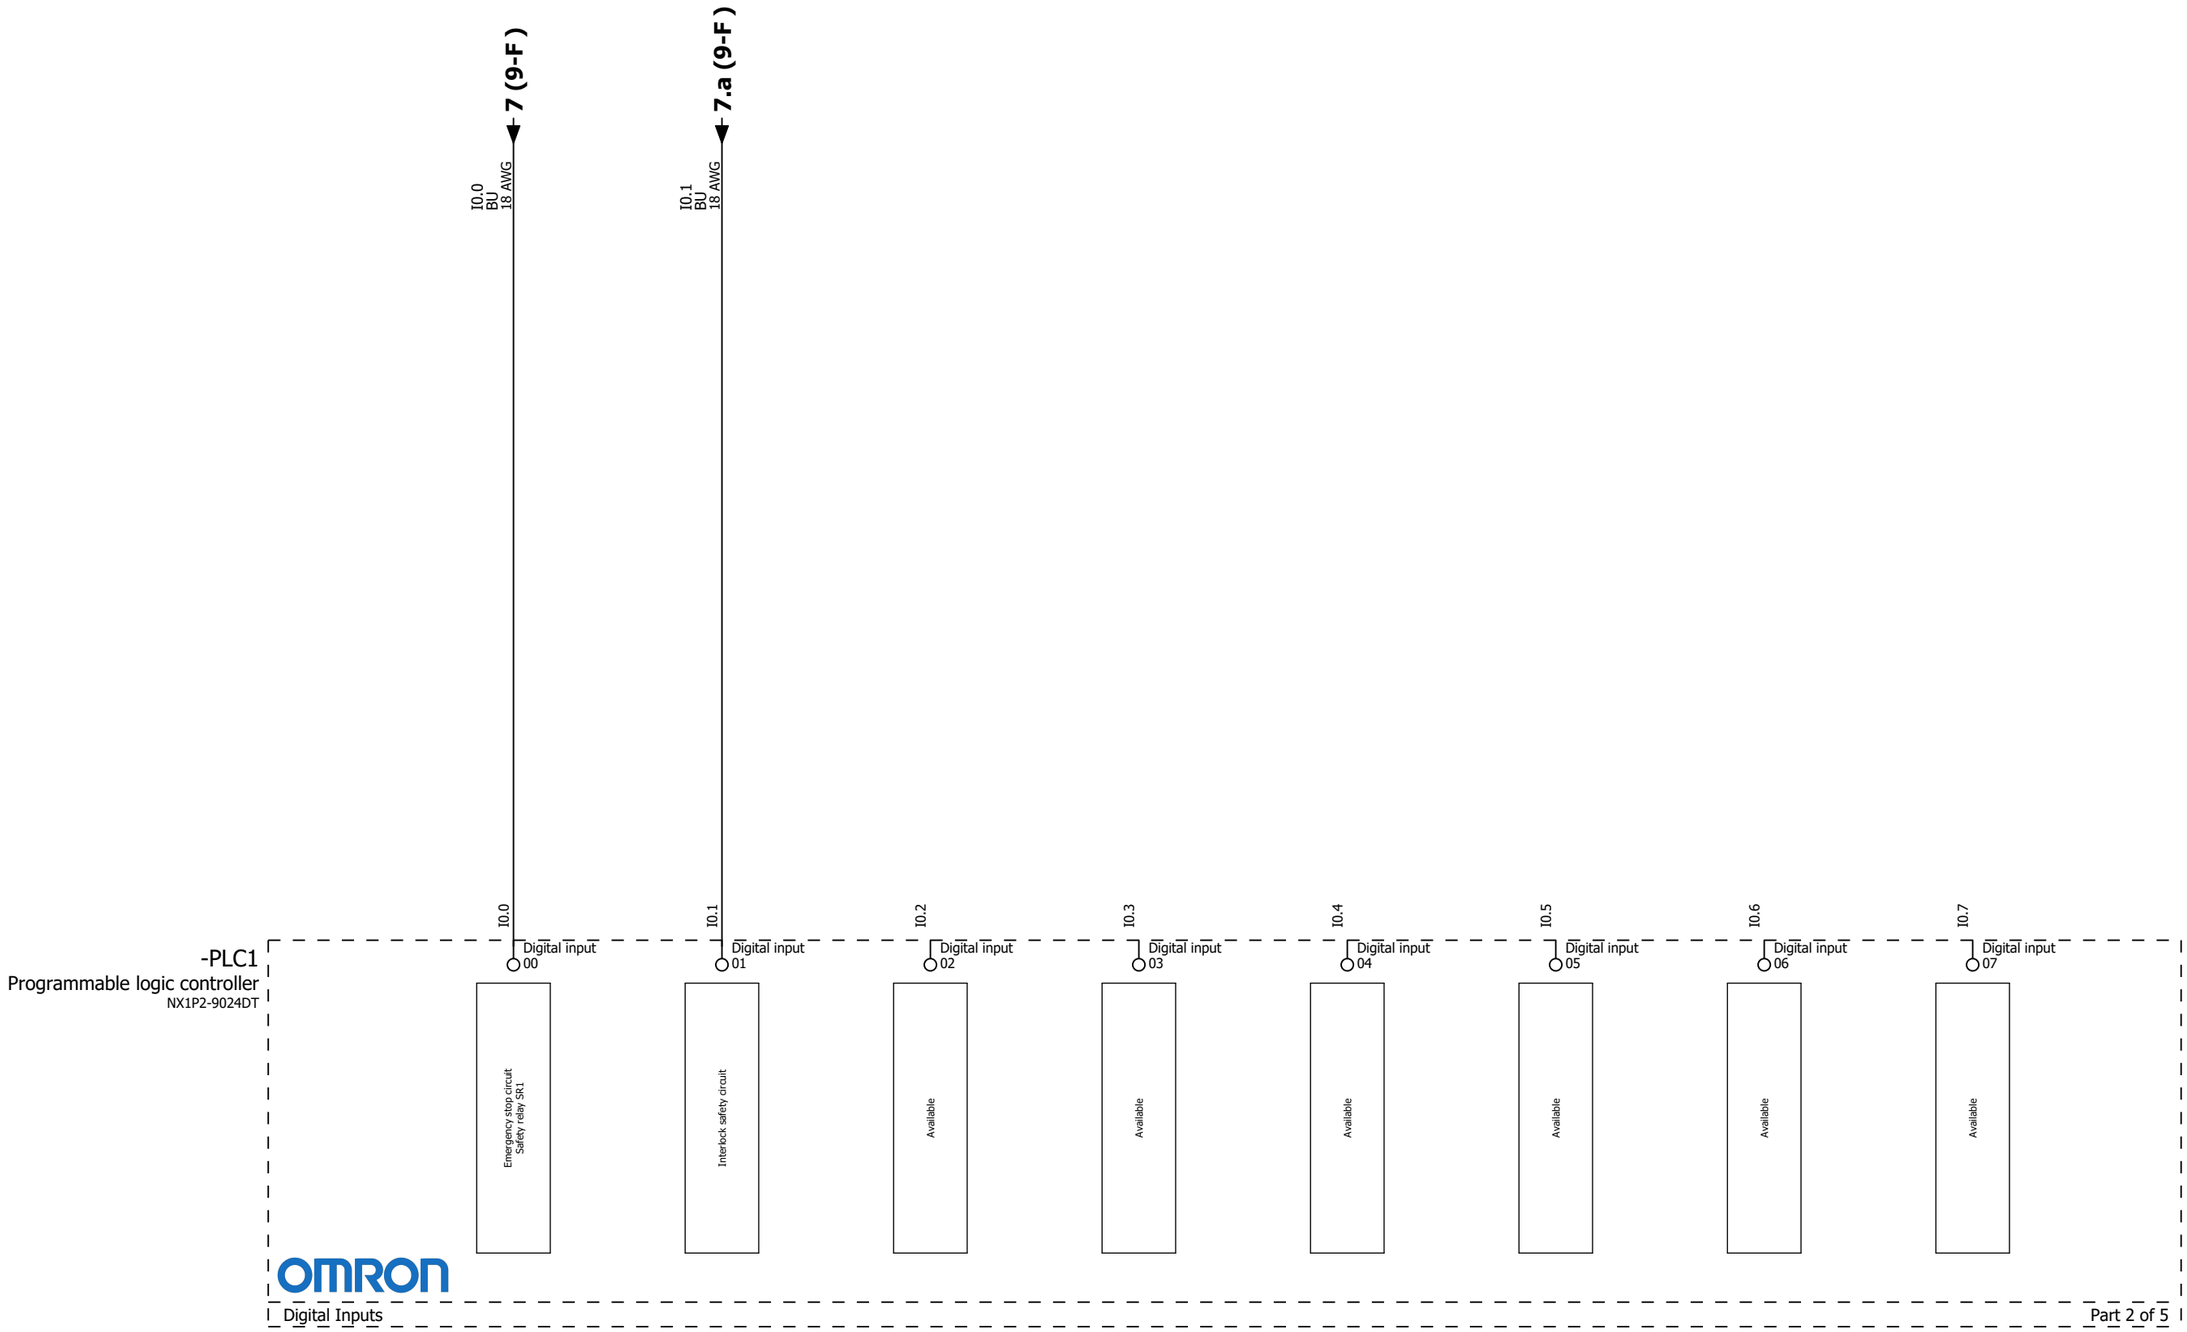

Automatyco®
Automatización,
Mantenimiento y Construcción
Condominio Industrial Siglo 21,
Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	30/12/2025	Project's name	Page name	Facility 24VCD
Client: Pegatron	Modified	03/01/2026	NV9X CP	PLC/Digital inputs connections	Mounting location GC
PEGATRON	Revision	0	Station name		Sheet 5.g
	Responsible	EPLAN	ST 60		Page 45 / 83

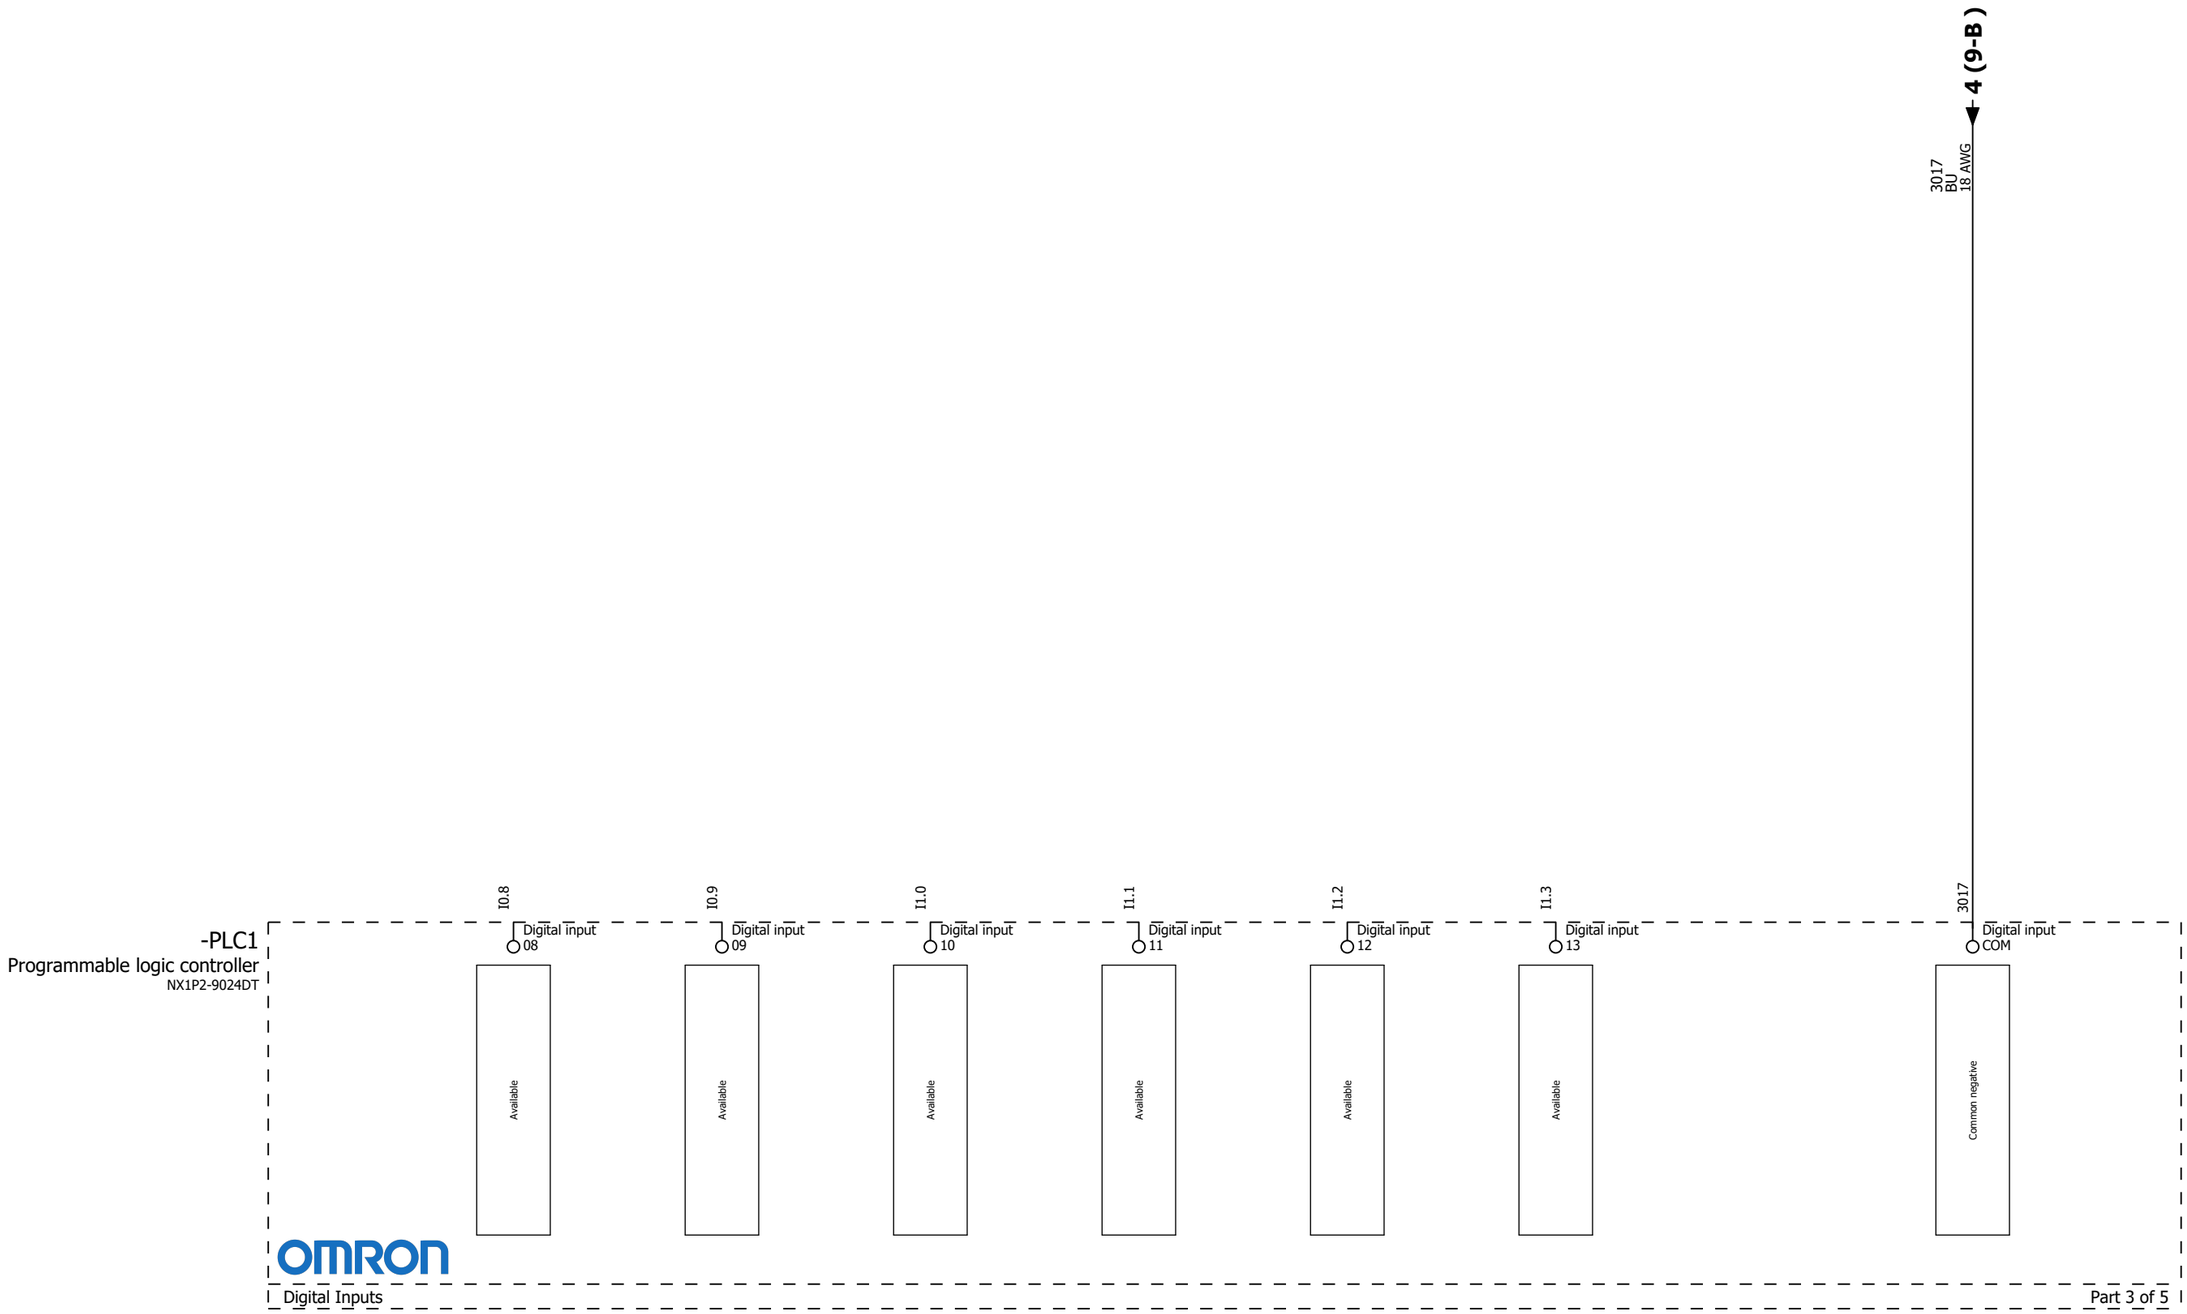

Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	30/12/2025	Project's name
Client: Pegatron	Modified	16/02/2026	NV9X CP
PEGATRON	Revision	0	Station name
	Responsible	EPLAN	ST 60


Page name
PLC/Digital inputs connections

Facility	24VCD
Mounting location	GC
Sheet	5.h
Page	46 / 83

-PLC1

Programmable logic controller

NX1P2-9024DT

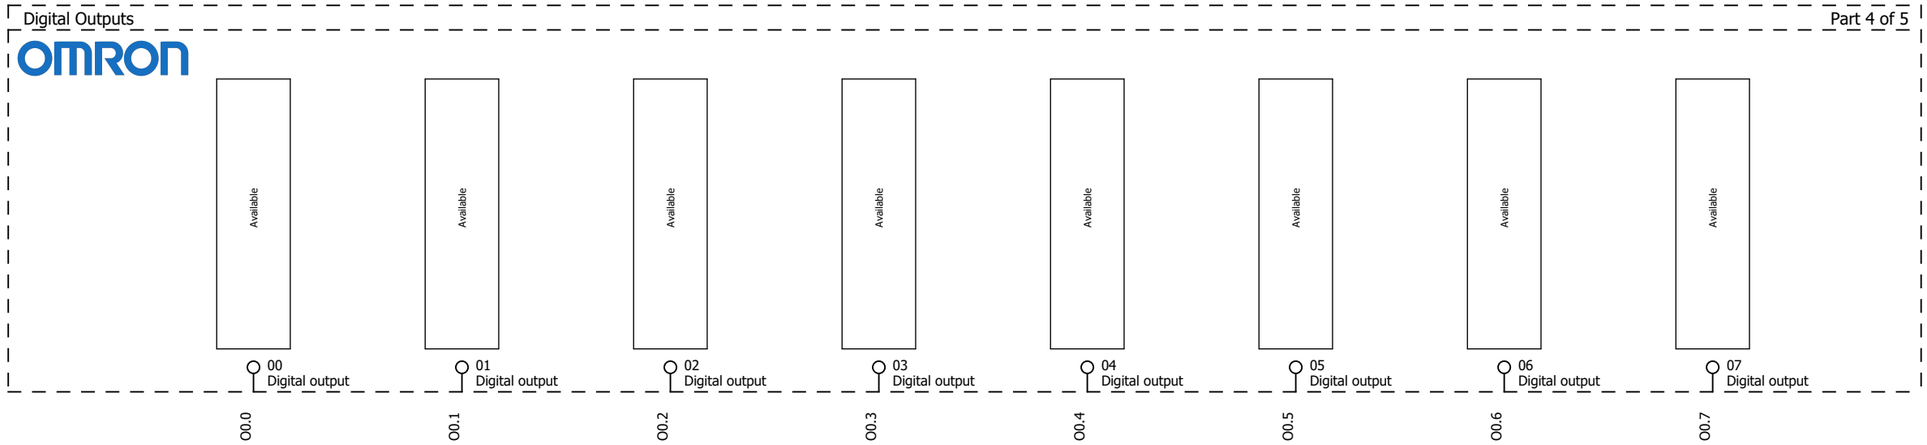

-PLC1
Programmable logic controller
NX1P2-9024DT

Digital Outputs

Part 5 of 5

Available

Available

Common negative

08
Digital output

09
Digital output

CO (0V)
Digital output


O0.8

O0.9


3018


3018
BU
18 AWG

4 (9-B)

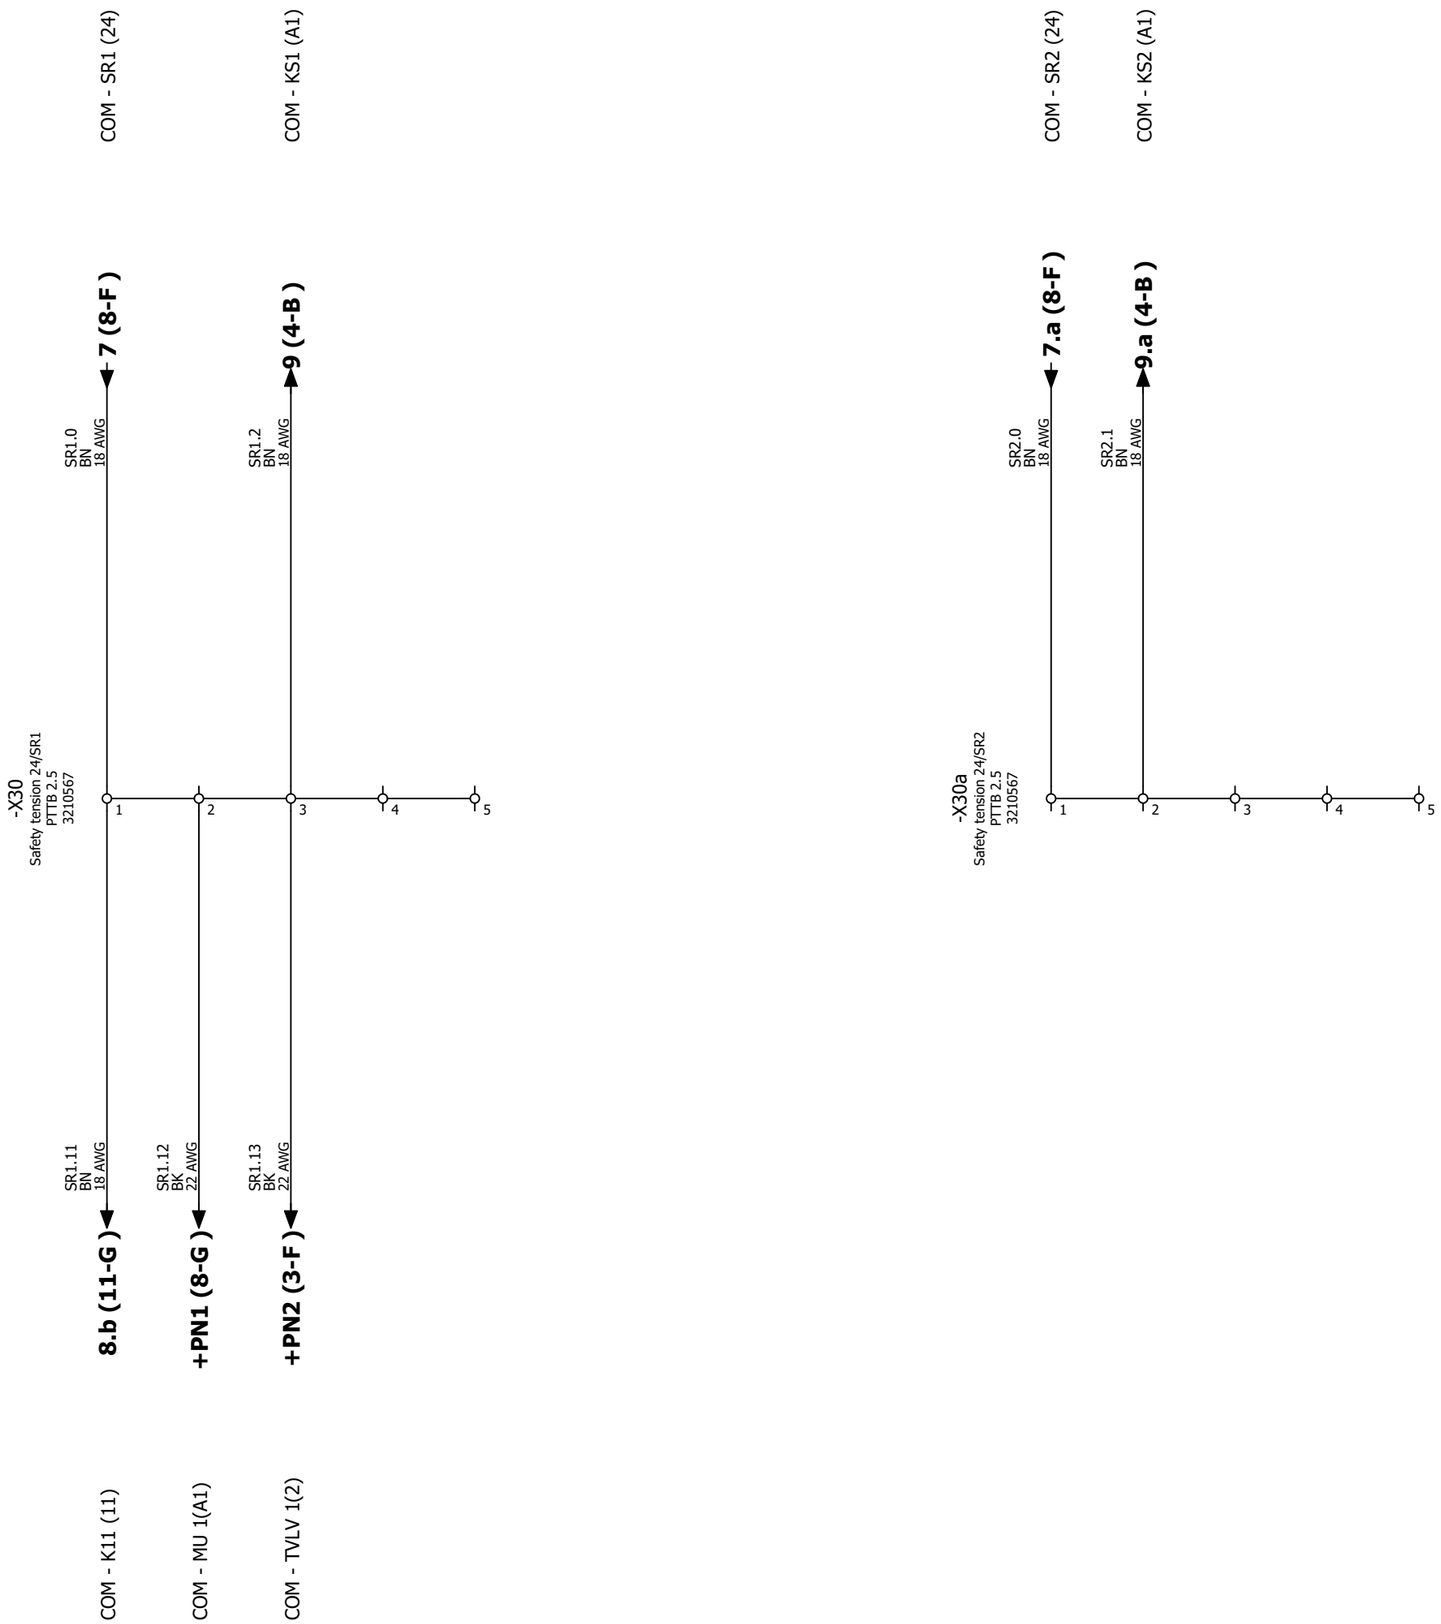


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Safety terminal connections	Mounting location GC
		Revision	0	Station name		Sheet 6
		Responsible	EPLAN	ST 60		Page 49 / 83

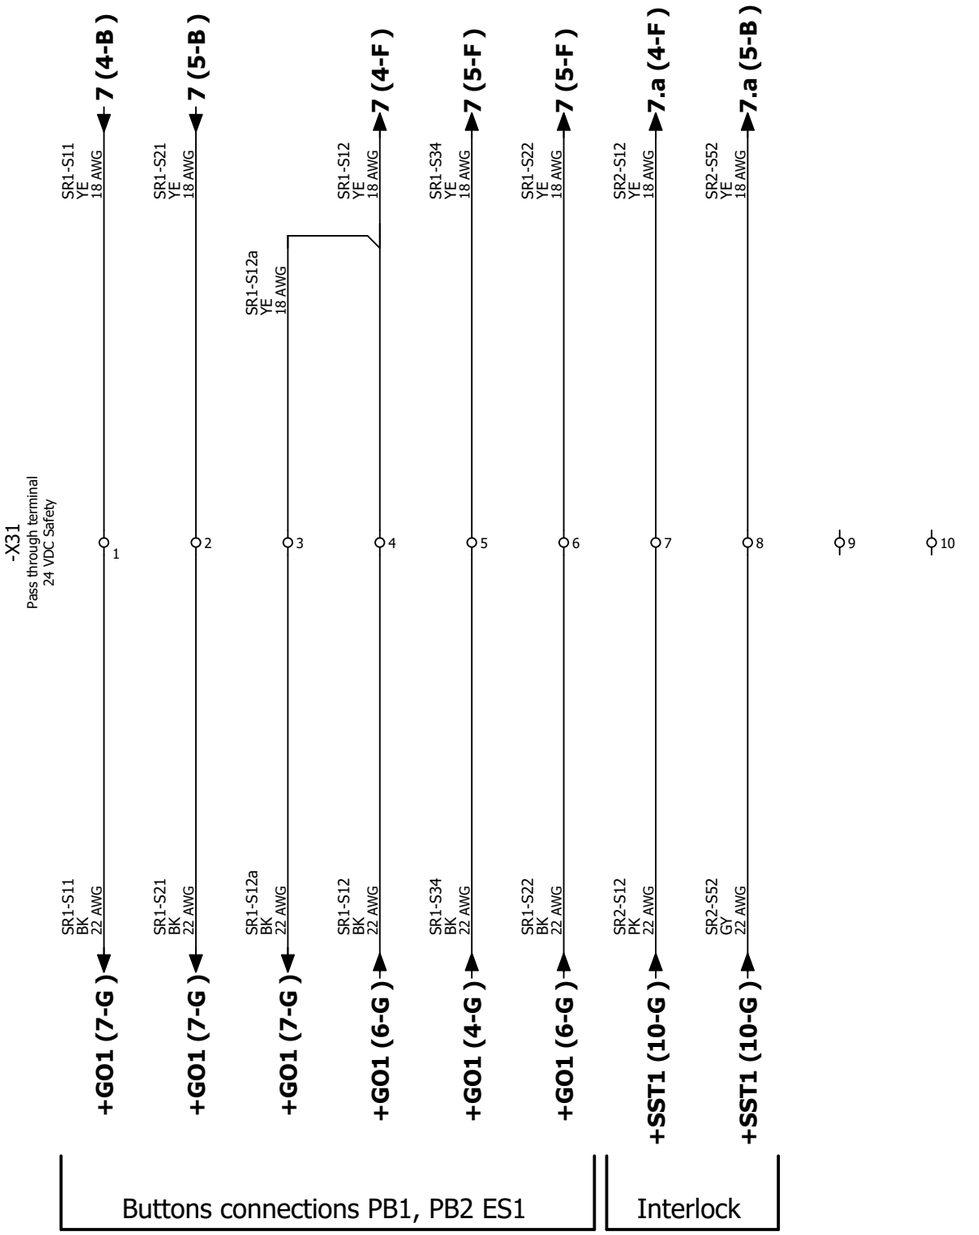

-X31
Pass through terminal
24 VDC Safety
SR1-S11
YE
18 AWG
7 (4-B)
SR1-S21
YE
18 AWG
7 (5-B)
SR1-S12a
YE
18 AWG
SR1-S12
YE
18 AWG
7 (4-F)
SR1-S34
YE
18 AWG
7 (5-F)
SR1-S22
YE
18 AWG
7 (5-F)
SR2-S12
YE
18 AWG
7.a (4-F)
SR2-S52
YE
18 AWG
7.a (5-B)
1
2
3
4
5
6
7
8
9
10
SR1-S11
BK
22 AWG
+GO1 (7-G)
SR1-S21
BK
22 AWG
+GO1 (7-G)
SR1-S12a
BK
22 AWG
+GO1 (7-G)
SR1-S12
BK
22 AWG
+GO1 (6-G)
SR1-S34
BK
22 AWG
+GO1 (4-G)
SR1-S22
BK
22 AWG
+GO1 (6-G)
SR2-S12
PK
22 AWG
+SST1 (10-G)
SR2-S52
GY
22 AWG
+SST1 (10-G)
Buttons connections PB1, PB2 ES1
Interlock

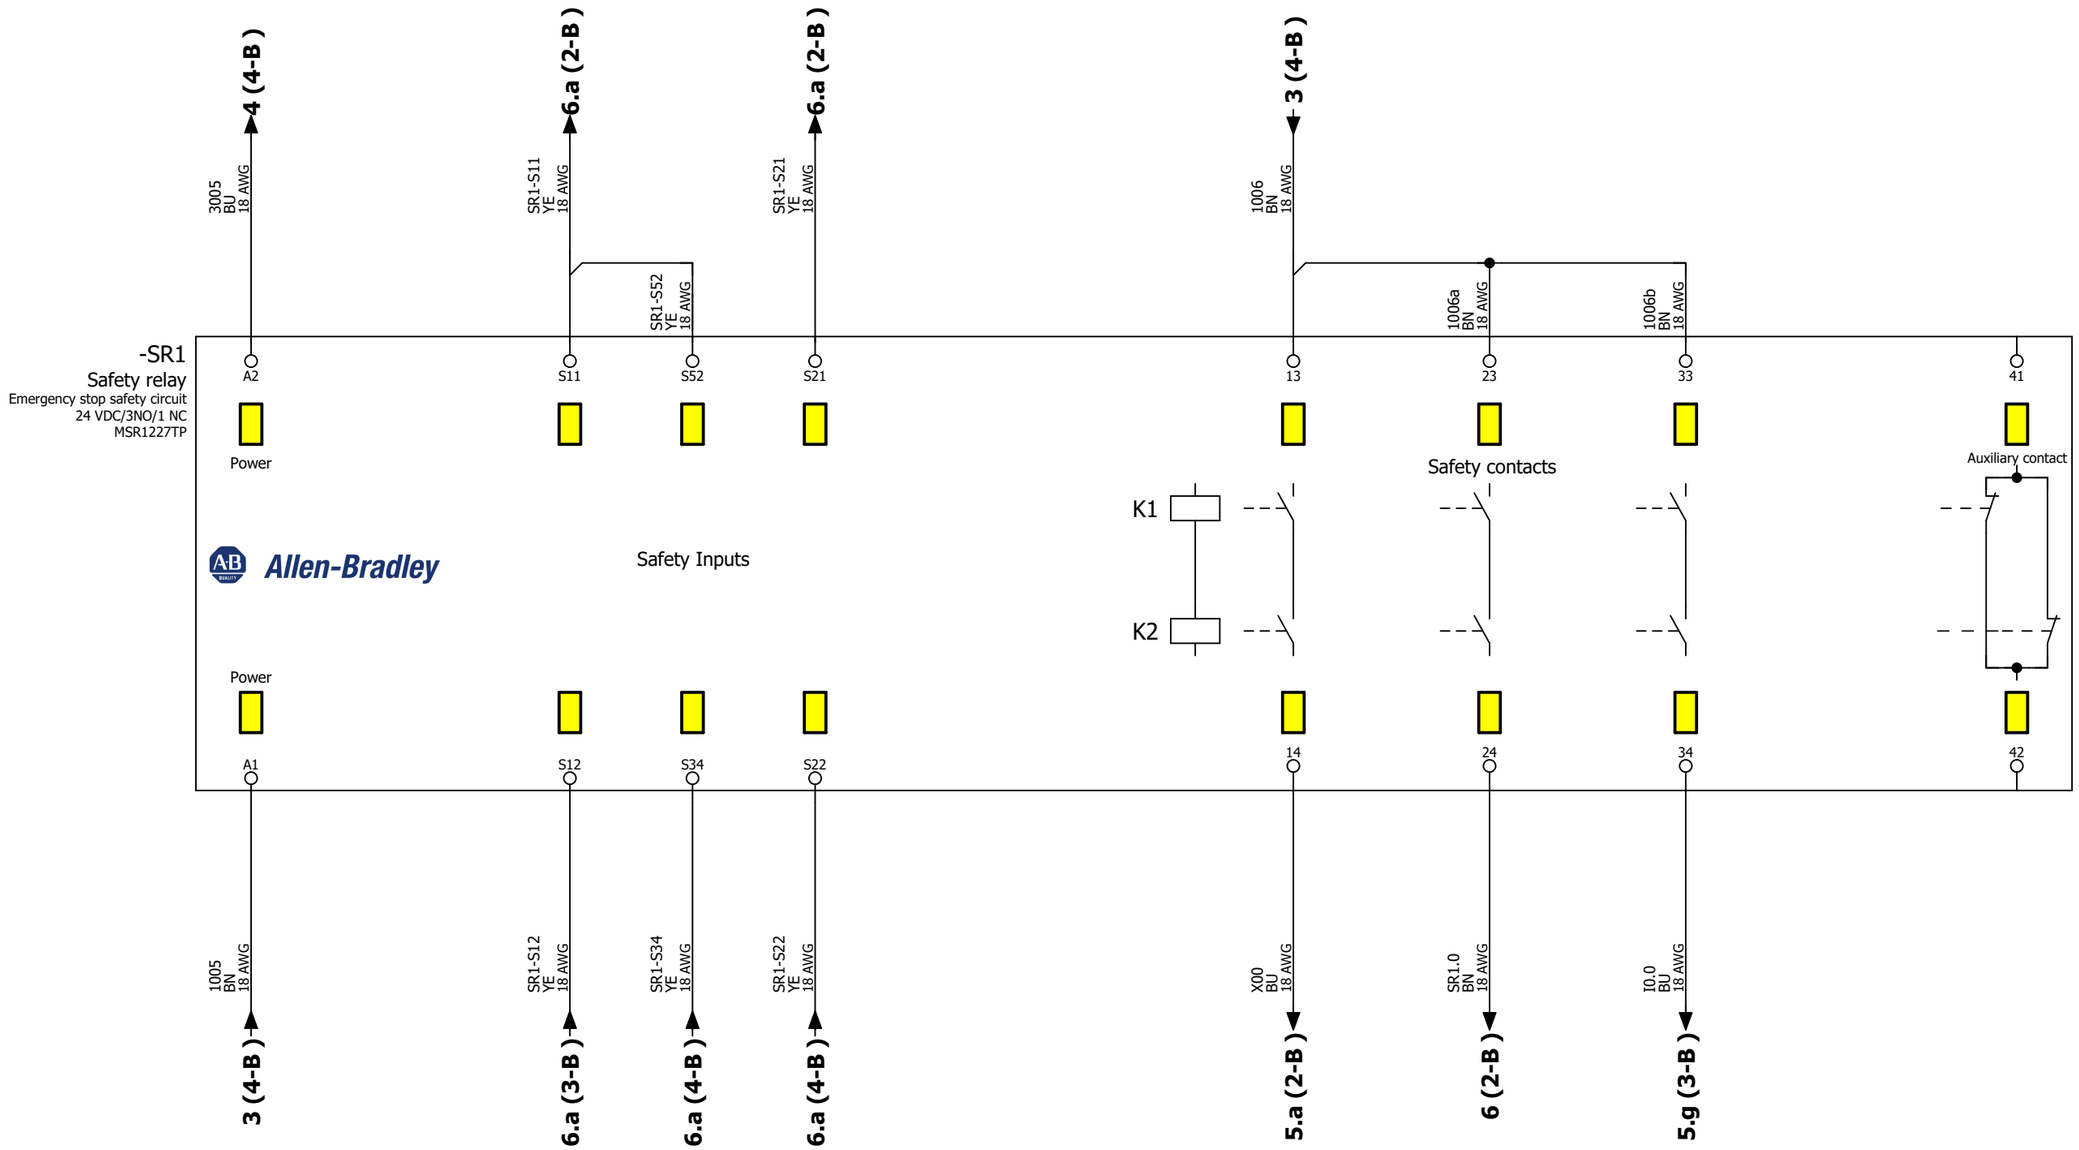


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Safety relay connections SR1	Mounting location GC
		Revision	0	Station name		Sheet 7
		Responsible	EPLAN	ST 60		Page 51 / 83

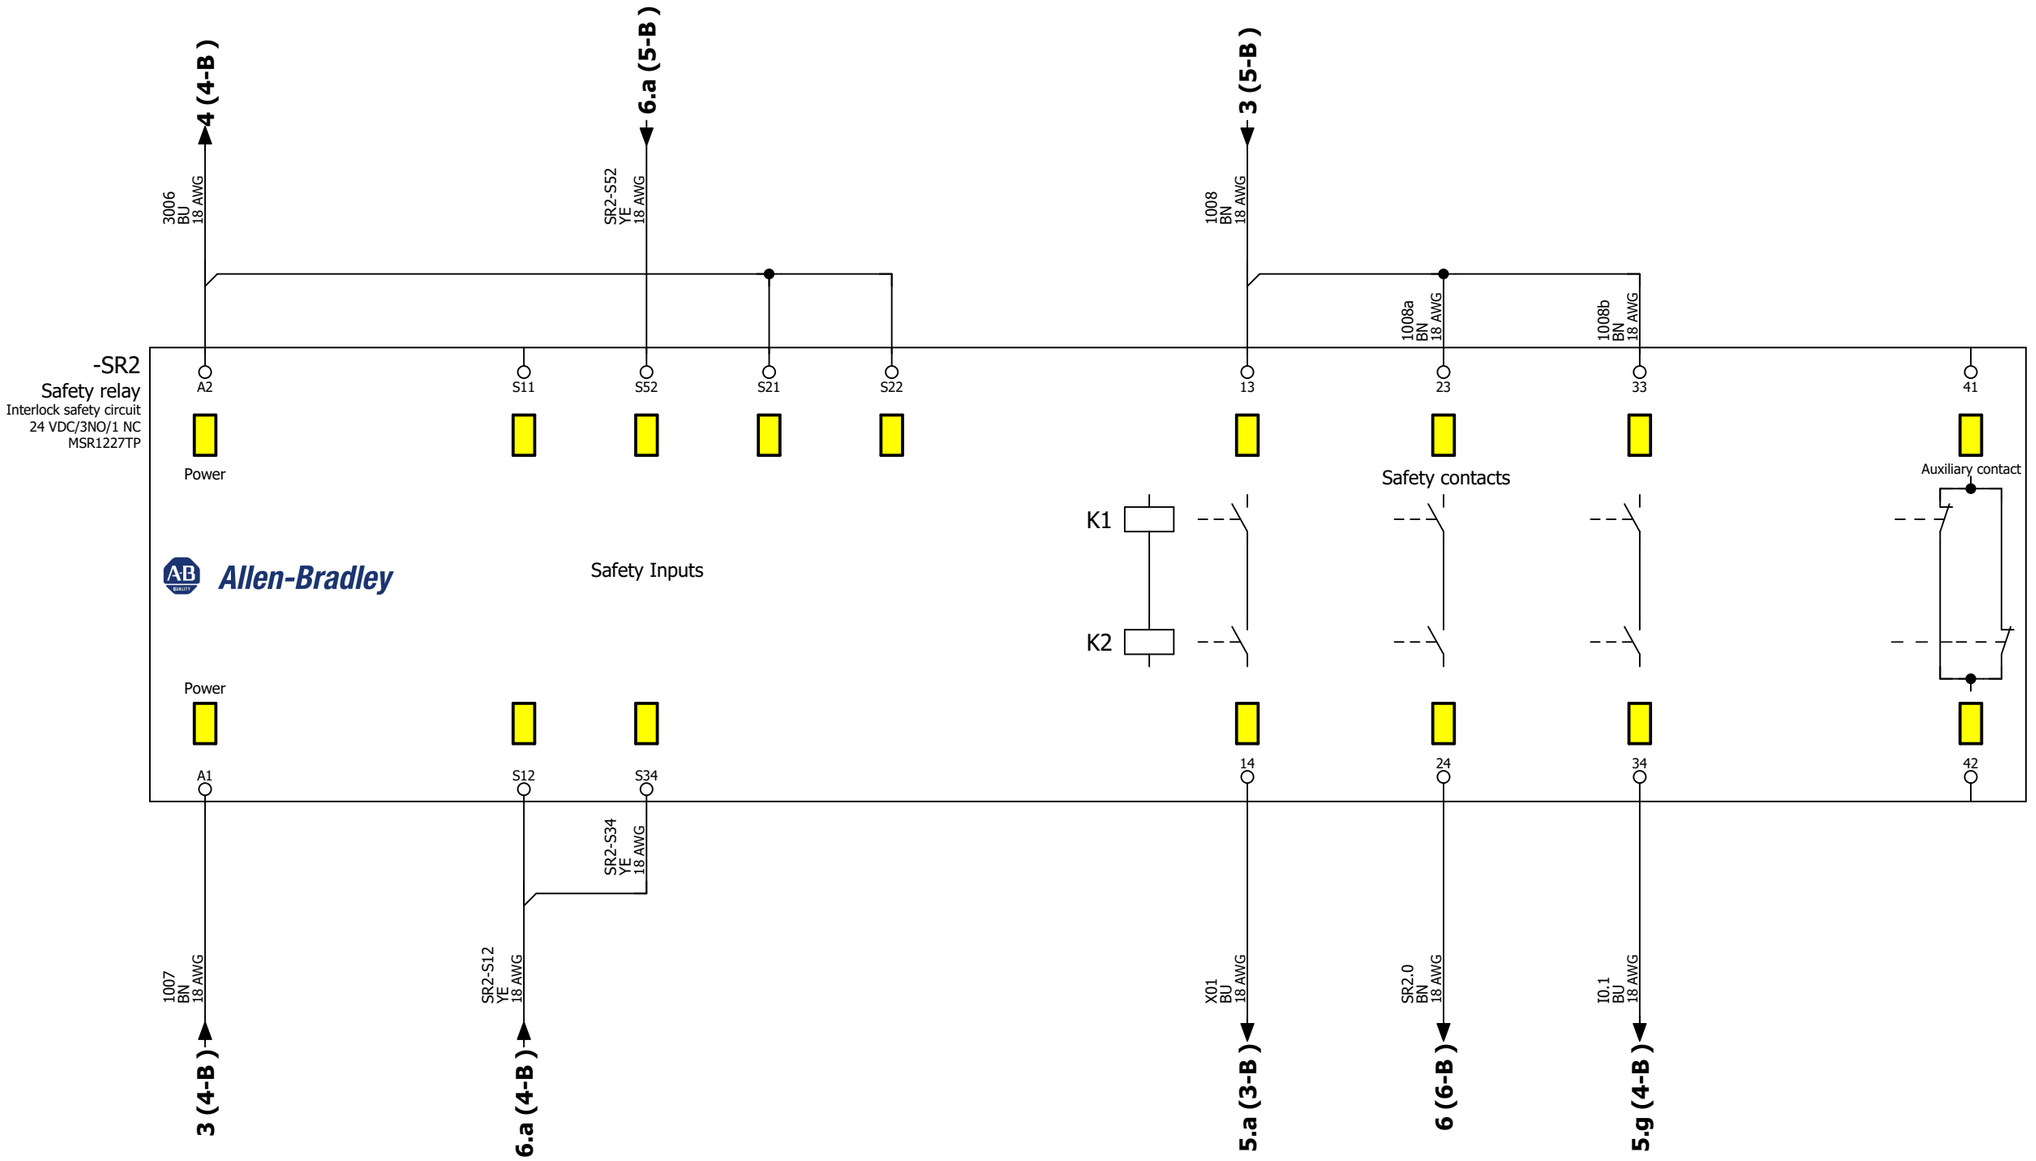


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron	Modified	19/05/2026	NV9X CP	Safety relay connections SR2	Mounting location GC
		PEGATRON	Revision	0	Station name		Sheet 7.a
			Responsible	EPLAN	ST 60		Page 52 / 83

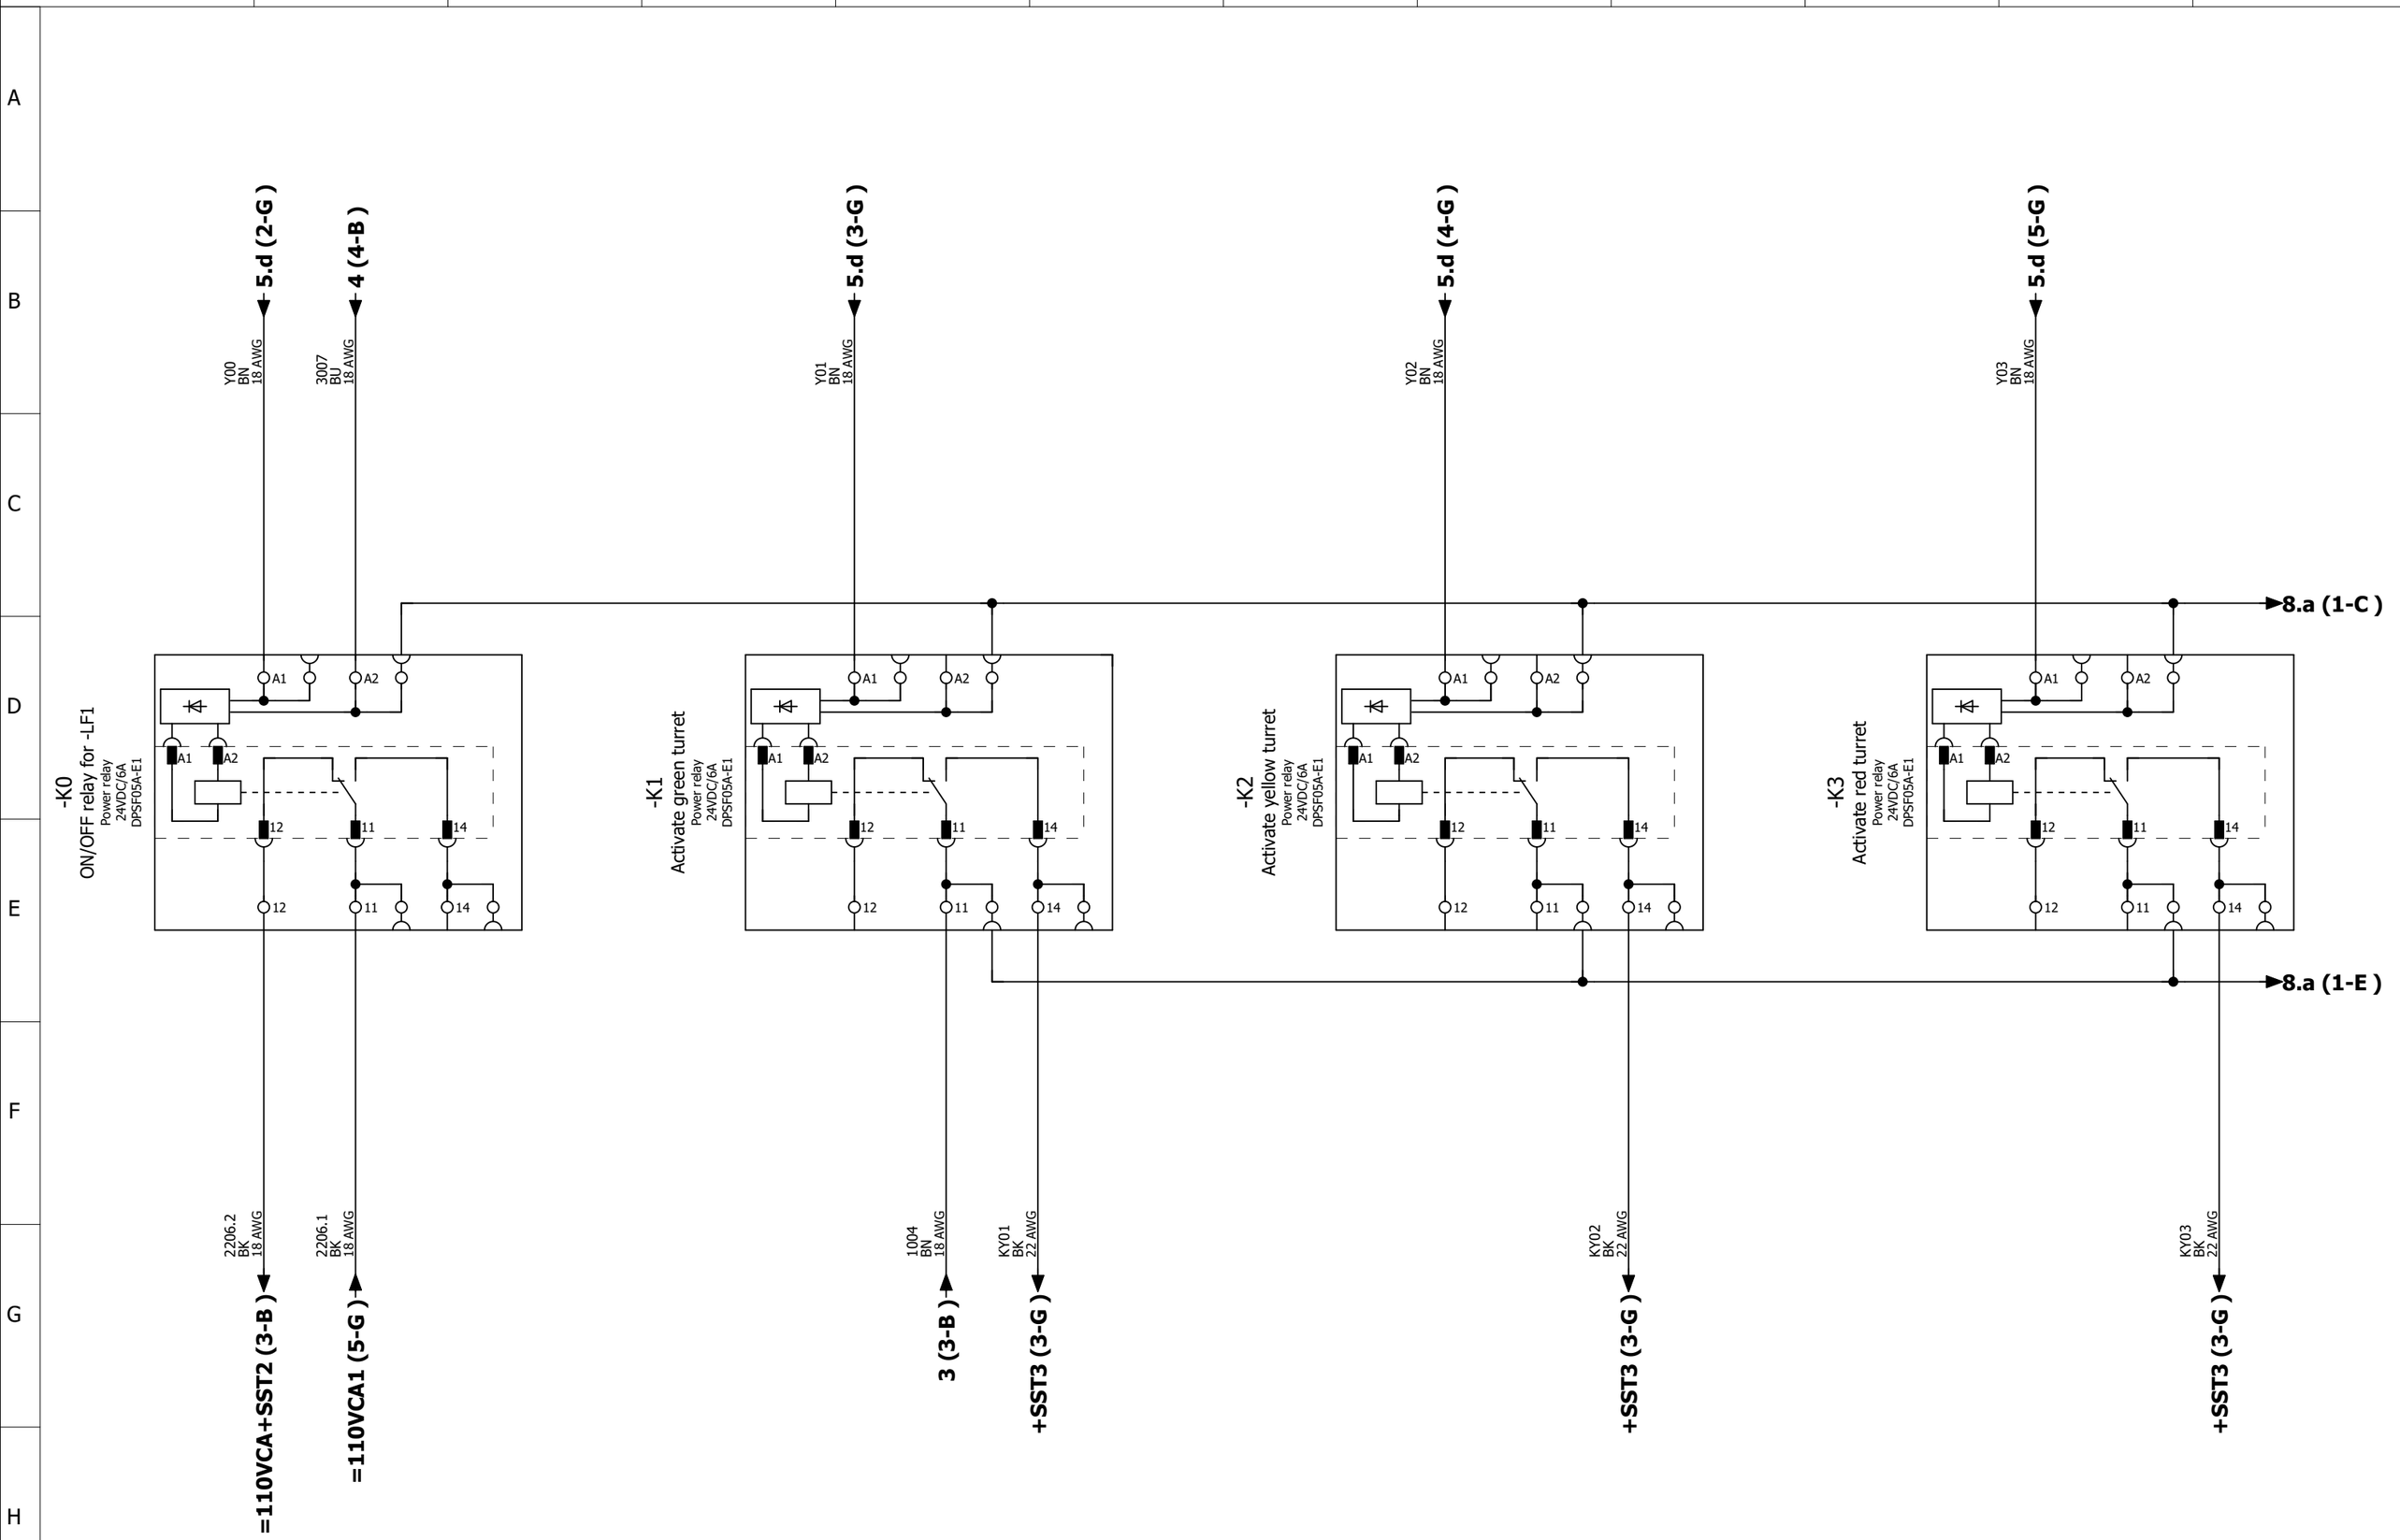

Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility	24VCD
	Client: Pegatron PEGATRON	Modified	27/03/2026	NV9X CP	Power relay connections	Mounting location	GC
		Revision	0	Station name		Sheet	8
		Responsible	EPLAN	ST 60		Page	53 / 83

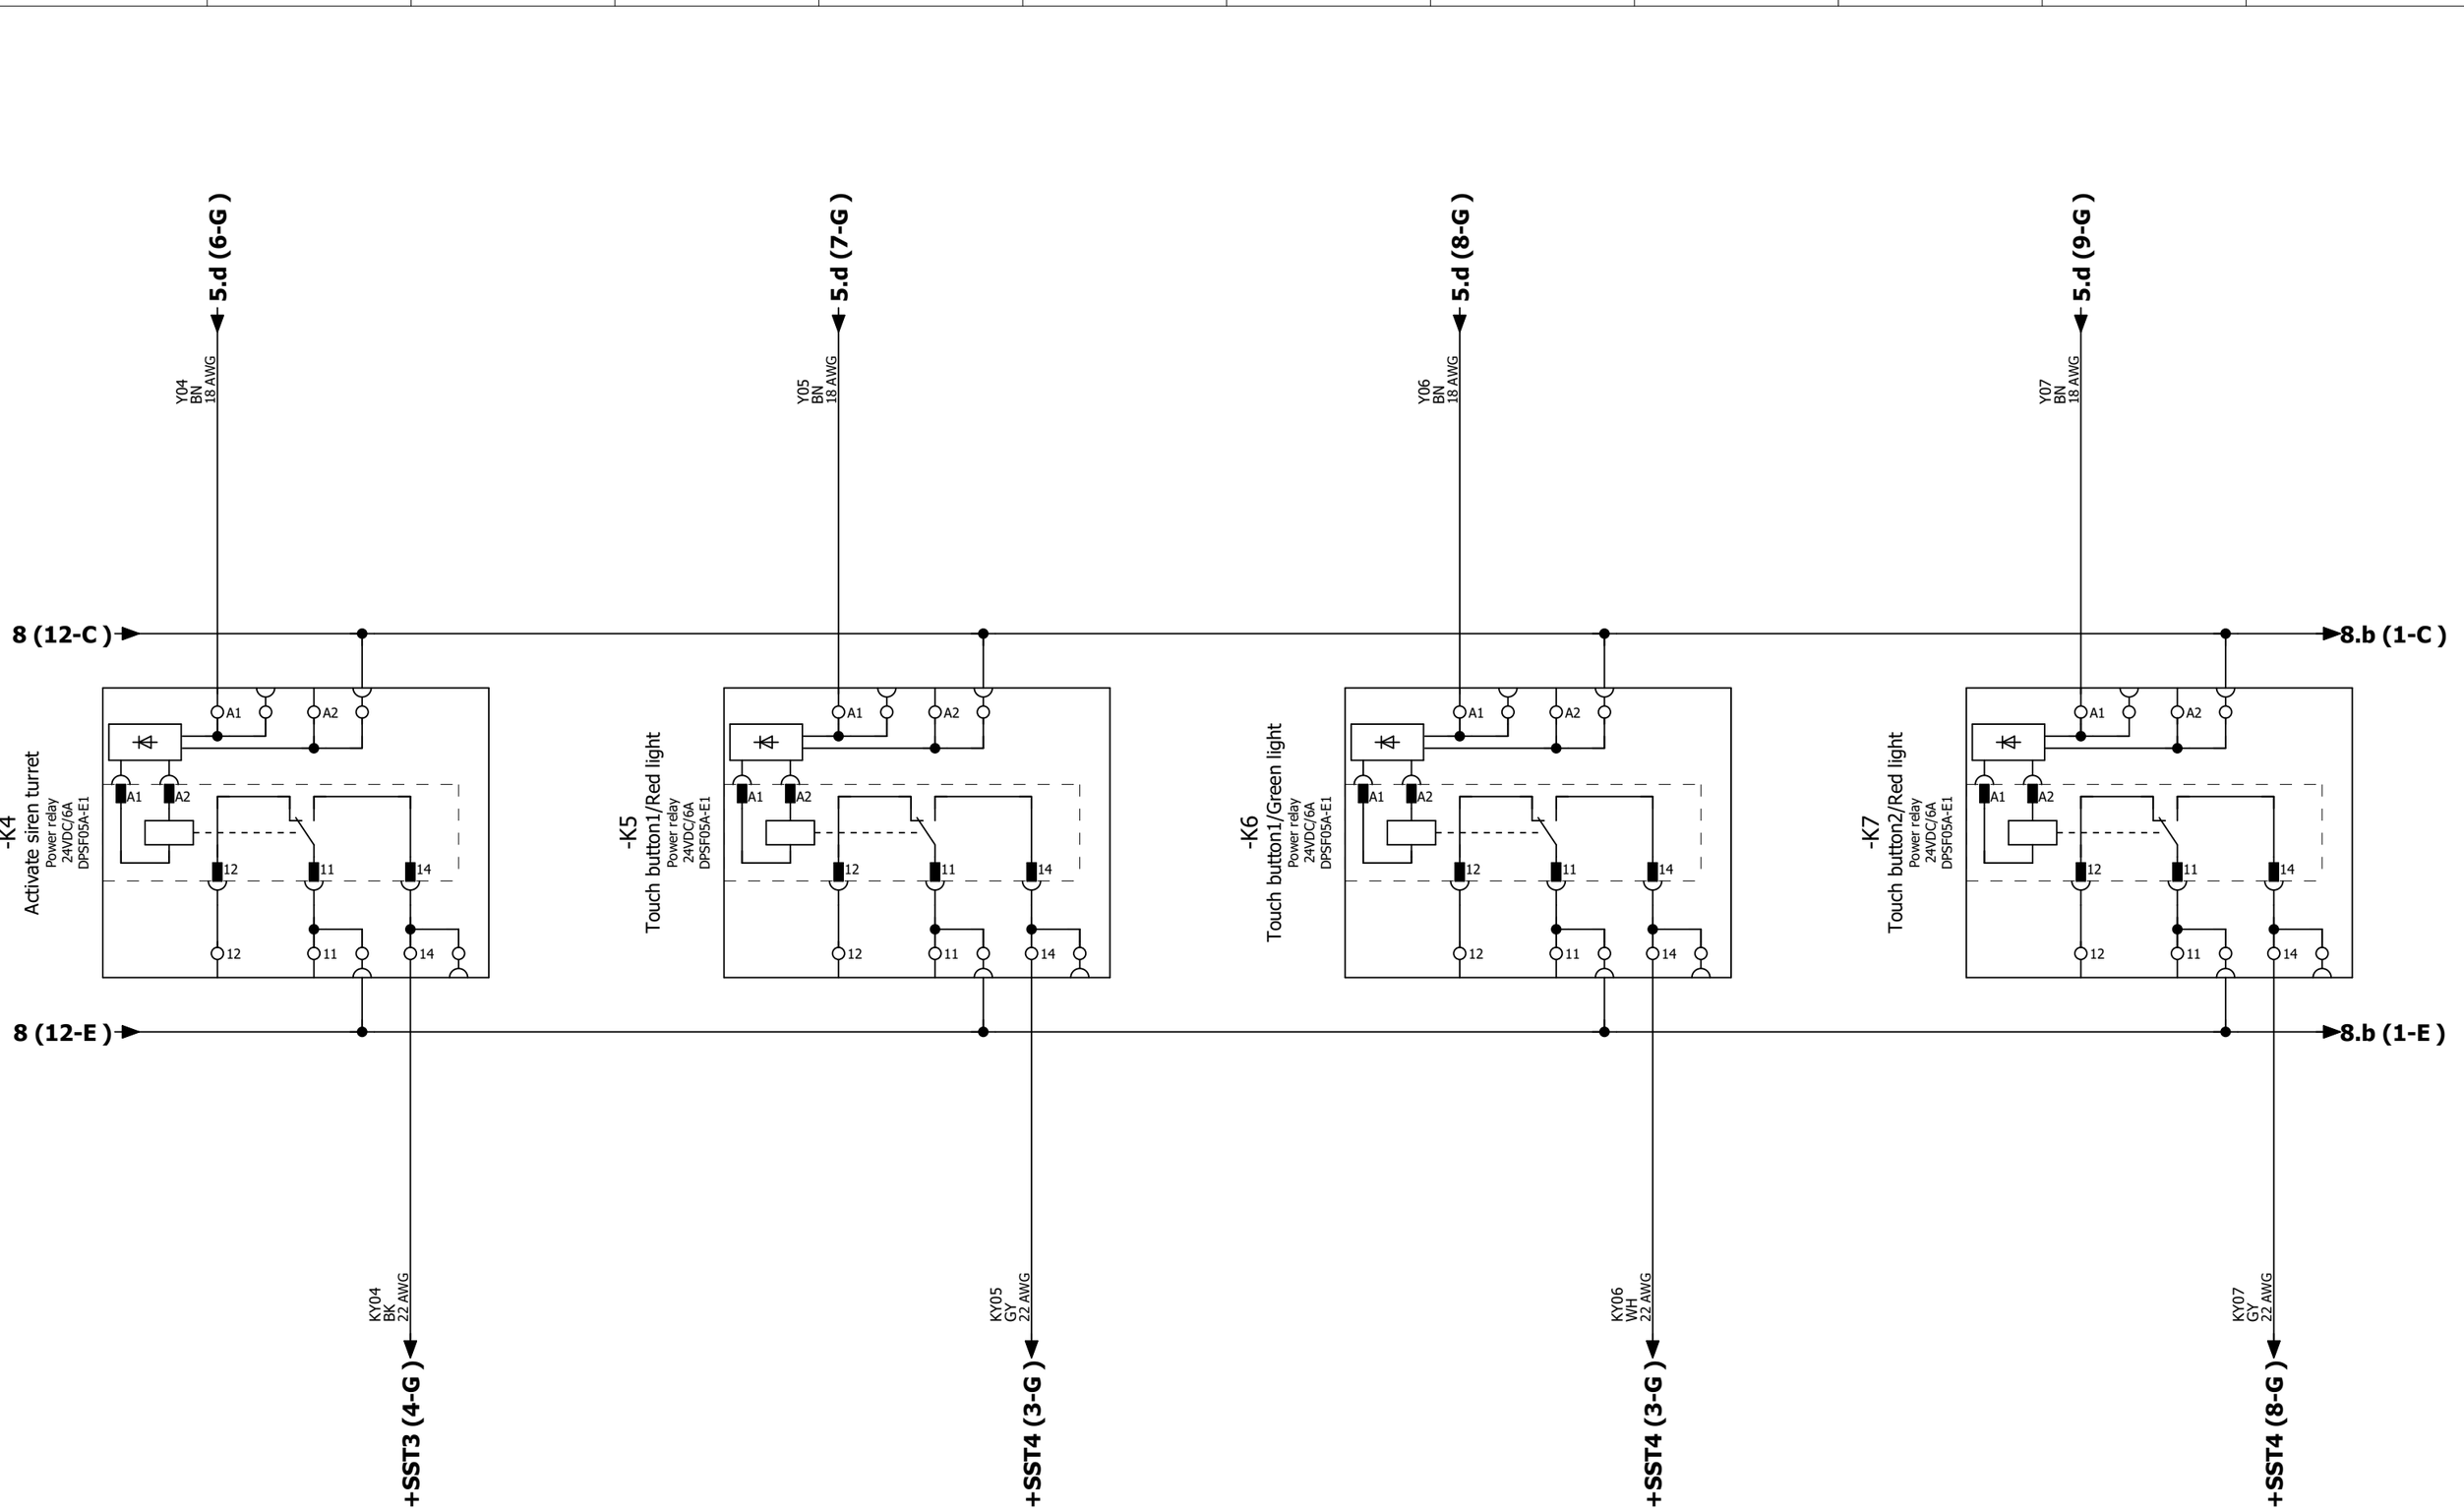

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	27/03/2026	NV9X CP	Power relay connections	Mounting location GC
			Revision	0	Station name		Sheet 8.a
			Responsible	EPLAN	ST 60		Page 54 / 83

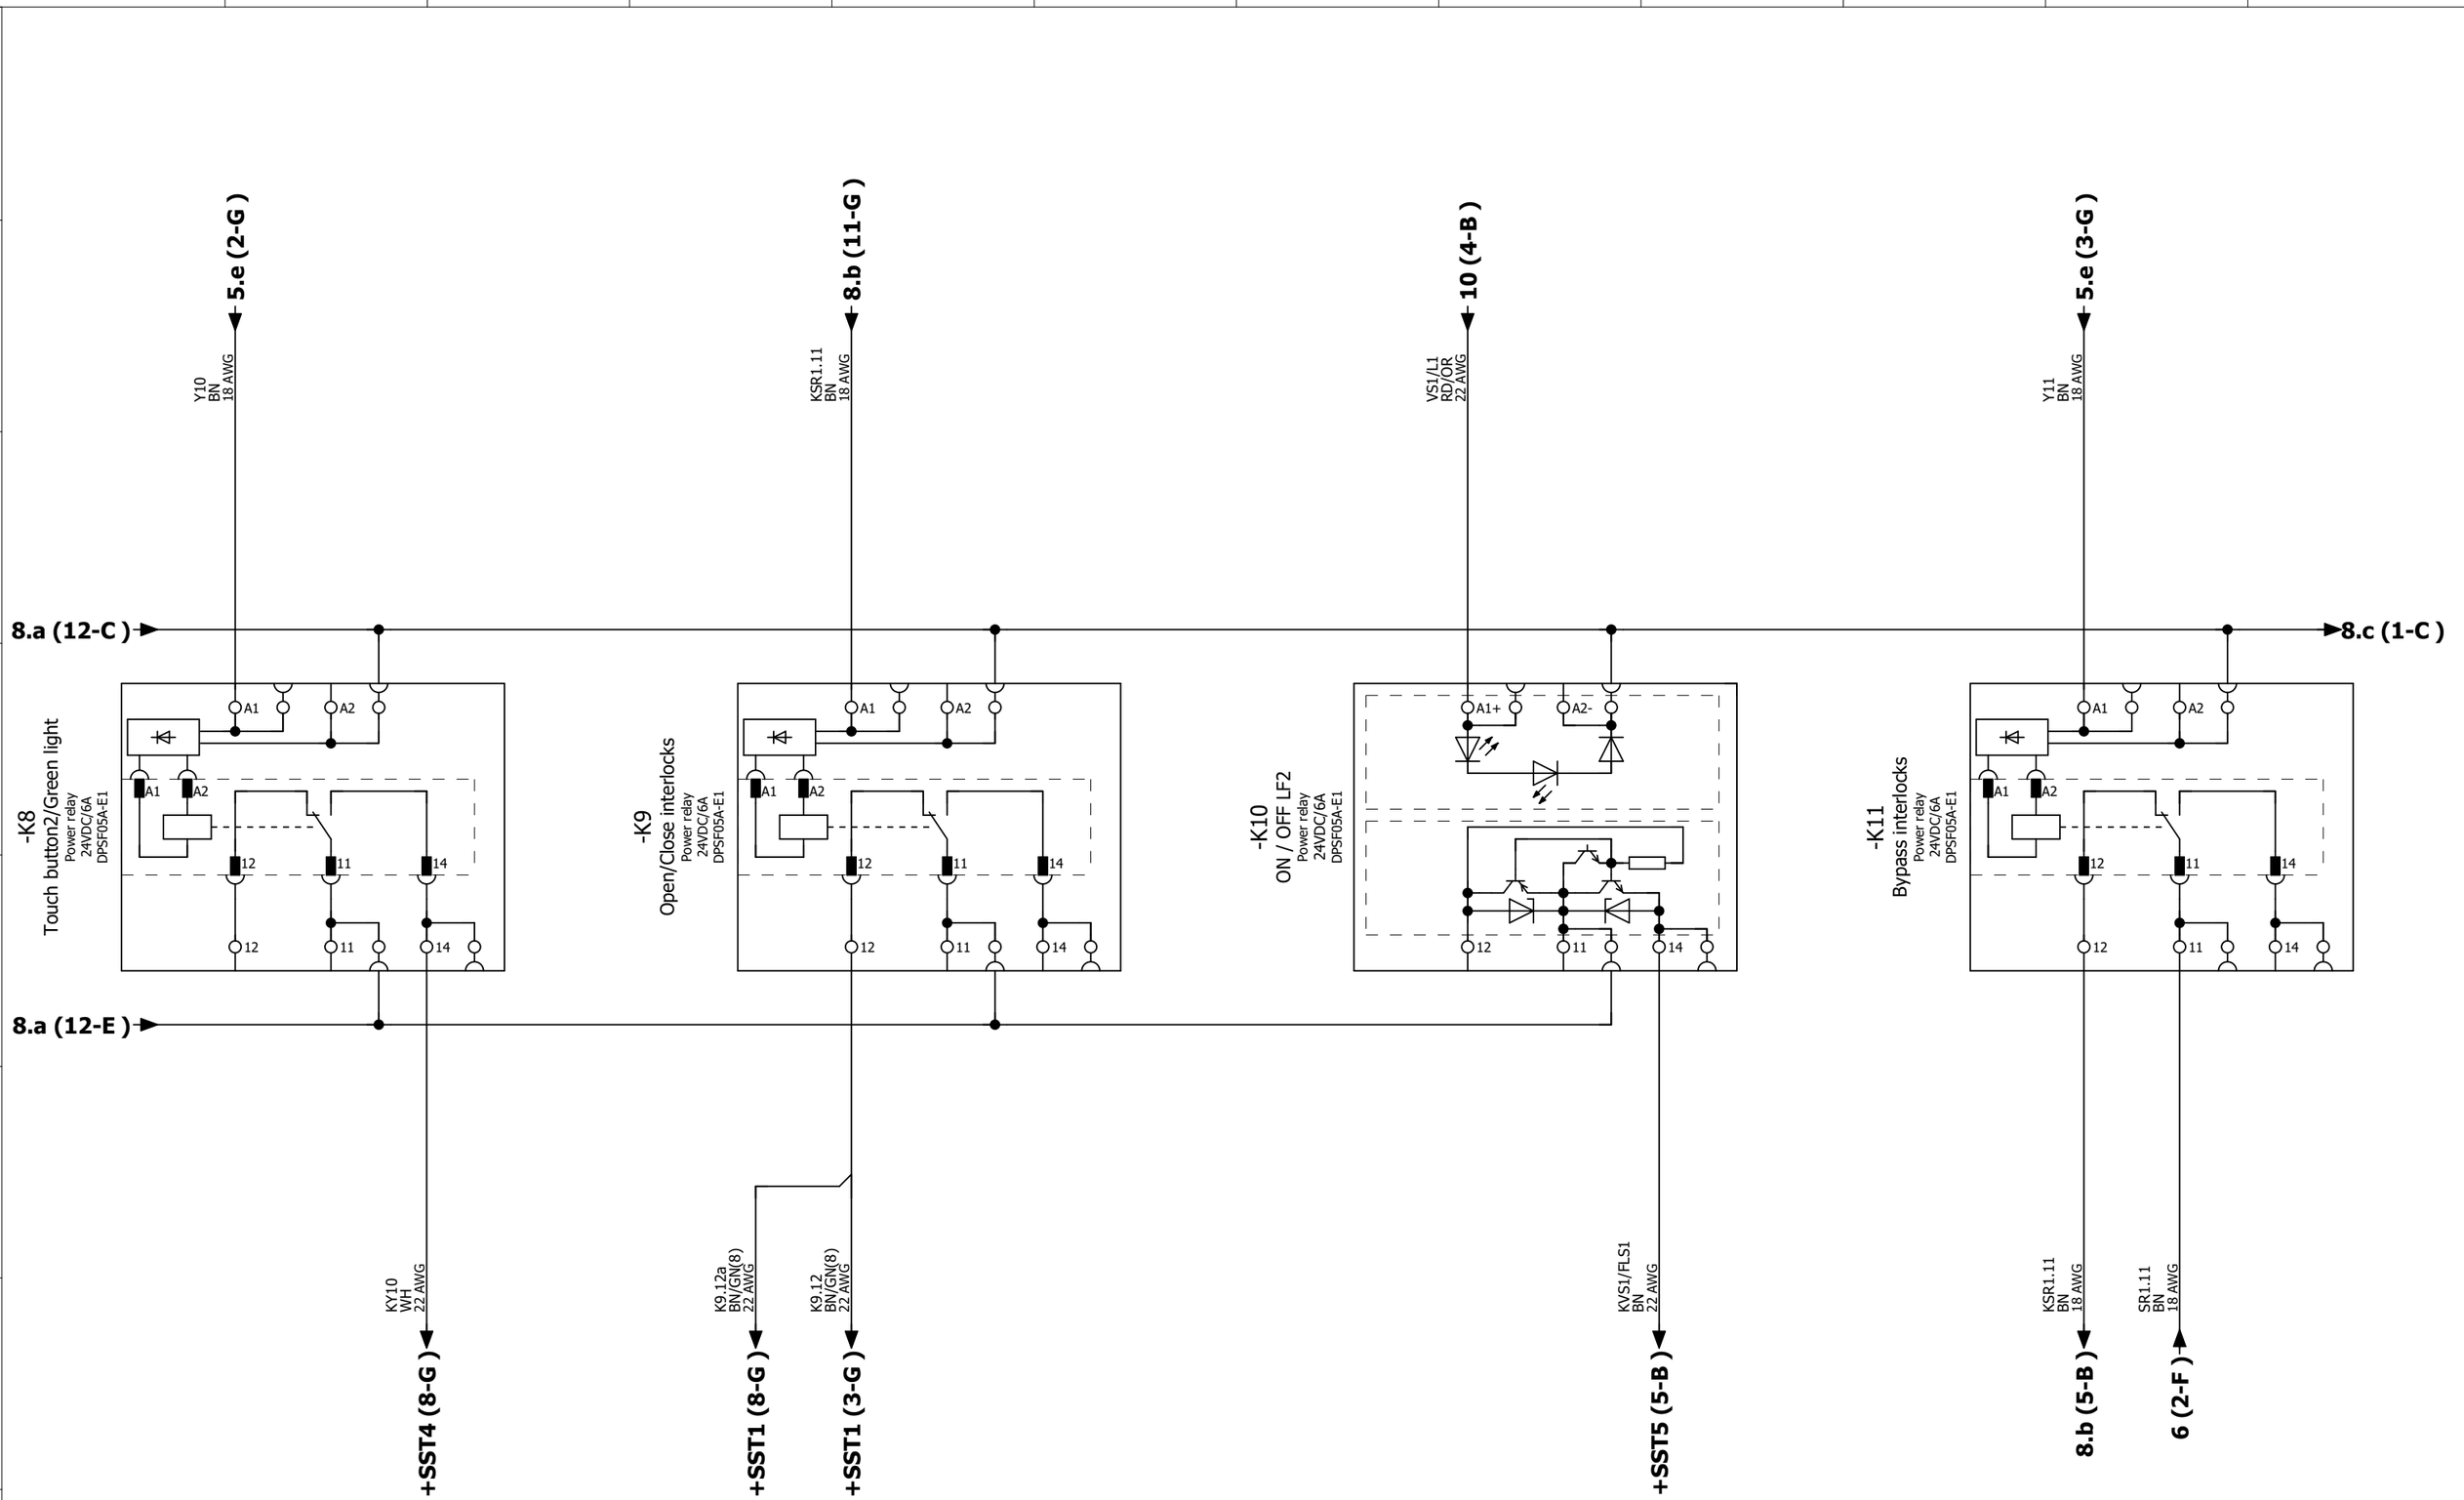

Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Power relay connections	Mounting location GC
	Revision	0	Station name		Sheet 8.b
	Responsible	EPLAN	ST 60		Page 55 / 83

2.a (2-G)

Y12.1
BN
18 AWG

8.b (12-C)

-K12
Voltage 48+
Power relay
24VDC/6A
DPSF05A-E1

A1 A2 12 11 14

KY12.11
BK
22 AWG

=220VCA+SST2 (9-E)

KY12.14
BK
22 AWG

8.c (5-G)

-K13
Voltage 48+
Power relay
24VDC/6A
DPSF05A-E1

A1 A2 12 11 14

KY13.12
BK
22 AWG

+SST10 (4-C)

KY13.14
BK
22 AWG

8.c (2-G)

2.a (5-G)

Y13.1
BN
18 AWG

8.d (1-C)

-K14
Voltage 48-
Power relay
24VDC/6A
DPSF05A-E1

A1 A2 12 11 14

KY14.11
BK
22 AWG

=220VCA+SST2 (9-E)

KY14.14
BK
22 AWG

8.c (11-G)

-K15
Voltage 48-
Power relay
24VDC/6A
DPSF05A-E1


A1 A2 12 11 14


KY15.12
BK
22 AWG

+SST10 (4-C)


KY15.14
BK
22 AWG

8.c (9-G)

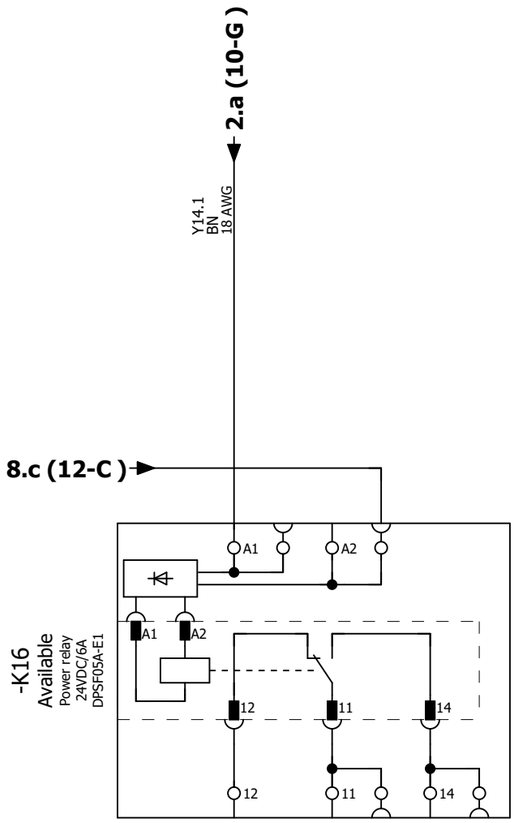

2.a (10-G)
Y14.1
BN
18 AWG
8.c (12-C)
A1
A2
-K16
Available
Power relay
24VDC/6A
DPSF05A-E1
A1
A2
12
11
14
12
11
14

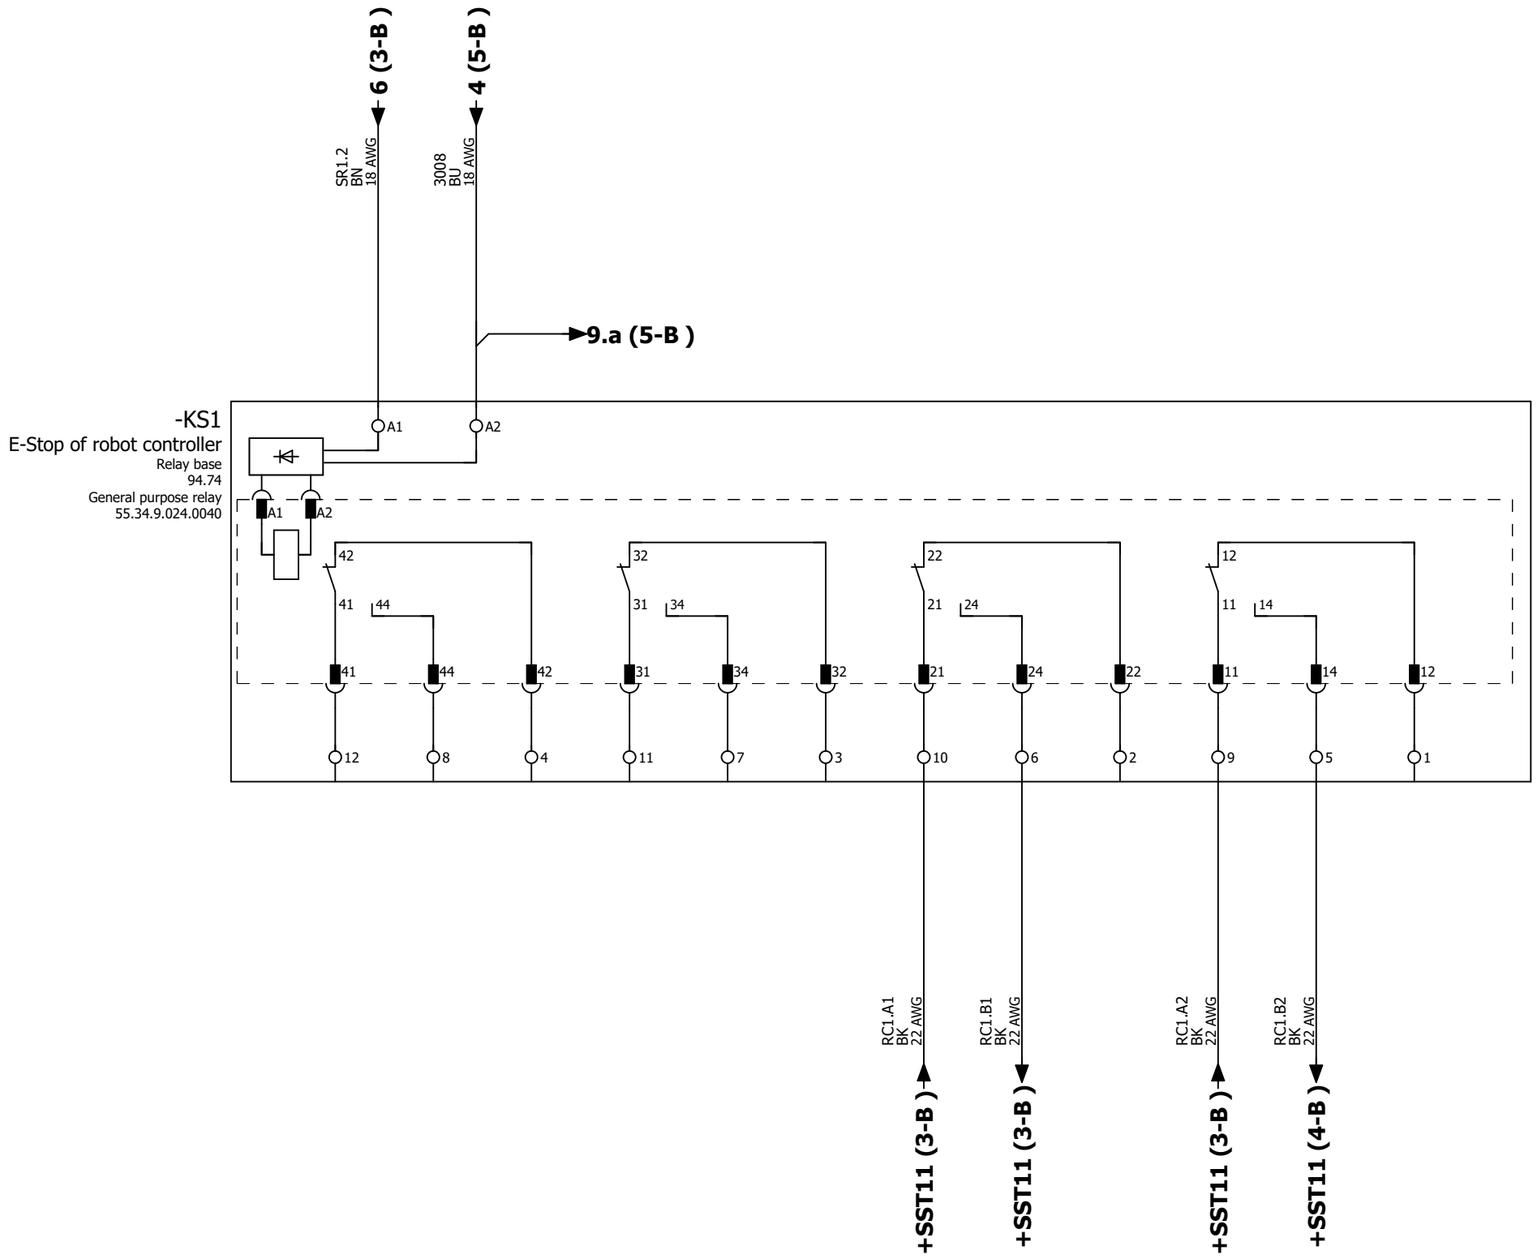


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zúñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility	24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Rele connections KS1	Mounting location	GC
		Revision	0	Station name		Sheet	9
		Responsible	EPLAN	ST 60		Page	58 / 83

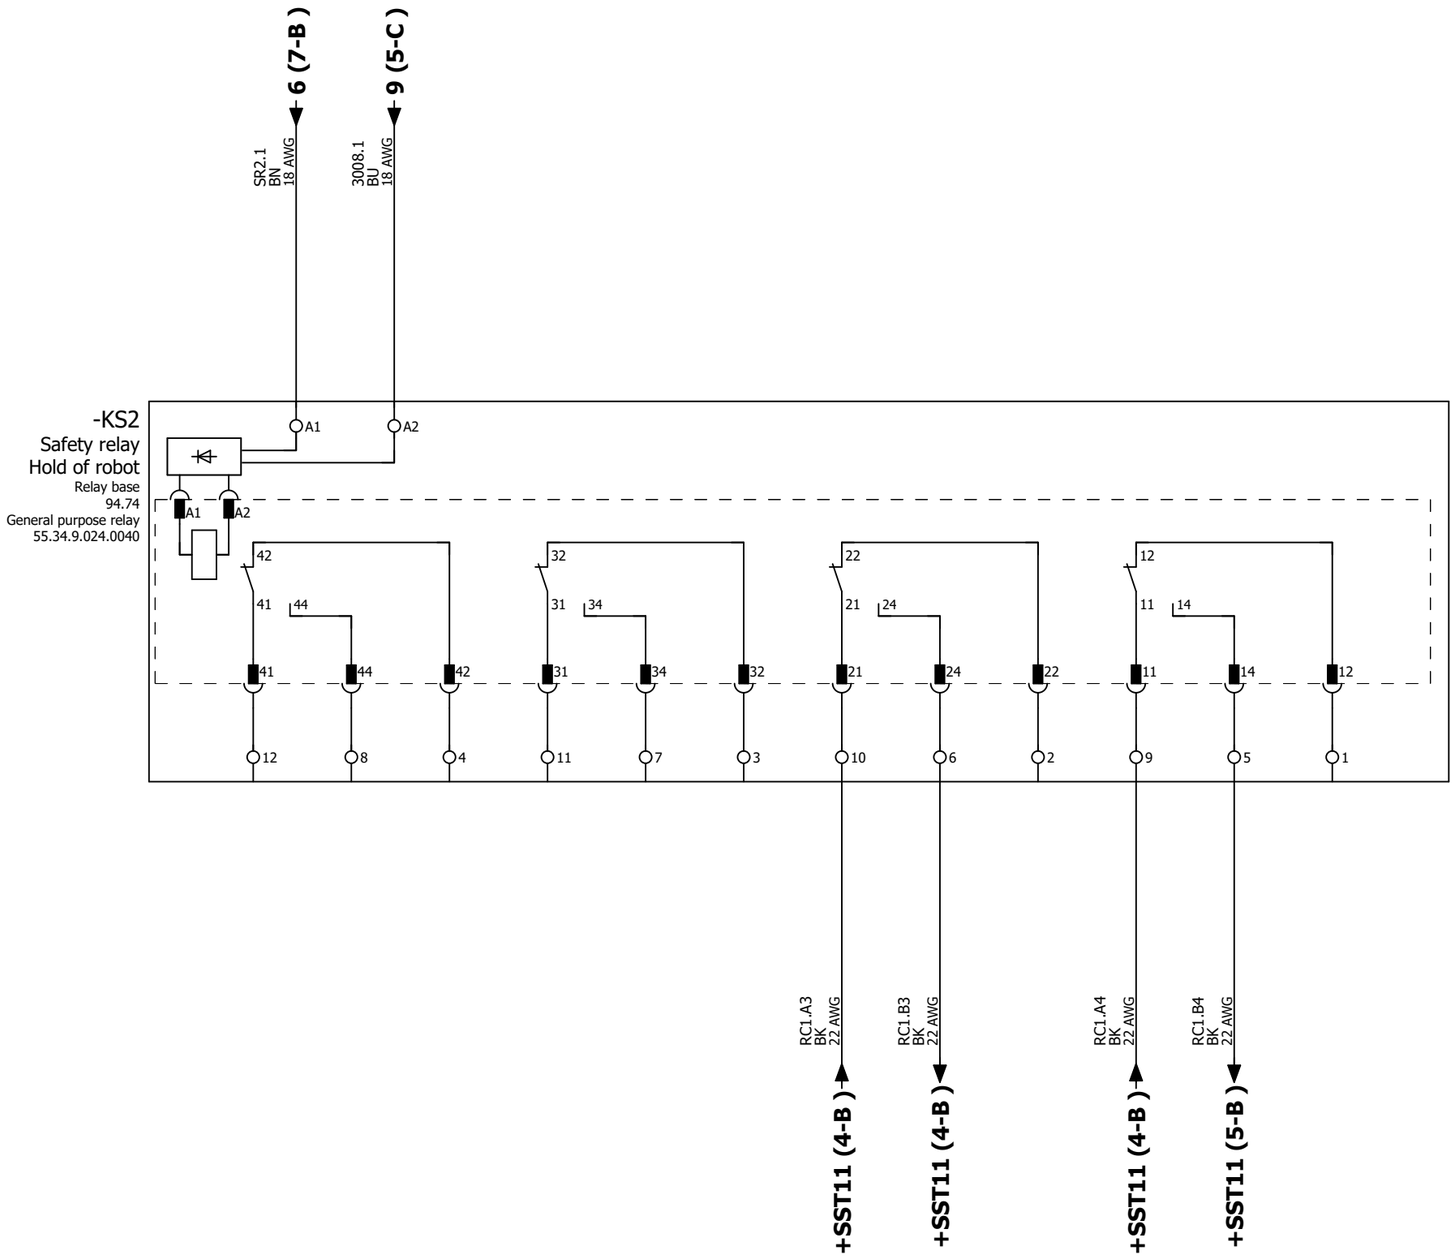


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility	24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Rele connections KS2	Mounting location	GC
		Revision	0	Station name		Sheet	9.a
		Responsible	EPLAN	ST 60		Page	59 / 83

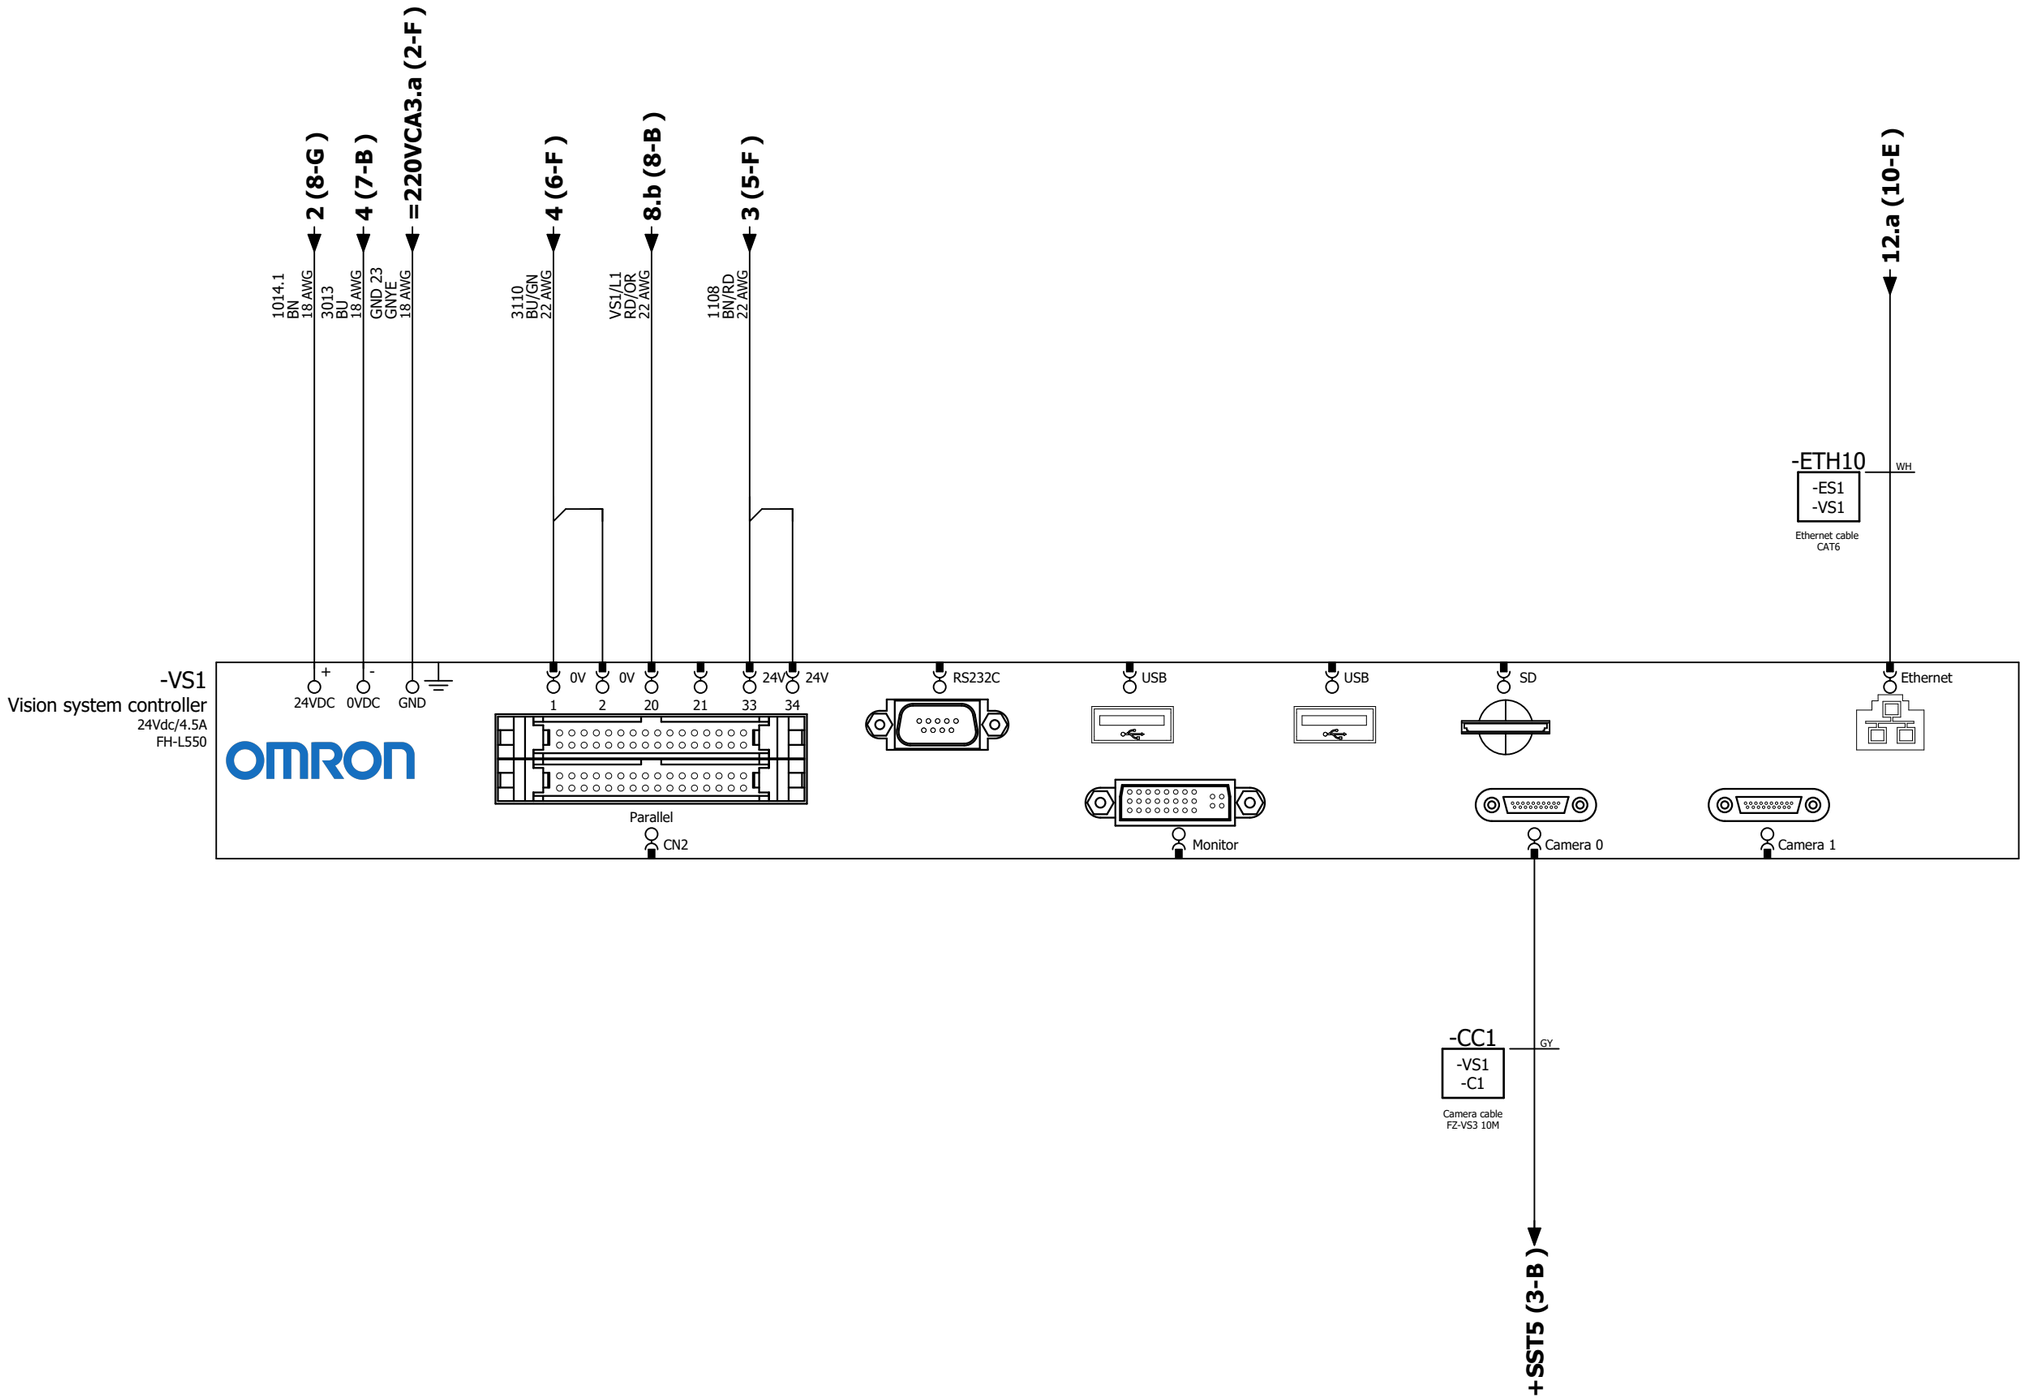
2 (8-G)
4 (7-B)
=220VCA3.a (2-F)
4 (6-F)
8.b (8-B)
3 (5-F)
12.a (10-E)
1014.1
BN
18 AWG
3013
BU
18 AWG
GND 23
GN/YE
18 AWG
3110
BU/GN
22 AWG
VS1/L1
RD/OR
22 AWG
1108
BN/RD
22 AWG
-ETH10
WH
-ES1
-VS1
Ethernet cable
CAT6
-VS1
Vision system controller
24Vdc/4.5A
FH-L550
OMRON
+
-
24VDC
0VDC
GND
0V
0V
24V
24V
1
2
20
21
33
34
Parallel
CN2
RS232C
USB
USB
SD
Ethernet
Monitor
Camera 0
Camera 1
-CC1
GY
-VS1
-C1
Camera cable
FZ-VS3 10M
+SST5 (3-B)

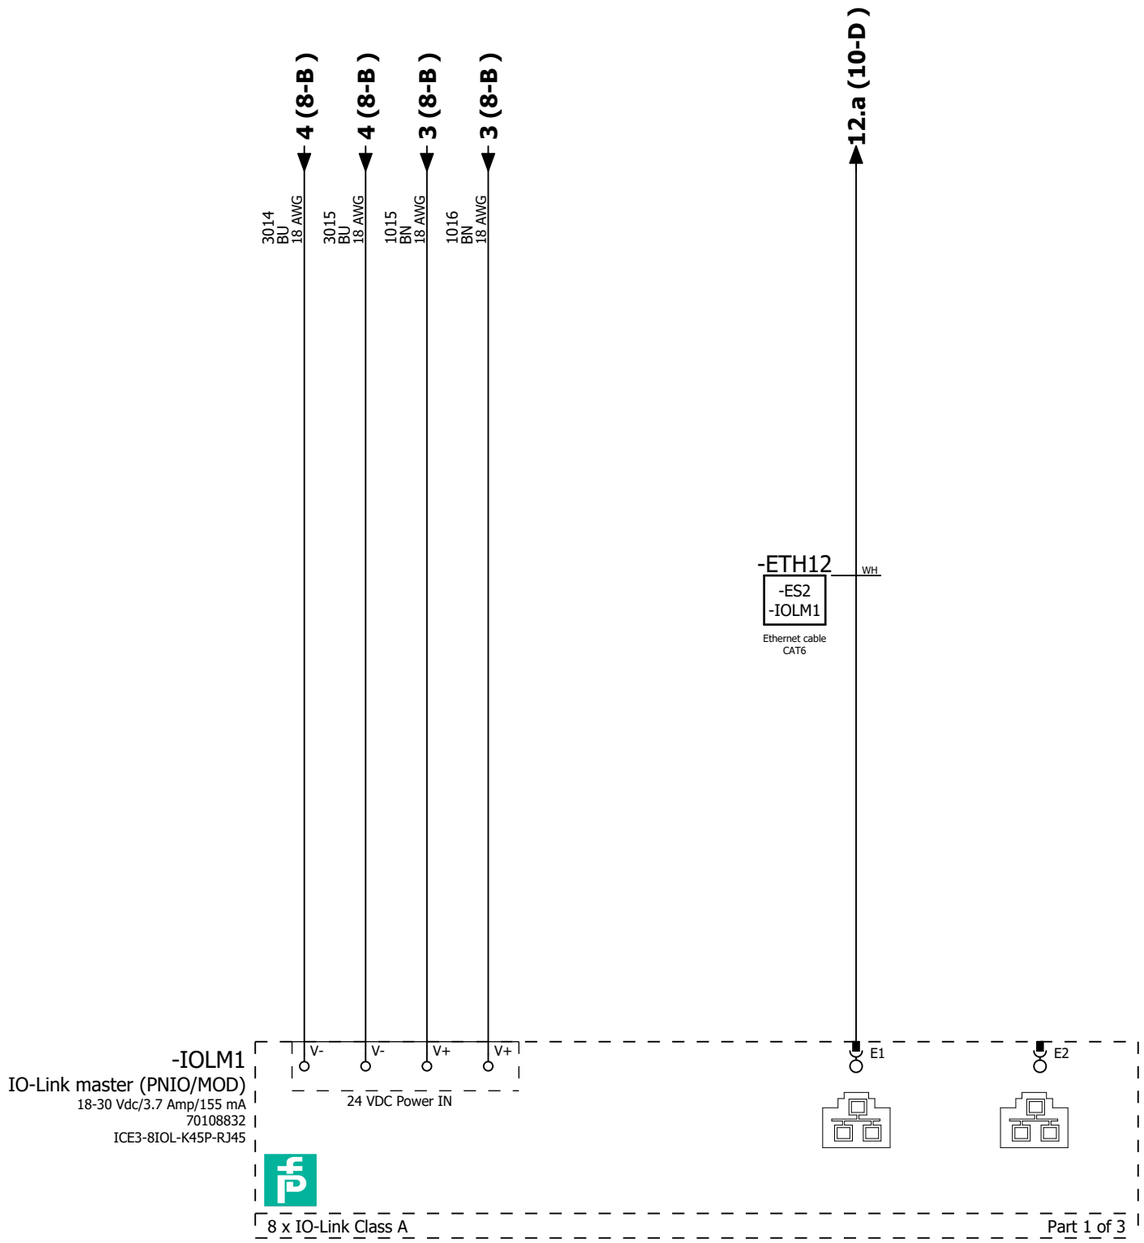

Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	10/12/2025	Project's name	Page name	Facility 24VCD
Client: Pegatron PEGATRON	Modified	27/03/2026	NV9X CP	Master I/O Link	Mounting location GC
	Revision	0	Station name		Sheet 11
	Responsible	EPLAN	ST 60		Page 61 / 83

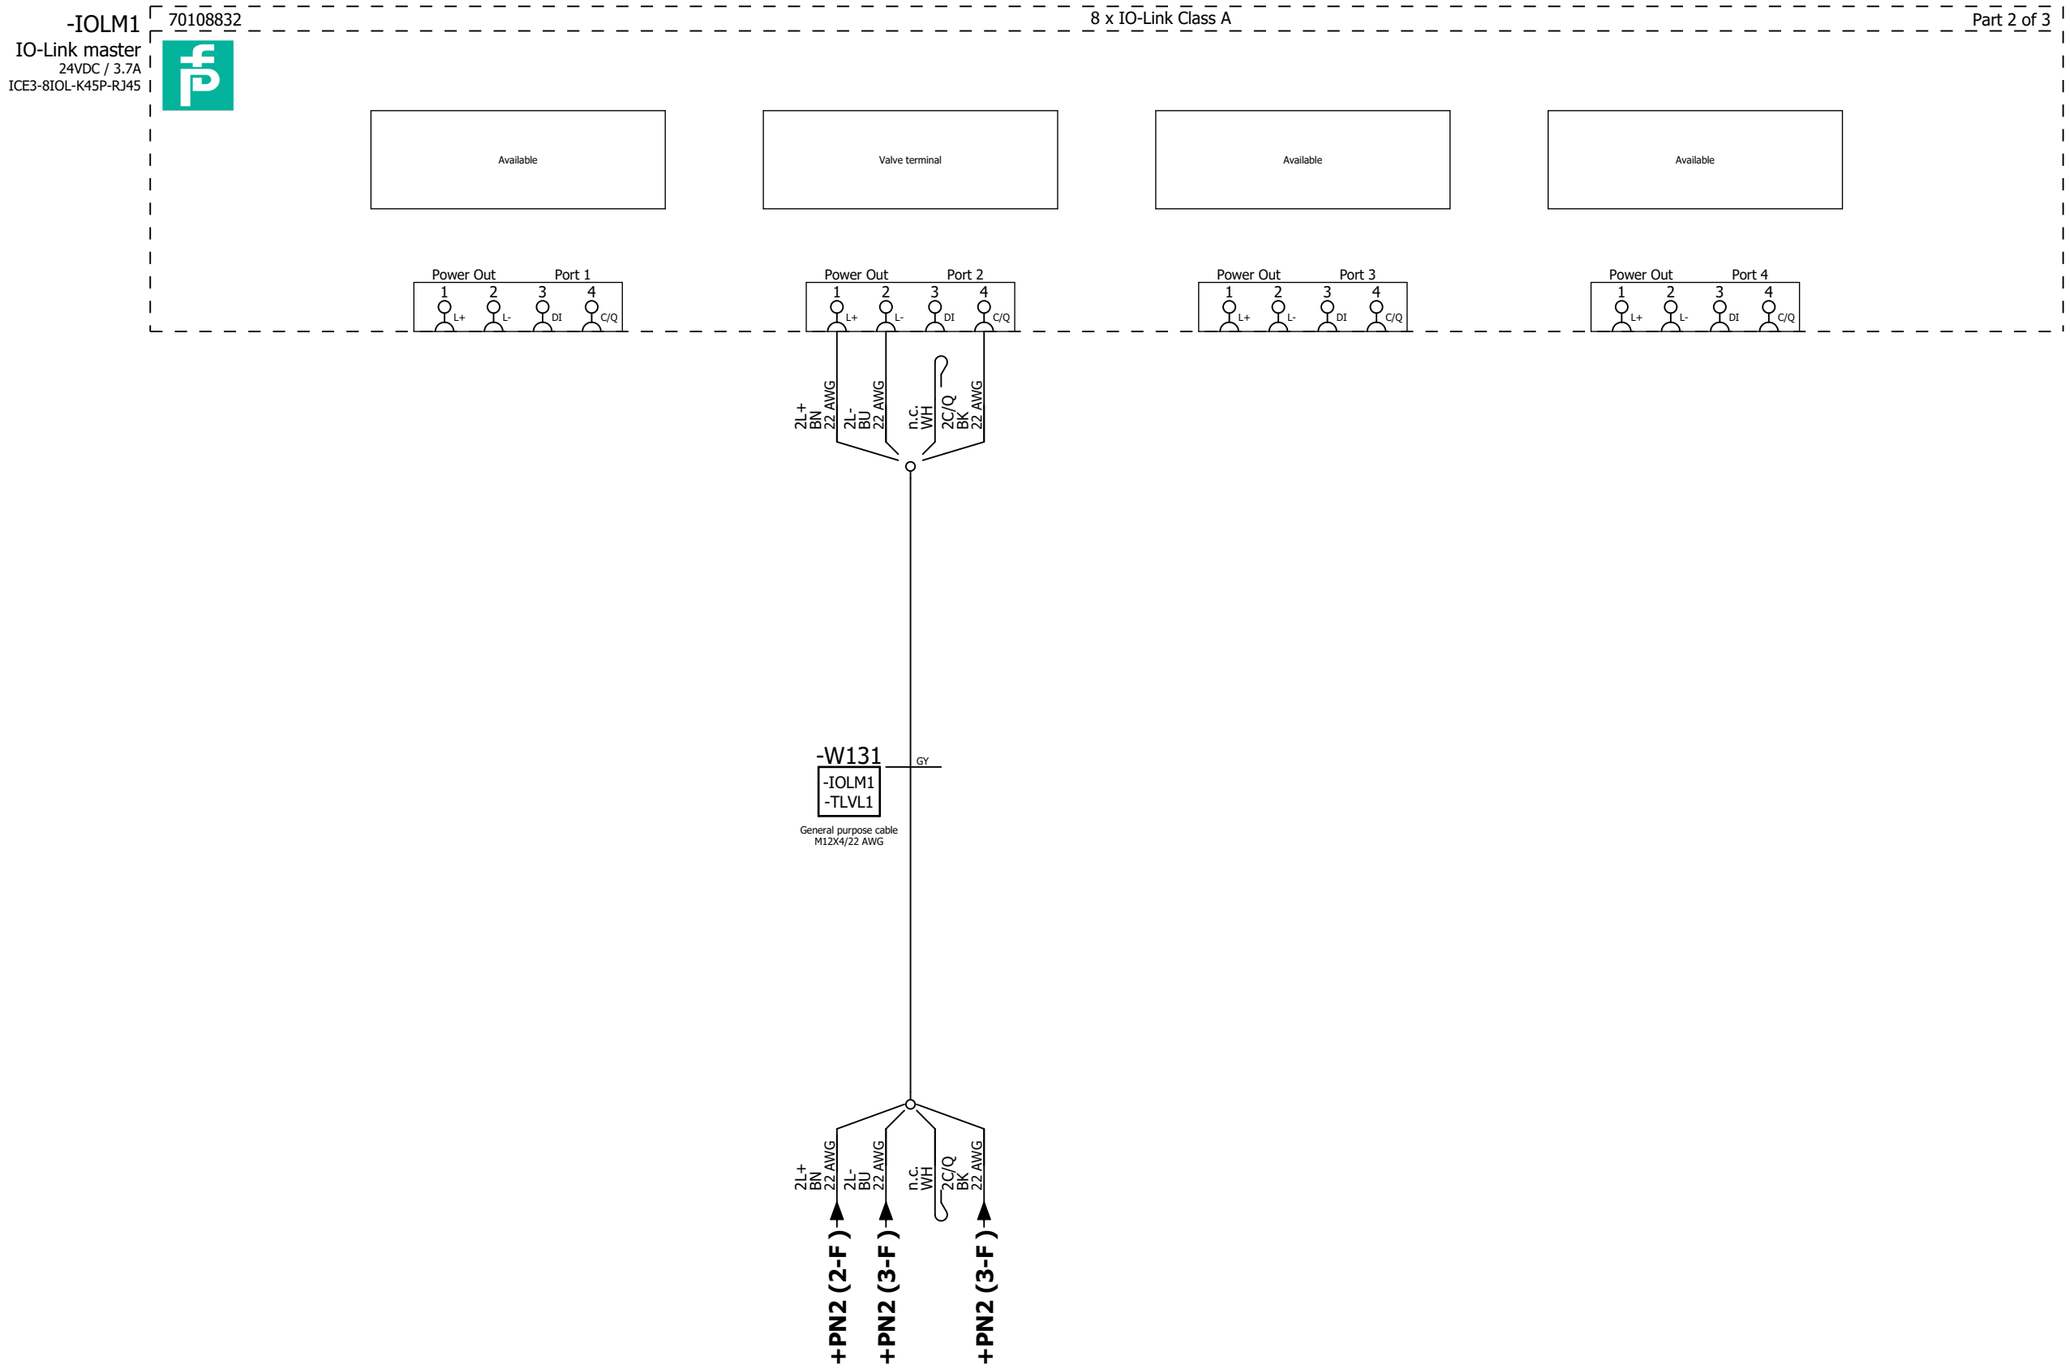

Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	10/12/2025	Project's name	Page name	Facility 24VCD
	Client: Pegatron PEGATRON	Modified	27/03/2026	NV9X CP	IO-Link Master 1 (PNIO/MOD)	Mounting location GC
		Revision	0	Station name		Sheet 11.a
		Responsible	EPLAN	ST 60		Page 62 / 83

-IOLM1
IO-Link master
24VDC / 3.7A
ICE3-8IOL-K45P-RJ45

70108832

8 x IO-Link Class A

Part 3 of 3

Available

HUB

Available

Available

Power Out Port 5
1 L+ 2 L- 3 DI 4 C/Q

Power Out Port 6
1 L+ 2 L- 3 DI 4 C/Q

Power Out Port 7
1 L+ 2 L- 3 DI 4 C/Q


Power Out Port 8
1 L+ 2 L- 3 DI 4 C/Q

6L+ BN 22 AWG
6L- BU 22 AWG
6DI BK
6C/Q WH 22 AWG


-W131
GY
-IOLM1
-HUB1
General purpose cable
M12X4/22 AWG

6L+ BN 22 AWG
6L- BU 22 AWG
6DI BK 22 AWG
n.c. GY


+SST8 (2-B)
+SST8 (3-B)
+SST8 (3-B)

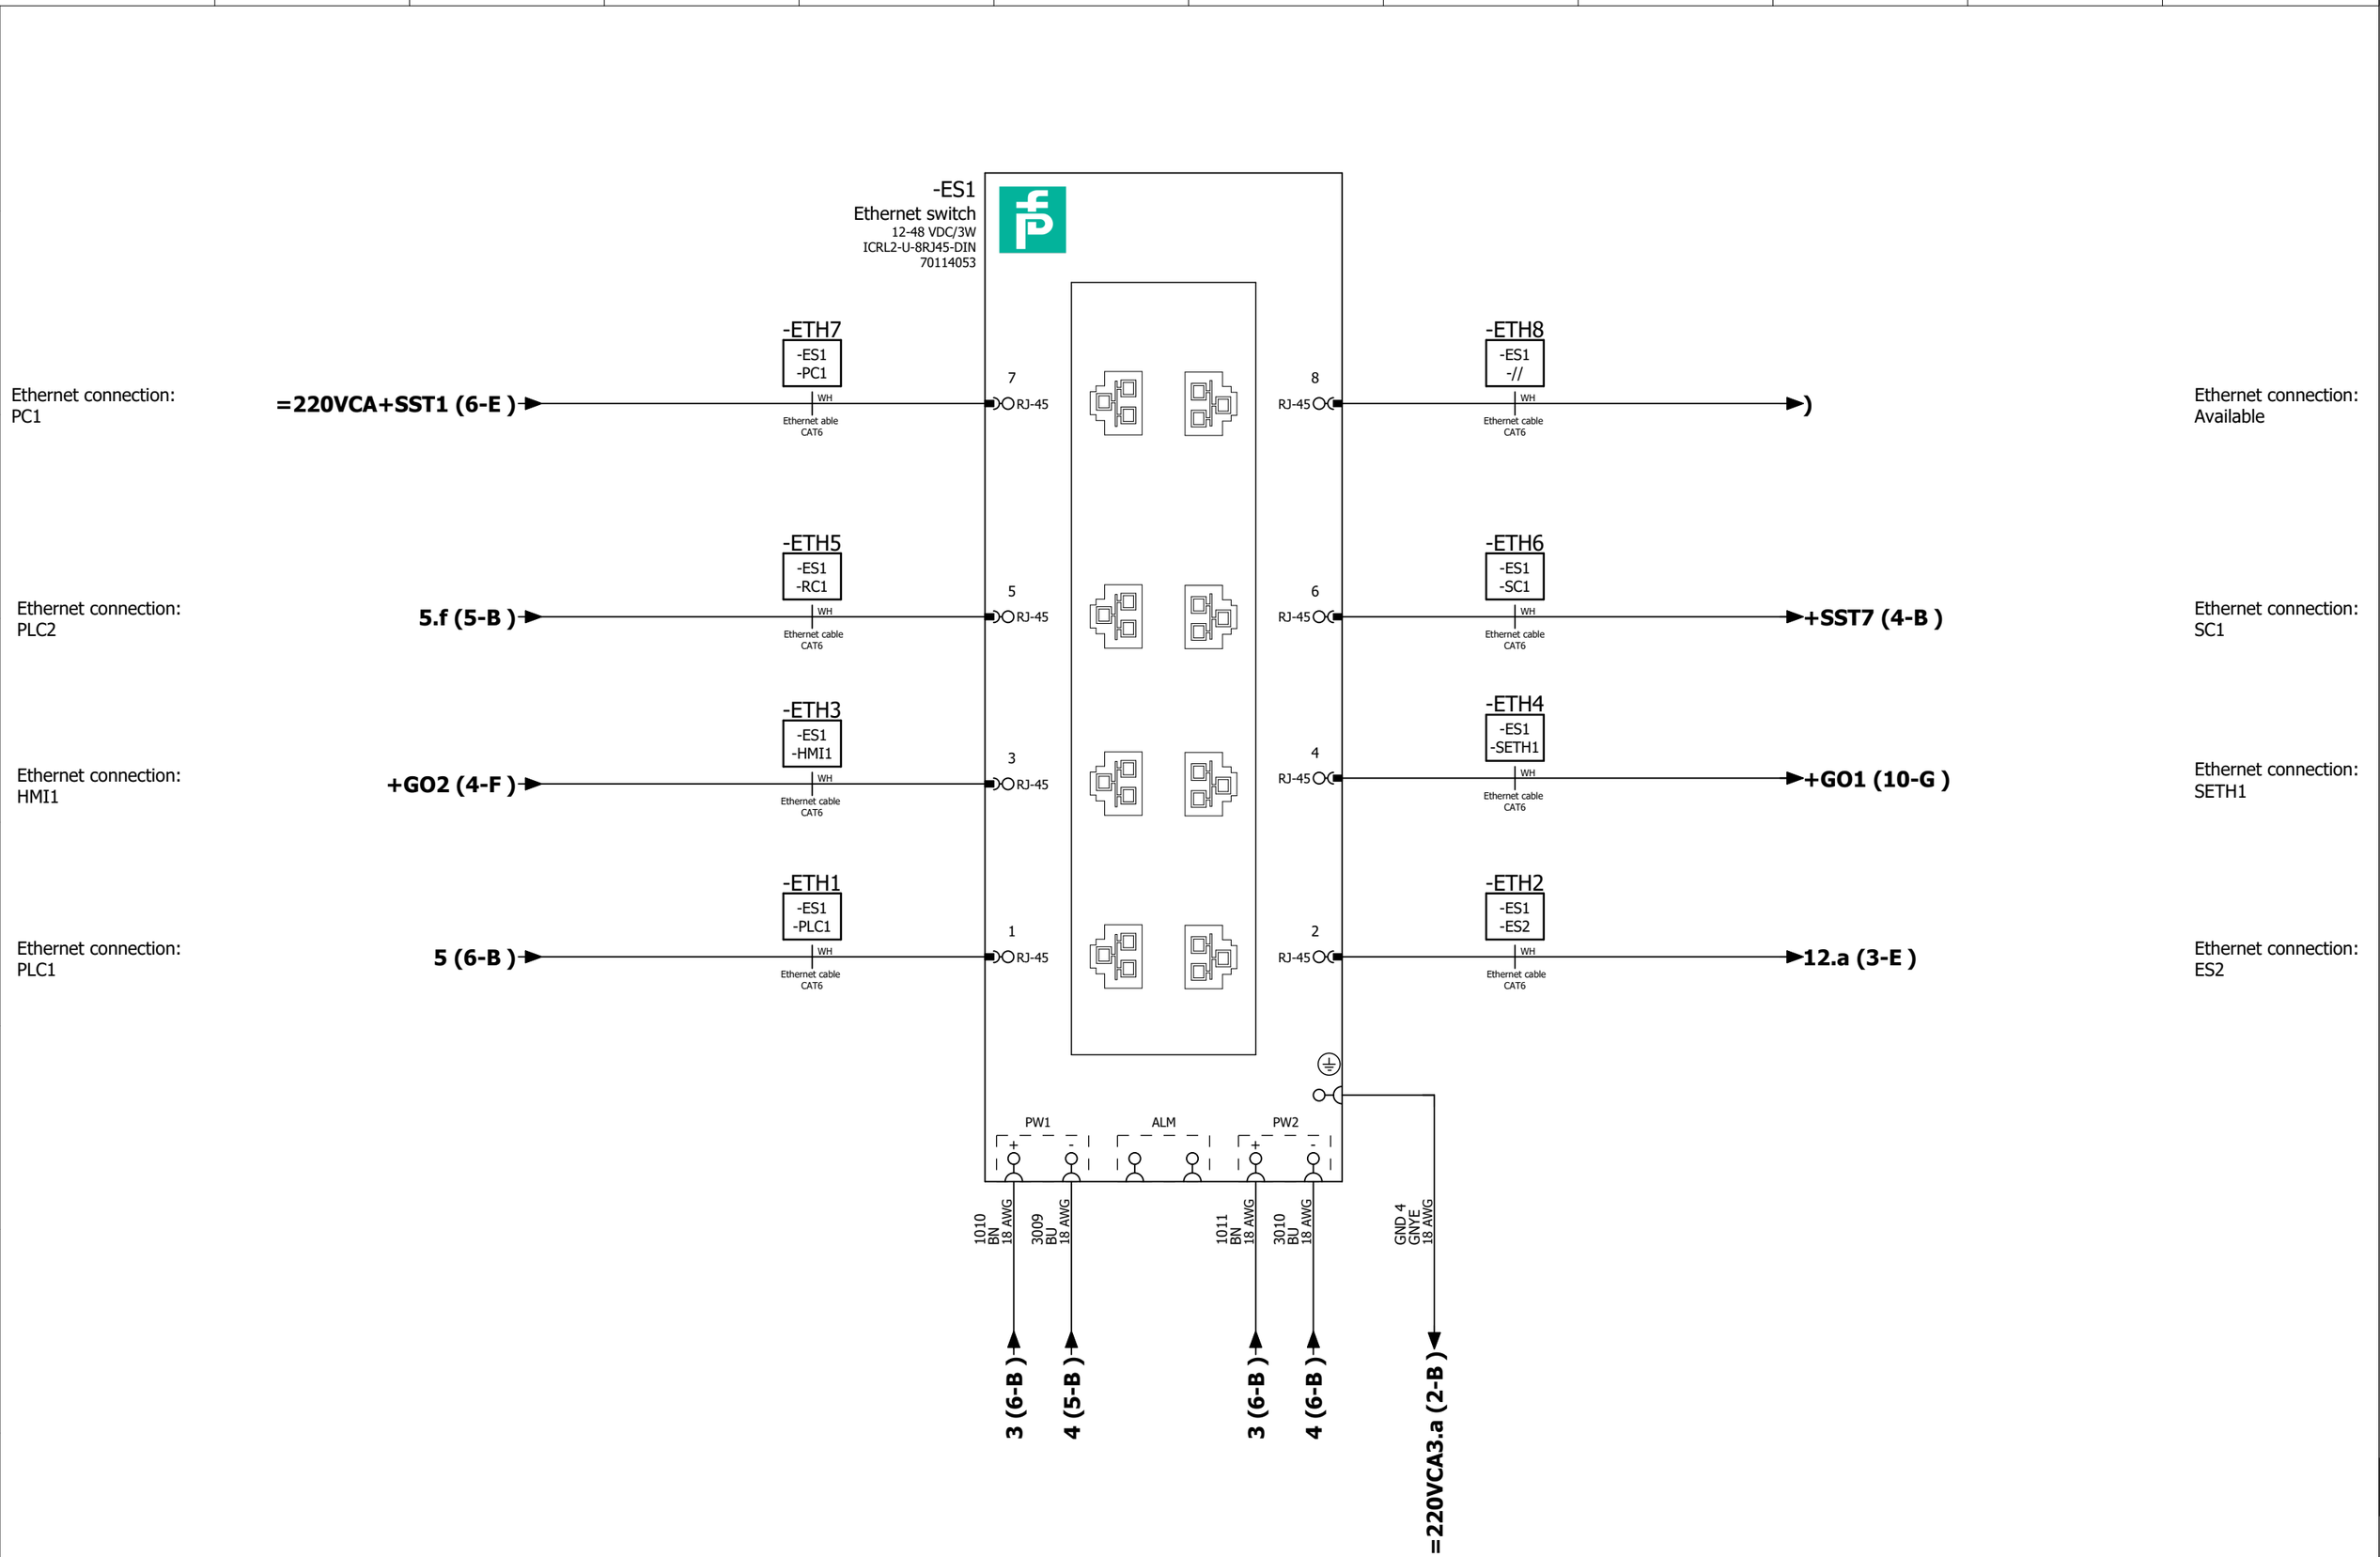

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	28/03/2026	NV9X CP	Ethernet switch connections	Mounting location GC
			Revision	0	Station name		Sheet 12
			Responsible	EPLAN	ST 60		Page 64 / 83

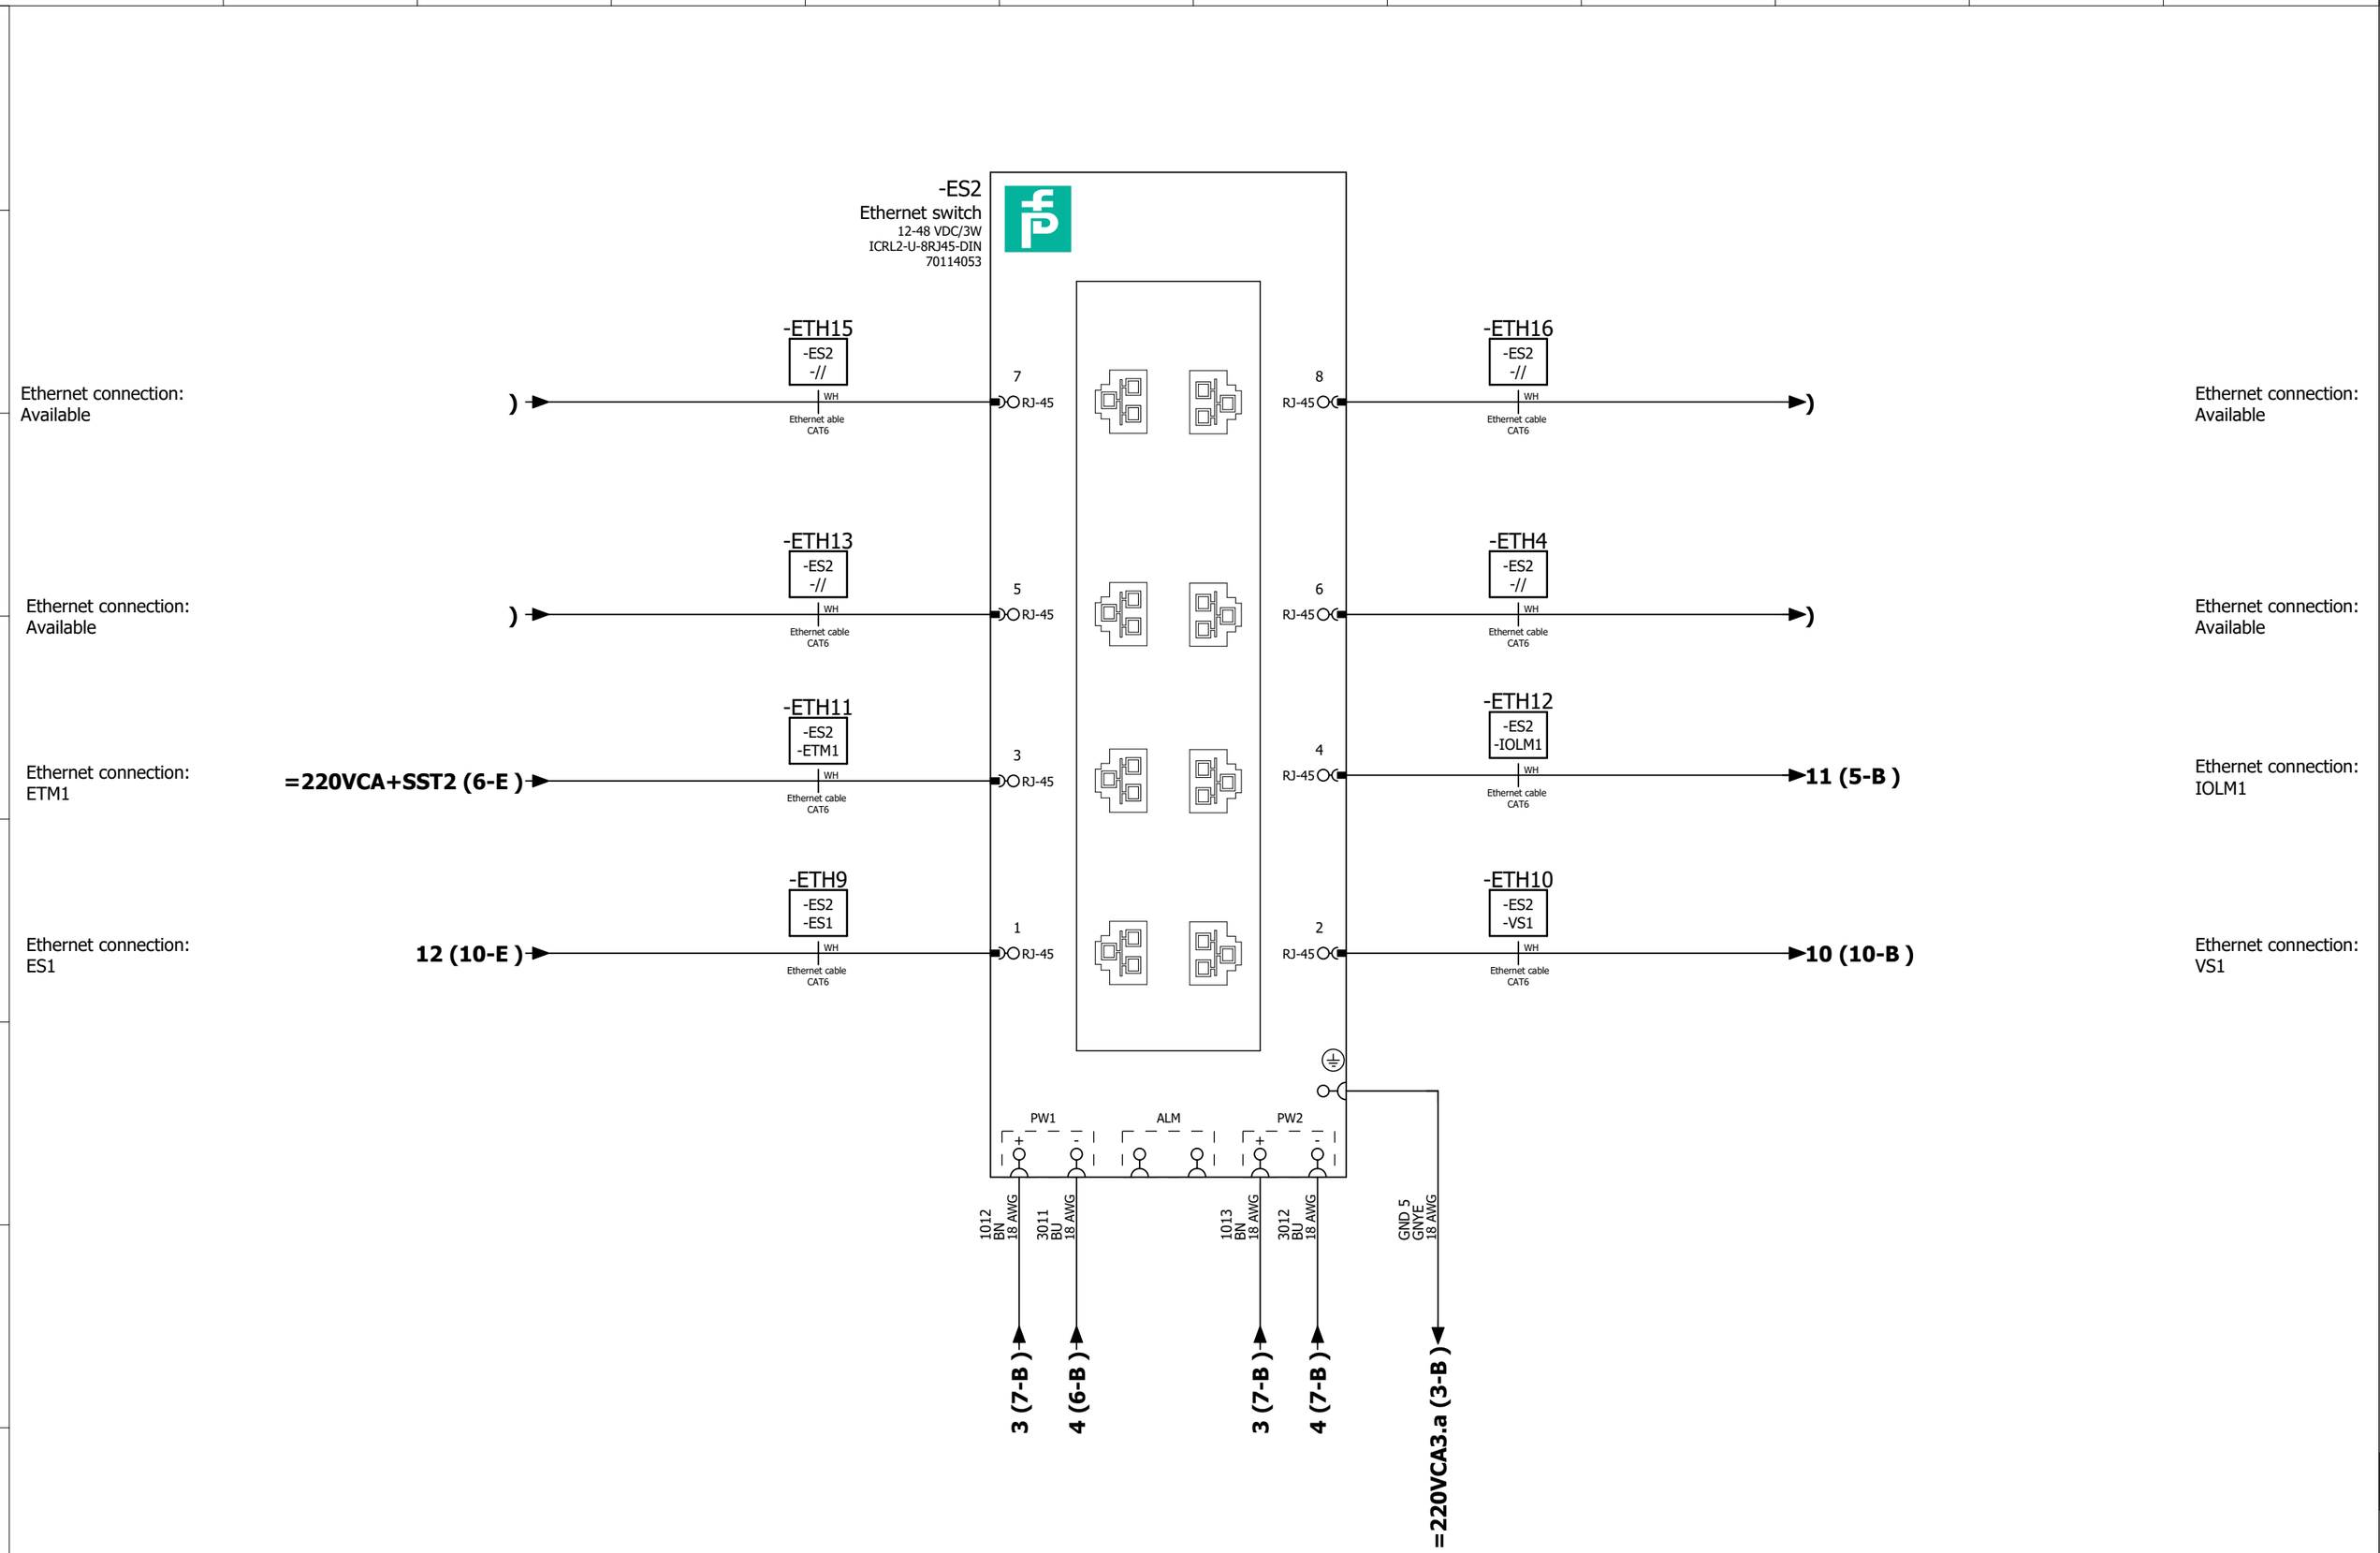


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
	Client: Pegatron PEGATRON	Modified	28/03/2026	NV9X CP	Ethernet switch connections	Mounting location GC
		Revision	0	Station name		Sheet 12.a
		Responsible	EPLAN	ST 60		Page 65 / 83

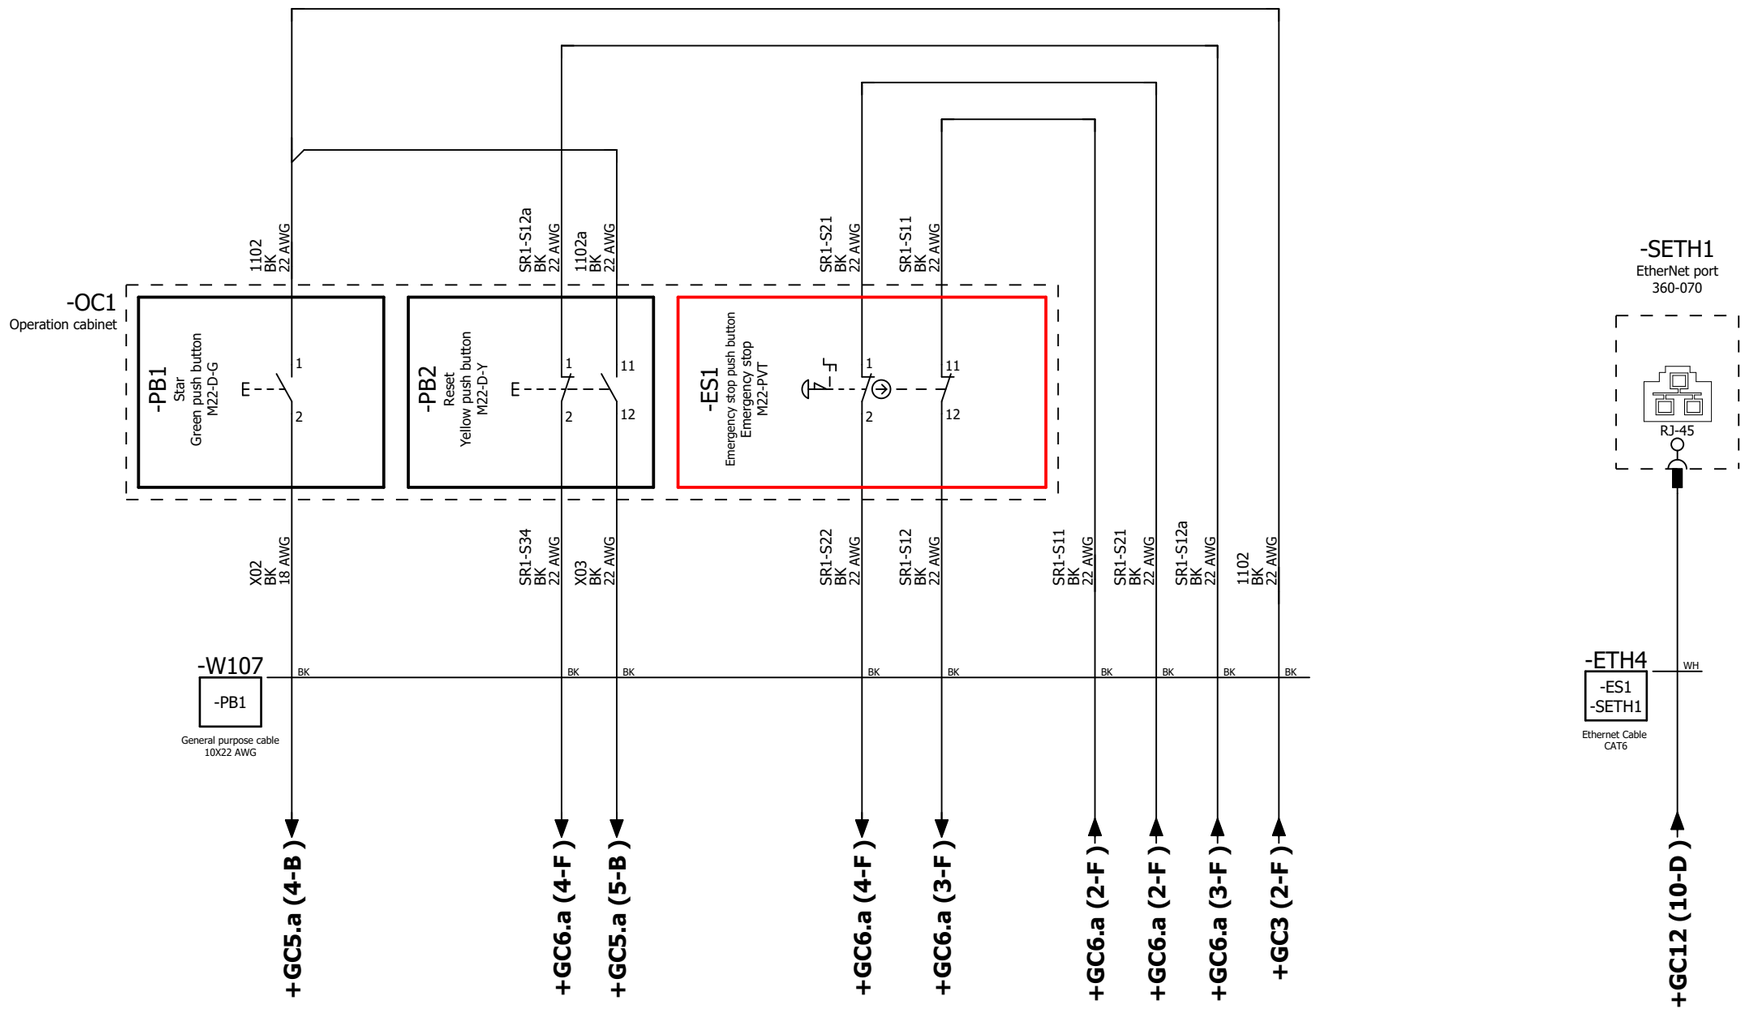

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Buttons	Mounting location GO
			Revision	0	Station name		Sheet 1
			Responsible	EPLAN	ST 60		Page 66 / 83

-HMI1
Human machine interface
24V DC / 0.3 Amp / 7" LCD TFT Color
GS2107-WTBD-N

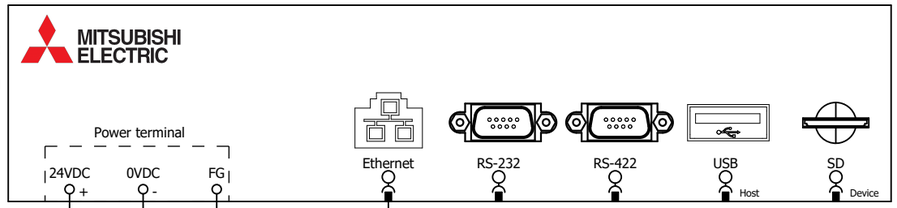

1101.1 BK 18 AWG
3101 WH 18 AWG
GND 22 GN 18 AWG

-W108 BK
-F22
-HMI1
General purpose cable
3X18AWG


-ETH3 WH
-ES1
-HMI1
Ethernet cable
CAT6

1101.1 BK 18 AWG
3101 WH 18 AWG
GND 22 GN 18 AWG


+GC2 (5-G)
+GC4 (2-F)
=220VCA+GC3.a (2-F)
+GC12 (3-D)

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Operation interface onnections	Mounting location GO
			Revision	0	Station name		Sheet 2
			Responsible	EPLAN	ST 60		Page 67 / 83

-SSD1
Safety switch
Rear door
4-24Vdc/1mA/8W
CTS-C1-BR-CC-FLX-AP-VSA
174014

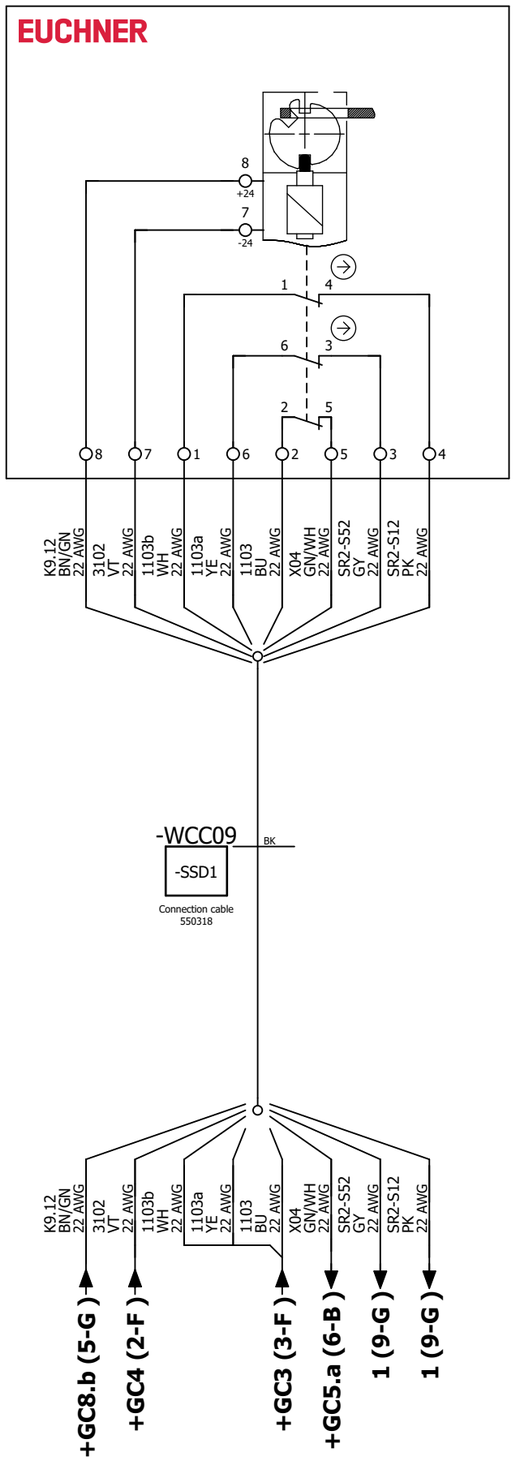

-SSD2
Safety switch
Front door
4-24Vdc/1mA/8W
CTS-C1-BR-CC-FLX-AP-VSA
174014

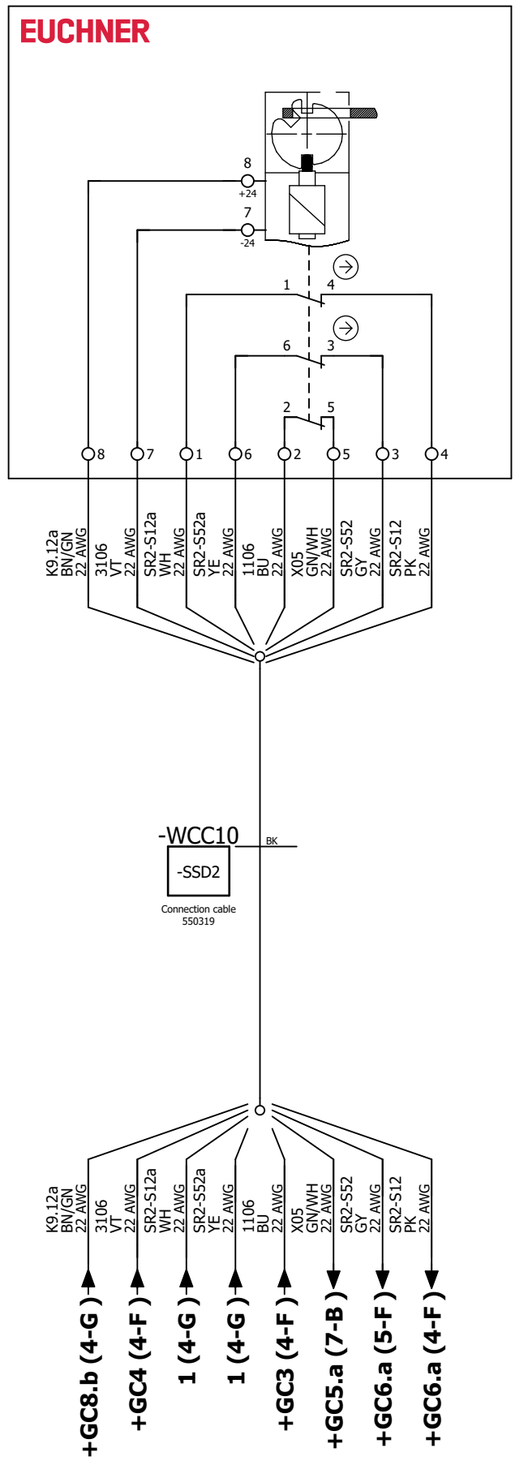

Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	08/12/2025	Project's name
Client: Pegatron	Modified	25/05/2026	NV9X CP
PEGATRON	Revision	0	Station name
	Responsible	EPLAN	ST 60


Page name
Interlock connections

Facility	24VCD
Mounting location	SST
Sheet	1
Page	68 / 83

-SL1

Signal turret


Signaling turret machine status
24VDC
MT5C3AL-3

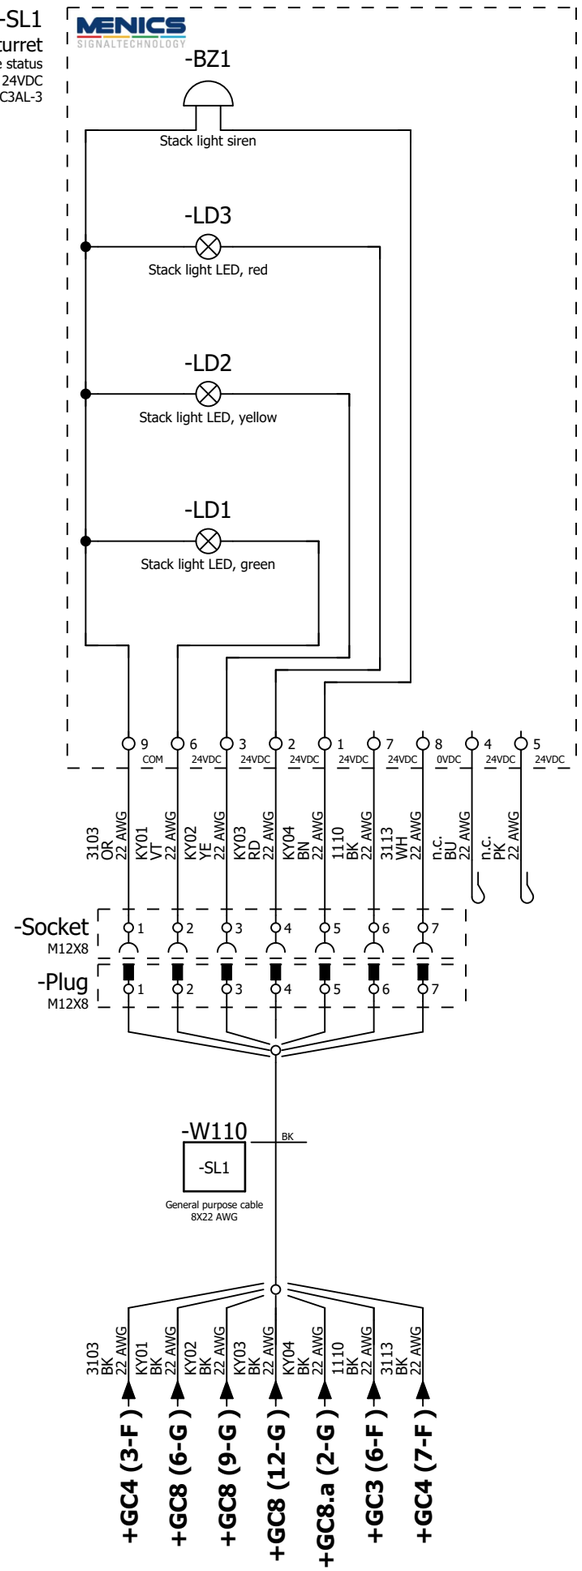




Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name
	Client: Pegatron PEGATRON	Modified	27/03/2026	NV9X CP	Start process button connections
		Revision	0	Station name	
		Responsible	EPLAN	ST 60	


Facility	24VCD
Mounting location	SST
Sheet	4
Page	70 / 83

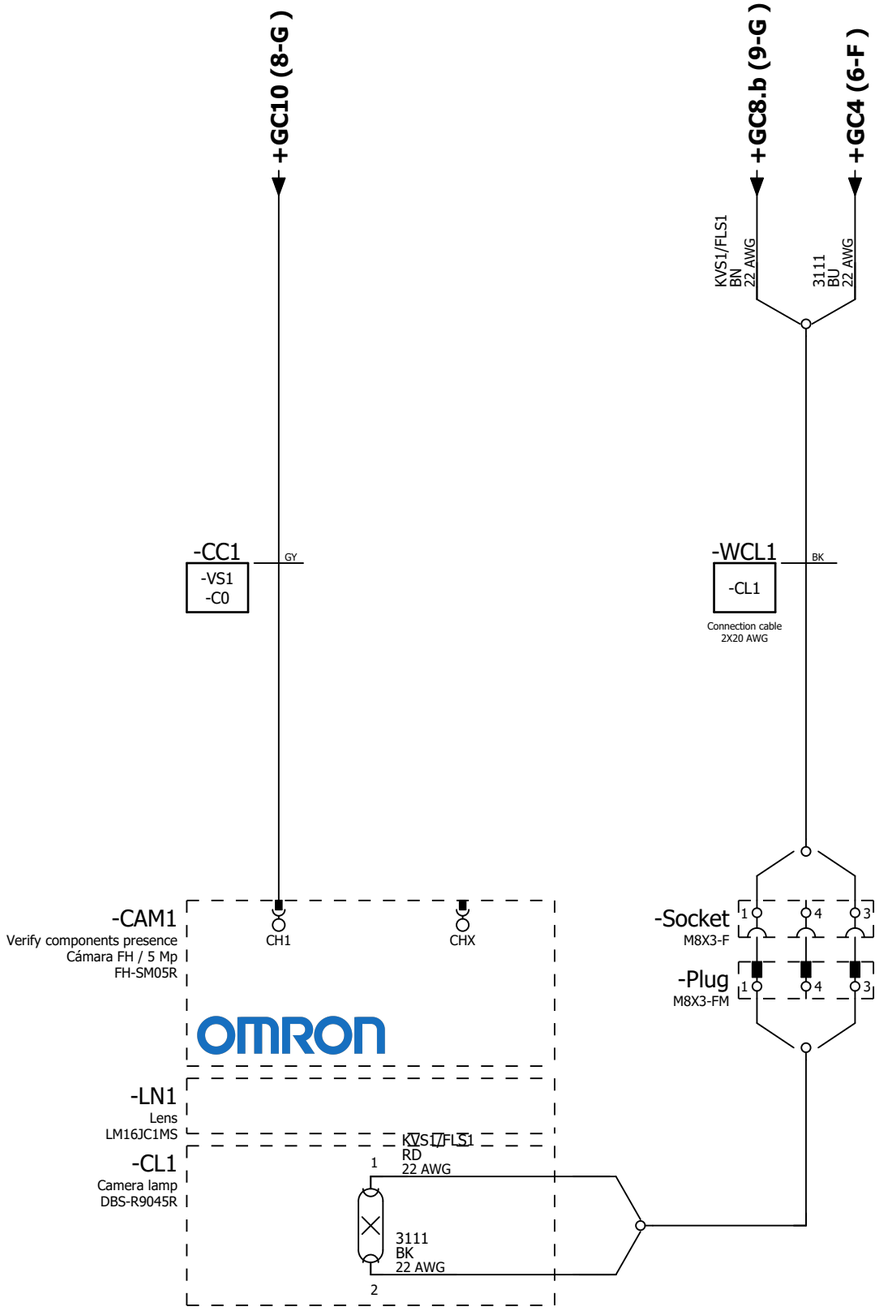


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	28/03/2026	NV9X CP	Camera connections	Mounting location SST
			Revision	0	Station name		Sheet 5
			Responsible	EPLAN	ST 60		Page 71 / 83

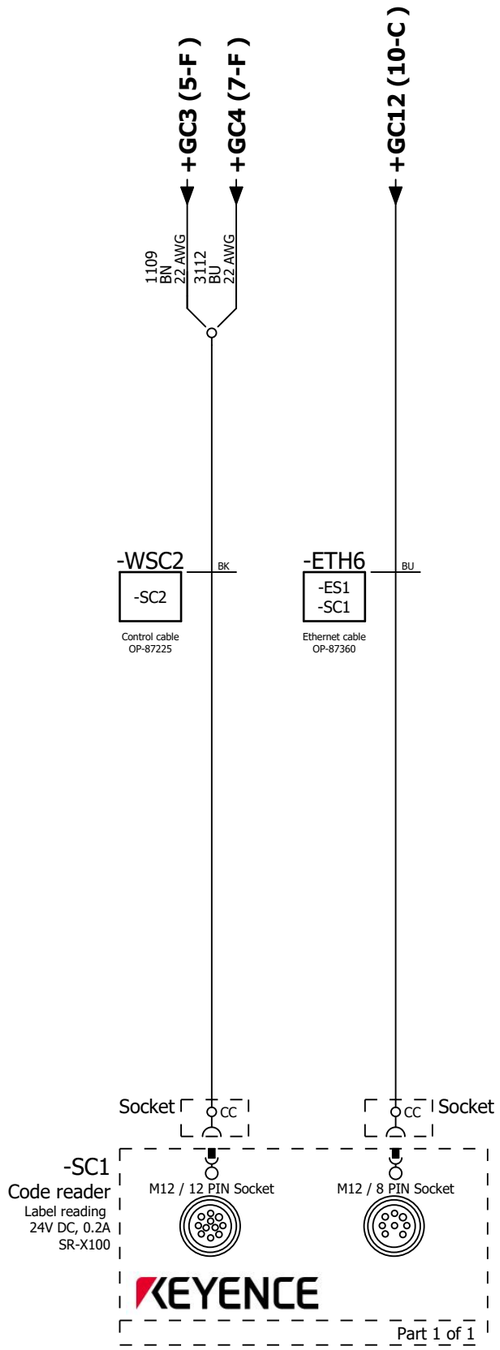

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	16/02/2026	NV9X CP	Code reader connections	Mounting location SST
			Revision	0	Station name		Sheet 7
			Responsible	EPLAN	ST 60		Page 72 / 83

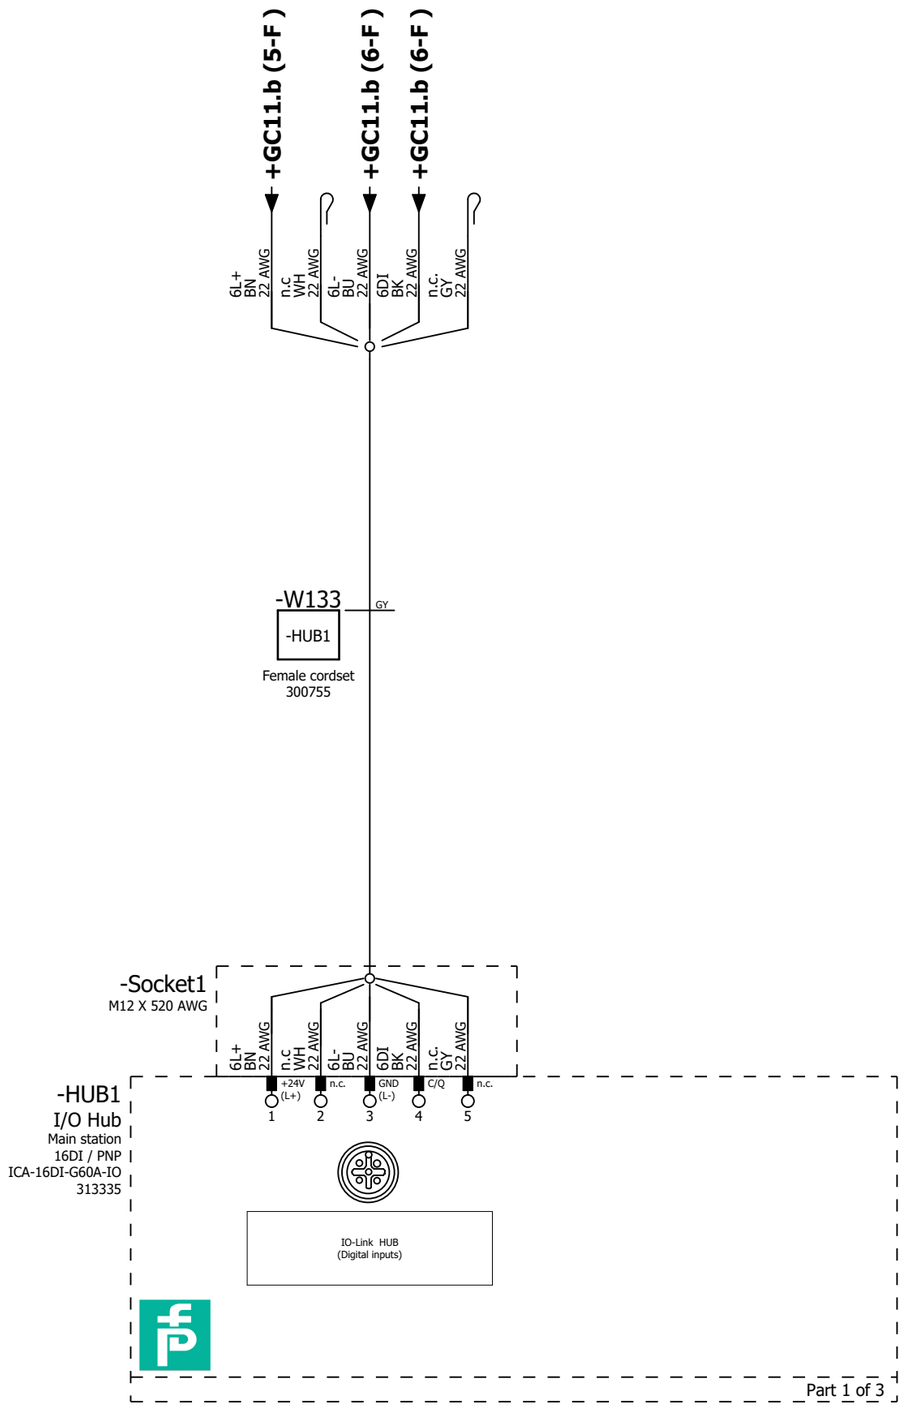


Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
		Client: Pegatron PEGATRON	Modified	28/03/2026	NV9X CP	IO-Link I/O Hub 1	Mounting location SST
			Revision	0	Station name		Sheet 8
			Responsible	EPLAN	ST 60		Page 73 / 83

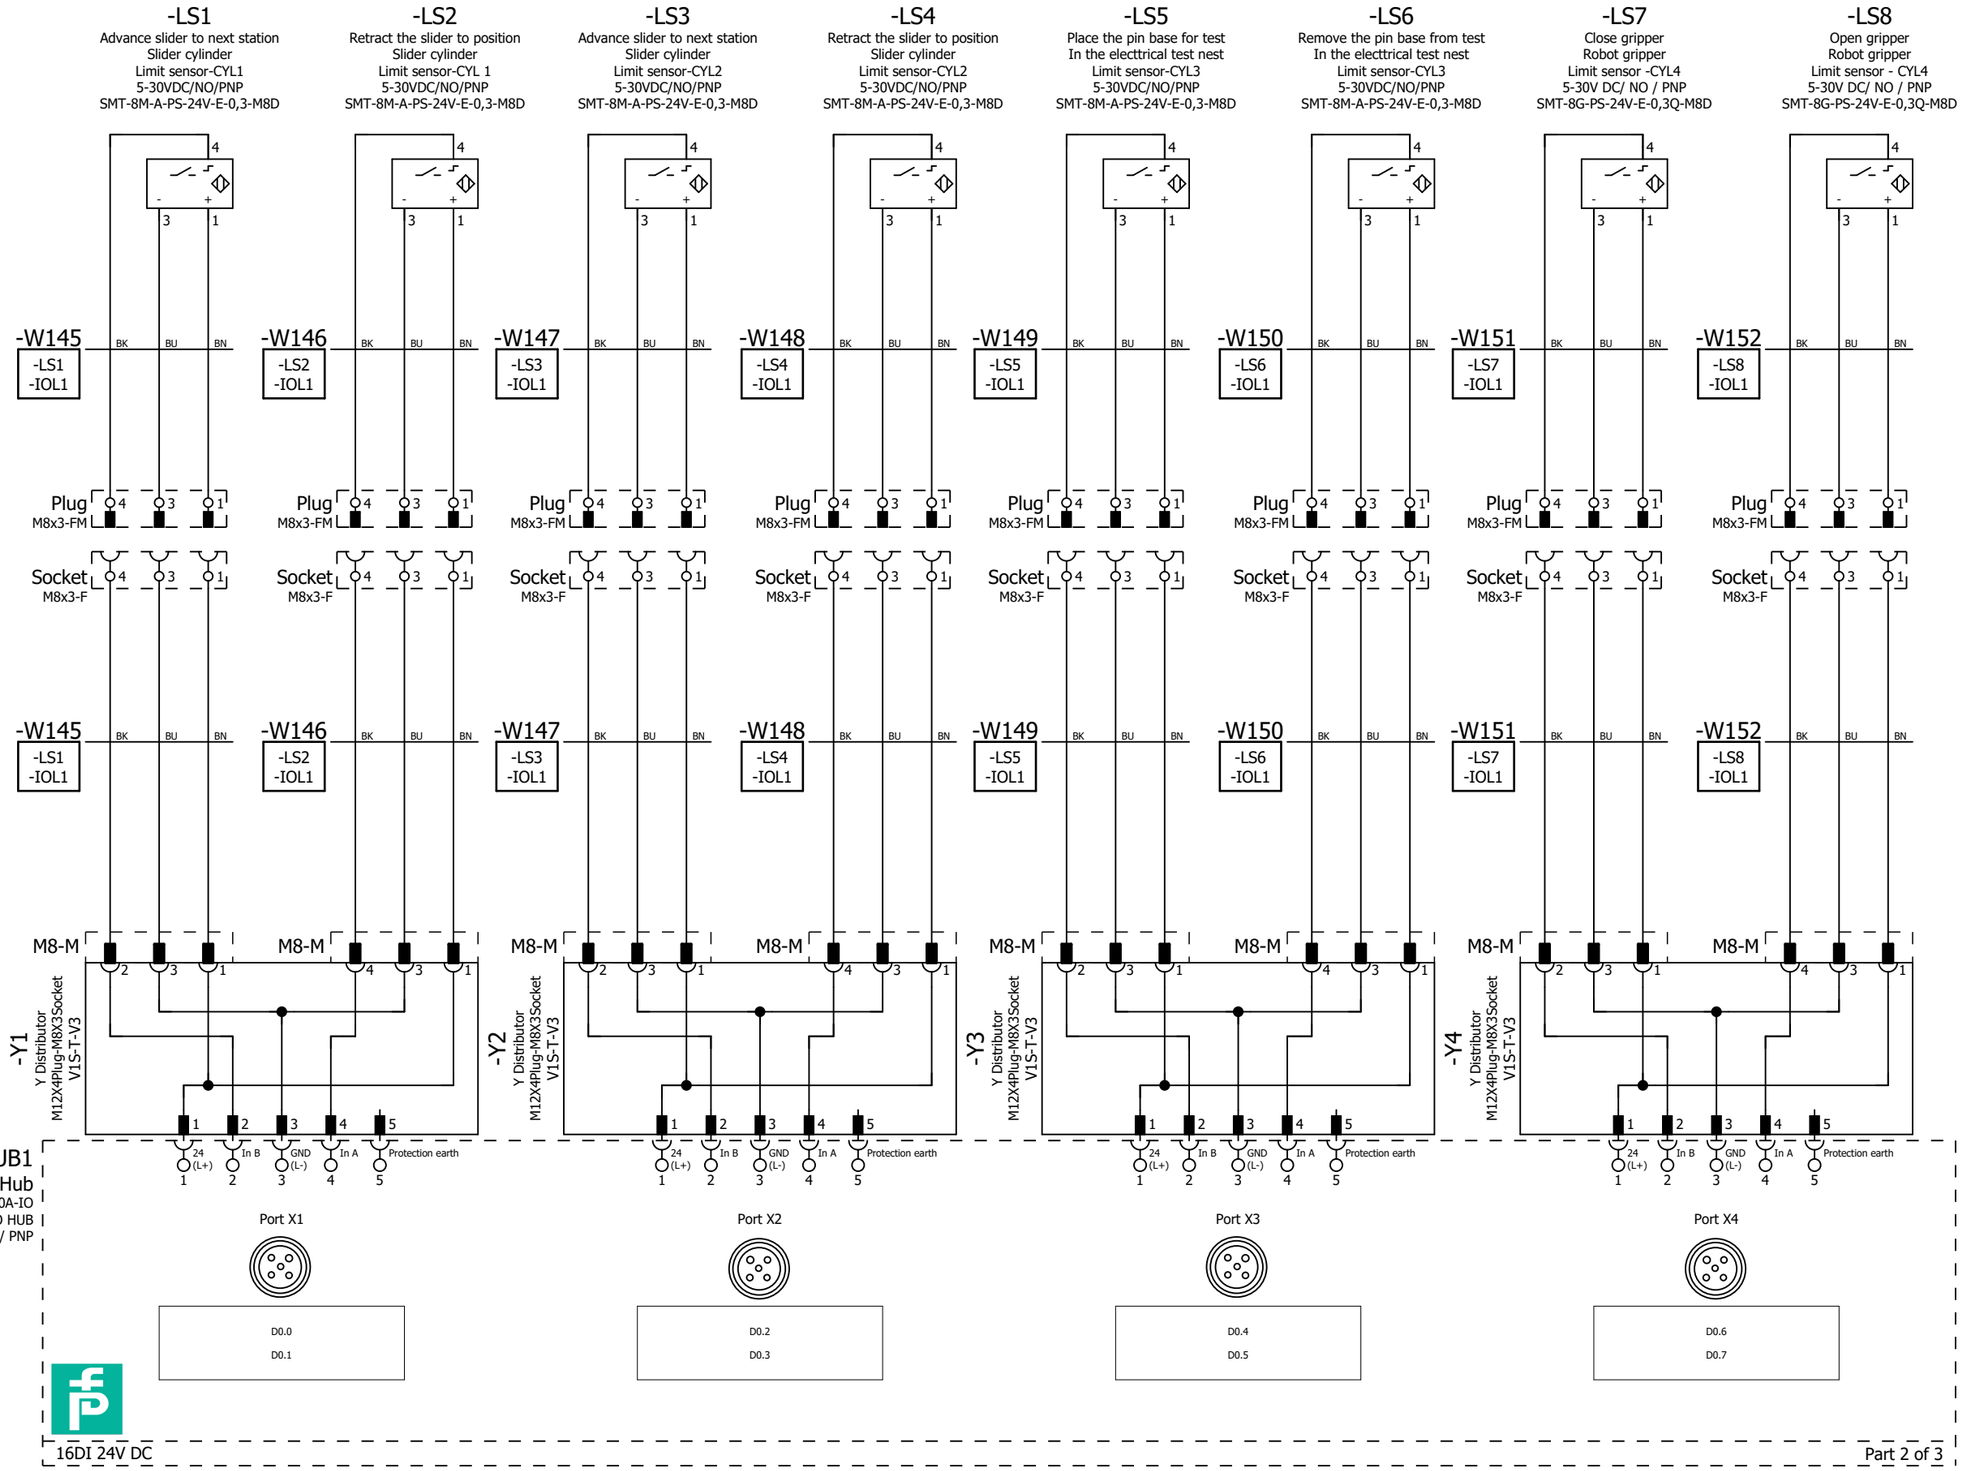

Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.


O.P. 973	Created	08/12/2025	Project's name: NV9X CP
Client: Pegatron	Modified	19/05/2026	Station name: ST 60
PEGATRON	Revision	0	Page name: IO-Link I/O Hub 1
	Responsible	EPLAN	Facility: 24VCD
			Mounting location: SST
			Sheet: 8.a
			Page: 74 / 83

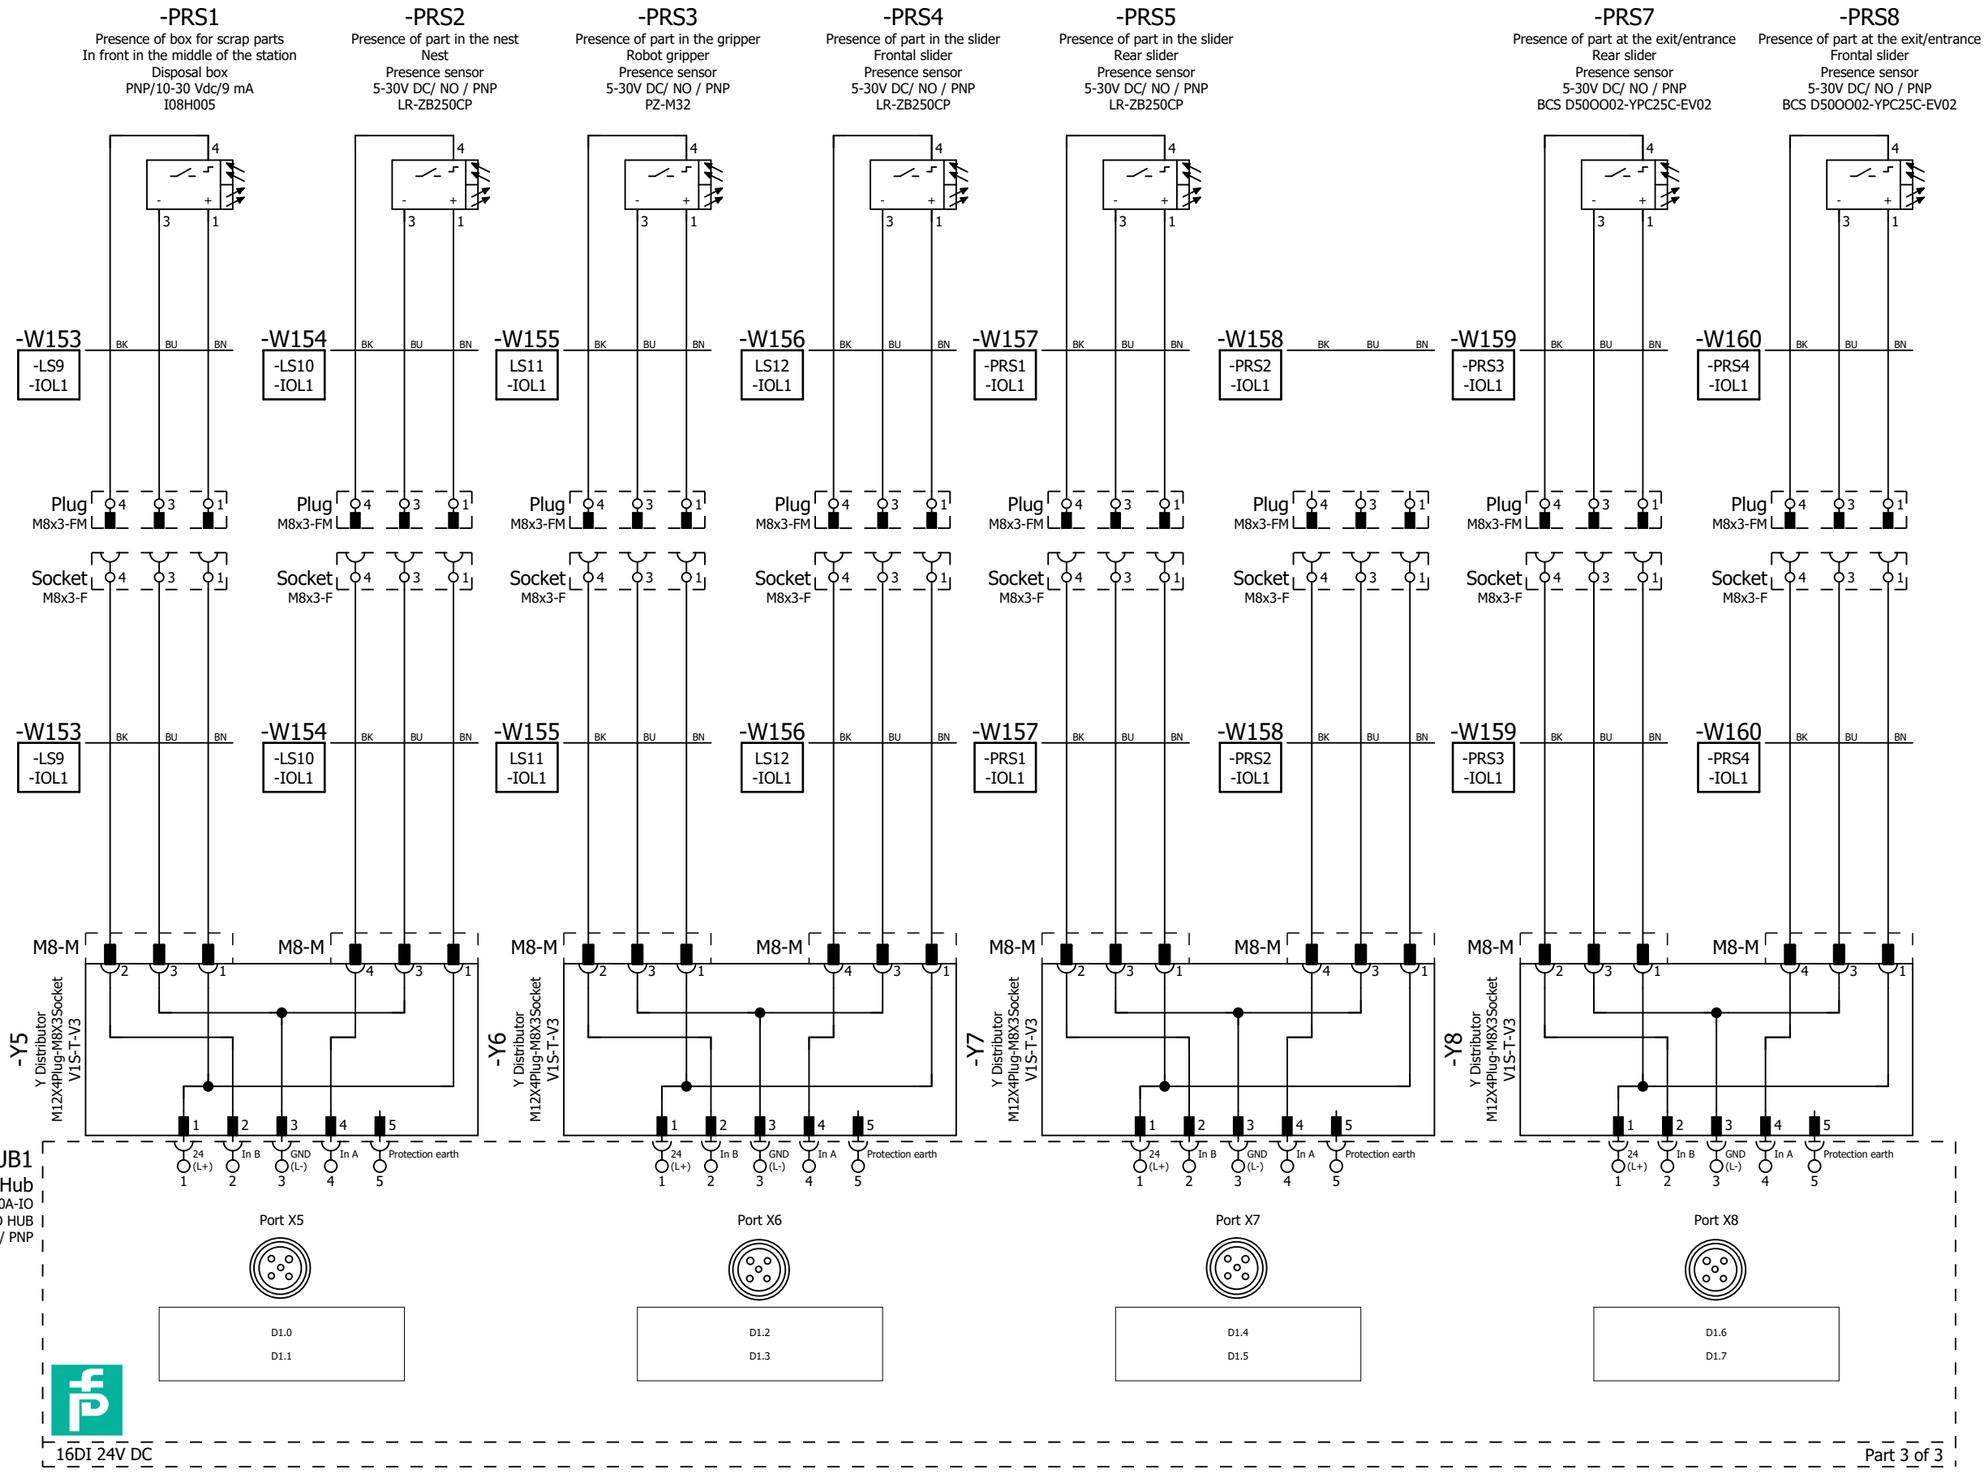


Automatyco®
Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973	Created	08/12/2025	Project's name: NV9X CP
Client: Pegatron	Modified	25/05/2026	Station name: ST 60
PEGATRON	Revision	0	Page name: IO-Link I/O Hub 1
	Responsible	EPLAN	


Facility	24VCD
Mounting location	SST
Sheet	8.b
Page	75 / 83

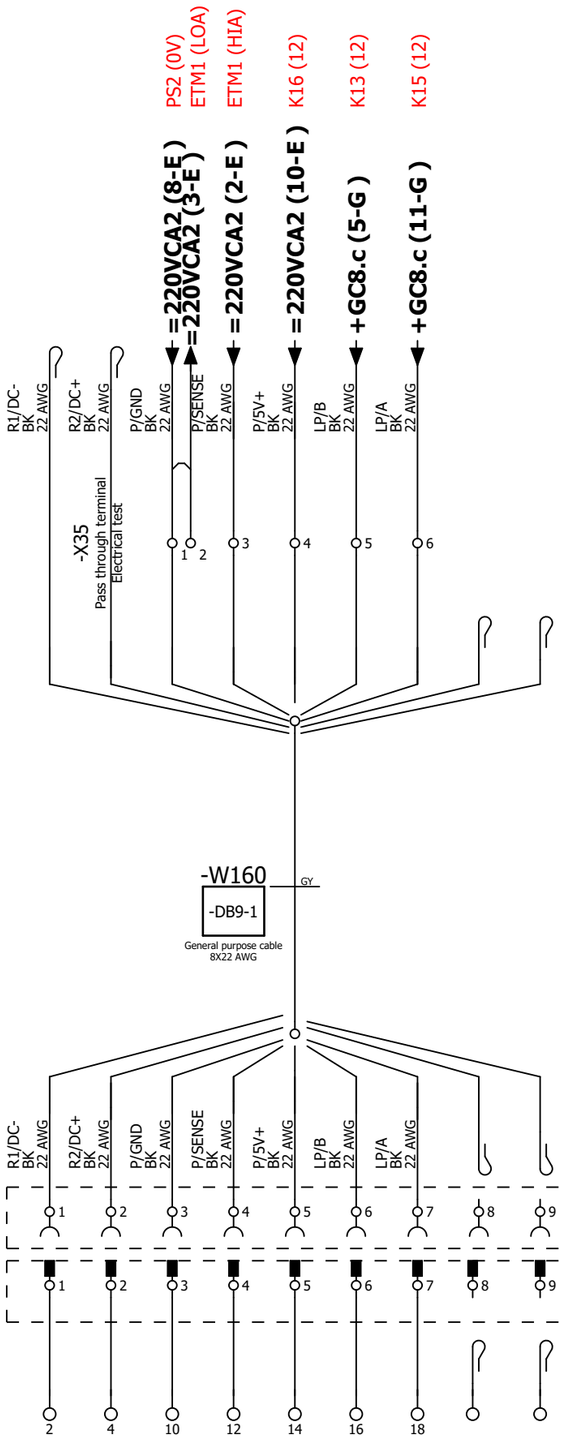

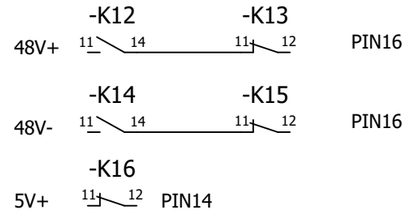


CYCLE LATCH 2x:
- APPLY VOLTAGE (PIN 16 & 18):
48±1V CYCLE 1, -48±1V CYCLE 2
- TEST TIME: 200±10 ms
- CURRENT: 1.5 AMPS MAX
RECORD POTENTIOMETER RESPONSE:
- APPLY VOLTAGE (PIN 14 TO 10): 5±0.5V
- MONITOR VOLTAGE (PIN 12 TO 10)
- MONITOR LATCH MOTION WITH VISION

- LATCH EXTENDS AND RETRACTS 2x PER DRAWING SPECIFICATION
- REFER TO ENGAGED & DISENGAGED SPECIFICATION
- CURRENT REMAINS BELOW SPECIFIED MAX
- POT SENSE (LATCH ENGAGED): 2.3±0.2 V
- POT SENSE (LATCH DISENGAGED): 3.6±0.2V

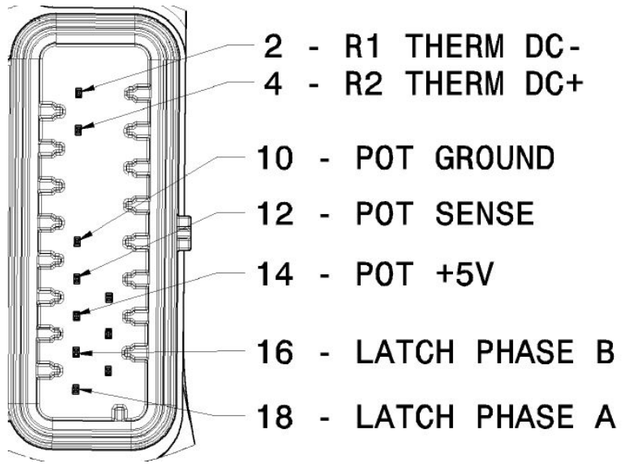


TEST PINS

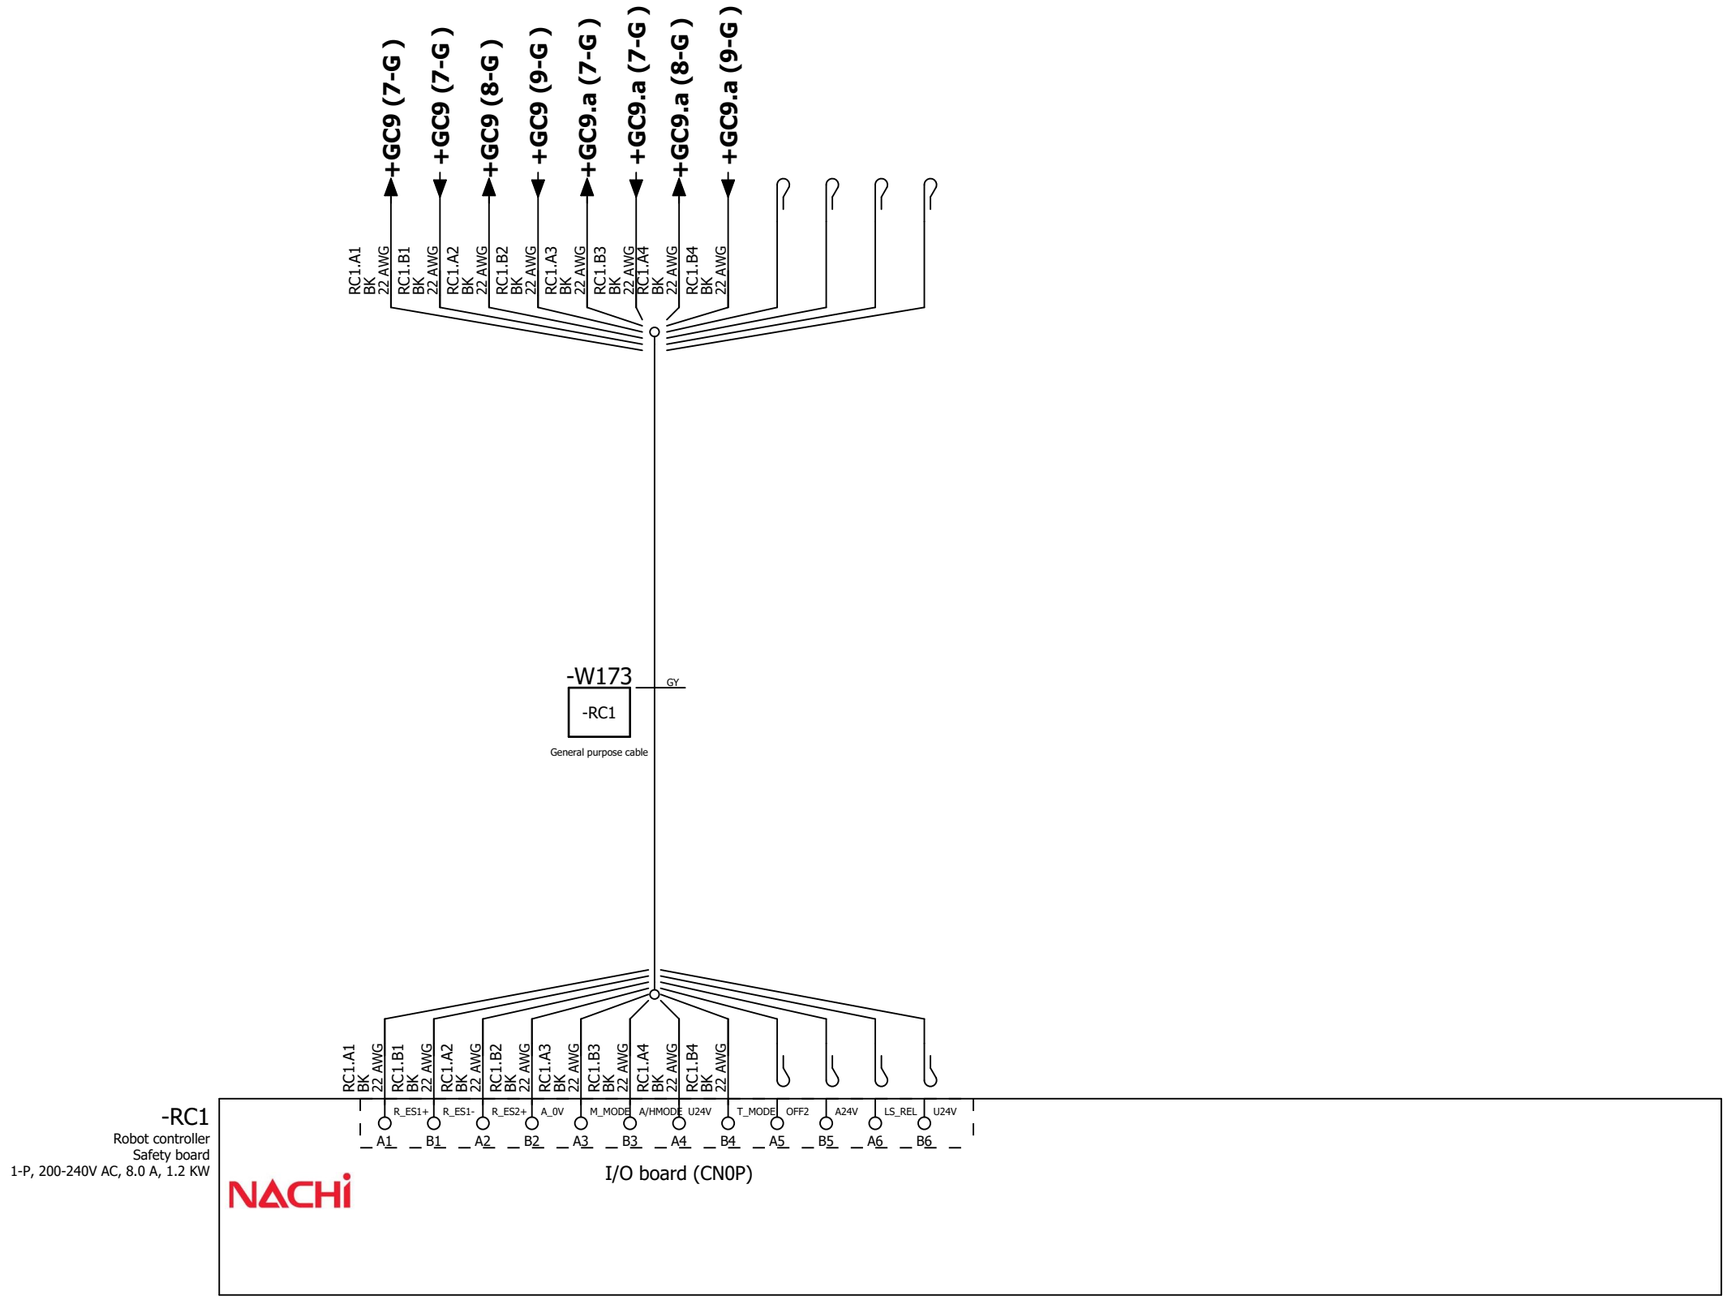

Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name		Facility 24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Robot controller connections		Mounting location SST
		Revision	0	Station name			Sheet 11
		Responsible	EPLAN	ST 60			Page 77 / 83


-MU1
Maintenance unit
1/4 4-10 bar
AC30-N03CG-Z-A

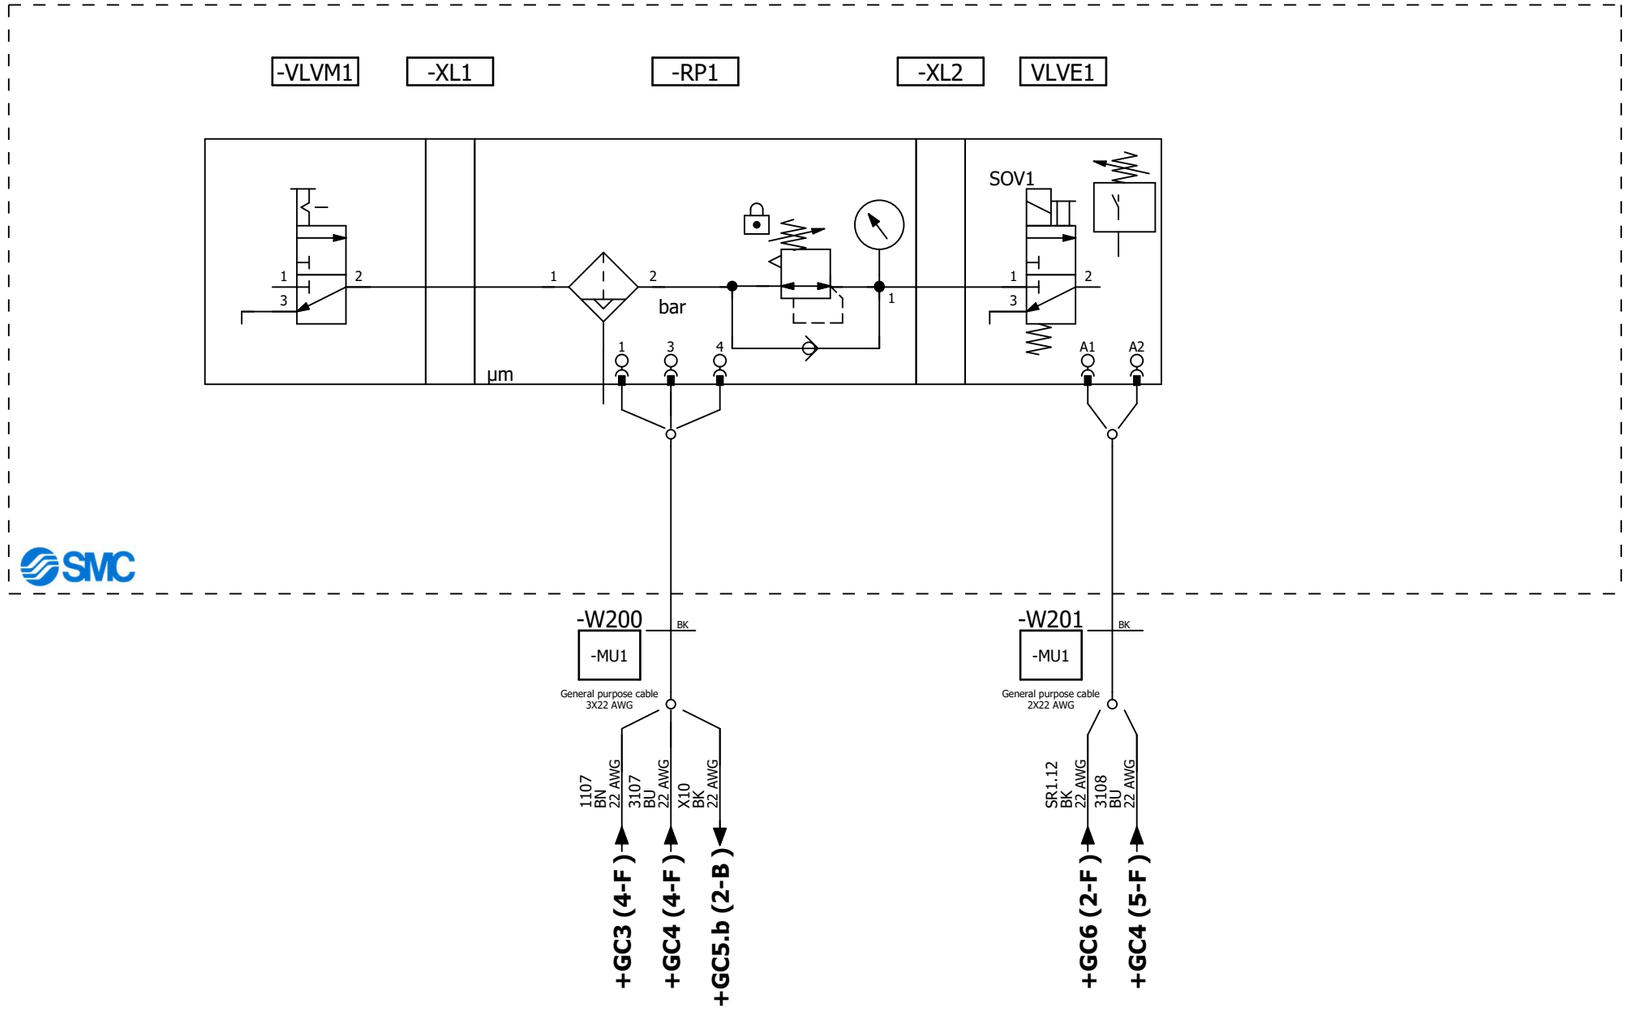



-W200 BK
-MU1
General purpose cable
3X22 AWG
1107 BN 22 AWG
3107 BU 22 AWG
X10 BK 22 AWG
+GC3 (4-F)
+GC4 (4-F)
+GC5.b (2-B)

-W201 BK
-MU1
General purpose cable
2X22 AWG
SR1.12 BK 22 AWG
3108 BU 22 AWG
+GC6 (2-F)
+GC4 (5-F)


Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility 24VCD
	Client: Pegatron PEGATRON	Modified	19/05/2026	NV9X CP	Mantenance unit connections	Mounting location PN
		Revision	0	Station name		Sheet 1
		Responsible	EPLAN	ST 60		Page 78 / 83

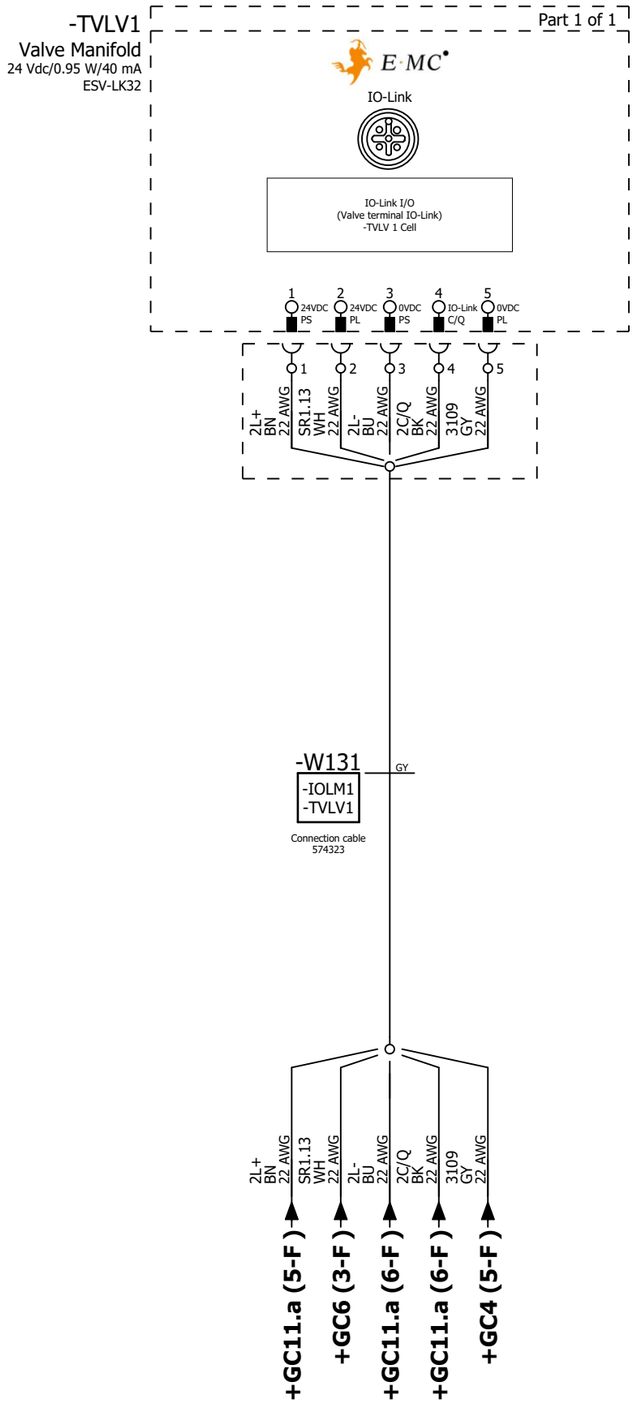
-TVLV1
Valve Manifold
24 Vdc/0.95 W/40 mA
ESV-LK32
Part 1 of 1
E·MC
IO-Link
IO-Link I/O
(Valve terminal IO-Link)
-TVLV 1 Cell
1 24VDC PS
2 24VDC PL
3 0VDC PS
4 IO-Link C/Q
5 0VDC PL
1 2 3 4 5
2L+ BN 22 AWG
SR1.13 WH 22 AWG
2L- BU 22 AWG
2C/Q BK 22 AWG
3109 GY 22 AWG
-W131
GY
-IOLM1
-TVLV1
Connection cable
574323
2L+ BN 22 AWG
SR1.13 WH 22 AWG
2L- BU 22 AWG
2C/Q BK 22 AWG
3109 GY 22 AWG
+GC11.a (5-F)
+GC6 (3-F)
+GC11.a (6-F)
+GC11.a (6-F)
+GC4 (5-F)

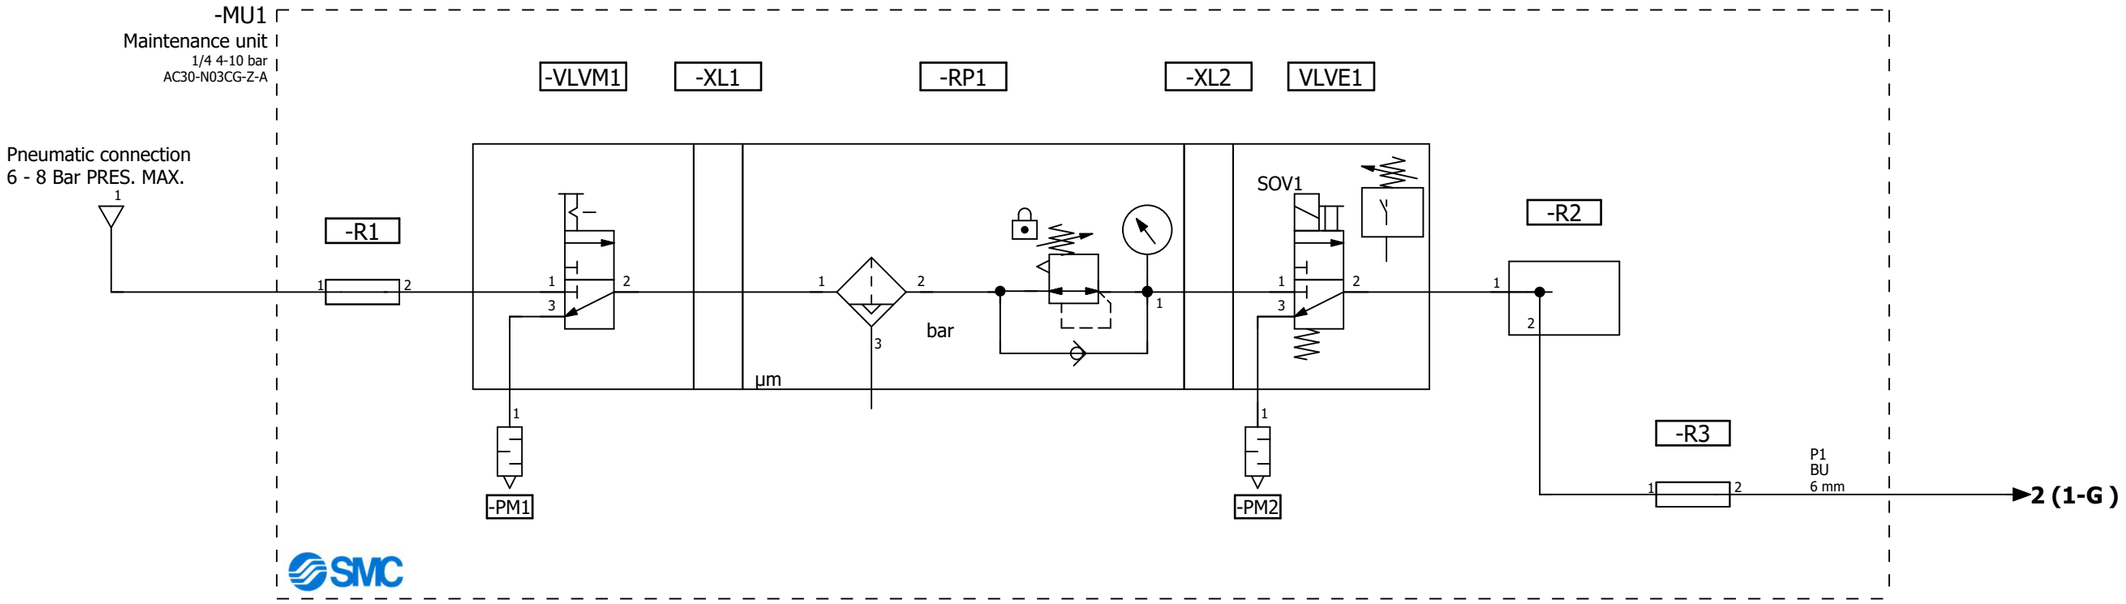

-MU1
Maintenance unit
1/4 4-10 bar
AC30-N03CG-Z-A
-VLVM1
-XL1
-RP1
-XL2
VLVE1
Pneumatic connection
6 - 8 Bar PRES. MAX.
-R1
SOV1
-R2
bar
µm
-PM1
-PM2
-R3
P1
BU
6 mm
2 (1-G)
SMC

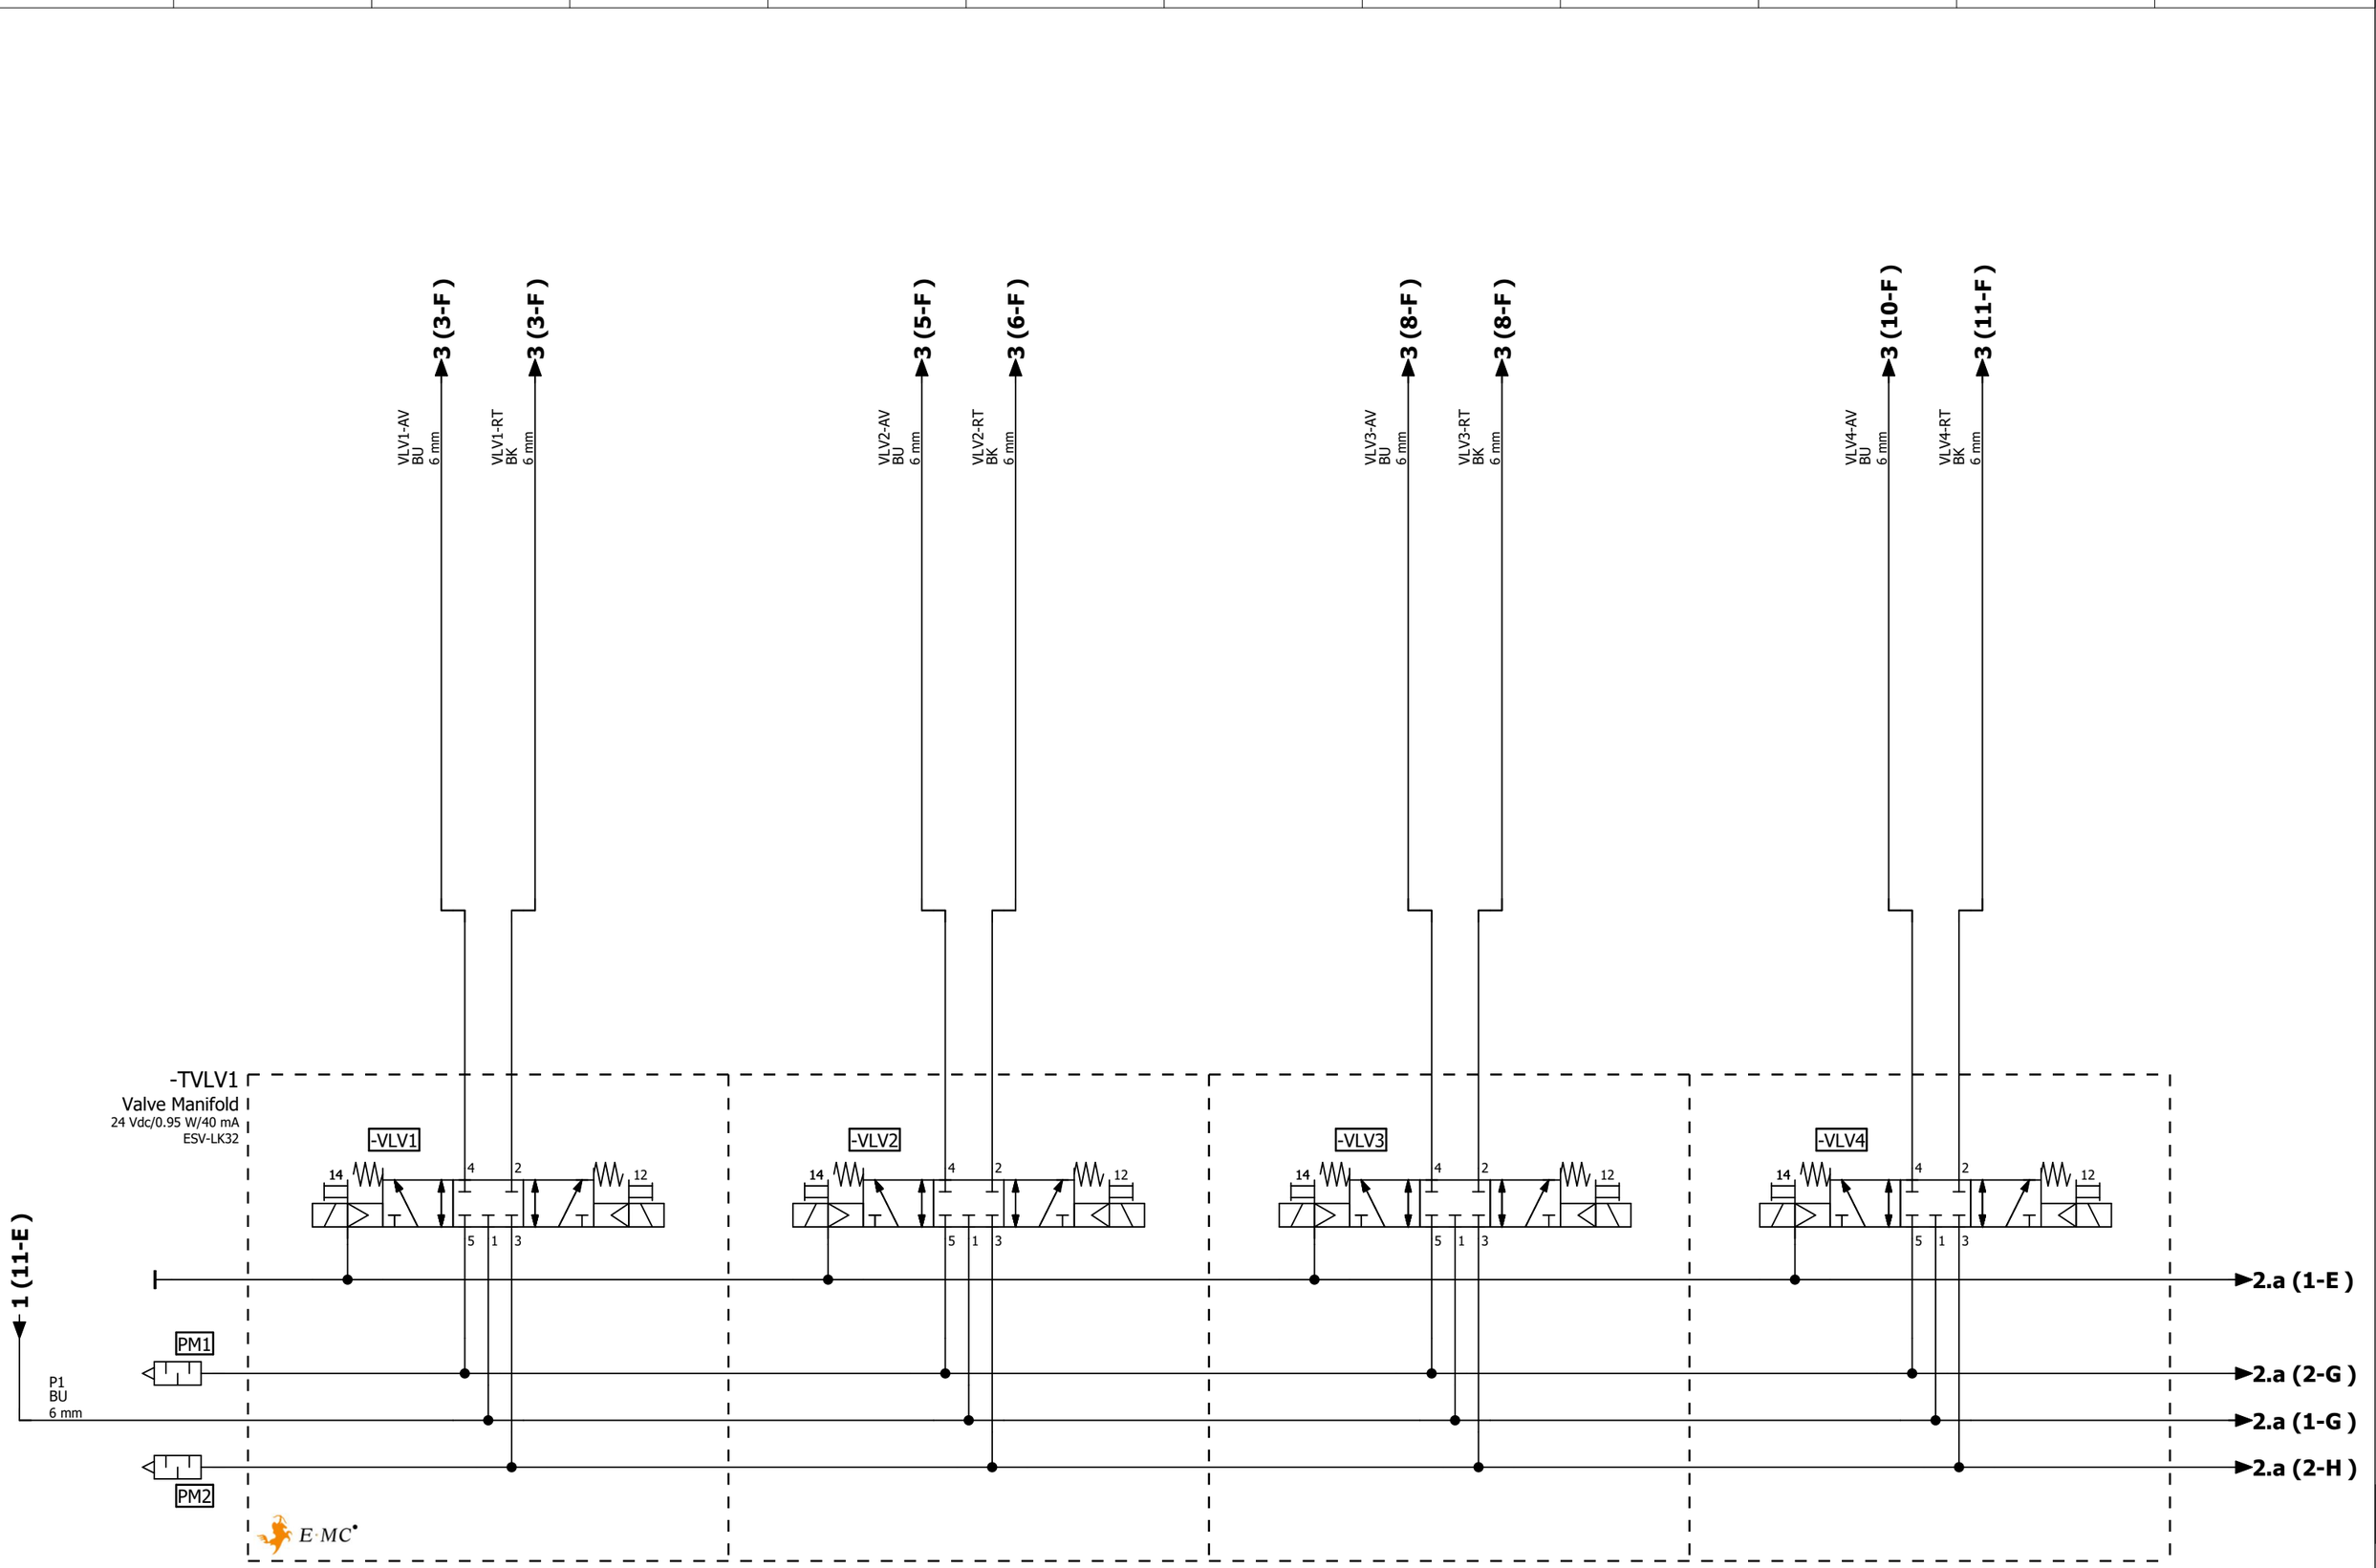

Automatyco®	Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility PNEU(Pneumatics)
		Client: Pegatron	Modified	19/05/2026	NV9X CP	Valve terminal connections	Mounting location SST
		PEGATRON	Revision	0	Station name		Sheet 2
			Responsible	EPLAN	ST 60		Page 81 / 83

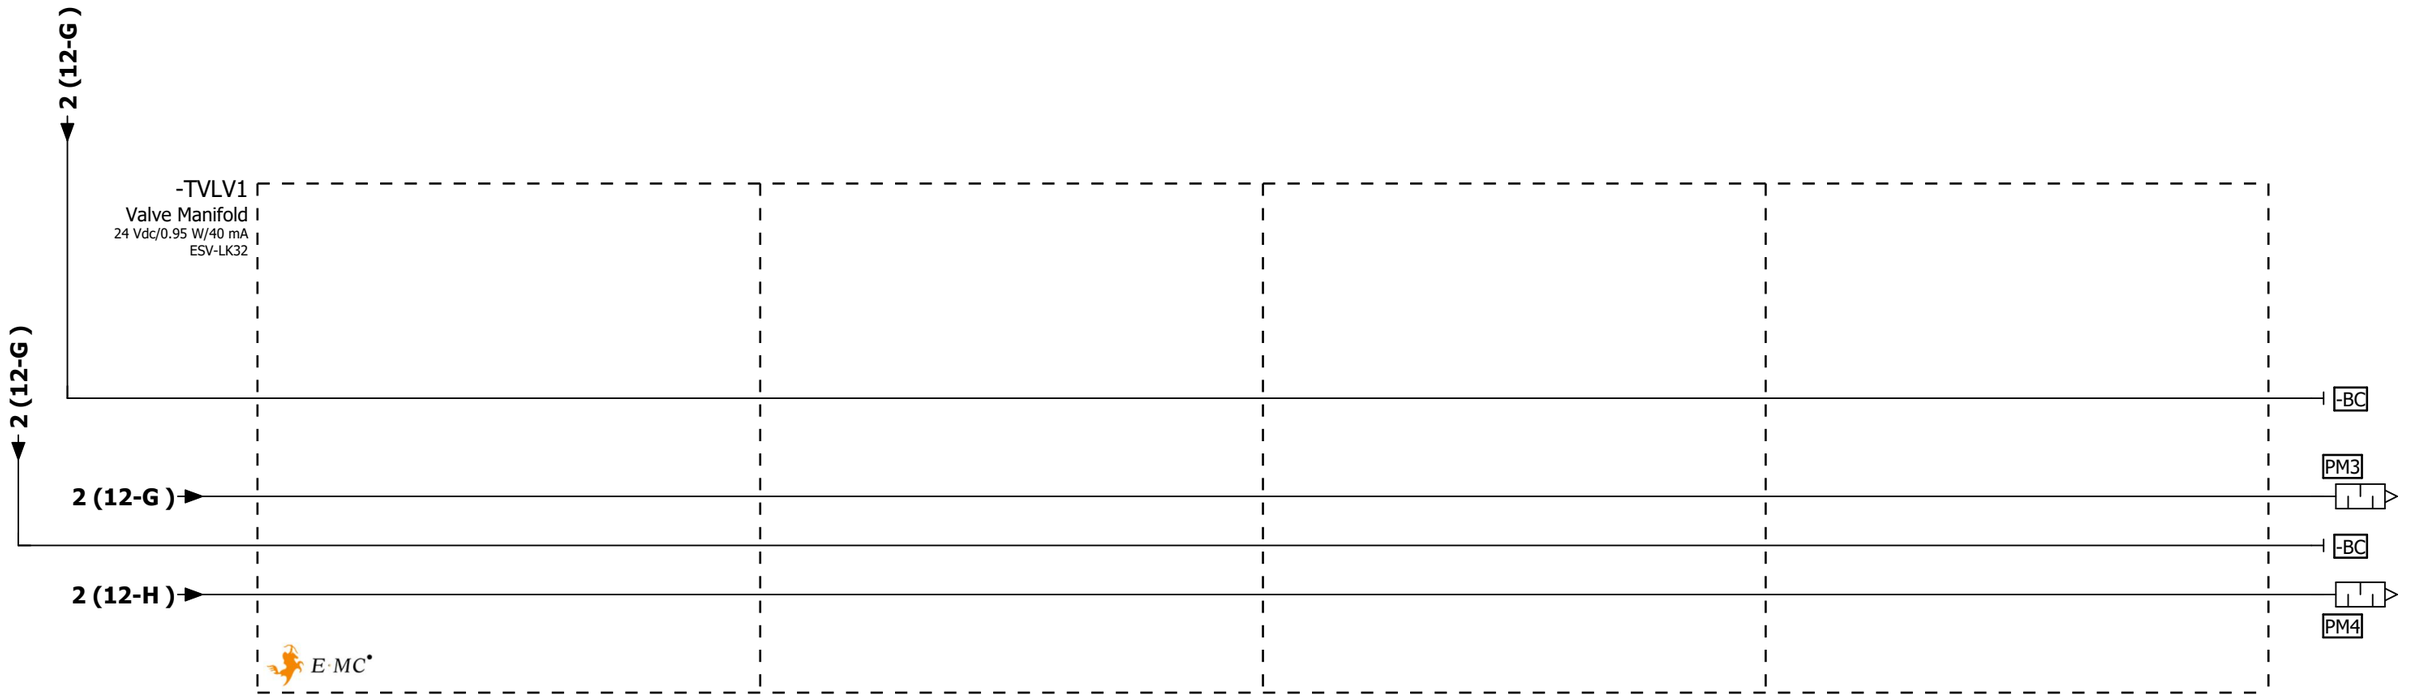

Automatyco® Automatización, Mantenimiento y Construcción Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115, Valle de Santa Cruz, CP 45640 Tlajomulco de Zuñiga, Jal, Mex.	O.P. 973	Created	08/12/2025	Project's name	Page name	Facility PNEU(Pneumatics)
	Client: Pegatron PEGATRON	Modified	28/03/2026	NV9X CP	Valve terminal connections	Mounting location SST
		Revision	0	Station name		Sheet 2.a
		Responsible	EPLAN	ST 60		Page 82 / 83

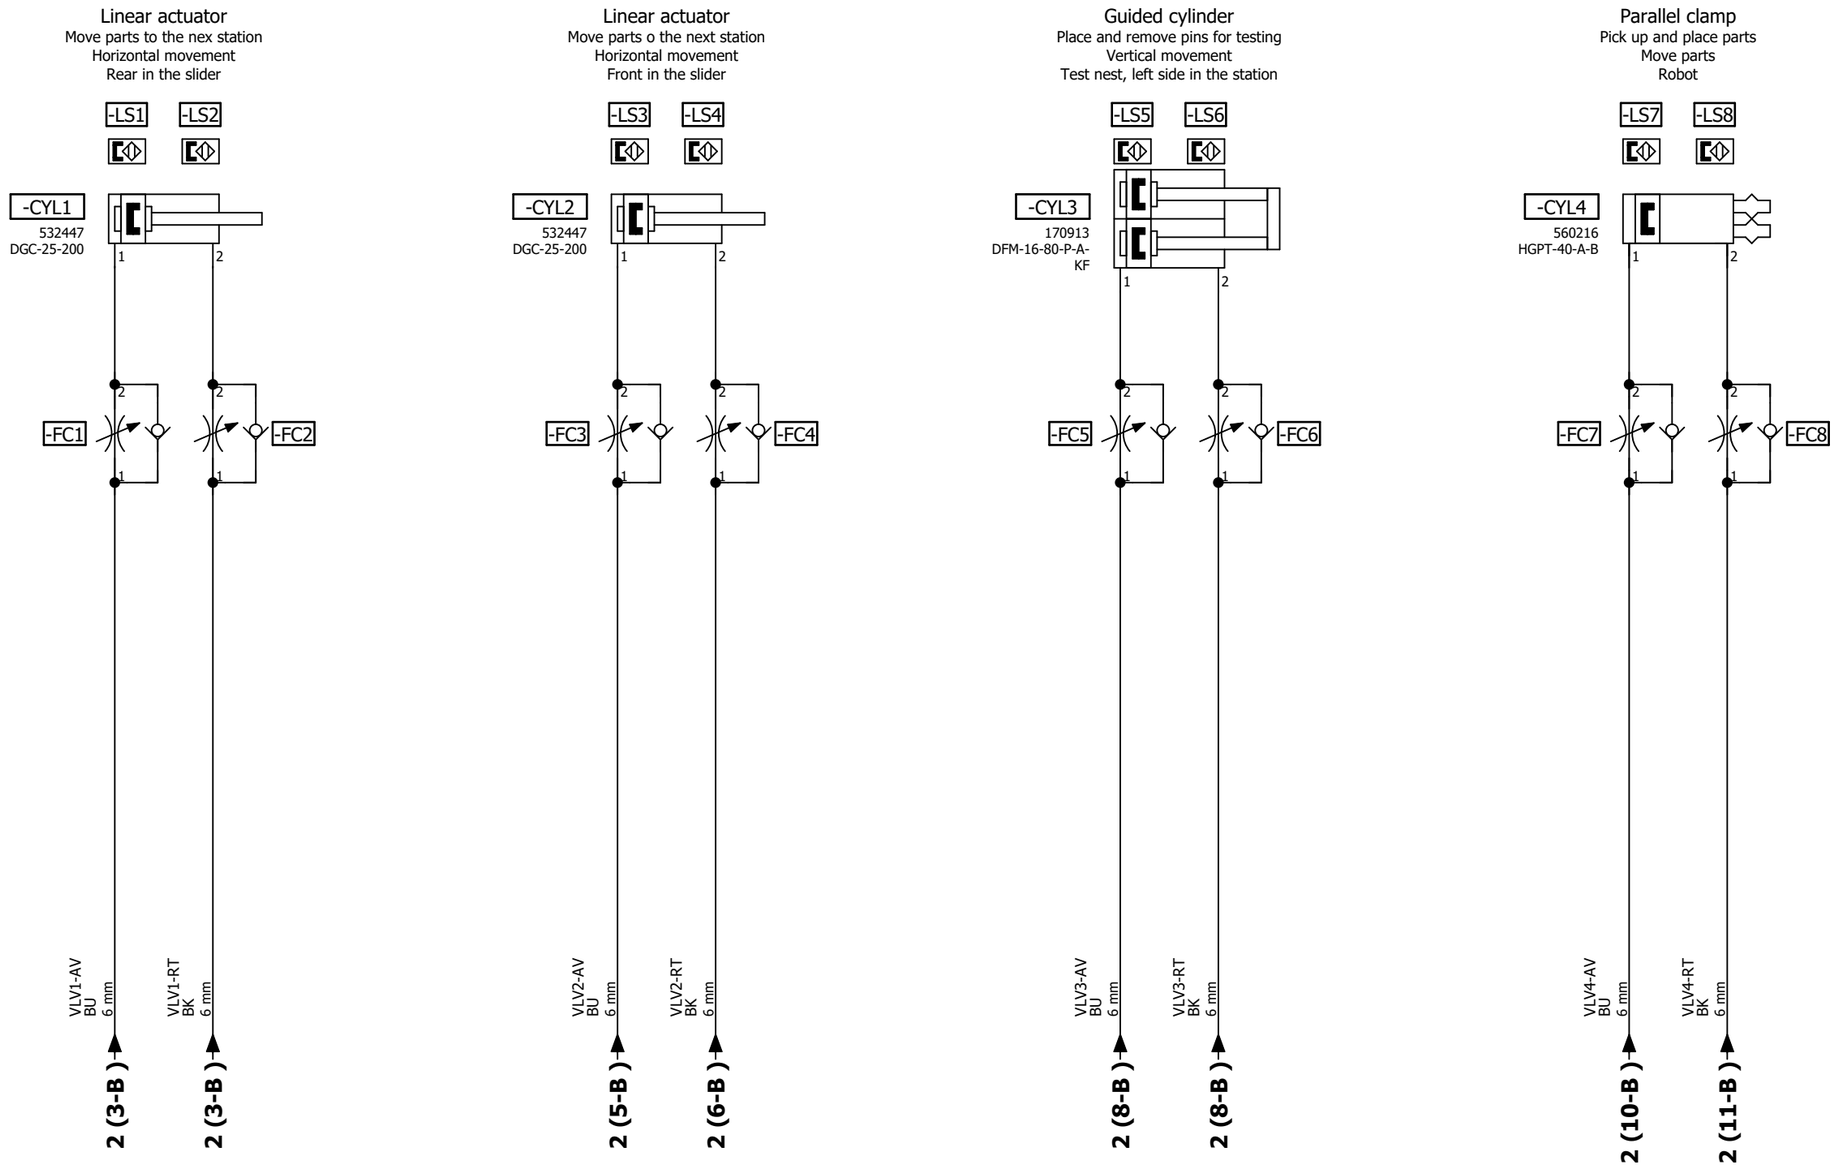

1	2	3	4	5	6	7	8	9	10	11	12

A B C D E F G H

Automatyco®

Automatización, Mantenimiento y Construcción
Condominio Industrial Siglo 21, Av. Siglo 21 #50 int #115,
Valle de Santa Cruz, CP 45640
Tlajomulco de Zuñiga, Jal, Mex.

O.P. 973

Client: Pegatron

PEGATRON

Created	08/12/2025
Modified	27/03/2026
Revision	0
Responsible	EPLAN

Project's name: NV9X CP

Station name: ST 60

Page name: Cylinders connections

Facility	PNEU(Pneumatics)
Mounting location	SST
Sheet	3
Page	83 / 83