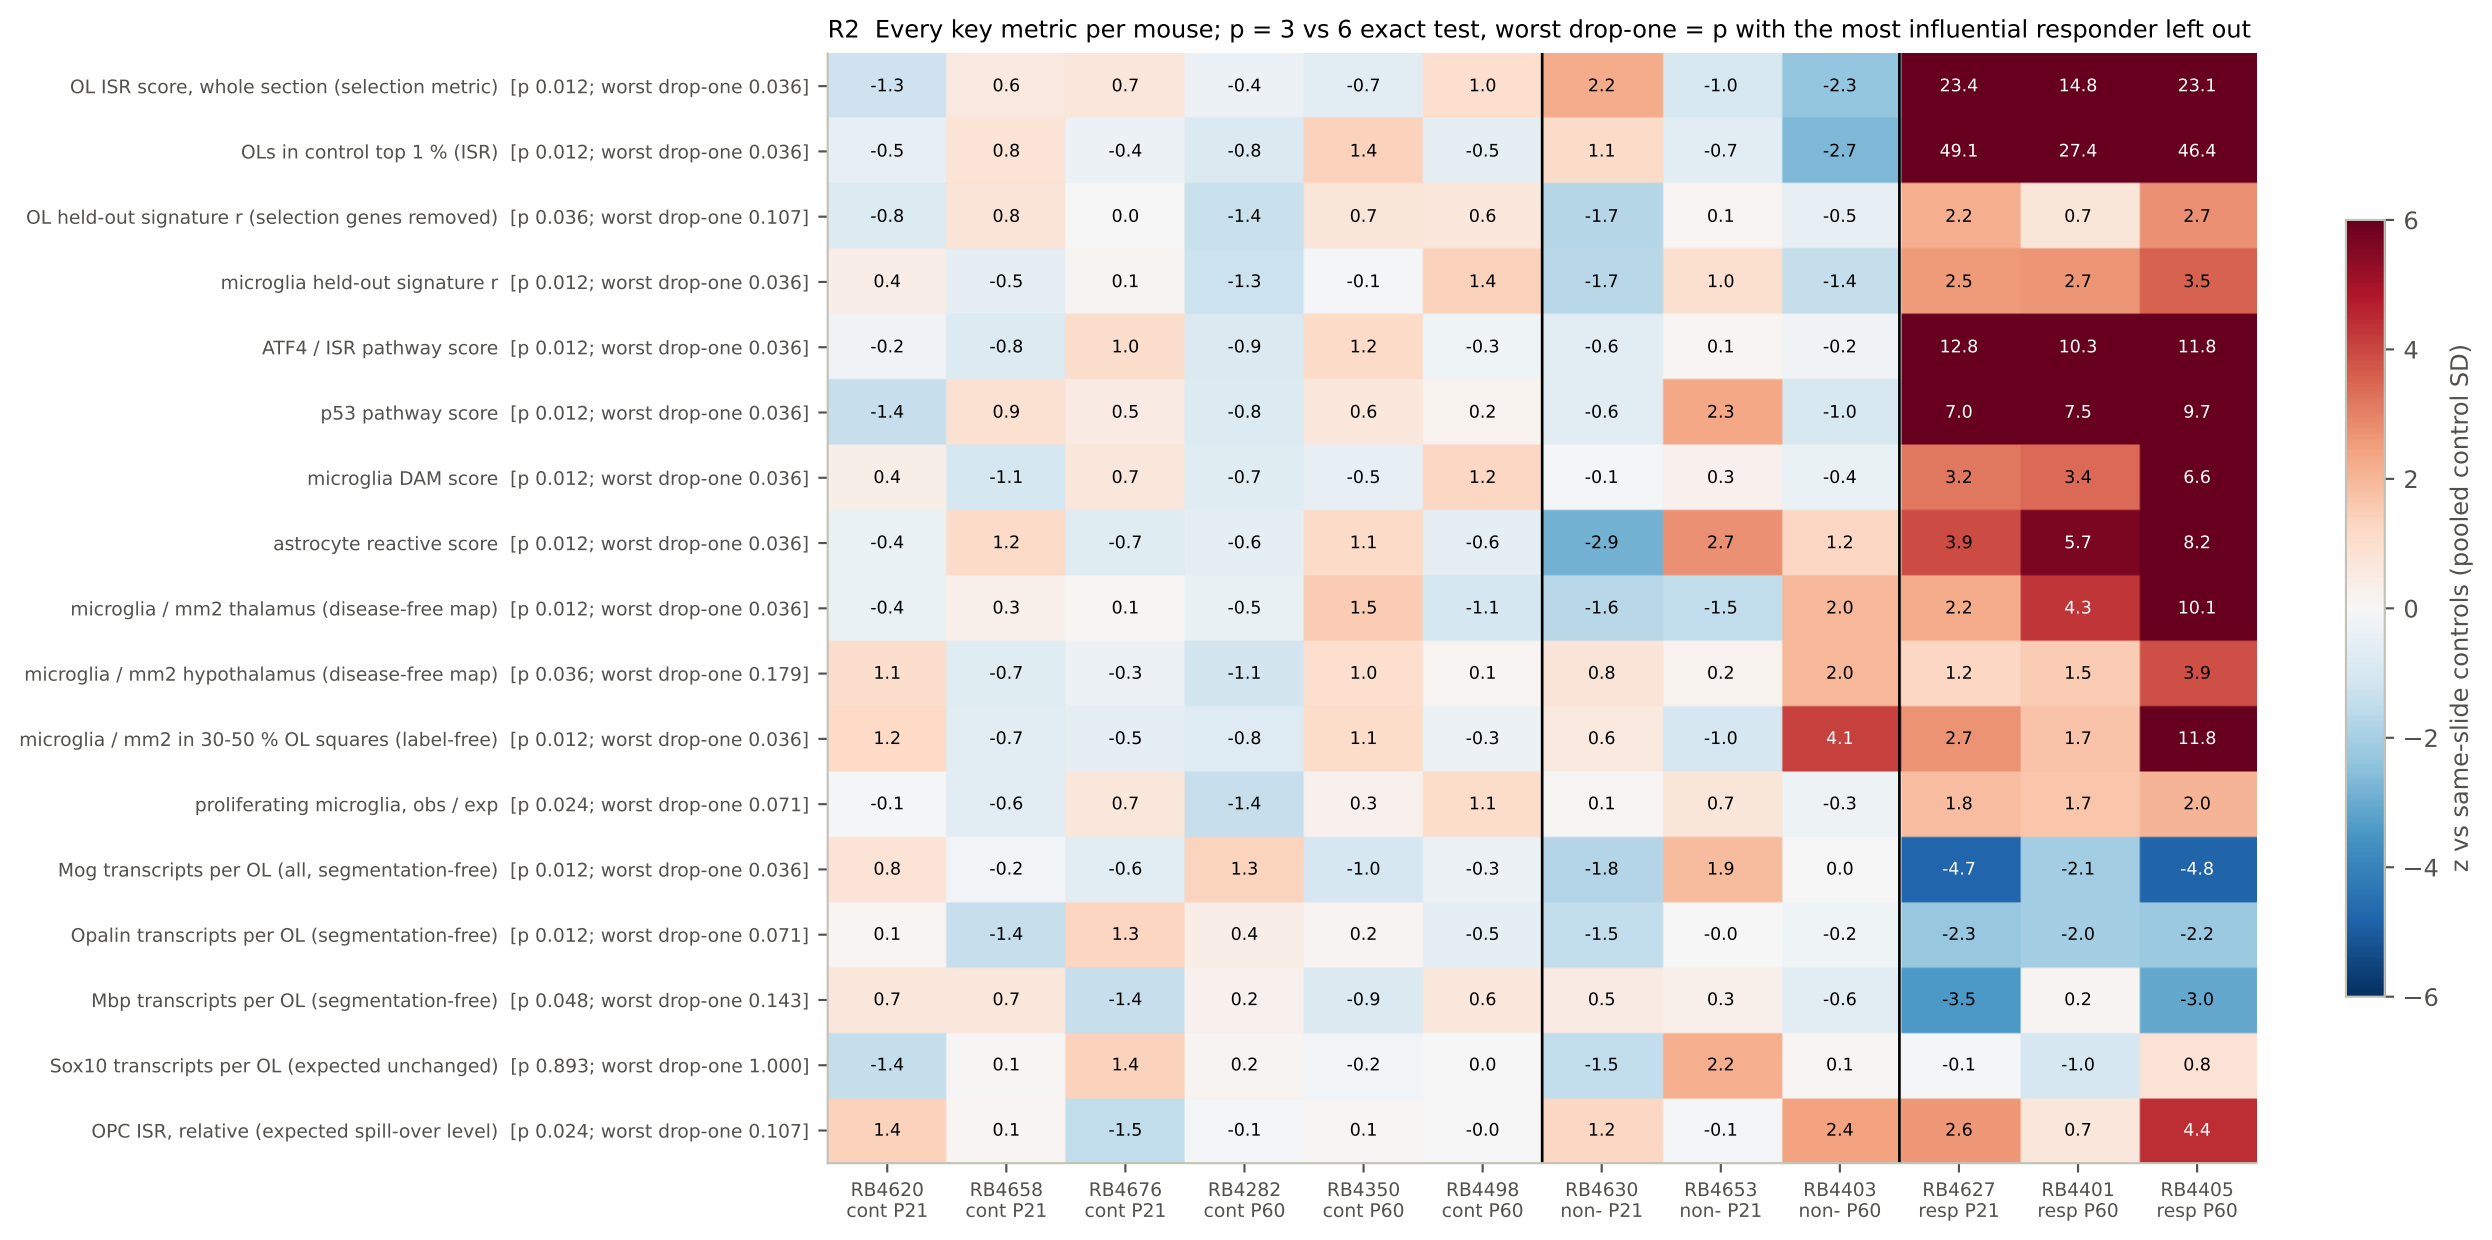
R2 Every key metric per mouse; p = 3 vs 6 exact test, worst drop-one = p with the most influential responder left out
OL ISR score, whole section (selection metric) [p 0.012; worst drop-one 0.036]
OLs in control top 1 % (ISR) [p 0.012; worst drop-one 0.036]
OL held-out signature r (selection genes removed) [p 0.036; worst drop-one 0.107]
microglia held-out signature r [p 0.012; worst drop-one 0.036]
ATF4 / ISR pathway score [p 0.012; worst drop-one 0.036]
p53 pathway score [p 0.012; worst drop-one 0.036]
microglia DAM score [p 0.012; worst drop-one 0.036]
astrocyte reactive score [p 0.012; worst drop-one 0.036]
microglia / mm2 thalamus (disease-free map) [p 0.012; worst drop-one 0.036]
microglia / mm2 hypothalamus (disease-free map) [p 0.036; worst drop-one 0.179]
microglia / mm2 in 30-50 % OL squares (label-free) [p 0.012; worst drop-one 0.036]
proliferating microglia, obs / exp [p 0.024; worst drop-one 0.071]
Mog transcripts per OL (all, segmentation-free) [p 0.012; worst drop-one 0.036]
Opalin transcripts per OL (segmentation-free) [p 0.012; worst drop-one 0.071]
Mbp transcripts per OL (segmentation-free) [p 0.048; worst drop-one 0.143]
Sox10 transcripts per OL (expected unchanged) [p 0.893; worst drop-one 1.000]
OPC ISR, relative (expected spill-over level) [p 0.024; worst drop-one 0.107]
-1.3 0.6 0.7 -0.4 -0.7 1.0 2.2 -1.0 -2.3 23.4 14.8 23.1
-0.5 0.8 -0.4 -0.8 1.4 -0.5 1.1 -0.7 -2.7 49.1 27.4 46.4
-0.8 0.8 0.0 -1.4 0.7 0.6 -1.7 0.1 -0.5 2.2 0.7 2.7
0.4 -0.5 0.1 -1.3 -0.1 1.4 -1.7 1.0 -1.4 2.5 2.7 3.5
-0.2 -0.8 1.0 -0.9 1.2 -0.3 -0.6 0.1 -0.2 12.8 10.3 11.8
-1.4 0.9 0.5 -0.8 0.6 0.2 -0.6 2.3 -1.0 7.0 7.5 9.7
0.4 -1.1 0.7 -0.7 -0.5 1.2 -0.1 0.3 -0.4 3.2 3.4 6.6
-0.4 1.2 -0.7 -0.6 1.1 -0.6 -2.9 2.7 1.2 3.9 5.7 8.2
-0.4 0.3 0.1 -0.5 1.5 -1.1 -1.6 -1.5 2.0 2.2 4.3 10.1
1.1 -0.7 -0.3 -1.1 1.0 0.1 0.8 0.2 2.0 1.2 1.5 3.9
1.2 -0.7 -0.5 -0.8 1.1 -0.3 0.6 -1.0 4.1 2.7 1.7 11.8
-0.1 -0.6 0.7 -1.4 0.3 1.1 0.1 0.7 -0.3 1.8 1.7 2.0
0.8 -0.2 -0.6 1.3 -1.0 -0.3 -1.8 1.9 0.0 -4.7 -2.1 -4.8
0.1 -1.4 1.3 0.4 0.2 -0.5 -1.5 -0.0 -0.2 -2.3 -2.0 -2.2
0.7 0.7 -1.4 0.2 -0.9 0.6 0.5 0.3 -0.6 -3.5 0.2 -3.0
-1.4 0.1 1.4 0.2 -0.2 0.0 -1.5 2.2 0.1 -0.1 -1.0 0.8
1.4 0.1 -1.5 -0.1 0.1 -0.0 1.2 -0.1 2.4 2.6 0.7 4.4
RB4620 cont P21
RB4658 cont P21
RB4676 cont P21
RB4282 cont P60
RB4350 cont P60
RB4498 cont P60
RB4630 non- P21
RB4653 non- P21
RB4403 non- P60
RB4627 resp P21
RB4401 resp P60
RB4405 resp P60
6
4
2
0
−2
−4
−6
z vs same-slide controls (pooled control SD)