

The complete solution to all
your cooling needs





NSCS 100-250/150/W46VCC4

NSCS 100-160/40/W45VCC4

Installation, Operating and Maintenance Manual

Client: Q Cooling

CN: CN3217




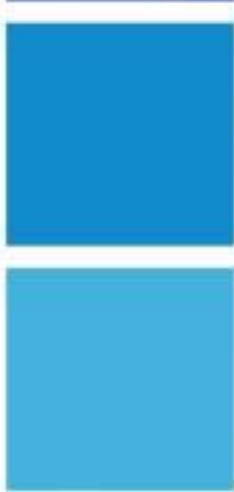
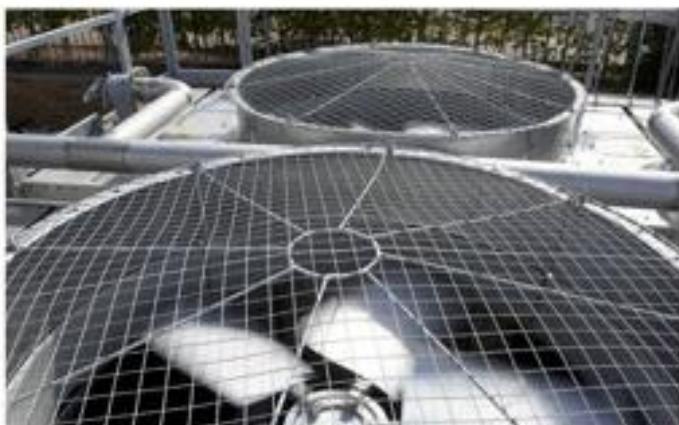


INSTALLATION, OPERATING AND MAINTENANCE MANUAL

PART	CONTENTS	
1.	General Assembly	3
2.	Electrical Drawings	5
3.	NCSE Pump Manual	81
4.	FCSE Inverter Manual	94
5.	Datasheets	98
6.	Certifications	194

General Assembly

E		
D		
C		
B		
A		
*	Name	Date
	Modification	

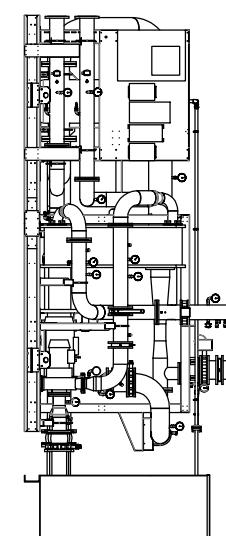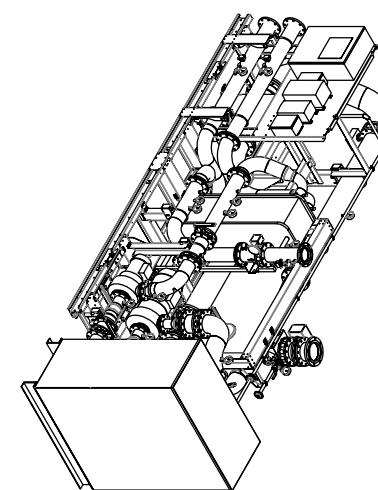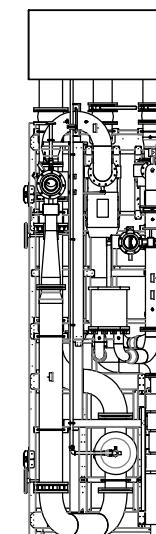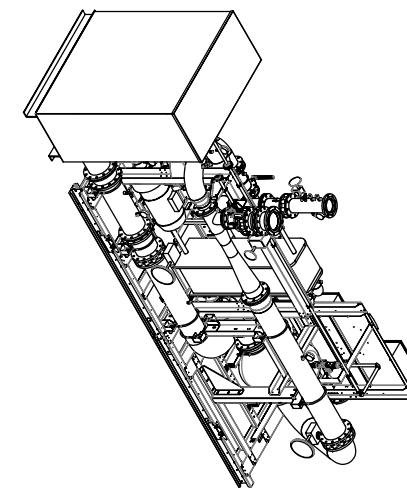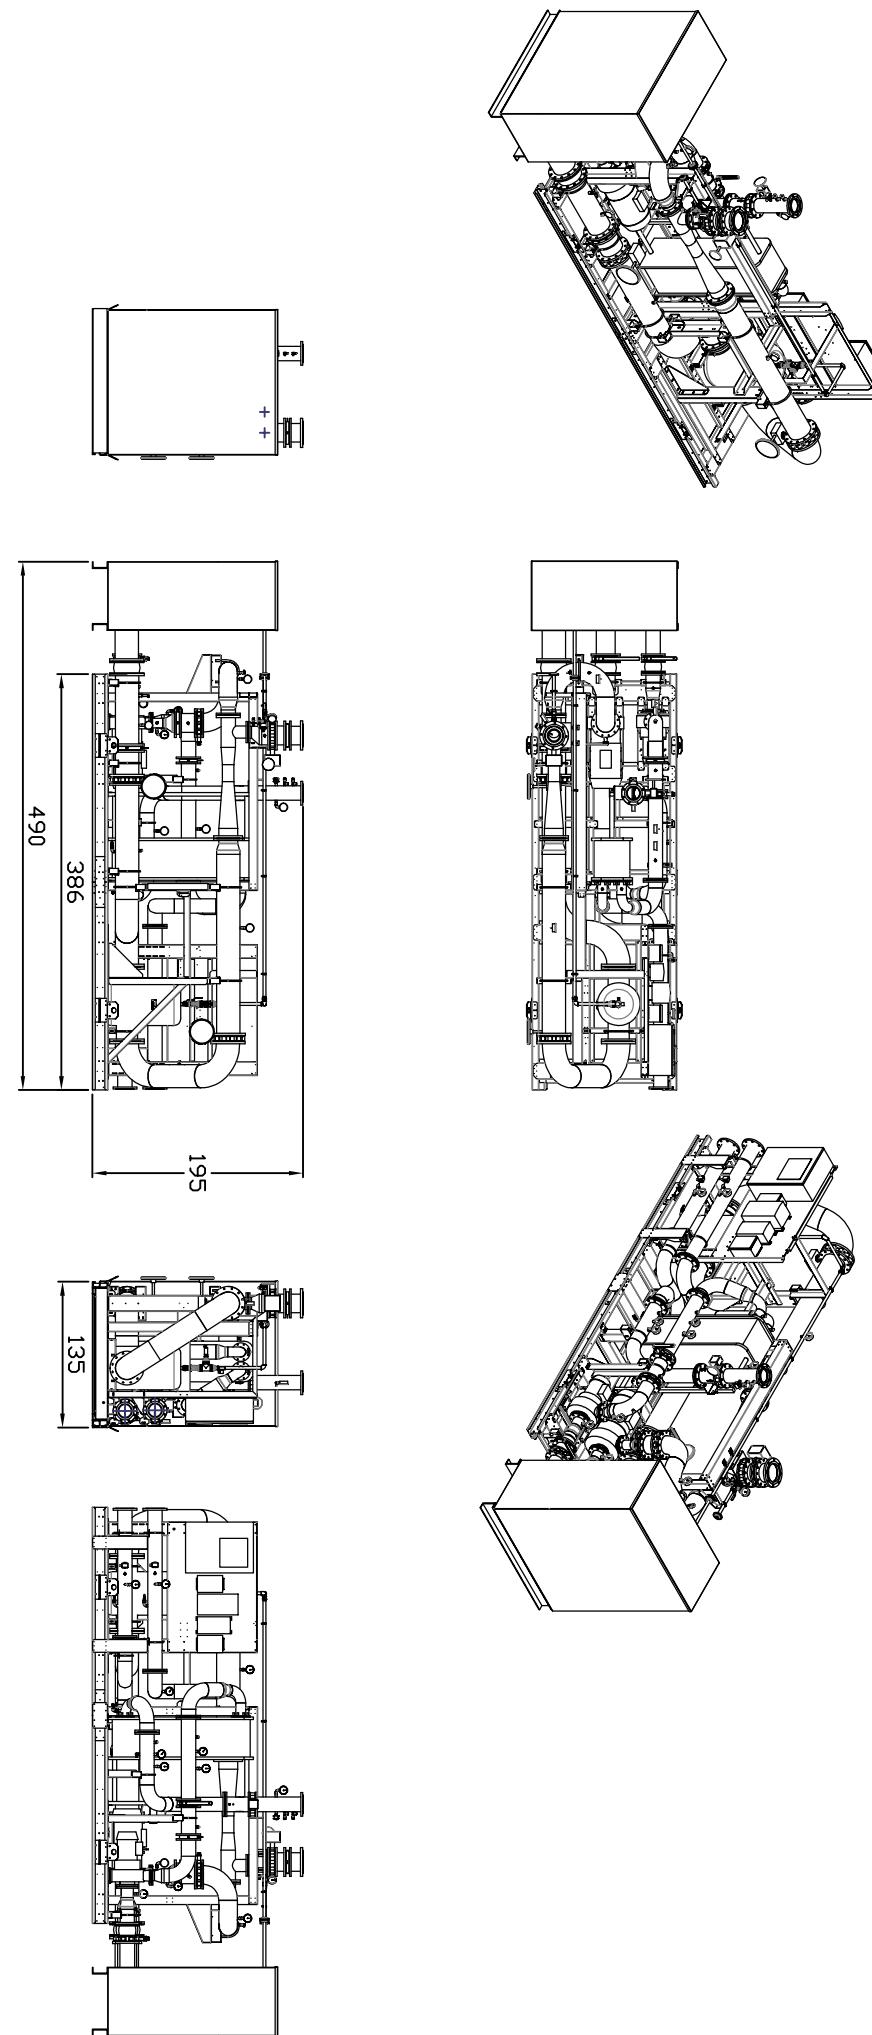

Electrical Drawings

AQUA COOLING SOLUTIONS LIMITED

UNIT D4 SEGENSWORTH BUSINESS CENTRE
SEGENSWORTH ROAD, FAREHAM
HAMPSHIRE PO15 5RQ

Tel.: +44 (0) 845 0941 800 Fax.: +44 (0) 845 0941 900

Customer :
Plant Designation : CP1
Drawing number : P15033
Project Number :

End User	:	Control panel by	: Shellau
Site Location	:	Incoming supply	: 110VAC
		Feeder	:
		Control voltage	: 24VDC
		Manufacturing date	: July 2015
		Degree of protect.	: IP65
		Panel Location	:

ISSUED FOR MANUFACTURE = 22/07/2015

Created on : 08. Jun. 2015
Responsible for project : Mike West
Date changed : 22. Jul. 2015 Highest Page No. : 135
Editor : MDC No. of pages : 63

		Date	08. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	Cover Sheet	P15033	=	
		Editor	M. CARMODY					+	
		Tested	22. Jul. 2015		Sub. f.				P. 1
Changes	Date	Name	Norm		Original	Sub. b.			135 P.

0	1	2	3	4	5	6	7	8	9
---	---	---	---	---	---	---	---	---	---

Table of contents

Column X: an automatically created page is manual changed

ESSJ010E

Page	Page designation	Suppl. page field	Date	User	X
1	Cover Sheet		22. Jul. 2015	M. CARMODY	
2	Table of Contents		22. Jul. 2015	MDC	x
3	Table of Contents		22. Jul. 2015	MDC	x
4	Table of Contents		22. Jul. 2015	MDC	x
5	General Specifications & Technical Information		22. Jul. 2015	M. CARMODY	
10	PLC Overview		21. Jul. 2015	MDC	
20	110VAC Power Supply Main Distribution		22. Jul. 2015	M. CARMODY	
30	110VAC & 24VDC Distribution		22. Jul. 2015	M. CARMODY	
40	Pump VSD's		22. Jul. 2015	MDC	
41	Pump Control		22. Jul. 2015	MDC	
42	Control Field Devices		22. Jul. 2015	MDC	
43	Control Field Devices		22. Jul. 2015	MDC	
50	Carel pC05+ Controller		22. Jul. 2015	MDC	
51	Carel pC05+ Controller Universal Analogue Inputs		21. Jul. 2015	M. CARMODY	
52	Carel pC05+ Controller Universal Analogue Inputs		21. Jul. 2015	MDC	
53	Carel pC05+ Controller Digital Inputs		22. Jul. 2015	M. CARMODY	
54	Carel pC05+ Controller Digital Inputs		22. Jul. 2015	MDC	
55	Carel pC05+ Controller Digital Inputs		22. Jul. 2015	MDC	
60	Carel pC05+ Controller Analogue Outputs		21. Jul. 2015	M. CARMODY	
61	Carel pC05+ Controller Digital Relay Outputs		21. Jul. 2015	M. CARMODY	
62	Carel pC05+ Controller Digital Relay Outputs		21. Jul. 2015	MDC	
63	Carel pC05+ Controller Digital Relay Outputs		21. Jul. 2015	MDC	
70	CP1 Panel Arrangement		22. Jul. 2015	MDC	
71	CP1 Label Engraving Details		22. Jul. 2015	MDC	
72	CP1 Backplate Arrangement		22. Jul. 2015	MDC	
80	CP2 Panel Arrangement Backplate Arrangement		11. Jun. 2015	MDC	
90	Bill of Materials		21. Jul. 2015	TMC	
91	Bill of Materials		21. Jul. 2015	TMC	
92	Bill of Materials		21. Jul. 2015	TMC	
93	Bill of Materials		21. Jul. 2015	TMC	

		Date					=	
		Editor	MDC				+	
		Tested	22. Jul. 2015					
		CP1		AQUA COOLING SOLUTIONS	Table of Contents	P15033		P. 2
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		135 P.

0	1	2	3	4	5	6	7	8	9
---	---	---	---	---	---	---	---	---	---

Table of contents

Column X: an automatically created page is manual changed

ESSJ010E

Page	Page designation	Suppl. page field	Date	User	X
94	Bill of Materials		21. Jul. 2015	TMC	
95	Bill of Materials		21. Jul. 2015	TMC	
102	X1CP2		15. Jun. 2015	MDC	x
106	-X4		15. Jun. 2015	MDC	x
107	-X5		15. Jun. 2015	MDC	x
108	Terminal strip and connector overview		15. Jun. 2015	MDC	x
109	Cable overview		15. Jun. 2015	MDC	x
110	W40DI1 PUMP - RTP1 LPS ISOLATOR TO VSD		15. Jun. 2015	MDC	x
111	W40DI2 PUMP - CTP1 RECIRCULATION		15. Jun. 2015	MDC	x
112	W40M1 PUMP - RTP1 LPS		15. Jun. 2015	MDC	x
113	W40M2 PUMP - CTP1 RECIRCULATION		15. Jun. 2015	MDC	x
114	W40TT5 CTP1 TEMPERATURE SENSOR		15. Jun. 2015	MDC	x
115	W40VSD-M1 MODBUS NETWORK		15. Jun. 2015	MDC	x
116	W40VSD-M2 MODBUS NETWORK		15. Jun. 2015	MDC	x
117	W40VSD1 VENTURI FLOW PRESSURE		15. Jun. 2015	MDC	x
118	W40VSD2 CTP1 TEMPERATURE SENSOR		15. Jun. 2015	MDC	x
119	W42FS1 VENTURI THERMAL FLOW SWITCH		15. Jun. 2015	MDC	x
120	W42LS1 LEAK LEVEL SENSOR		15. Jun. 2015	MDC	x
121	W42PT1 NEGATIVE VENTURI SUCTION No. 1		15. Jun. 2015	MDC	x
122	W42PT2 NEGATIVE VENTURI SUCTION No. 2		15. Jun. 2015	MDC	x
123	W43SV1 AIR RELEASE SOLENOID VALVE		15. Jun. 2015	MDC	x
124	W51PT3 VENTURI INLET PRESSURE		15. Jun. 2015	MDC	x
125	W51PT4 DATA CENTRE FLOW PRESSURE No. 1		15. Jun. 2015	MDC	x
126	W51PT5 DATA CENTRE FLOW PRESSURE No. 2		15. Jun. 2015	MDC	x
127	W51TT1 CHILLER FLOW TEMPERATURE		15. Jun. 2015	MDC	x
128	W51TT2 CHILLER RETURN TEMPERATURE		15. Jun. 2015	MDC	x
129	W52TT3 DATA CENTRE RETURN TEMPERATURE		15. Jun. 2015	MDC	x
130	W52TT4 DATA CENTRE FLOW TEMPERATURE		15. Jun. 2015	MDC	x
131	WX1-40VSD1 40VSD1 CONTROL		15. Jun. 2015	MDC	x
132	WX2-40VSD2 40VSD2 CONTROL		15. Jun. 2015	MDC	x

Changes	Date	Name Norm	Editor MDC	Tested 22. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Table of Contents	P15033		=	P. 3
								Original	Sub. f.	Sub. b.	

Table of contents

Column X: an automatically created page is manual changed

ESSJ010E

		Date		CP1	AQUA COOLING SOLUTIONS	Table of Contents	P15033		=
		Editor	MDC						+ +
		Tested	22. Jul. 2015						P. 4
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.			135 P.

GENERAL SPECIFICATIONS AND TECHNICAL INFORMATION

CONTROL PANEL DETAILS	SPECIFICATION	NOTE COMMENTS: -	PAINT FINISH	SPECIFICATION
TOTAL SIZE OF ENCLOSURE/CONTROL PANEL/S	800(H) x 600(W) x 250(D) mm		GLOSS: SEMI GLOSS: MATT: POWDER-COATED etc	RITTAL STANDARD PAINT FINISH
APPROXIMATE OVERALL WEIGHT			EXTERIOR COLOUR (EXCLUDING DOORS)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY	1 PHASE/NEUTRAL/EARTH 110VAC/60Hz		EXTERIOR COLOUR (DOORS)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY TYPE			INTERIOR COLOUR (EXCLUDING BACKPLATE)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY REQUIREMENTS	13AMP SUPPLY		INTERIOR COLOUR (INSIDE OF DOORS)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY ALLOWANCES FOR DIVERSITY	DIVERSITY 100%FLC CONNECTED		MOUNTING PLATE/S	RITTAL STANDARD (ZINC PLATED)
SYSTEM SUPPLY DESIGN CURRENT REQUIREMENTS			BASE/PLINTH (FITTED)	RITTAL STANDARD (RAL 7022)
MAIN SUPPLY ISOLATOR TYPE 400AMP FUSE DISCONNECTOR	25AMP / 25kA MAIN ISOLATOR		CABLE CHAMBER (NOT FITTED)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SHORT CIRCUIT CAPACITY	10kA			
APPARENT POWER (KVA CONNECTED)		P = V x I x 1.732		
ACTIVE POWER (KW CONNECTED)		P = V x I x 1.732 x 0.8		
DC CONTROL POWER (WATTS CONNECTED)		POWER SUPPLY UNIT 400VAC/24VDC/60AMP/1440W.		
ENCLOSURE LIGHTS & SOCKETS, VOLTAGE	230VAC			
CONTROL & INDICATION VOLTAGE	24VDC			
PROTECTION	SPECIFICATION	COMMENTS: -	PLC EQUIPMENT	SPECIFICATION
BS/EN/IEC STANDARDS IMPLEMENTED	EN292/BSEN954-1/BSEN60204-1/BS7671	NOTE: -ALL APPLICABLE & RELEVANT STANDARDS etc.	PLC MAKE	CAREL
DEGREE OF ENCLOSURE PROTECTION (IP RATING)	IP54		PLC TYPE	PC05
DETAILS OF EQUIPMENT BY BARRIER SCREENING	25VAC/60VDC AND ABOVE (IP20B)	NOTE: -DRY ENVIRONMENTS MAINTAINED (EN60204)	PLC INTERFACE	
EQUIPOTENTIAL BONDING IMPLEMENTED	YES	BS7671 STANDARDS		
AUTOMATIC DISCONNECTION INSTALLED	YES			
MANUFACTURERS SPECIFICATIONS IMPLEMENTED	YES			
EMC STANDARDS REQUIRED (SCREENING)	YES	MANUFACTURERS EMC REQUIREMENTS IMPLEMENTED		
STANDARD LABELS TO BE FITTED	YES	HAZARDS/WARNING SIGNS AND VOLTAGE LABELS		
CONDUCTORS AND TERMINATIONS	SPECIFICATION	COMMENTS: -	CABLE COLOURS	SPECIFICATION
MINIMUM SIZE OF POWER WIRING	1.5mm ²		AC 460VAC POWER WIRING	BLACK
MINIMUM SIZE OF CONTROLS & I/O WIRING 24VDC	1.0mm ² (I/O 0.5mm ²)		AC 230VAC POWER WIRING	BLACK
MINIMUM SIZE OF POWER TERMINALS	4.0mm TERMINATION		PROTECTIVE CONDUCTOR	GREEN/YELLOW
MINIMUM SIZE OF CONTROL TERMINALS	2.5mm TERMINATION		AC 110VAC POWER WIRING - 110V	RED
MAIN POWER BUSBAR SIZE			AC 110VAC POWER WIRING - 0V	WHITE/RED
MAIN EARTH BUSBAR SIZE			DC CONTROL CIRCUITS +	DARK BLUE
EARTH BUSBAR POSITIONS			DC CONTROL CIRCUITS -	WHITE/BLUE
METHOD OF TERMINATING OUTGOING PROTECTIVE CONDUCTORS	BUSBAR AND/OR PE TERMINALS		NEUTRAL CIRCUITS	LIGHT BLUE
EXTERNAL CABLES, ENTRY POSITION	BOTTOM/TOP ENTRY		LIVE SIDE OF ISOLATOR CIRCUITS	ORANGE
METHOD OF FIXING/SUPPORTING OUTGOING CABLES	CABLE TRUNKING/TRAY		EXTERNALLY FED INTERLOCKS CIRCUITS (AC)	ORANGE
SCHEMATIC SYMBOLS & CONTACT REFERENCE NUMBERS Etc	SYMBOLS BS EN 60617	EQUIPMENT PAGE-PATH NUMBERING.	EXTERNALLY FED INTERLOCKS CIRCUITS (DC)	ORANGE

GENERAL COMMENTS: -

50E4 50/1	ADDRESS	PAGE	FUNCTION
UNIVERSAL ANALOGUE INPUTS	U10—	51/0	NEGATIVE PRESSURE VENTURI SUCTION
	U20—	51/1	NEGATIVE PRESSURE VENTURI SUCTION
	U30—	51/2	VENTURI INLET PRESSURE
	U40—	51/4	CHILLER FLOW TEMPERATURE
	U50—	51/5	CHILLER RETURN TEMPERATURE
	U60—	51/7	DATA CENTRE FLOW PRESSURE No. 1
	U70—	51/8	DATA CENTRE FLOW PRESSURE No. 2
	U80—	51/8	TANK LEVEL (NOT SELECTED)
	U90—	52/3	DATA CENTRE RETURN TEMPERATURE
	U100—	52/5	DATA CENTRE FLOW TEMPERATURE

50E4 50/1	ADDRESS	PAGE	FUNCTION
ANALOGUE OUTPUTS	Y1O—	60/2	HEAT EXCHANGER PRIMARY CONTROL VALE CHILLER (NOT SELECTED)
	Y2O—	60/3	NEGATIVE PRESSURE CONTROL VALVE LPS (NOT SELECTED)
	Y3O—	60/4	SPARE
	Y4O—	60/5	SPARE
	Y5O—	60/6	SPARE
	Y6O—	60/7	SPARE


50E4 50/1	ADDRESS	PAGE	FUNCTION
24VDC DIGITAL INPUTS	ID10—	53/0	RTP1 LPS PUMP INVERTER FAULT
	ID20—	53/1	SPARE
	ID30—	53/2	SPARE
	ID40—	53/3	SPARE
	ID50—	53/4	CTP1 RECIRCULATION PUMP INVERTER FAULT
	ID60—	53/5	SPARE
	ID70—	53/6	SPARE
	ID80—	53/7	SPARE
	ID90—	54/0	LEAK DETECTION (NOT SELECTED)
	ID100—	54/1	B. E. M. S. INTERLOCK
	ID110—	54/2	24VDC CONTROL CIRCUIT HEALTHY
	ID120—	54/3	VENTURI FLOW SENSOR
	ID13H0—	54/4	SPARE
	ID130—	54/5	SPARE
	ID140—	54/6	LEAK LEVEL SENSOR
	ID14H0—	54/7	SPARE
	ID15H0—	55/1	SPARE
	ID150—	55/2	SELECTION SETPOINT HEAT EXCHANGER
	ID160—	55/3	CONFIGURABLE INPUT No. 1 (NOT SELECTED)
	ID16H0—	55/4	SPARE
	ID170—	55/5	CONFIGURABLE INPUT No. 2 (NOT SELECTED)
	ID180—	55/6	CONFIGURABLE INPUT No. 3 (NOT SELECTED)

50E4 50/1	ADDRESS	PAGE	FUNCTION
DIGITAL RELAY OUTPUTS	N010—	61/0	RTP1 + CTP1 PUMP ENABLE
	N020—	61/1	AIR RELEASE SOLENOID VALVE
	N030—	61/2	SPARE
	N040—	61/3	SPARE
	N050—	61/4	HIGH PRIORITY ALARM
	N060—	61/5	SPARE
	N070—	61/7	SPARE
	N080—	61/8	SPARE
	NC80—	61/9	SPARE
	N090—	62/0	SPARE
	N0100—	62/1	SPARE
	N0110—	62/2	SPARE
	N0120—	62/4	SPARE
	NC120—	62/4	SPARE
	N0130—	62/6	CONFIGURABLE OUTPUT No. 1 (NOT SELECTED)
	NC130—	62/6	SPARE
	N0140—	62/8	LPS PUMP No. 1 ENABLE (NOT SELECTED)
	NC140—	62/8	SPARE
	N0150—	63/2	LPS PUMP No. 2 ENABLE (NOT SELECTED)
	NC150—	63/3	SPARE
	N0160—	63/4	SPARE
	N0170—	63/5	SPARE
	N0180—	63/6	SPARE

		Date		CP1	AQUA COOLING SOLUTIONS	PLC Overview	P15033		=	
		Editor	MDC						+	
		Tested	22. Jul. 2015		Original	Sub. f.	Sub. b.			P. 10
Changes	Date	Name	Norm							135 P.

0 1 2 3 4 5 6 7 8 9


MAIN POWER SUPPLY
110VAC/60Hz

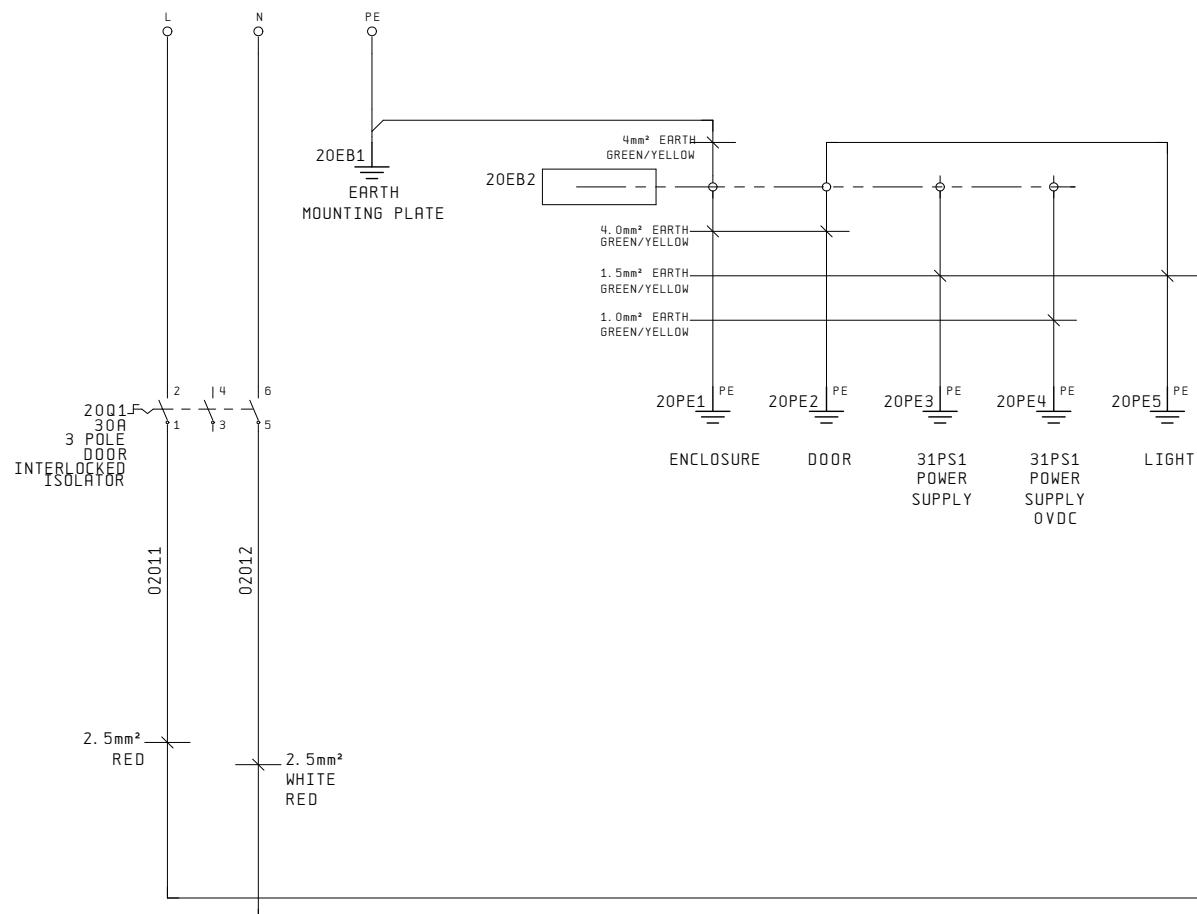


10


		Date	08. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	110VAC Power Supply Main Distribution	P15033	=
		Editor	M. CARMODY					+
		Tested	22. Jul. 2015					P. 20
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		135 P.

0 1 2 3 4 5 6 7 8 9

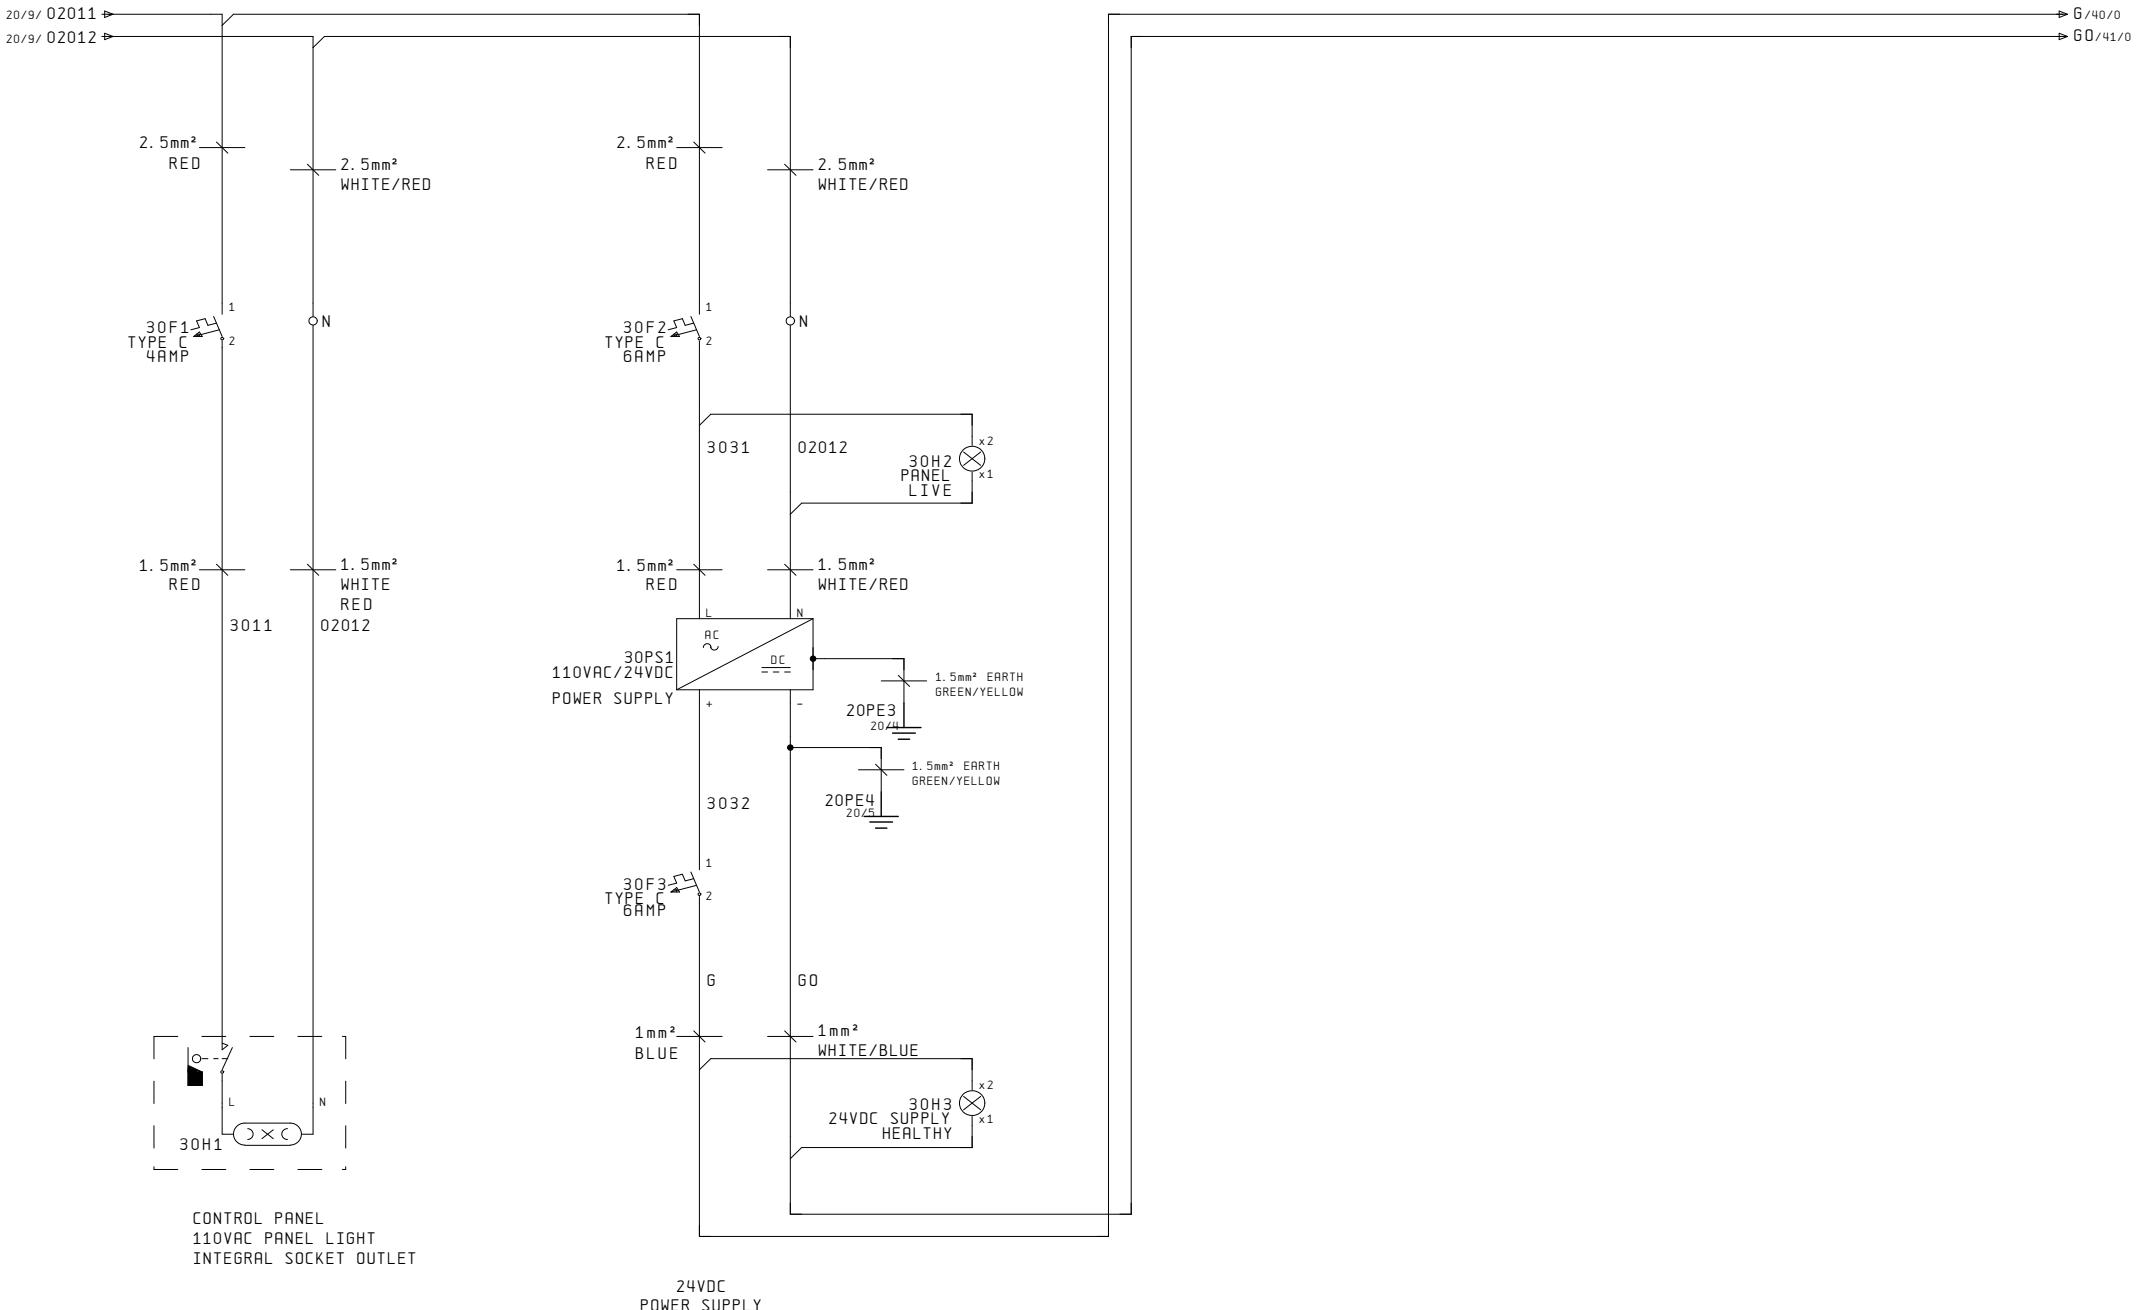


		Date	08. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	110VAC & 24VDC Distribution	P15033	=
		Editor	M. CARMODY					+
		Tested	22. Jul. 2015					P. 30
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		135 P.

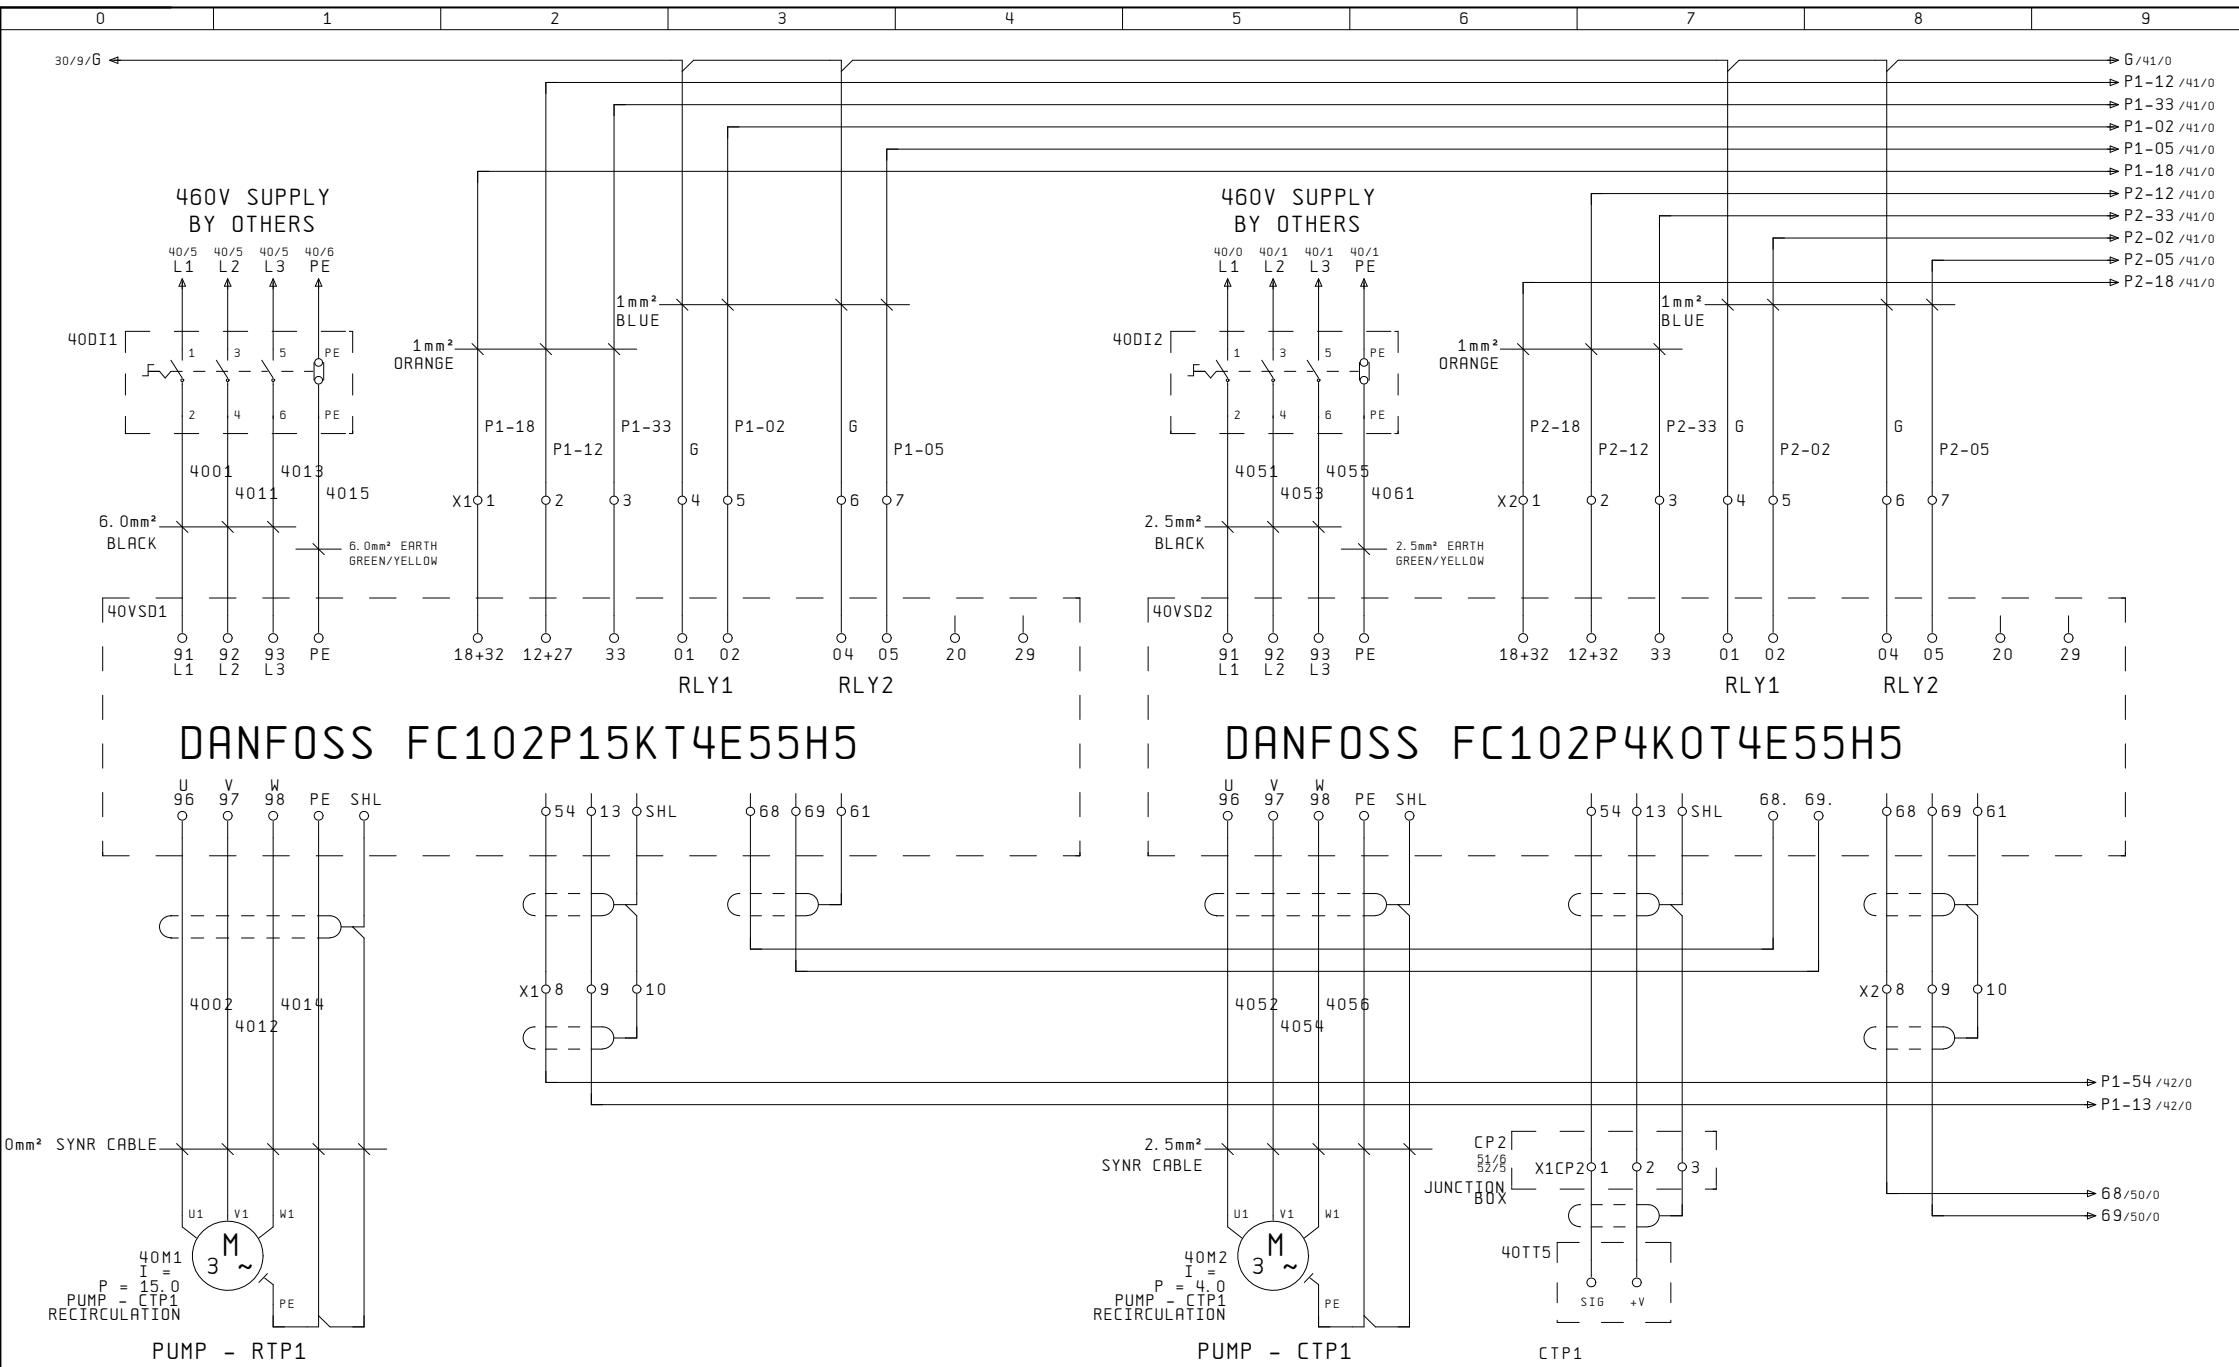

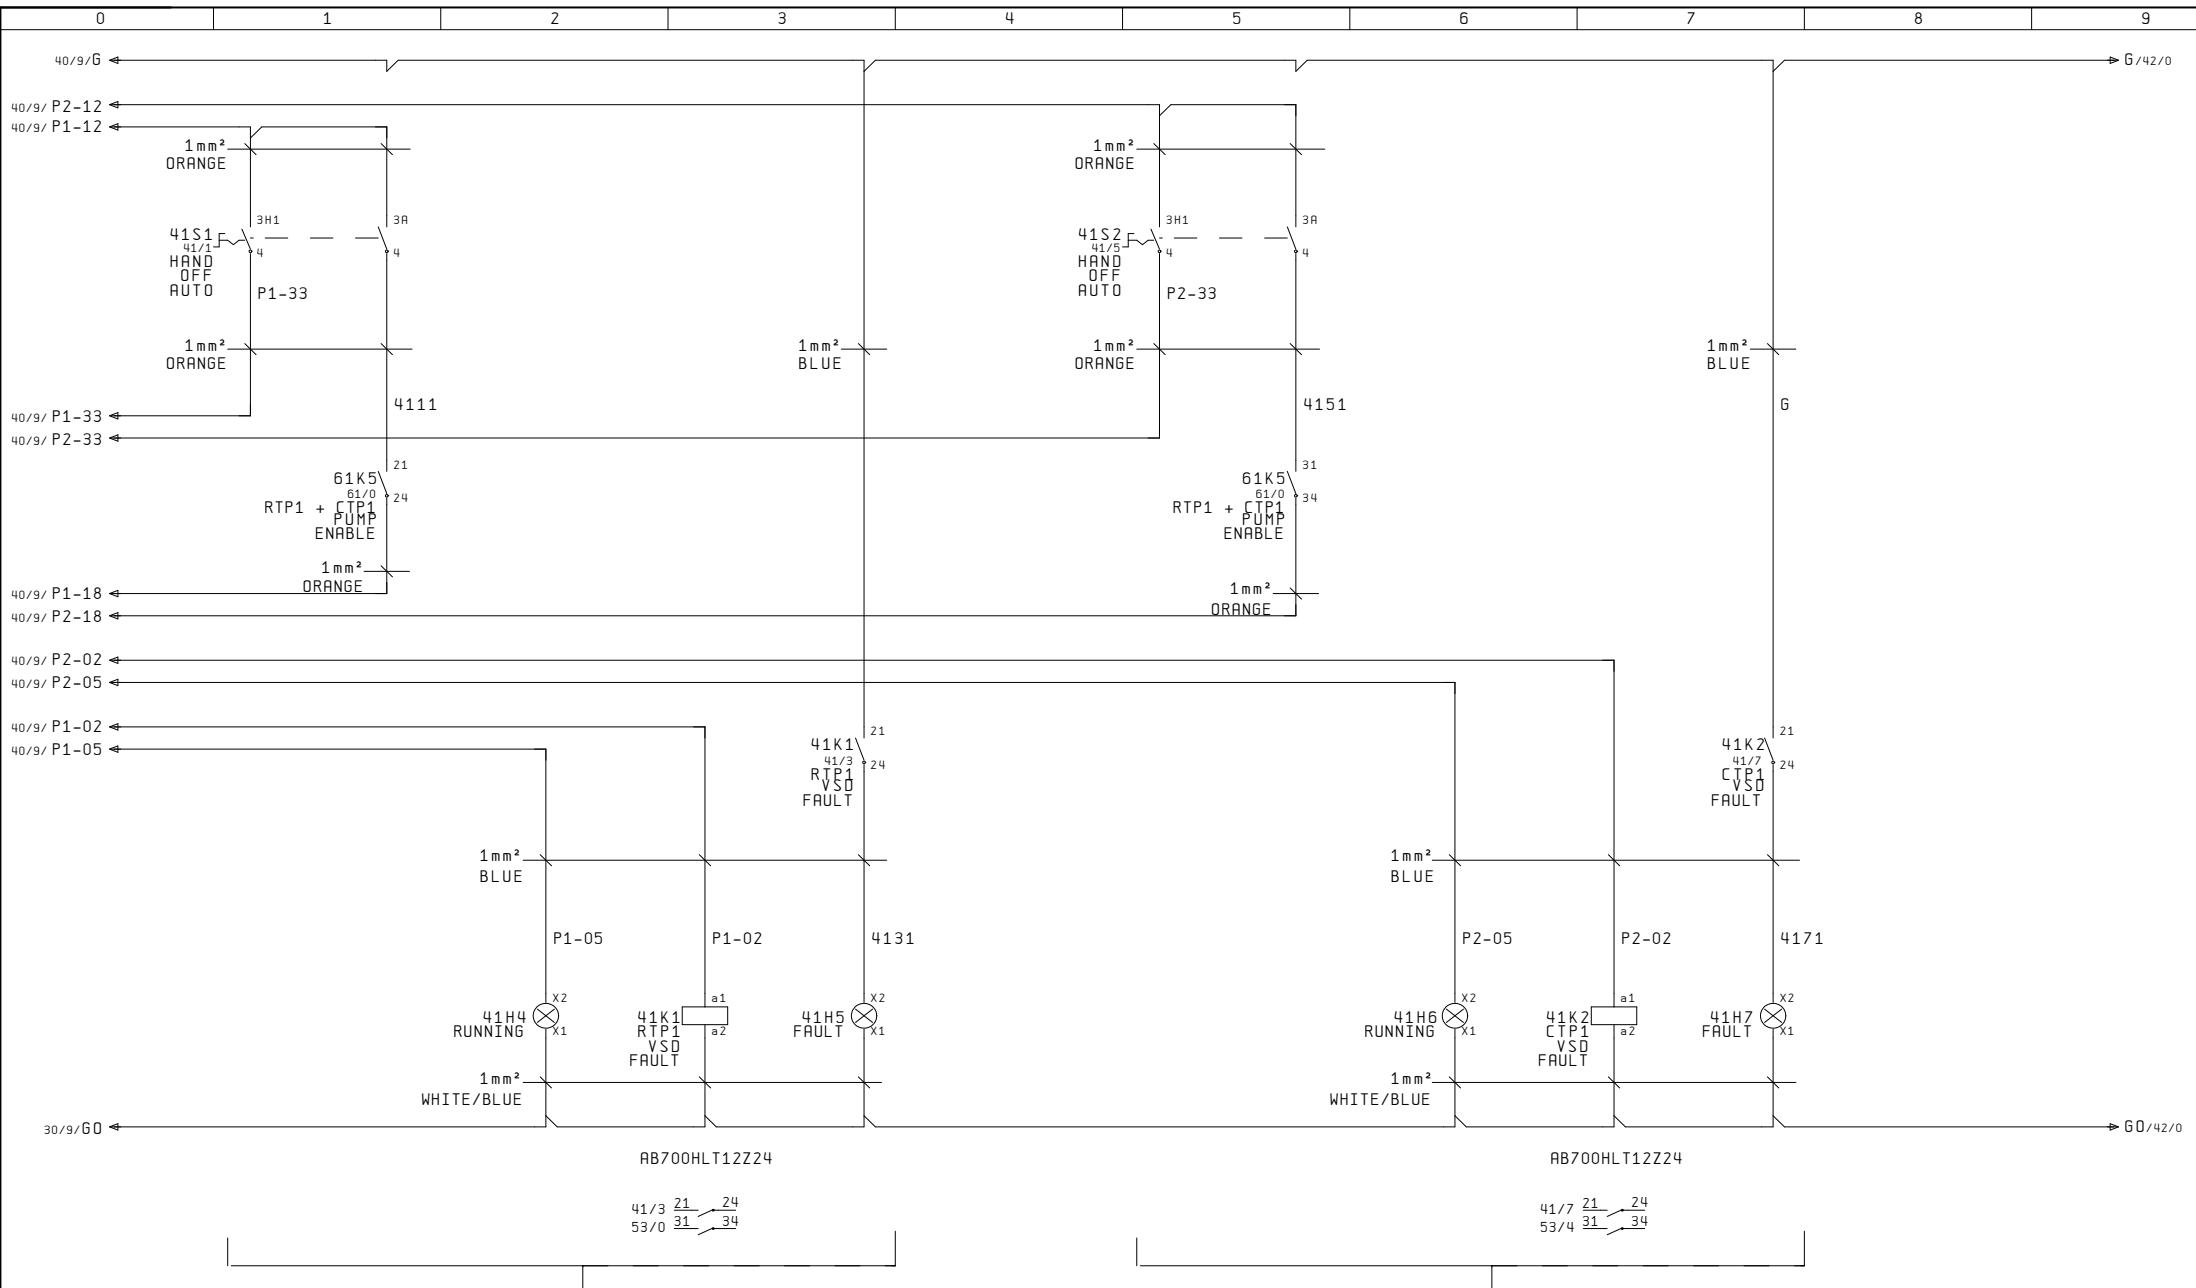


PUMP RTP1 - LPS

PUMP CTP1 - RECIRCULATION

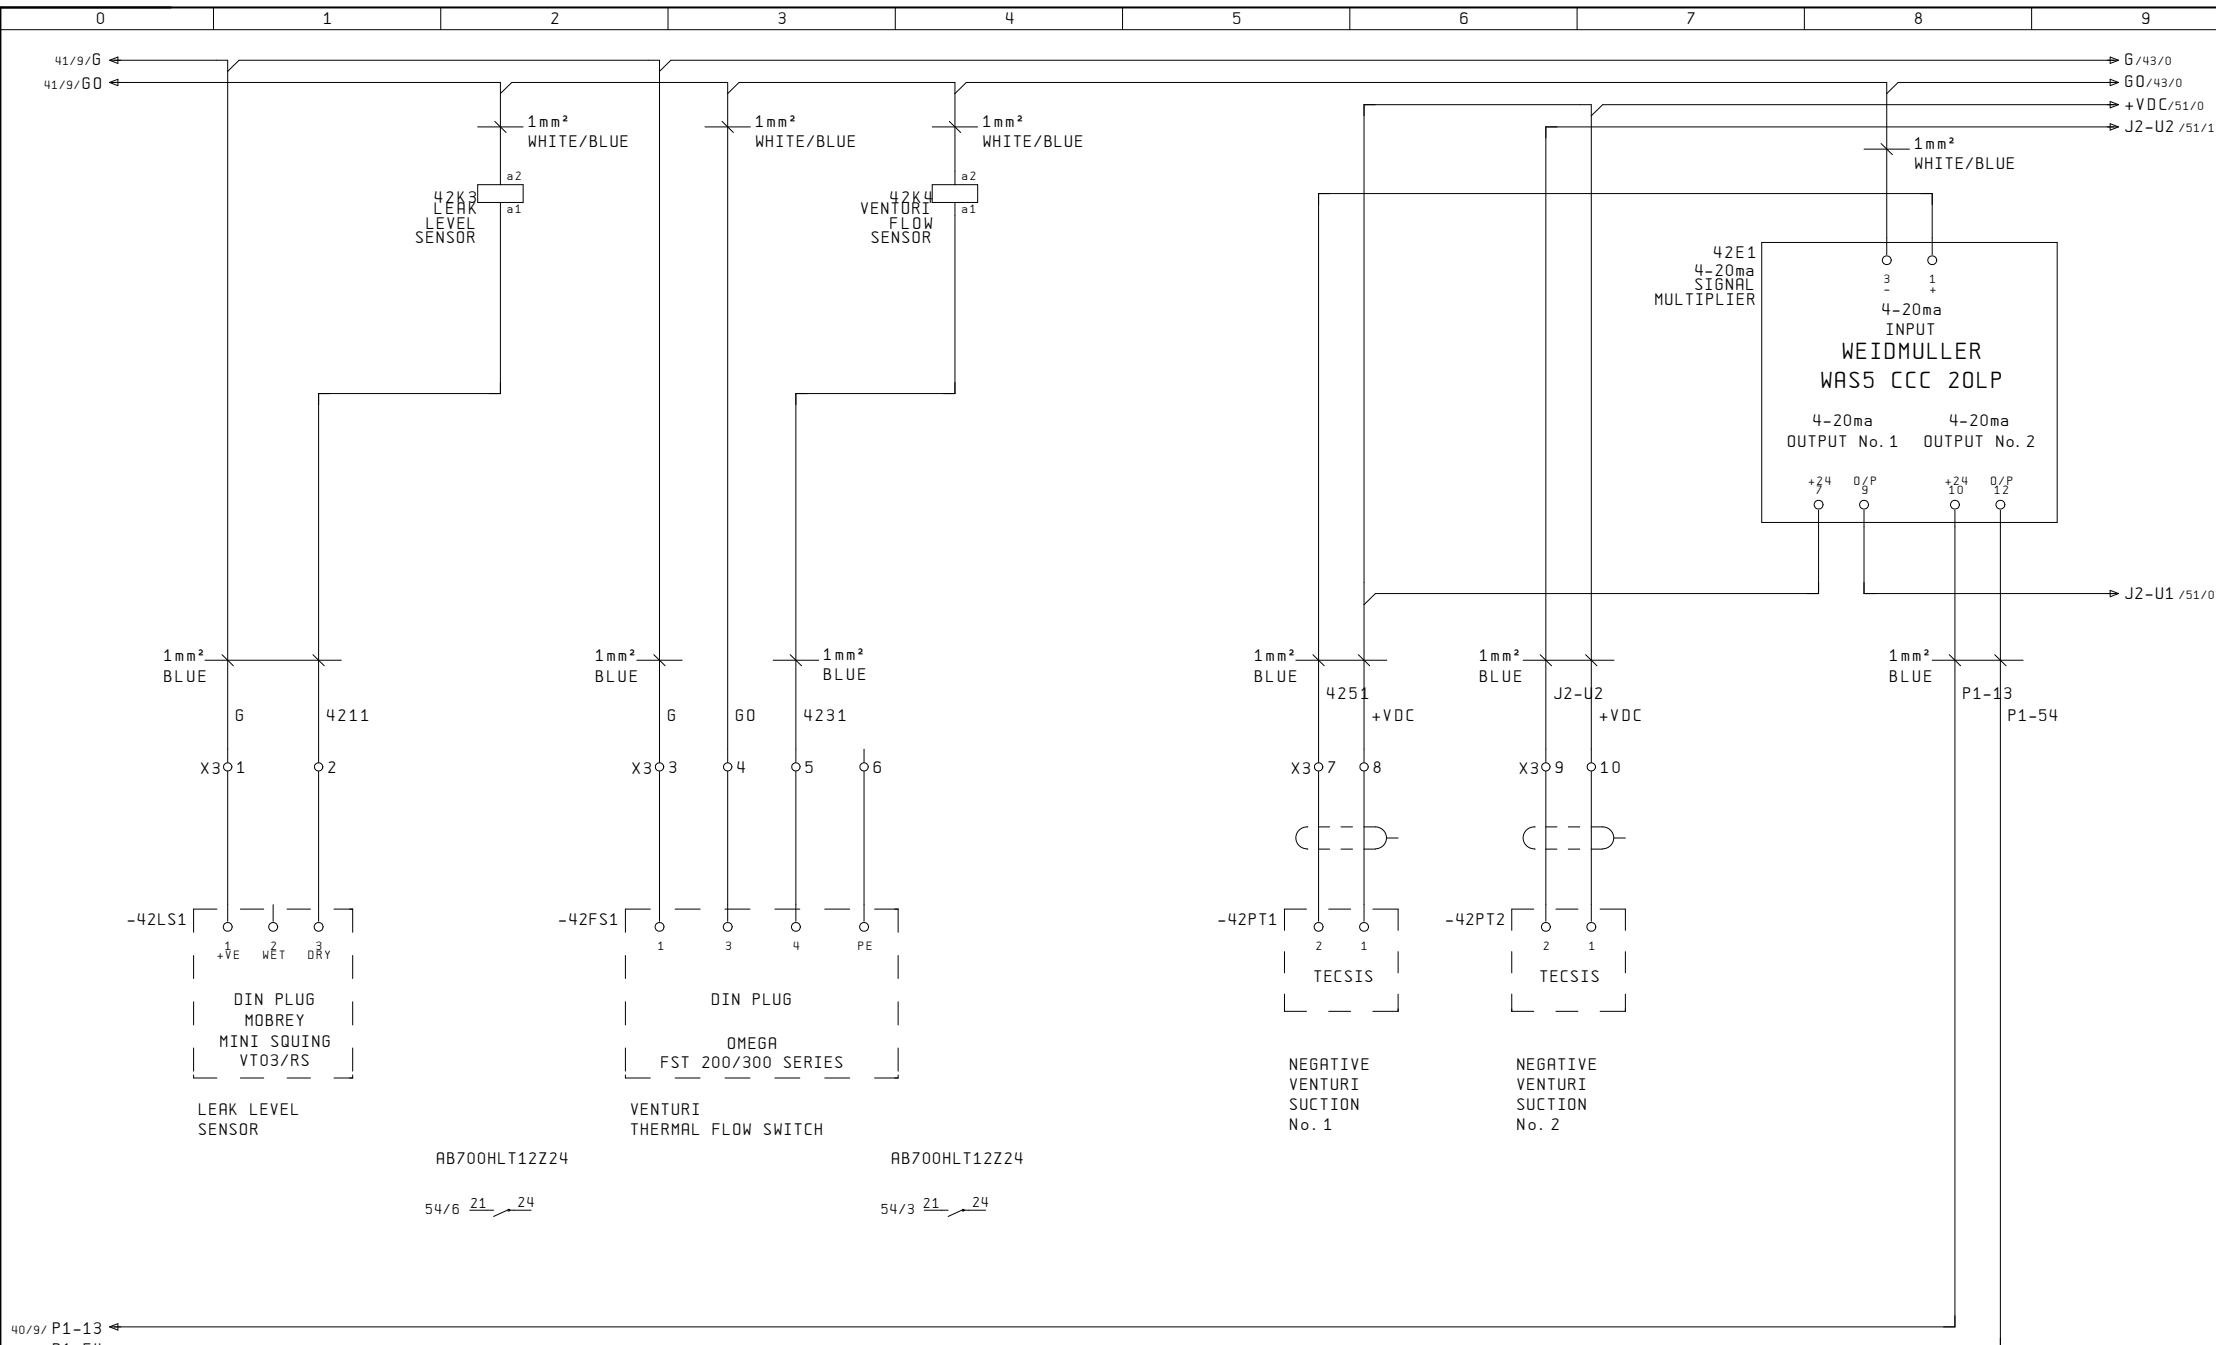

		Date		CP1	AQUA COOLING SOLUTIONS	Control Field Devices	P15033		=	
		Editor	MDC						+ +	
		Tested	22. Jul. 2015		Original	Sub. f.	Sub. b.		P. 42	
Changes	Date	Name	Norm							135 P.


0 1 2 3 4 5 6 7 8 9

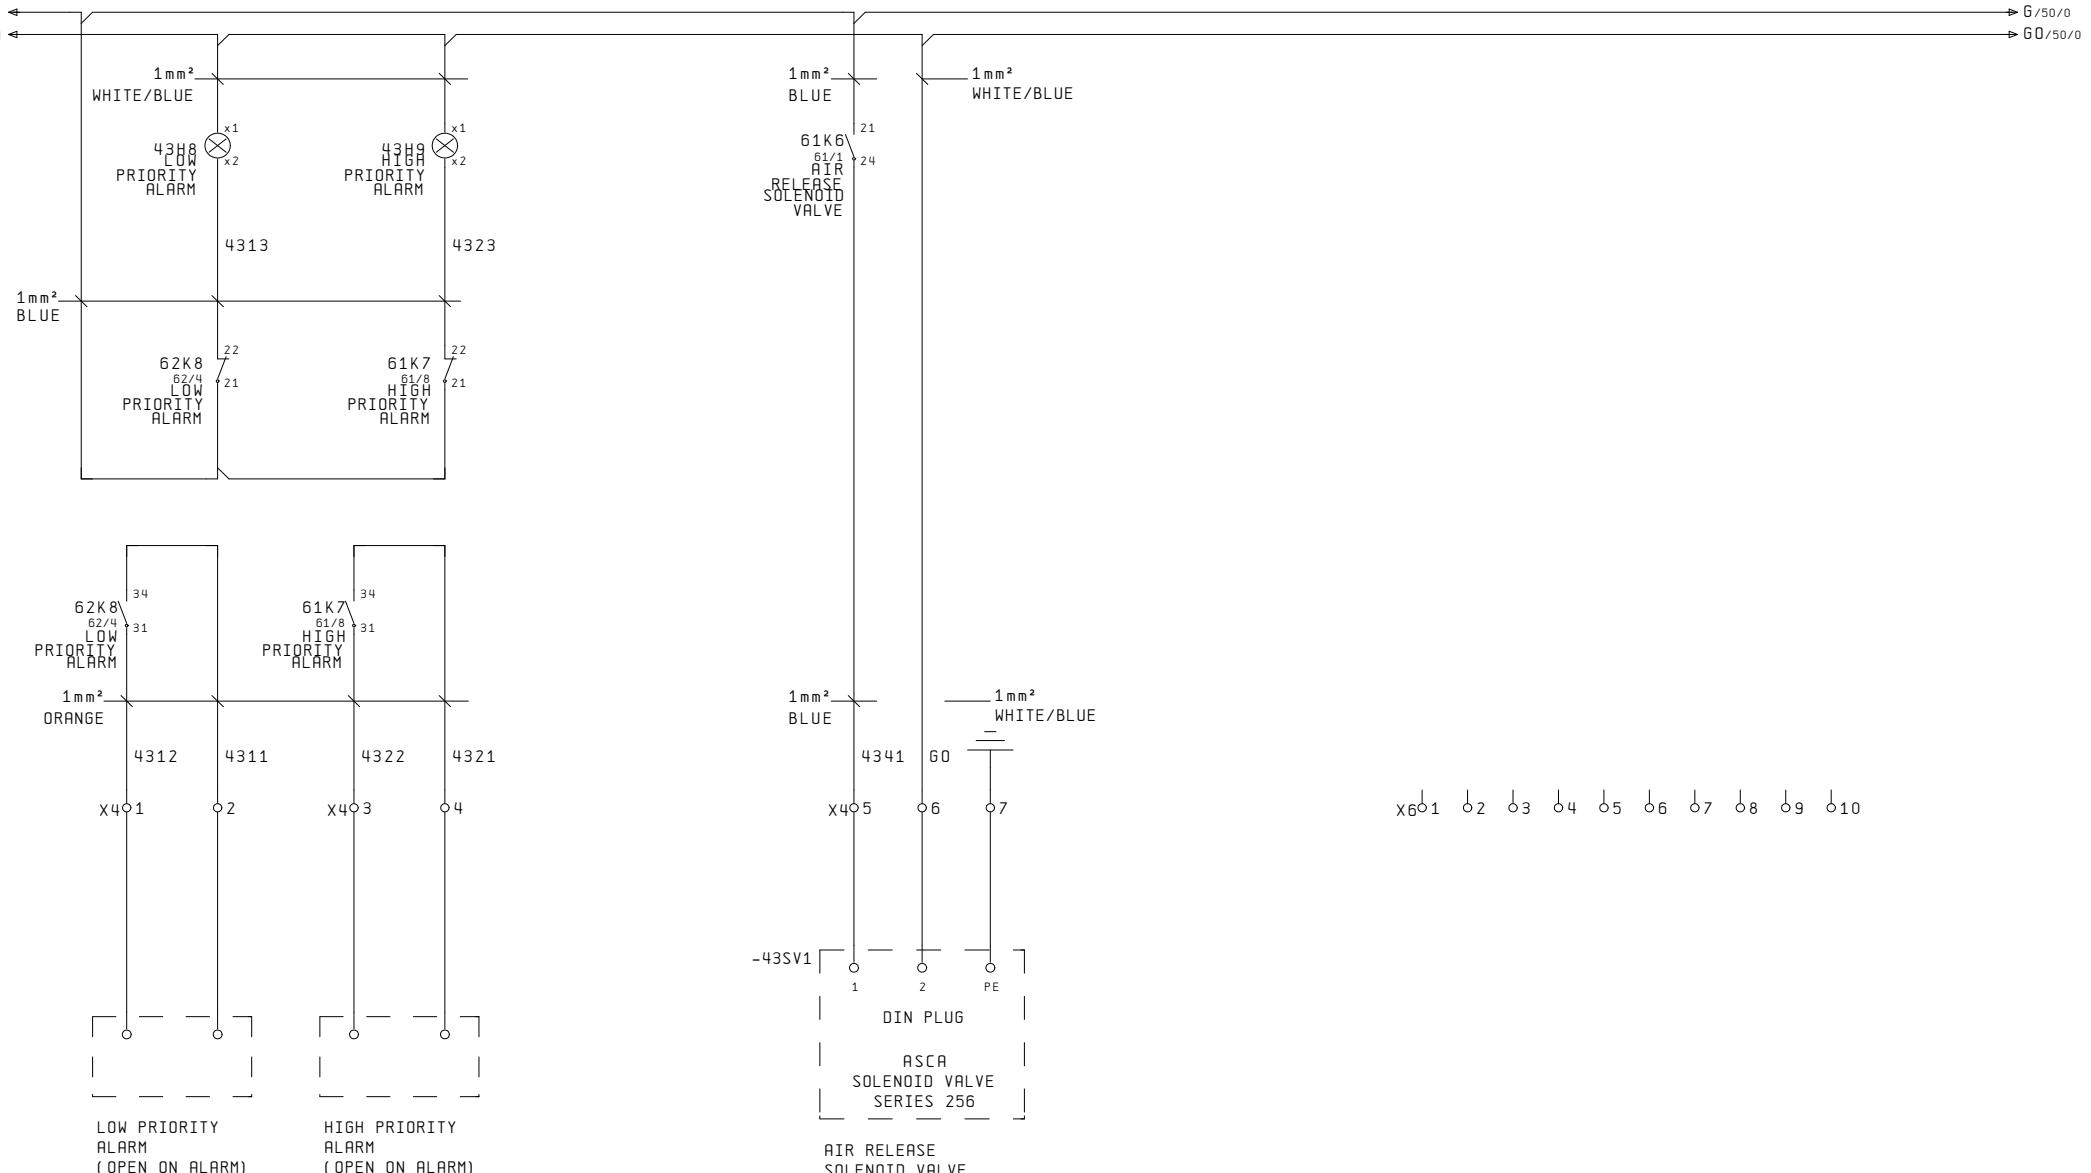

		Date	Editor	MDC	CP1	AQUA COOLING SOLUTIONS	Control Field Devices	P15033		P. 43
		Tested	22. Jul. 2015							
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			135 P.

0 1 2 3 4 5 6 7 8 9


BACnet / MSTP (RS485)
TO
DANFOSS DRIVES

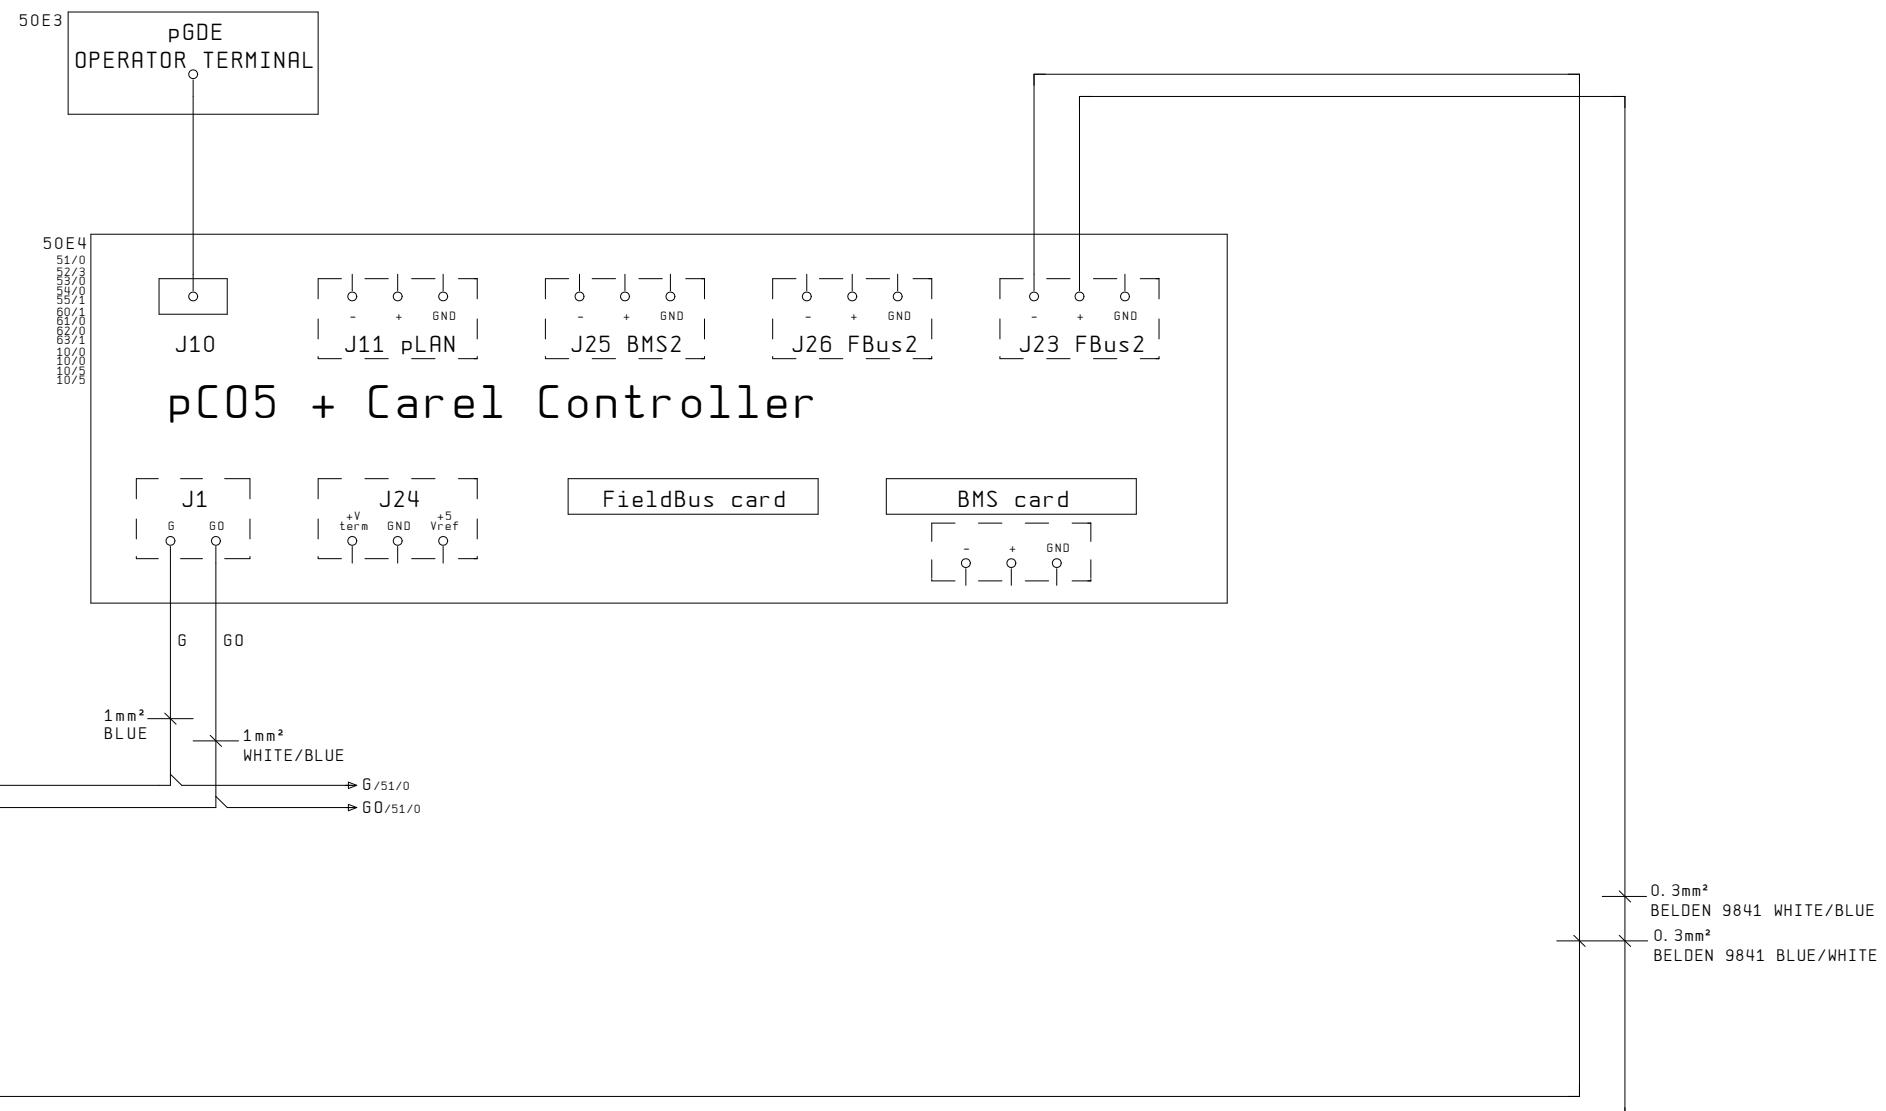

Date	Date	Date	Date	AQUA COOLING SOLUTIONS	Carel pC05+ Controller	P15033	=
Editor	MDC	Editor	MDC	Original	Sub. f.	Sub. b.	+
Tested	22. Jul. 2015	CP1	CP1	Original	Sub. f.	Sub. b.	P. 50
Changes	Date	Name	Norm				135 P.

0	1	2	3	4	5	6	7	8	9
---	---	---	---	---	---	---	---	---	---

50/3/G → G/53/0
 50/3/G0 → G0/53/0

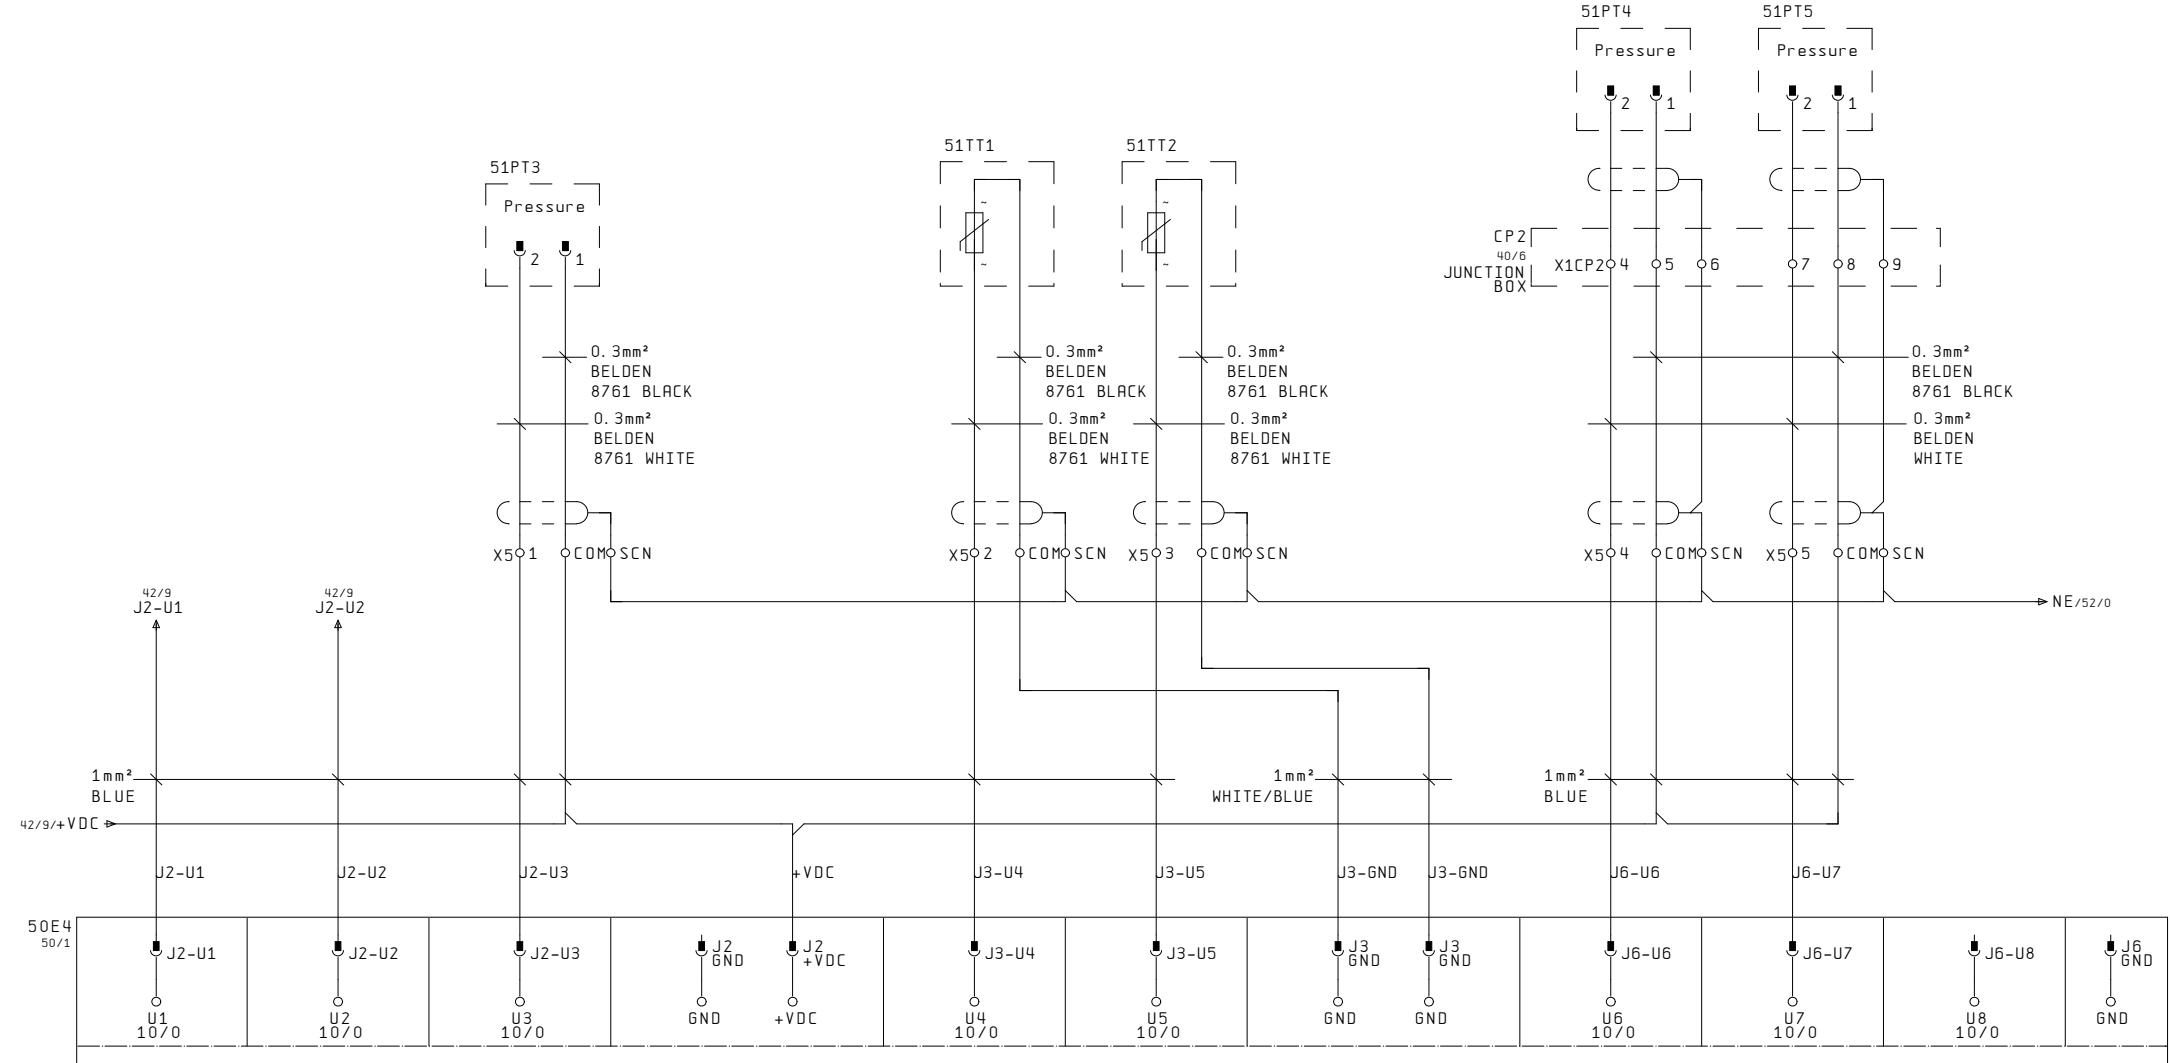

UNIVERSAL ANALOGUE INPUTS - NTC, 0-1V, 0-10V, 0-20mA, 4-20mA, PTC, PT100, PT500, PT1000

CAREL pC05+

NEGATIVE
PRESSURE
VENTURI
SUCTION

NEGATIVE
PRESSURE
VENTURI
SUCTION

VENTURI
INLET
PRESSURE

CHILLER
FLOW
TEMPERATURE


CHILLER
RETURN
TEMPERATURE

DATA
CENTRE
FLOW
PRESSURE
No. 1


DATA
CENTRE
FLOW
PRESSURE
No. 2

TANK LEVEL
(NOT SELECTED)

		Date		CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Universal Analogue Inputs	P15033		=
	Editor	M. CARMODY							
	Tested	22. Jul. 2015		Original	Sub. f.	Sub. b.			P. 51
Changes	Date	Name	Norm						135 P.

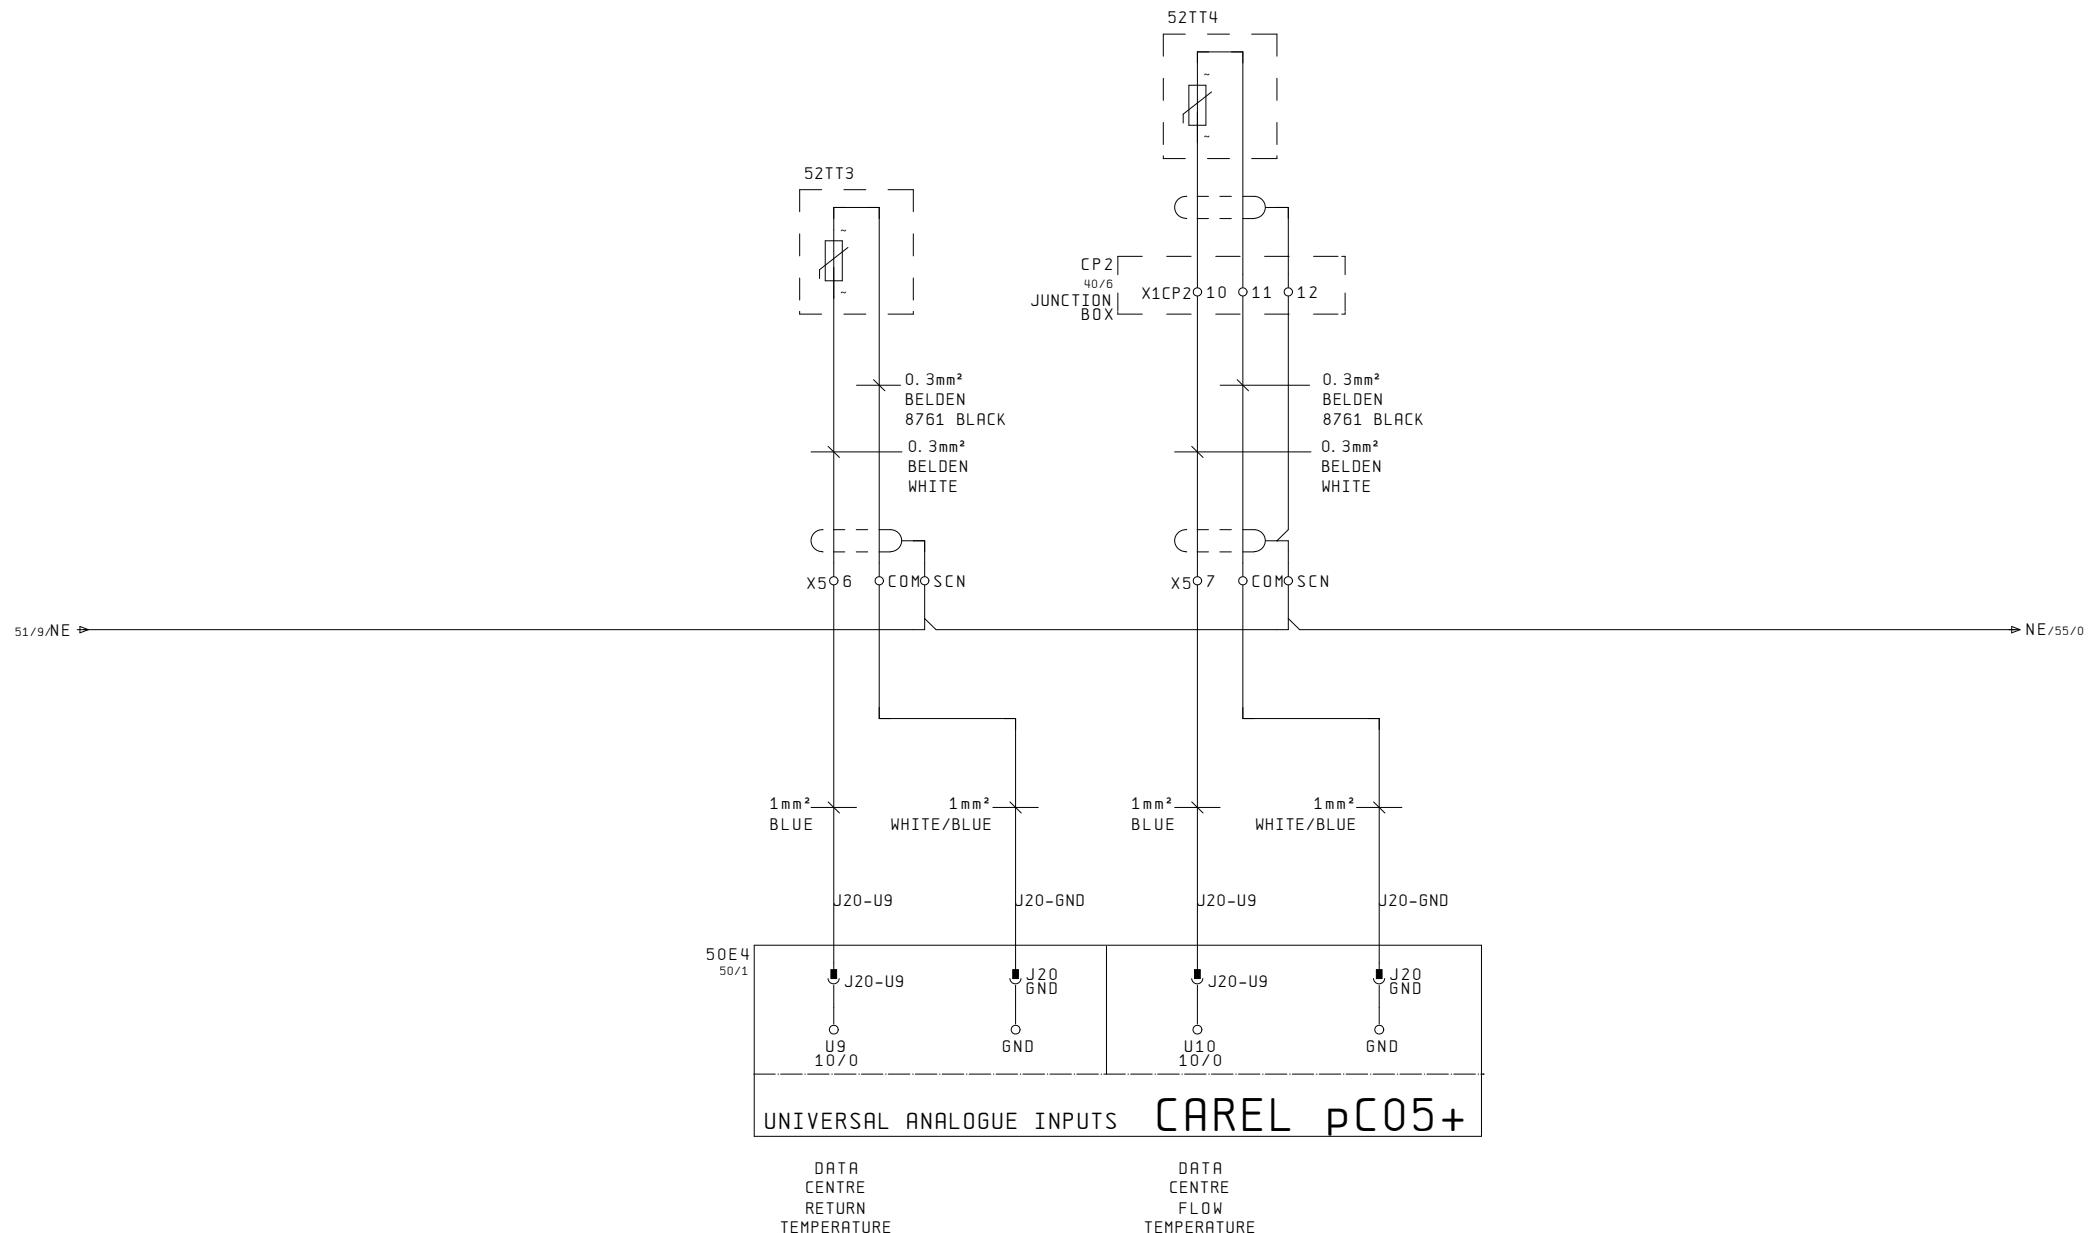

		Date				P15033	=
		Editor	MDC				+
		Tested	22.Jul.2015				
Changes	Date	Name	Norm	CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Universal Analogue Inputs	P. 52
		Original	Sub. f.		Sub. b.		135 P.

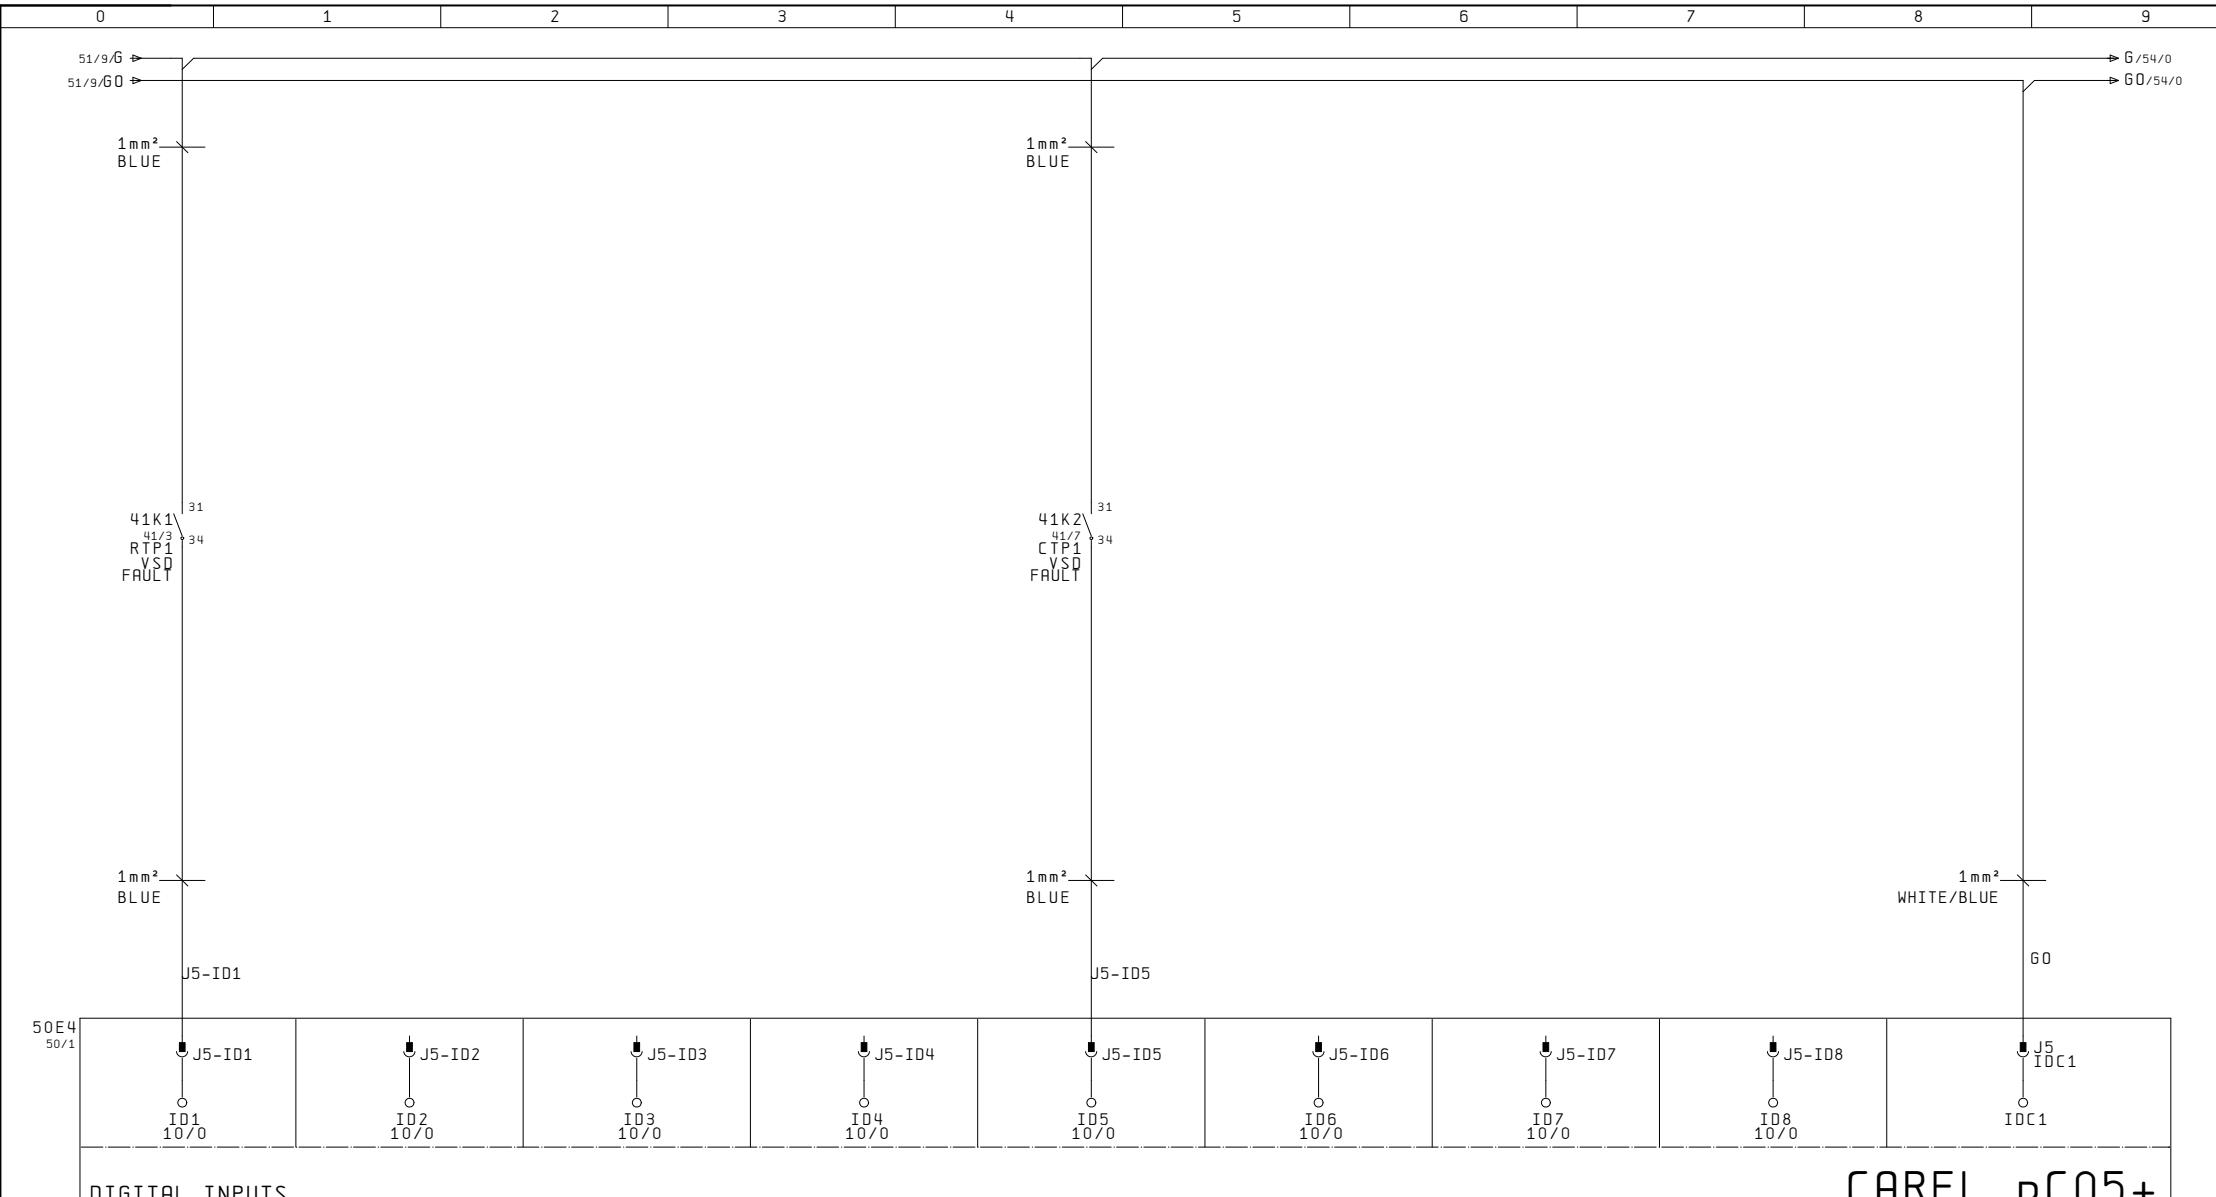

RTP1
LPS PUMP
INVERTER
FAULT

SPARE

SPARE

SPARE


CTP1
RECIRCULATION PUMP
INVERTER
FAULT

SPARE

SPARE


SPARE

		Date		CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Digital Inputs	P15033		=
	Editor	M. CARMODY							
	Tested	22. Jul. 2015							P. 53
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.			135 P.

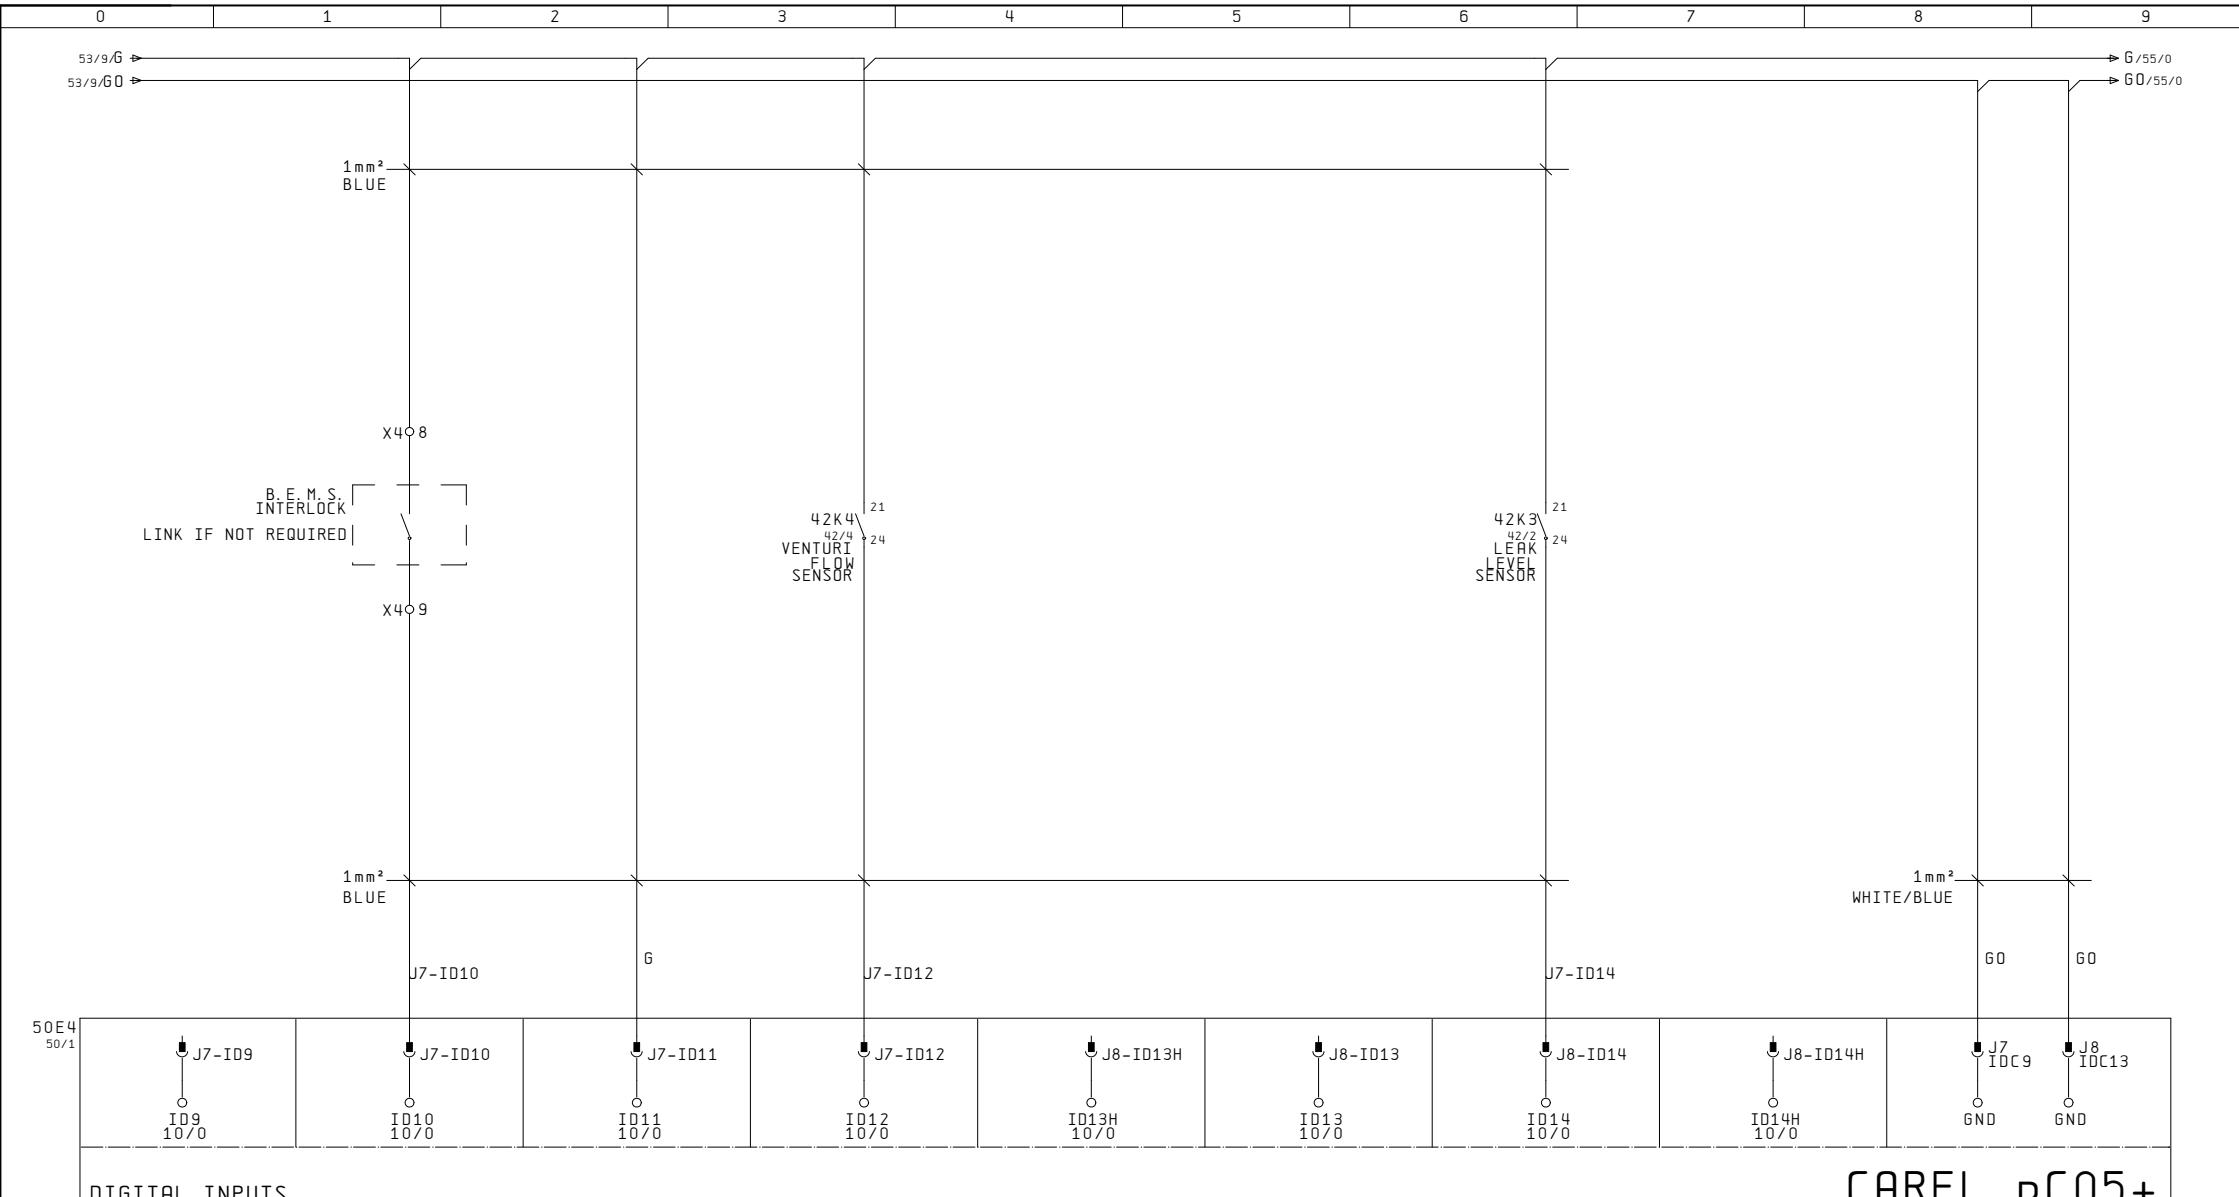


		Date	Editor	MDC	CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Digital Inputs	P15033		=
		Tested	22.Jul.2015							+
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			P. 54
										135 P.

0 1 2 3 4 5 6 7 8 9

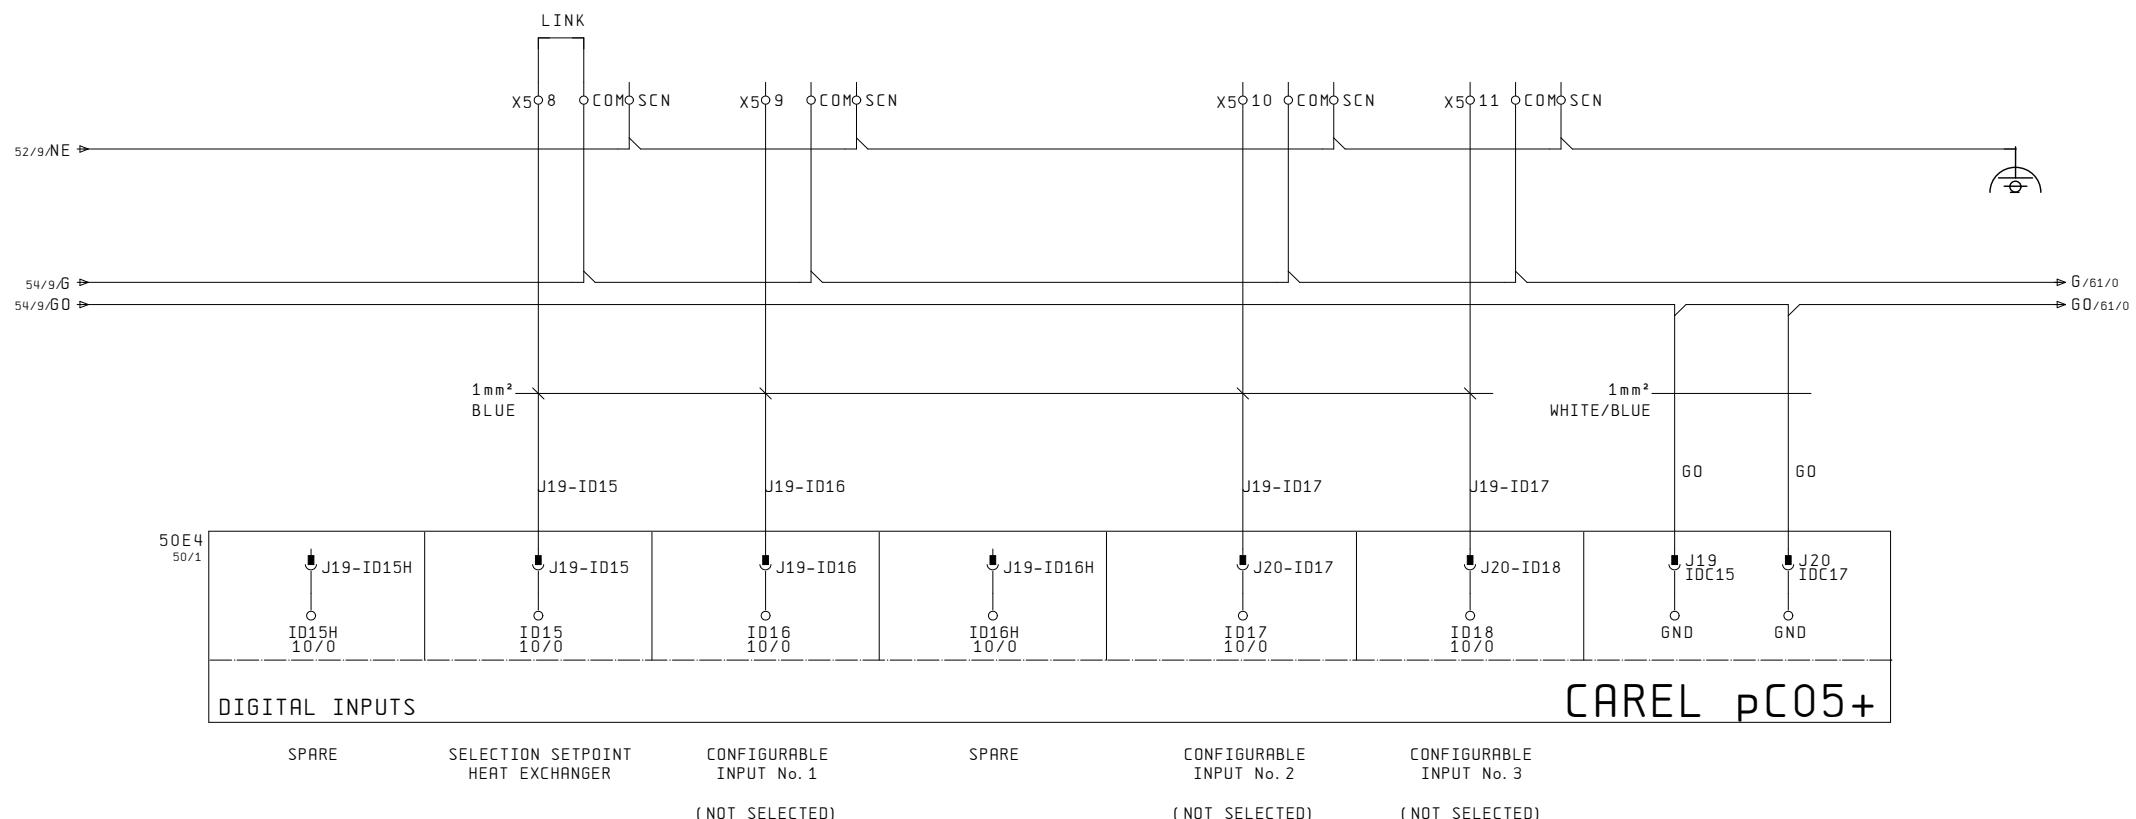

		Date		CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Digital Inputs	P15033		=
		Editor	MDC						+
		Tested	22. Jul. 2015						P. 55
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.			135 P.

0	1	2	3	4	5	6	7	8	9
---	---	---	---	---	---	---	---	---	---

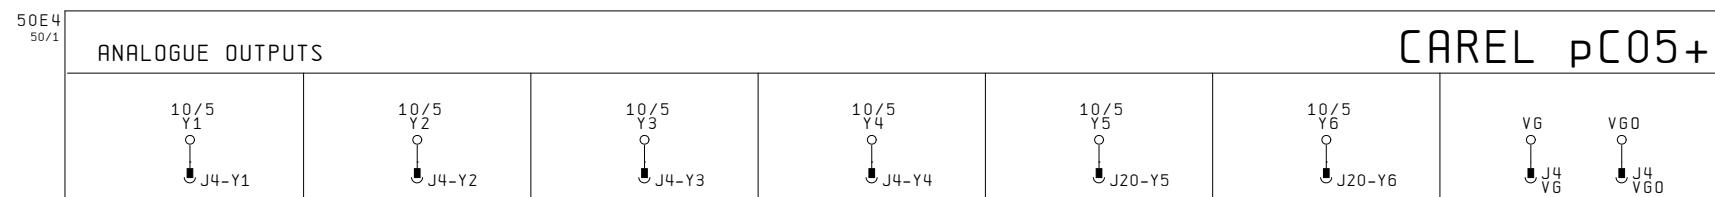

HEAT EXCHANGER
PRIMARY CONTROL VALVE
CHILLER

(NOT SELECTED)

NEGATIVE PRESSURE
CONTROL VALVE
LPS

(NOT SELECTED)

SPARE


SPARE

SPARE

SPARE


Date	Date	Editor	M. CARMODY	CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Analogue Outputs	P15033		=
Tested	22. Jul. 2015	Original	Sub. f.						+ P. 60
Changes	Date	Name	Norm						135 P.

0 1 2 3 4 5 6 7 8 9

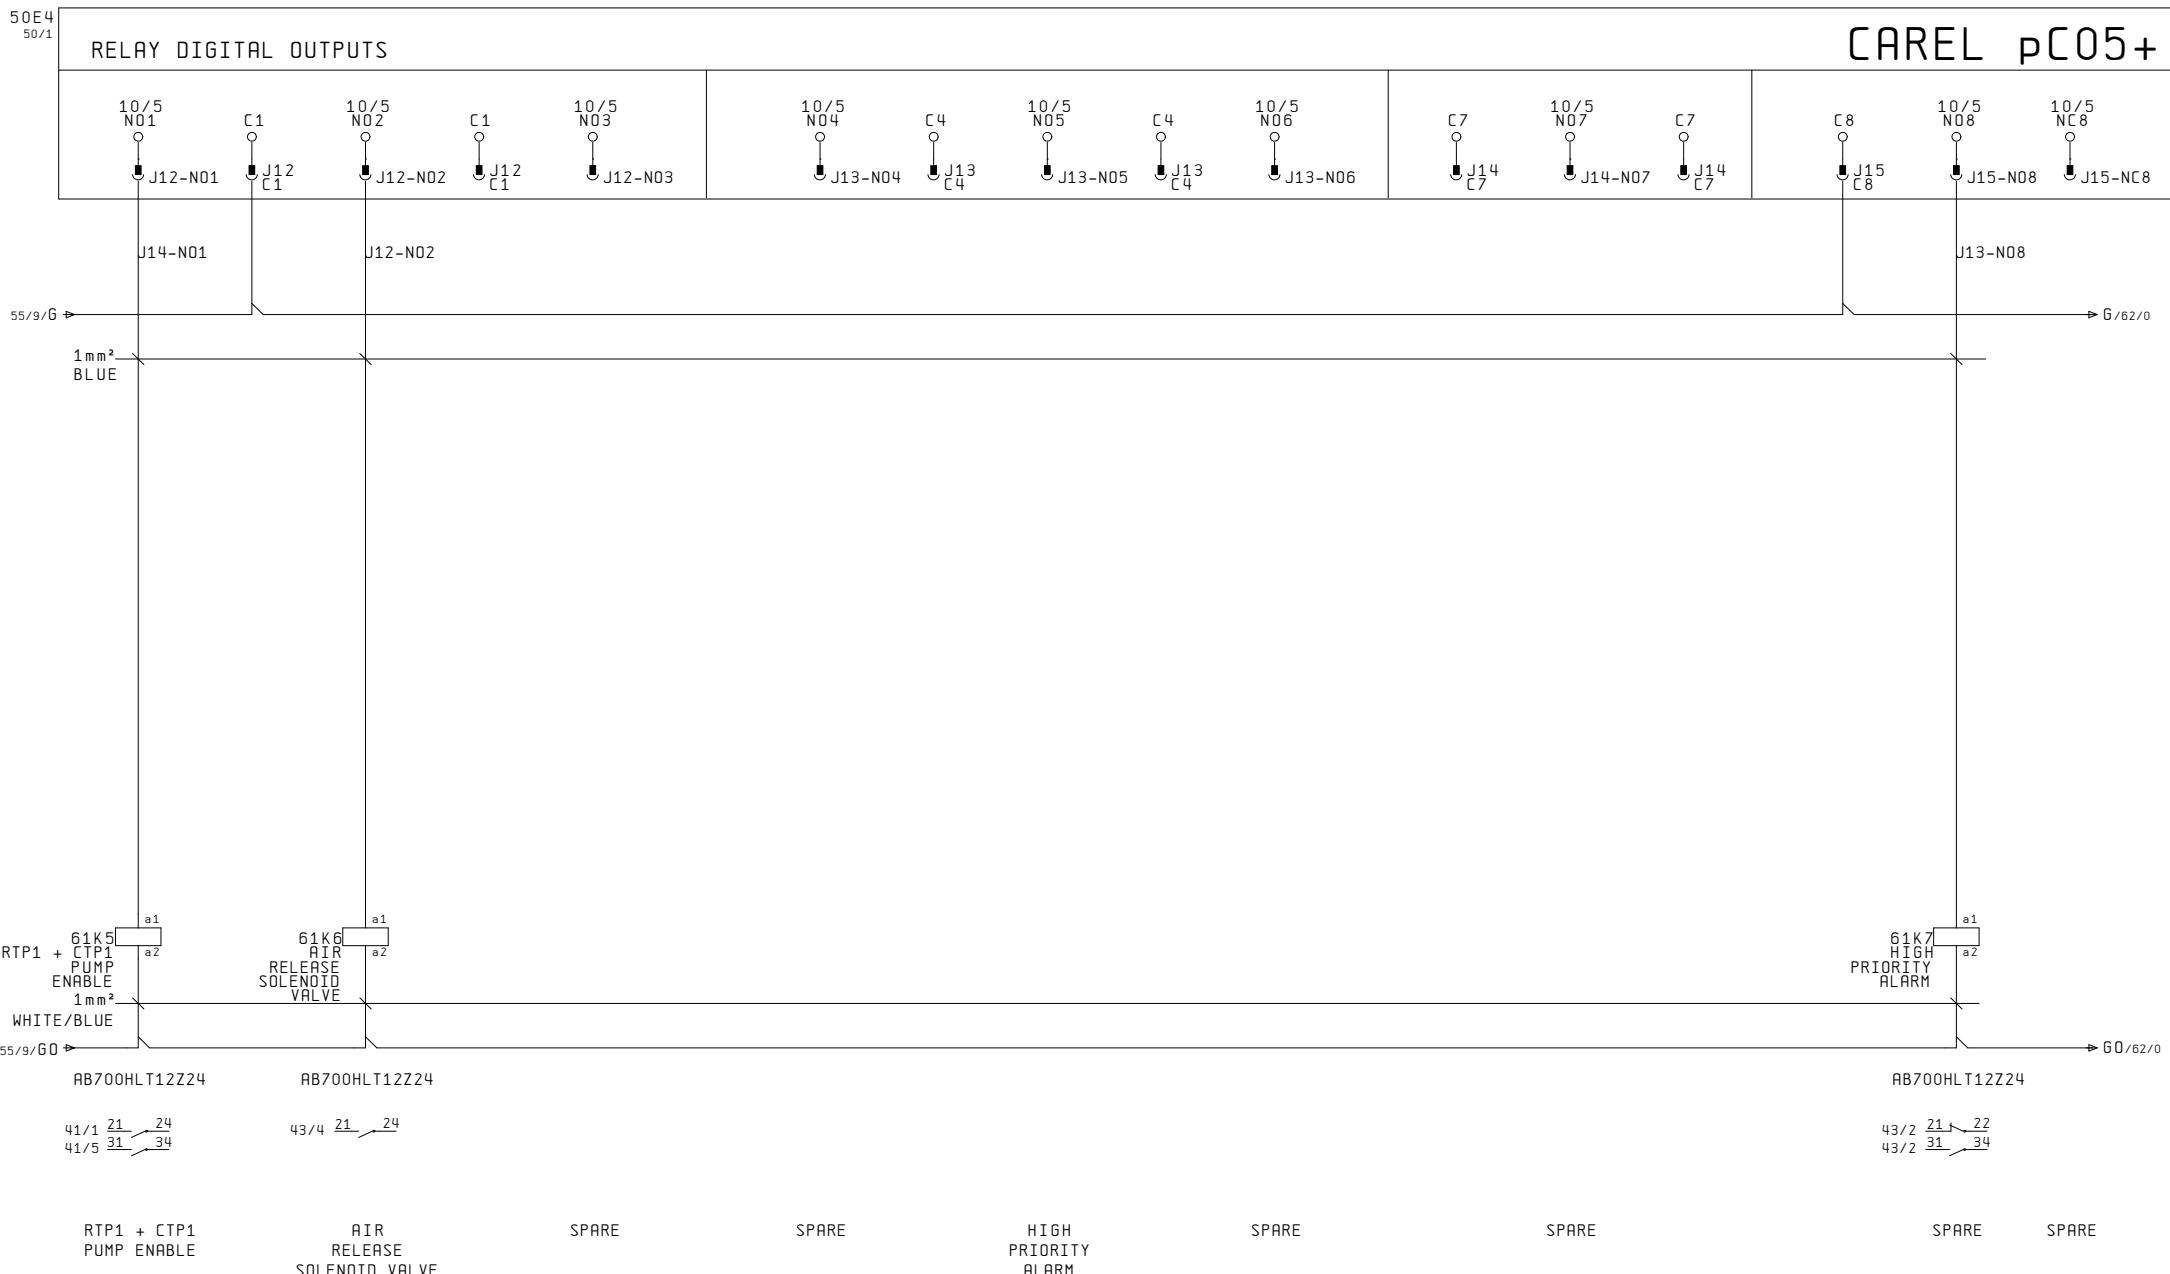

		Date		CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Digital Relay Outputs	P15033		=
	Editor	M. CARMODY							
	Tested	22. Jul. 2015							P. 61
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.			135 P.

0 1 2 3 4 5 6 7 8 9

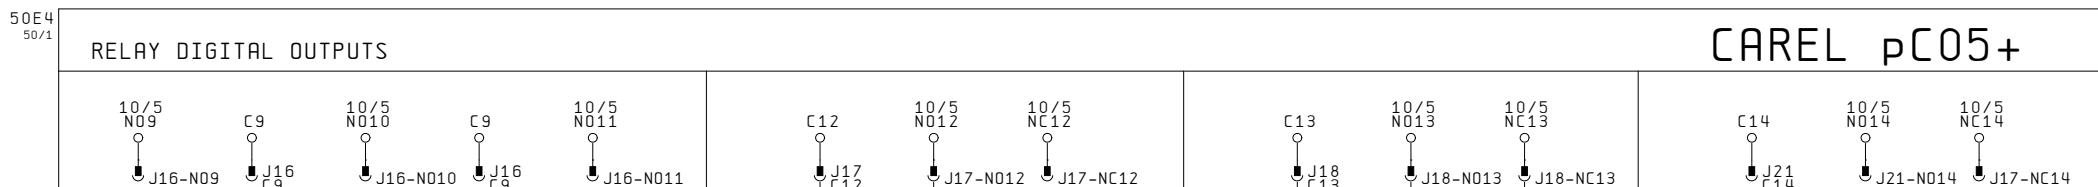

61/9/6 ➡

1 mm²
BLUE

J13-N012


J18-C13 J18-N013 J18-NC13

61/9/60 ➡



AB700HLT12Z24

43/1 21 22
43/1 31 34

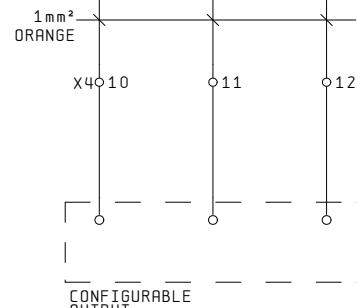

SPARE

SPARE

SPARE

SPARE


SPARE

LPS PUMP
No. 1
ENABLE

(NOT SELECTED)

63

		Date			CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Digital Relay Outputs	P15033	=
	Editor	MDC							+
	Tested	22. Jul. 2015							
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		P. 62 135 P.

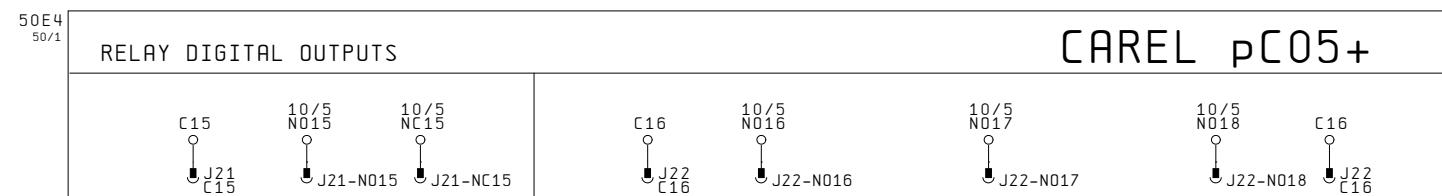

LPS PUMP SPAR
No. 2
ENABLE

SPARE





SPARE

SPARE

(NOT SELECTED)


		Date		CP1	AQUA COOLING SOLUTIONS	Carel pC05+ Controller Digital Relay Outputs	P15033	=		
		Editor	MDC					+		
		Tested	22. Jul. 2015						P. 63	
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			135 P.

70ENC1

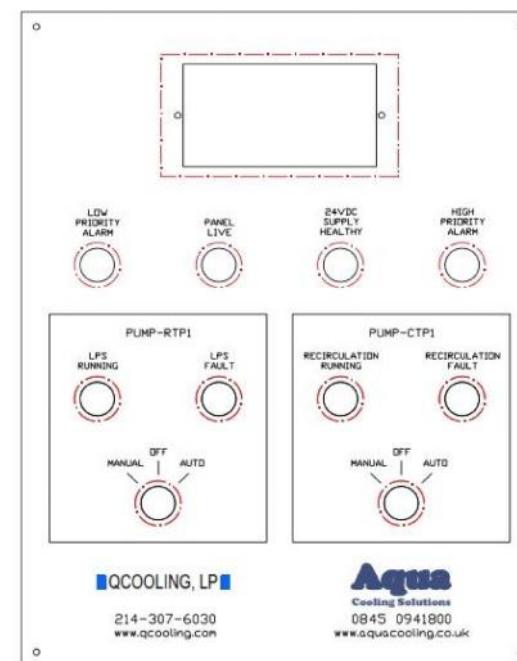

MANUFACTURING NOTE:-
ALL DIMENSIONS AND POSITIONS
ARE APPROXIMATE SCALE 1:2
(A3 PRINT SIZE)

		Date		CP1	AQUA COOLING SOLUTIONS	CP1 Panel Arrangement	P15033	
	Editor	MDC					=	+
	Tested	22.Jul.2015						
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		P. 70 135 P.

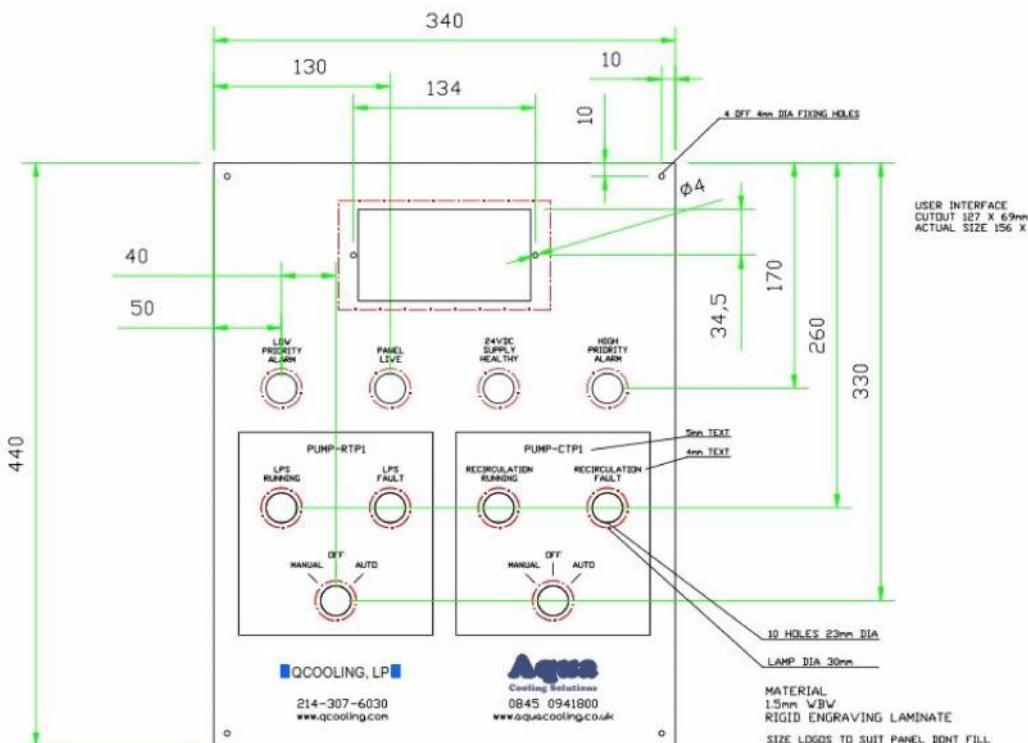

71LAB1

1. DANGER 110VAC

71LAB2

12. ISOLATE HERE
BEFORE OPENING DOOR

71LAB3


SUPPLY VOLTAGE	110V
CONTROL VOLTAGE	24VDC
INCOMING CABLE SIZE	
IP RATING	IP65
MANUFACTURING DATE	JULY 2015
SCL GROUP PROJECT NUMBER	P15033
SCL GROUP DRAWING NUMBER	P15033/CP1
CLIENT	AQUA COOLING SOLUTIONS
CLIENT PROJECT NUMBER	CNxxxx

71LAB4

NOTICE - AFTER COMMISSIONING
THIS CONTROL PANEL SHOULD BE ISOLATED
AND ALL TERMINATIONS TIGHTENED


Date	Editor	MDC	CP1		AQUA COOLING SOLUTIONS	CP1 Label Engraving Details	P15033	
Tested			Original	Sub. f.	Sub. b.			=
Changes	Date	Name Norm						

0 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9

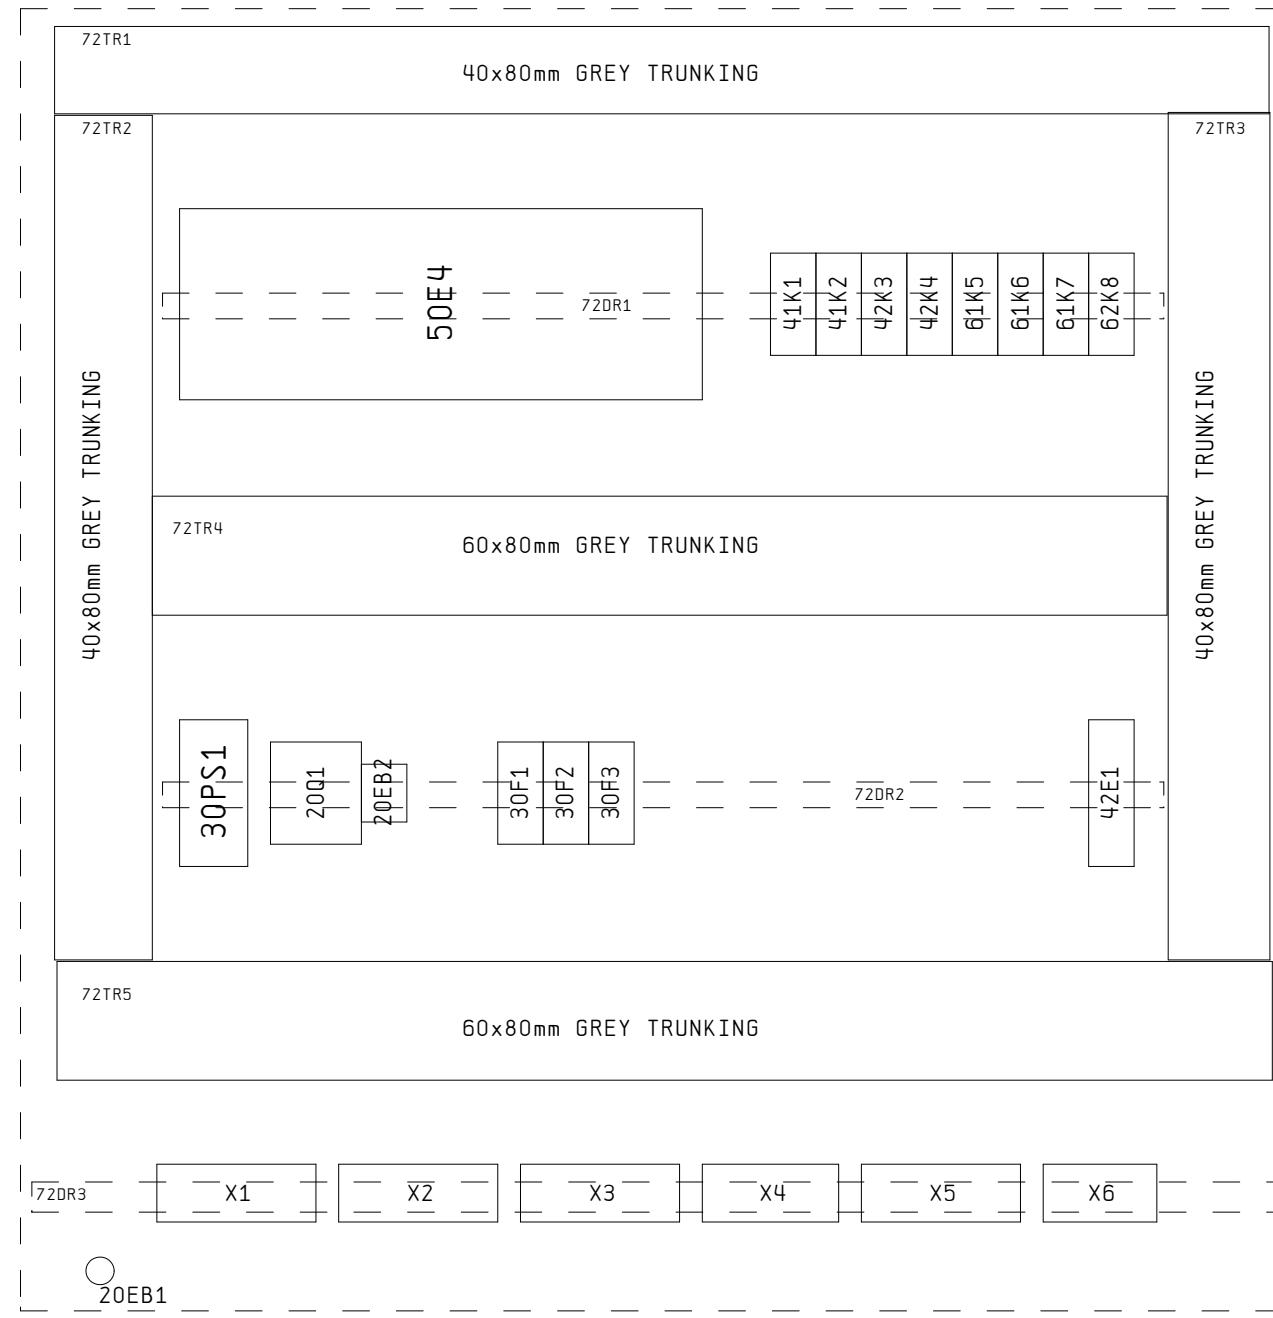

71

80

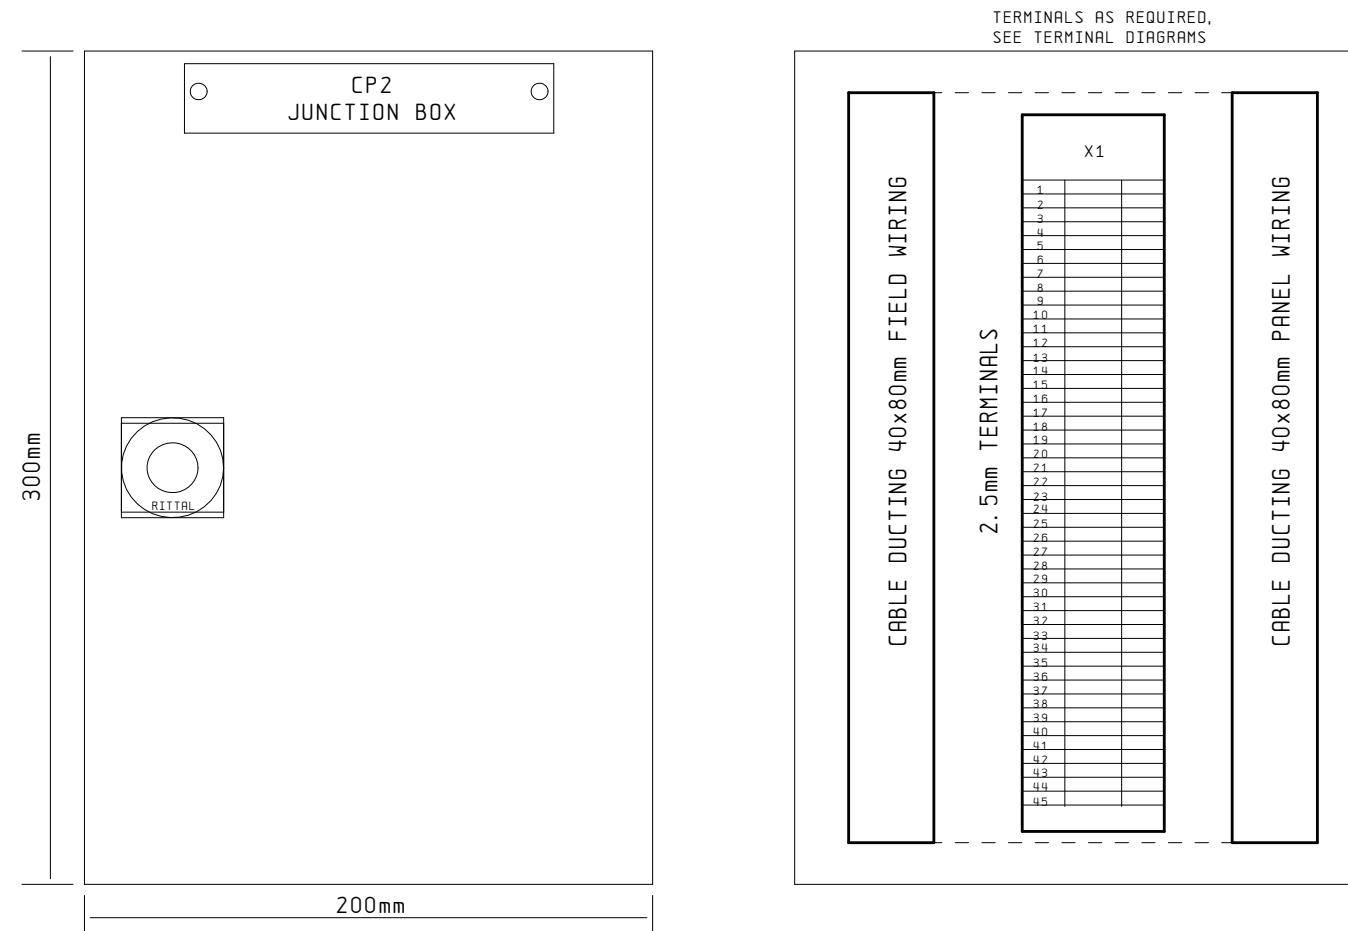

MANUFACTURING NOTE: -
ALL DIMENSIONS AND POSITIONS
ARE APPROXIMATE SCALE 1:2
(A3 PRINT SIZE)

		Date		CP1	AQUA COOLING SOLUTIONS	CP2 Panel Arrangement Backplate Arrangement	P15033	=
		Editor	MDC					+
		Tested	22. Jul. 2015					P. 80
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		135 P.

0	1	2	3	4	5	6	7	8	9	
DEVICE DESIGNATION	DESCRIPTION				MODEL TYPE/PART №	MANUFACTURER	UNIT QUANTITY	SCHEMATIC PAGE, PATH	LINE CODE	ITEM №
20Q1	UL98 3 POLE 30A DISCONNECT SWITCH				AB194R-N30-1753	ALLEN BRADLEY	1	20. 1		1
20Q1	12" EXTENSION SHAFT				AB194R-RS1	ALLEN BRADLEY	1	20. 1		2
20Q1	AB194R BLACK PISTOL HANDLE				AB194R-PB	ALLEN BRADLEY	1	20. 1		3
20Q1	AB194R 3 POLE COVER				AB194R-30C3	ALLEN BRADLEY	2	20. 1		4
20EB1	M8x40mm BRASS HEX BOLT				M8X40	Merlin	1	20. 2		5
20EB1	M8 CUT WASHER				M8S	Merlin	1	20. 2		6
20EB1	M8 BRASS WASHER				M8W	Merlin	5	20. 2		7
20EB1	M8 BRASS NUT				M8N	Merlin	3	20. 2		8
20EB2	4mm PE Terminal				57. 504. 9055. 0	WIELAND ELECTRIC	4	20. 2		9
30F1	4A 1 POLE AC C CURVE MCB				AB1489-M1C040	ALLEN BRADLEY	1	30. 1		10
30F1	4mm Terminal				57. 504. 0055. 0	WIELAND ELECTRIC	1	30. 1		11
30H1	120V 60Hz STANDARD LIGHT WITH DOOR OPERATED SWITCH				SZ 4138. 250	Rittal Ltd	1	30. 1		12
30H1	Universal Bracket - AE/TP				SZ 2373. 000	Rittal Ltd	2	30. 1		13
30H1	SZ CONNECTION CABLE - 3M				SZ 4315. 150	Rittal Ltd	1	30. 1		14
30F2	6A 1 POLE AC C CURVE MCB				AB1489-M1C060	ALLEN BRADLEY	1	30. 5		15
30F2	4mm Terminal				57. 504. 0055. 0	WIELAND ELECTRIC	1	30. 5		16
30F2	2. 5/4mm END PLATE				07. 311. 0155. 0	WIELAND ELECTRIC	1	30. 5		17
30PS1	85...264VAC 24VDC POWER SUPPLY 5A				AB1606XLE120E	ALLEN BRADLEY	1	30. 5		18
30F3	6A 1 POLE DC C CURVE MCB				AB1492-D1C060	ALLEN BRADLEY	1	30. 5		19
30H2	CLEAR PILOT LAMP				800FP-P7	ALLEN BRADLEY	1	30. 6		20

		Date	21. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Bill of Materials	P15033		=	
		Editor	TMC						+/-	
		Tested	22. Jul. 2015							P. 90
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			135 P.

0	1	2	3	4	5	6	7	8	9	
DEVICE DESIGNATION	DESCRIPTION				MODEL TYPE/PART №	MANUFACTURER	UNIT QUANTITY	SCHEMATIC PAGE, PATH	LINE CODE	ITEM №
30H2	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	30. 6		21
30H2	110V WHITE LED MODULE				800F-N5W	ALLEN BRADLEY	1	30. 6		22
30H3	CLEAR PILOT LAMP				800FP-P7	ALLEN BRADLEY	1	30. 6		23
30H3	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	30. 6		24
30H3	24VAC/DC WHITE LED MODULE				800F-N3W	ALLEN BRADLEY	1	30. 6		25
40VSD1	15.0KW IP55 INVERTER DRIVE H5 FILTER				FC102P15KT4E55H5	DANFOSS	1	40. 0		26
40DI1	UL ENCLOSED STEEL FUSED DISCONNECT SWITCH				AB194R-FJ60-1753-PB	ALLEN BRADLEY	1	40. 0		27
40DI1	40A CLASS J SERIES FUSE				JKS-40	BUSSMAN	3	40. 0		28
X1	4mm Terminal				57.504.0055.0	WIELAND ELECTRIC	7	40. 2		29
X1	TERMINAL END STOP				Z5.522.8555.0	WIELAND ELECTRIC	2	40. 2		30
X1	4mm Knife Terminal				57.504.2055.0	WIELAND ELECTRIC	3	40. 2		31
40VSD2	4.0KW IP55 INVERTER DRIVE H5 FILTER				FC102P4K0T4E55H5	DANFOSS	1	40. 5		32
40DI2	UL ENCLOSED STEEL FUSED DISCONNECT SWITCH				AB194R-FJ30-1753-PB	ALLEN BRADLEY	1	40. 5		33
40DI2	20A CLASS J SERIES FUSE				JKS-20	BUSSMAN	3	40. 5		34
X2	4mm Terminal				57.504.0055.0	WIELAND ELECTRIC	7	40. 6		35
X2	TERMINAL END STOP				Z5.522.8555.0	WIELAND ELECTRIC	2	40. 6		36
X2	4mm Knife Terminal				57.504.2055.0	WIELAND ELECTRIC	3	40. 6		37
CP2	200x200x80mm KL TERMINAL BOX RAL 7035				KL 1515.510	Rittal Ltd	1	40. 6		38
CP2	200x200x80mm KL MOUNTING PLATE RAL 7035				KL 1562.700	Rittal Ltd	1	40. 6		39
X1CP2	2.5mm Terminal				57.503.0055.0	WIELAND ELECTRIC	12	40. 7		40

		Date	21. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Bill of Materials	P15033		=	
		Editor	TMC						+ P. 91	
		Tested	22. Jul. 2015							
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.				135 P.

0	1	2	3	4	5	6	7	8	9	
DEVICE DESIGNATION	DESCRIPTION				MODEL TYPE/PART №	MANUFACTURER	UNIT QUANTITY	SCHEMATIC PAGE, PATH	LINE CODE	ITEM №
X1CP2	2.5/4mm END PLATE				07. 311. 0155. 0	WIELAND ELECTRIC	1	40. 7		41
X1CP2	TERMINAL END STOP				Z5. 522. 8555. 0	WIELAND ELECTRIC	2	40. 7		42
41S1	3 POSITION SELECTOR SWITCH				800FP-SM32	ALLEN BRADLEY	1	41. 1		43
41S1	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	41. 1		44
41S1	N.O. CONTACT BLOCK				800F-X10	ALLEN BRADLEY	2	41. 1		45
41H4	GREEN PILOT LAMP				800FP-P3	ALLEN BRADLEY	1	41. 2		46
41H4	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	41. 2		47
41H4	24VAC/DC GREEN LED MODULE				800F-N3G	ALLEN BRADLEY	1	41. 2		48
41K1	24VDC 2 POLE CHANGEOVER RELAY				AB700HLT12Z24	ALLEN BRADLEY	1	41. 3		49
41H5	RED PILOT LAMP				800FP-P4	ALLEN BRADLEY	1	41. 3		50
41H5	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	41. 3		51
41H5	24VAC/DC RED LED MODULE				800F-N3R	ALLEN BRADLEY	1	41. 3		52
41S2	3 POSITION SELECTOR SWITCH				800FP-SM32	ALLEN BRADLEY	1	41. 5		53
41S2	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	41. 5		54
41S2	N.O. CONTACT BLOCK				800F-X10	ALLEN BRADLEY	2	41. 5		55
41H6	GREEN PILOT LAMP				800FP-P3	ALLEN BRADLEY	1	41. 6		56
41H6	PLASTIC MOUNTING LATCH				800F-ALP	ALLEN BRADLEY	1	41. 6		57
41H6	24VAC/DC GREEN LED MODULE				800F-N3G	ALLEN BRADLEY	1	41. 6		58
41K2	24VDC 2 POLE CHANGEOVER RELAY				AB700HLT12Z24	ALLEN BRADLEY	1	41. 7		59
41H7	RED PILOT LAMP				800FP-P4	ALLEN BRADLEY	1	41. 7		60

		Date	21. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Bill of Materials	P15033		=	
		Editor	TMC						+	
		Tested	22. Jul. 2015							P. 92
Changes	Date	Name	Norm				Original	Sub. f.	Sub. b.	135 P.

0	1	2	3	4	5	6	7	8	9
DEVICE DESIGNATION	DESCRIPTION			MODEL TYPE/PART №	MANUFACTURER	UNIT QUANTITY	SCHEMATIC PAGE, PATH	LINE CODE	ITEM №
41H7	PLASTIC MOUNTING LATCH			800F-ALP	ALLEN BRADLEY	1	41. 7		61
41H7	24VAC/DC RED LED MODULE			800F-N3R	ALLEN BRADLEY	1	41. 7		62
X3	4mm Knife Terminal			57. 504. 2055. 0	WIELAND ELECTRIC	5	42. 1		63
X3	TERMINAL END STOP			Z5. 522. 8555. 0	WIELAND ELECTRIC	2	42. 1		64
X3	4mm Terminal			57. 504. 0055. 0	WIELAND ELECTRIC	5	42. 1		65
X3	2.5/4mm END PLATE			07. 311. 0155. 0	WIELAND ELECTRIC	1	42. 1		66
42K3	24VDC 2 POLE CHANGEOVER RELAY			AB700HLT12Z24	ALLEN BRADLEY	1	42. 2		67
42K4	24VDC 2 POLE CHANGEOVER RELAY			AB700HLT12Z24	ALLEN BRADLEY	1	42. 4		68
42E1	WASS CCC 20LP SIGNAL MULTIPLIER			KL8581160000	Weidmüller	1	42. 7		69
X4	4mm Terminal			57. 504. 0055. 0	WIELAND ELECTRIC	9	43. 1		70
X4	TERMINAL END STOP			Z5. 522. 8555. 0	WIELAND ELECTRIC	2	43. 1		71
X4	4mm Knife Terminal			57. 504. 2055. 0	WIELAND ELECTRIC	1	43. 1		72
43H8	YELLOW PILOT LAMP			800FP-P5	ALLEN BRADLEY	1	43. 1		73
43H8	PLASTIC MOUNTING LATCH			800F-ALP	ALLEN BRADLEY	1	43. 1		74
43H8	24VAC/DC WHITE LED MODULE			800F-N3W	ALLEN BRADLEY	1	43. 1		75
43H9	RED PILOT LAMP			800FP-P4	ALLEN BRADLEY	1	43. 2		76
43H9	PLASTIC MOUNTING LATCH			800F-ALP	ALLEN BRADLEY	1	43. 2		77
43H9	24VAC/DC RED LED MODULE			800F-N3R	ALLEN BRADLEY	1	43. 2		78
X6	4mm Terminal			57. 504. 0055. 0	WIELAND ELECTRIC	10	43. 6		79
X6	TERMINAL END STOP			Z5. 522. 8555. 0	WIELAND ELECTRIC	2	43. 6		80

		Date	21. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Bill of Materials	P15033		=	
		Editor	TMC						+	
		Tested	22. Jul. 2015							P. 93
Changes	Date	Name	Norm				Original	Sub. f.	Sub. b.	135 P.

0	1	2	3	4	5	6	7	8	9	
DEVICE DESIGNATION	DESCRIPTION				MODEL TYPE/PART №	MANUFACTURER	UNIT QUANTITY	SCHEMATIC PAGE, PATH	LINE CODE	ITEM №
X6	2.5/4mm END PLATE				07. 311. 0155. 0	WIELAND ELECTRIC	1	43. 6		81
50E3	PGD1 GRAPHICS TERMINAL				PGD1000FW0	Carel	1	50. 1		82
50E4	pC05+ CAREL CONTROLLER LARGE FB/BMS, NO OPTO, NO USB				P+500B0R000LO	Carel	1	50. 1		83
X5	3 Tier Terminal				57. 503. 8855. 0	WIELAND ELECTRIC	7	51. 2		84
X5	TERMINAL END STOP				Z5. 522. 8555. 0	WIELAND ELECTRIC	2	51. 2		85
X5	70 WAY BLUE COMB				Z7. 267. 0027. 6	WIELAND ELECTRIC	1	51. 2		86
-X4	4mm Knife Terminal				57. 504. 2055. 0	WIELAND ELECTRIC	1	54. 1		87
-X4	4mm Terminal				57. 504. 0055. 0	WIELAND ELECTRIC	1	54. 1		88
-X4	2.5/4mm END PLATE				07. 311. 0155. 0	WIELAND ELECTRIC	1	54. 1		89
-X5	3 Tier Terminal				57. 503. 8855. 0	WIELAND ELECTRIC	4	55. 2		90
61K5	24VDC 2 POLE CHANGEOVER RELAY				AB700HLT12Z24	ALLEN BRADLEY	1	61. 0		91
61K6	24VDC 2 POLE CHANGEOVER RELAY				AB700HLT12Z24	ALLEN BRADLEY	1	61. 1		92
61K7	24VDC 2 POLE CHANGEOVER RELAY				AB700HLT12Z24	ALLEN BRADLEY	1	61. 8		93
62K8	24VDC 2 POLE CHANGEOVER RELAY				AB700HLT12Z24	ALLEN BRADLEY	1	62. 4		94
70ENC1	800x600x250mm AE ENCLOSURE				AE 1058. 500	Rittal Ltd	1	70. 2		95
-71LAB1	105x20mm ENGRAVED LABEL - Y/B/Y				LAB8	CE Controls	1	71. 5		96
-71LAB2	105x20mm ENGRAVED LABEL - Y/B/Y				LAB8	CE Controls	1	71. 5		97
-71LAB3	RATING PLATE				LAB10	CE Controls	1	71. 5		98
-71LAB4	COMMISSIONING NOTICE				LAB11	CE Controls	1	71. 5		99
-72TR1	40X80mm NARROW TRUNKING				E154	Lovato Electric	1	72. 2		100

		Date	21. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Bill of Materials	P15033		=	
		Editor	TMC						+/-	
		Tested	22. Jul. 2015							P. 94
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.				135 P.

		Date	21. Jul. 2015	CP1	AQUA COOLING SOLUTIONS	Bill of Materials	P15033		=
		Editor	TMC						+ P. 95
		Tested	22. Jul. 2015		Original	Sub. f.	Sub. b.		135 P.
Changes	Date	Name	Norm						

Terminal diagram

ESSK034E

Strip designation

X1CP2

Terminal diagram

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	-X4	P15033		=		
		Editor	MDC						+ +		
		Tested	22. Jul. 2015							P. 106	
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.				135 P.

Terminal diagram

Terminal strip and connector overview

ESSR001E

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	Terminal strip and connector overview	P15033		=
		Editor	MDC						+
		Tested	22. Jul. 2015						P. 108
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

0	1	2	3	4	5	6	7	8	9
---	---	---	---	---	---	---	---	---	---

Cable overview

ESS002E

Cable name Cable designation	Source by	Target to	Cable type	Total Cores	Used Cores	Cross- section mm ²	Leng. m	Remark	Graphics- Page
W40DI1	-40DI1	-40VSD1	YYNR	4/PE	4/PE	6	-	PUMP - RTP1 LPS ISOLATOR	VS
W40DI2	-40DI2	-40VSD2	YYNR	4/PE	4/PE	2.5	-	PUMP - CTP1 RECIRCULATION	
W40M1			SYNR	4/PE+SHIELD	4/PE+SHIELD	2.5	-	PUMP - RTP1 LPS	112
	-40M1	-40VSD1		4/PE+SHIELD	4/PE	2.5		PUMP - RTP1 LPS	112
	SHIELD	-40VSD1		4/PE+SHIELD	0+SHIELD	2.5		PUMP - RTP1 LPS	112
W40M2			SYNR	4/PE+SHIELD	4/PE+SHIELD	2.5	-	PUMP - CTP1 RECIRCULATION	
	-40M2	-40VSD2		4/PE+SHIELD	4/PE	2.5		PUMP - CTP1 RECIRCULATION	
	SHIELD	-40VSD2		4/PE+SHIELD	0+SHIELD	2.5		PUMP - CTP1 RECIRCULATION	
W40TT5	X1CP2	-40TT5	8761	2+SHIELD	2+SHIELD	0.3	-	CTP1 TEMPERATURE SENSOR	14
W40VSD-M1	-40VSD1	-40VSD2	9841	2+SHIELD	2+SHIELD	0.3	-	MODBUS NETWORK	115
W40VSD-M2	-40VSD2	-X2	9841	2+SHIELD	2+SHIELD	0.3	-	MODBUS NETWORK	116
W40VSD1	-40VSD1	-X1	8761	2+SHIELD	2+SHIELD	0.3	-	VENTURI FLOW PRESSURE	117
W40VSD2	-40VSD2	X1CP2	8761	2+SHIELD	2+SHIELD	0.3	-	CTP1 TEMPERATURE SENSOR	18
W42FS1	-X3	-42FS1	YYNR	4/PE	4/PE	0.75	-	VENTURI THERMAL FLOW SWITCH	
W42LS1	-X3	-42LS1	YYNR	2	2	0.75	-	LEAK LEVEL SENSOR	120
W42PT1	-X3	-42PT1	8761	2+SHIELD	2	0.3	-	NEGATIVE VENTURI SUCTION	No. 1
W42PT2	-X3	-42PT2	8761	2+SHIELD	2	0.3	-	NEGATIVE VENTURI SUCTION	No. 2
W43SV1	-X4	-43SV1	YYNR	3/PE	3/PE	0.75	-	AIR RELEASE SOLENOID VALVE	
W51PT3	-51PT3	-X5	8761	2+SHIELD	2+SHIELD	0.3	-	VENTURI INLET PRESSURE	124
W51PT4	-51PT4	X1CP2	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE FLOW PRESSURE	No. 1
W51PT5	-51PT5	X1CP2	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE FLOW PRESSURE	No. 2
W51TT1	-X5	-51TT1	8761	2+SHIELD	2+SHIELD	0.3	-	CHILLER FLOW TEMPERATURE	27
W51TT2	-X5	-51TT2	8761	2+SHIELD	2+SHIELD	0.3	-	CHILLER RETURN TEMPERATURE	28
W52TT3	-X5	-52TT3	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE RETURN TEMPERATURE	
W52TT4	X1CP2	-52TT4	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE FLOW TEMPERATURE	
WX1-40VSD1	-X1	-40VSD1	YYNR	8/PE	7	1.5	-	40VSD1 CONTROL	131
WX2-40VSD2	-X2	-40VSD2	YYNR	8/PE	7	1.5	-	40VSD2 CONTROL	132
WX5. 1	X1CP2	-X5	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE FLOW PRESSURE	No. 1
WX5. 2	X1CP2	-X5	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE FLOW PRESSURE	No. 2
WX5. 3	X1CP2	-X5	8761	2+SHIELD	2+SHIELD	0.3	-	DATA CENTRE FLOW TEMPERATURE	

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	Cable overview	P15033		=
		Editor	MDC						+
		Tested	22. Jul. 2015						P. 109
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.			135 P.

Interconnection diagram

ESSN001E

113

115

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W40TT5 CTP1 TEMPERATURE SENSOR	P15033		=
		Editor	MDC						+
		Tested	22. Jul. 2015						P. 114
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

Interconnection diagram

T-FILE CO

三

ESSN001B

114

116

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W40VSD-M1 MODBUS NETWORK	P15033	=	
		Editor	MDC					+	
		Tested	22. Jul. 2015						P. 115
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

Interconnection diagram

תְּלֵבָה

卷之三

ESSN001B

Table type
Table designation
W40VSD-M2
9841

Remark

MODBUS NETWORK

2+SHIELD 0.3

Cable length

1

2 + SHTETL 0 3

10

10

10

1 2 3 4 5 6 7 8 9

115

117

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W40VSD-M2 MODBUS NETWORK	P15033		=	
		Editor	MDC						+	
		Tested	22. Jul. 2015						P. 116	
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.				135 P.

Interconnection diagram

ESSN001E

119

121

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W42LS1 LEAK LEVEL SENSOR	P15033	=	
		Editor	MDC					+	
		Tested	22. Jul. 2015		Original	Sub. f.			P. 120
Changes	Date	Name	Norm			Sub. b.			135 P.

Interconnection diagram

[ab] a duci anatice

三三

SESSION

120

122

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W42PT1 NEGATIVE VENTURI SUCTION No. 1	P15033	=	
		Editor	MDC					+	
		Tested	22. Jul. 2015						P. 121
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

Interconnection diagram

ESSN001E

123

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W42PT2 NEGATIVE VENTURI SUCTION No. 2	P15033	=	
		Editor	MDC					+ +	
		Tested	22. Jul. 2015						P. 122
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

Interconnection diagram

ESSN001E

126

124		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W51PT4 DATA CENTRE FLOW PRESSURE	No. 1	P15033	=
		Editor	MDC						+ P. 125
		Tested	22. Jul. 2015						
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

Interconnection diagram

[Cob] e desianation

二三

ESSN001E

W51PT5	Cable designation
8761	Cable type

Remark

DATA CENTRE E1 0W BRESSUIRE NO 3 3+SHIELD 0 3

3

CITE

1

0 1 2 3 4 5 6 7 8 9

125

127

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W51PT5 DATA CENTRE FLOW PRESSURE	No. 2	P15033	=	
		Editor	MDC						+	
		Tested	22. Jul. 2015							P. 126
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			135 P.

Interconnection diagram

ESSN001E

1

127

129

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	W51TT2 CHILLER RETURN TEMPERATURE	P15033		=	
		Editor	MDC						+	
		Tested	22. Jul. 2015		Original	Sub. f.	Sub. b.			P. 128
Changes	Date	Name	Norm							135 P.

Interconnection diagram

ESSN001E

131

133

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	WX2-40VSD2 40VSD2 CONTROL	P15033		=	
		Editor	MDC						+	
		Tested	22. Jul. 2015						P. 132	
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.			135 P.

Interconnection diagram

תְּלִינוּ

三

ESSN0018

134

		Date	15. Jun. 2015	CP1	AQUA COOLING SOLUTIONS	WX5.3 DATA CENTRE FLOW TEMPERATURE	P15033	=	
		Editor	MDC					+ +	
		Tested	22. Jul. 2015						P. 135
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.		135 P.

AQUA COOLING SOLUTIONS LIMITED

UNIT D4 SEGENSWORTH BUSINESS CENTRE
SEGENSWORTH ROAD, FAREHAM
HAMPSHIRE PO15 5RQ

Tel.: +44 (0) 845 0941 800 Fax.: +44 (0) 845 0941 900

Customer	:	Nautilus Data Technologie			
Plant Designation	:	HMI			
Drawing number	:	P15033/HMI			
Project Number	:				
End User	:	Nautilus Data Technologie	Control panel by	:	Shellau
Site Location	:	1260 Nimitz Avenue Vallejo CA 94592	Incoming supply	:	120VAC 60Hz
			Feeder	:	
			Control voltage	:	24VDC
			Manufacturing date	:	November 2015
			Degree of protect.	:	IP54
			Panel Location	:	
Created on	:	03. Nov. 2015			
Responsible for project	:	M. CARMODY			
Date changed	:	04. Nov. 2015	Highest Page No.	:	61
Editor	:	MDC	No. of pages	:	12

Table of contents

Column X: an automatically created page is manual changed

ESSJ010E

		Date		HMI	AQUA COOLING SOLUTIONS	Table of Contents	P15033/HMI		=
		Editor	MDC				REV. B		+ ISSUED FOR MANUFACTURE
		Tested	04. Nov. 2015				04/11/2015	P. 2	
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.			61 P.

GENERAL SPECIFICATIONS AND TECHNICAL INFORMATION


CONTROL PANEL DETAILS		SPECIFICATION	NOTE COMMENTS: -	PAINT FINISH	SPECIFICATION
TOTAL SIZE OF ENCLOSURE/CONTROL PANEL/S		380(H) x 600(W) x 210(D) mm	RITTAL TS RANGE (1200/800mm Width) SECTIONS	GLOSS: SEMI GLOSS: MATT: POWDER-COATED etc	RITTAL STANDARD PAINT FINISH
APPROXIMATE OVERALL WEIGHT		25kg.		EXTERIOR COLOUR (EXCLUDING DOORS)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY		1 PHASE/NEUTRAL/EARTH 230VAC/50Hz		EXTERIOR COLOUR (DOORS)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY TYPE		TN-S		INTERIOR COLOUR (EXCLUDING BACKPLATE)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY REQUIREMENTS		6AMP SUPPLY		INTERIOR COLOUR (INSIDE OF DOORS)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SYSTEM SUPPLY ALLOWANCES FOR DIVERSITY		DIVERSITY 100%FLC CONNECTED		MOUNTING PLATE/S	RITTAL STANDARD (ZINC PLATED)
SYSTEM SUPPLY DESIGN CURRENT REQUIREMENTS				BASE/PLINTH (FITTED)	RITTAL STANDARD (RAL 7022)
MAIN SUPPLY ISOLATOR TYPE 400AMP FUSE DISCONNECTOR				CABLE CHAMBER (NOT FITTED)	RITTAL POWDER-COATED TEXTURED (RAL 7035)
SHORT CIRCUIT CAPACITY					
APPARENT POWER (KVA CONNECTED)			P = V x I x 1.732		
ACTIVE POWER (KW CONNECTED)			P = V x I x 1.732 x 0.8		
DC CONTROL POWER (WATTS CONNECTED)			POWER SUPPLY UNIT 400VAC/24VDC/60AMP/1440W.		
ENCLOSURE LIGHTS & SOCKETS, VOLTAGE		230VAC			
CONTROL & INDICATION VOLTAGE		24VDC			
PROTECTION		SPECIFICATION	COMMENTS: -	PLC EQUIPMENT	SPECIFICATION
BS/EN/IEC STANDARDS IMPLEMENTED		EN292/BSEN954-1/BSEN60204-1/BS7671	NOTE: -ALL APPLICABLE & RELEVANT STANDARDS etc.	PLC MAKE	ALLEN BRADLEY
DEGREE OF ENCLOSURE PROTECTION (IP RATING)		IP54		PLC TYPE	POINT IO
DETAILS OF EQUIPMENT BY BARRIER SCREENING		25VAC/60VDC AND ABOVE (IP20B)	NOTE: -DRY ENVIRONMENTS MAINTAINED (EN60204)	PLC INTERFACE	ETHERNET
EQUIPOTENTIAL BONDING IMPLEMENTED		YES	BS7671 STANDARDS		
AUTOMATIC DISCONNECTION INSTALLED		YES			
MANUFACTURERS SPECIFICATIONS IMPLEMENTED		YES			
EMC STANDARDS REQUIRED (SCREENING)		YES	MANUFACTURERS EMC REQUIREMENTS IMPLEMENTED		
STANDARD LABELS TO BE FITTED		YES	HAZARDS/WARNING SIGNS AND VOLTAGE LABELS		
CONDUCTORS AND TERMINATIONS		SPECIFICATION	COMMENTS: -	CABLE COLOURS	SPECIFICATION
MINIMUM SIZE OF POWER WIRING		2.5mm ²		AC 400VAC POWER WIRING	BLACK
MINIMUM SIZE OF CONTROLS & I/O WIRING 24VDC		1.0mm ² (I/O 0.5mm ²)		AC 230VAC POWER WIRING	BLACK
MINIMUM SIZE OF POWER TERMINALS		4.0mm TERMINATION		PROTECTIVE CONDUCTOR	GREEN/YELLOW
MINIMUM SIZE OF CONTROL TERMINALS		2.5mm TERMINATION		AC CONTROL CIRCUITS +	RED
MAIN POWER BUSBAR SIZE		15x5mm COPPER BAR		AC CONTROL CIRCUITS -	WHITE/RED
MAIN EARTH BUSBAR SIZE		30x15mm COPPER BAR		DC CONTROL CIRCUITS +	DARK BLUE
EARTH BUSBAR POSITIONS		BOTTOM OF PANEL/S		DC CONTROL CIRCUITS -	WHITE/BLUE
METHOD OF TERMINATING OUTGOING PROTECTIVE CONDUCTORS		BUSBAR AND/OR PE TERMINALS		NEUTRAL CIRCUITS	LIGHT BLUE
EXTERNAL CABLES, ENTRY POSITION		BOTTOM/TOP ENTRY		LIVE SIDE OF ISOLATOR CIRCUITS	ORANGE
METHOD OF FIXING/SUPPORTING OUTGOING CABLES		CABLE TRUNKING/TRAY		EXTERNALLY FED INTERLOCKS CIRCUITS (AC)	ORANGE
SCHEMATIC SYMBOLS & CONTACT REFERENCE NUMBERS Etc		SYMBOLS BS EN 60617	EQUIPMENT PAGE-PATH NUMBERING.	EXTERNALLY FED INTERLOCKS CIRCUITS (DC)	ORANGE

GENERAL COMMENTS: -

EN SAFETY RELATED CATEGORIES


<u>EN954-1 SAFETY RELATED CIRCUIT CATEGORIES.</u>	<u>MACHINERY AND EQUIPMENTS.</u>	<u>BSEN 60204-1 SAFETY RELATED STOPPING CATEGORIES.</u>
<u>CATEGORY "B"</u> PLC INPUT CONTROLLED. PLC OUTPUT CONTROLLED. PLC OUTPUTS FOR RUN ENABLE RELAY. PLC OUTPUTS FOR INVERTER POWER CONTACTORS.	MOTOR CONTACTORS INVERTER DRIVE UNITS CONTROL PANEL EMERGENCY STOP DRIVE BOX EMERGENCY STOP OP STATION EMERGENCY STOP	<u>CATEGORY "2"</u> IMMEDIATE STOP (PLC CONTROLLED) CONTACTORS.
<u>CATEGORY "1-2"</u> DUAL CHANNEL INPUT TO SAFETY RELAY. SINGLE CHANNEL OUTPUT FROM SAFETY RELAY TO HARDWIRED CONTACTOR.	MOTOR CONTACTORS INVERTER DRIVE UNITS CONTROL PANEL EMERGENCY STOP	<u>CATEGORY "0"</u> IMMEDIATE STOP (SAFETY CONTACTS) DUAL CHANNEL HARDWIRED CONTROLLED TO CONTACTOR WITH DIVERSITY CIRCUITS.
<u>GENERAL DUTY TENANCE NOTE:</u> ISOLATE ALL MACHINERY AND/OR EQUIPMENT AT ISOLATION POINTS BEFORE UNDERTAKING ANY DUTY TENANCE WORK.		

		Date	03. Nov. 2015	HMI	AQUA COOLING SOLUTIONS	HMI EN Standards Safety Related Categories.	P15033/HMI	=
		Editor	M. CARMODY					+
		Tested	04. Nov. 2015					
Changes	Date	Name	Norm		Original	Sub. f.	Sub. b.	REV. B ISSUED FOR MANUFACTURE P. 31 04/11/2015 61 P.

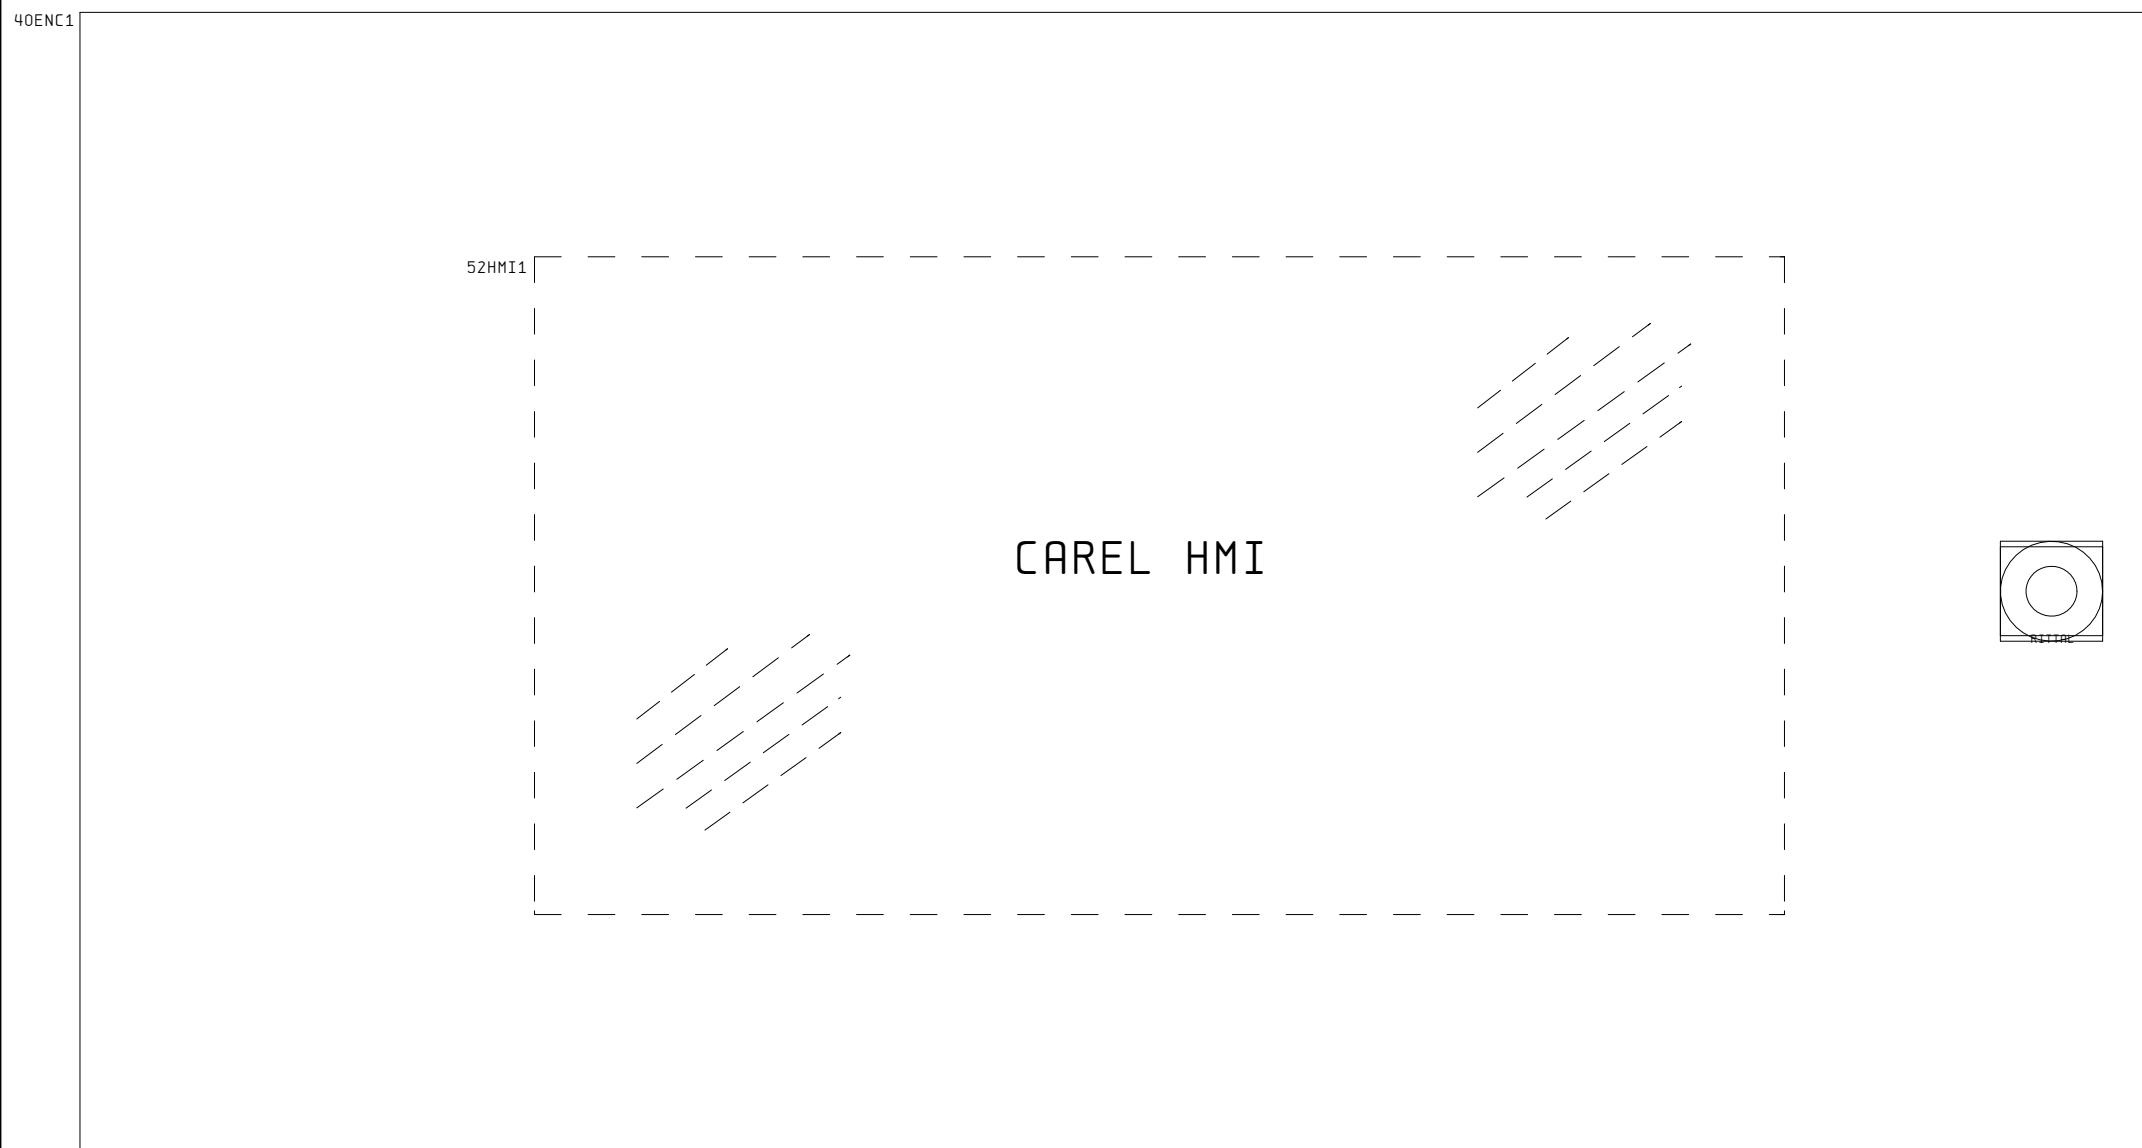

MANUFACTURING NOTE:-
ALL DIMENSIONS AND POSITIONS
ARE APPROXIMATE SCALE 1:2
(A3 PRINT SIZE)


		Date	03. Nov. 2015	HMI	AQUA COOLING SOLUTIONS	Control Panel General Arrangement	P15033/HMI	=	
		Editor	M. CARMODY					+	
		Tested	04. Nov. 2015				REV. B	ISSUED FOR MANUFACTURE	P. 40
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		04/11/2015	61 P.

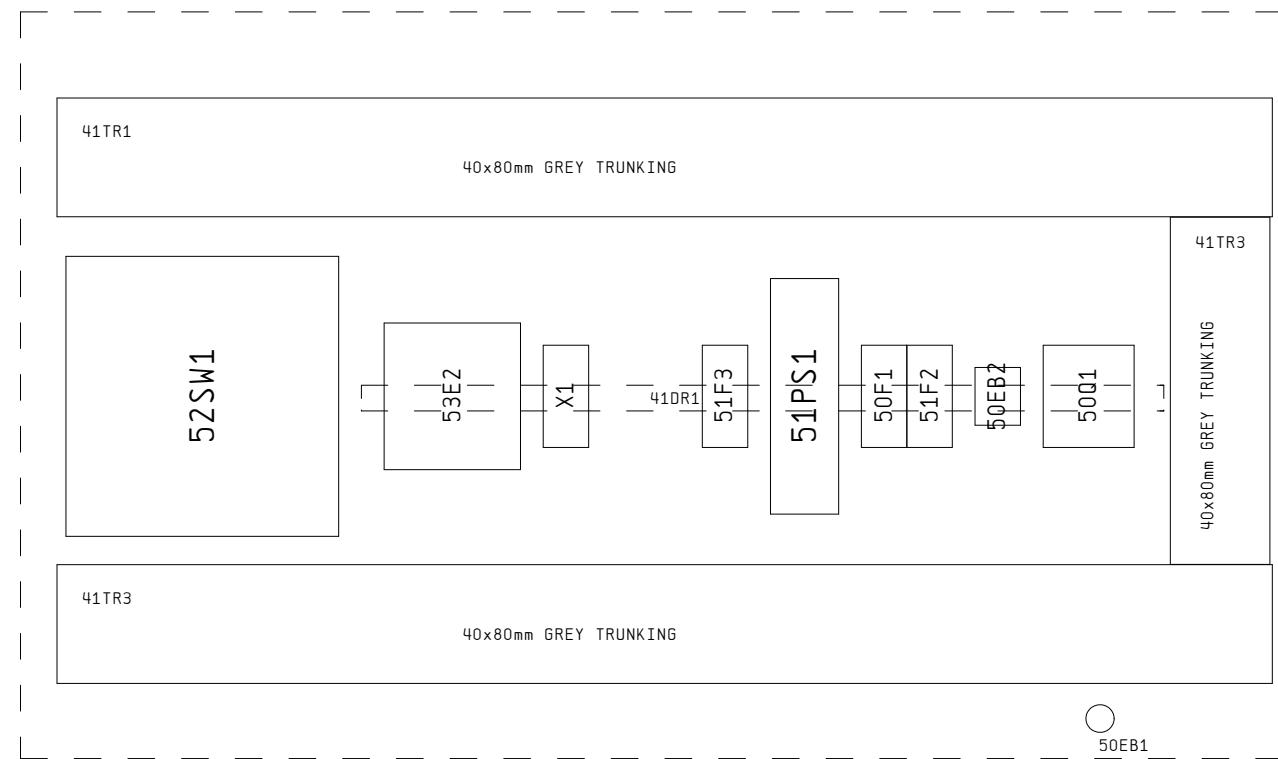


		Date	03. Nov. 2015	HMI	AQUA COOLING SOLUTIONS	Control Panel Backplate Layout	P15033/HMI		=	
		Editor	M. CARMODY				REV. B		+ ISSUED FOR MANUFACTURE	
		Tested	04. Nov. 2015		Original	Sub. f.	Sub. b.	04/11/2015	P. 41	61 P.
Changes	Date	Name	Norm							


0 1 2 3 4 5 6 7 8 9

MAIN POWER SUPPLY
120VAC/60Hz/

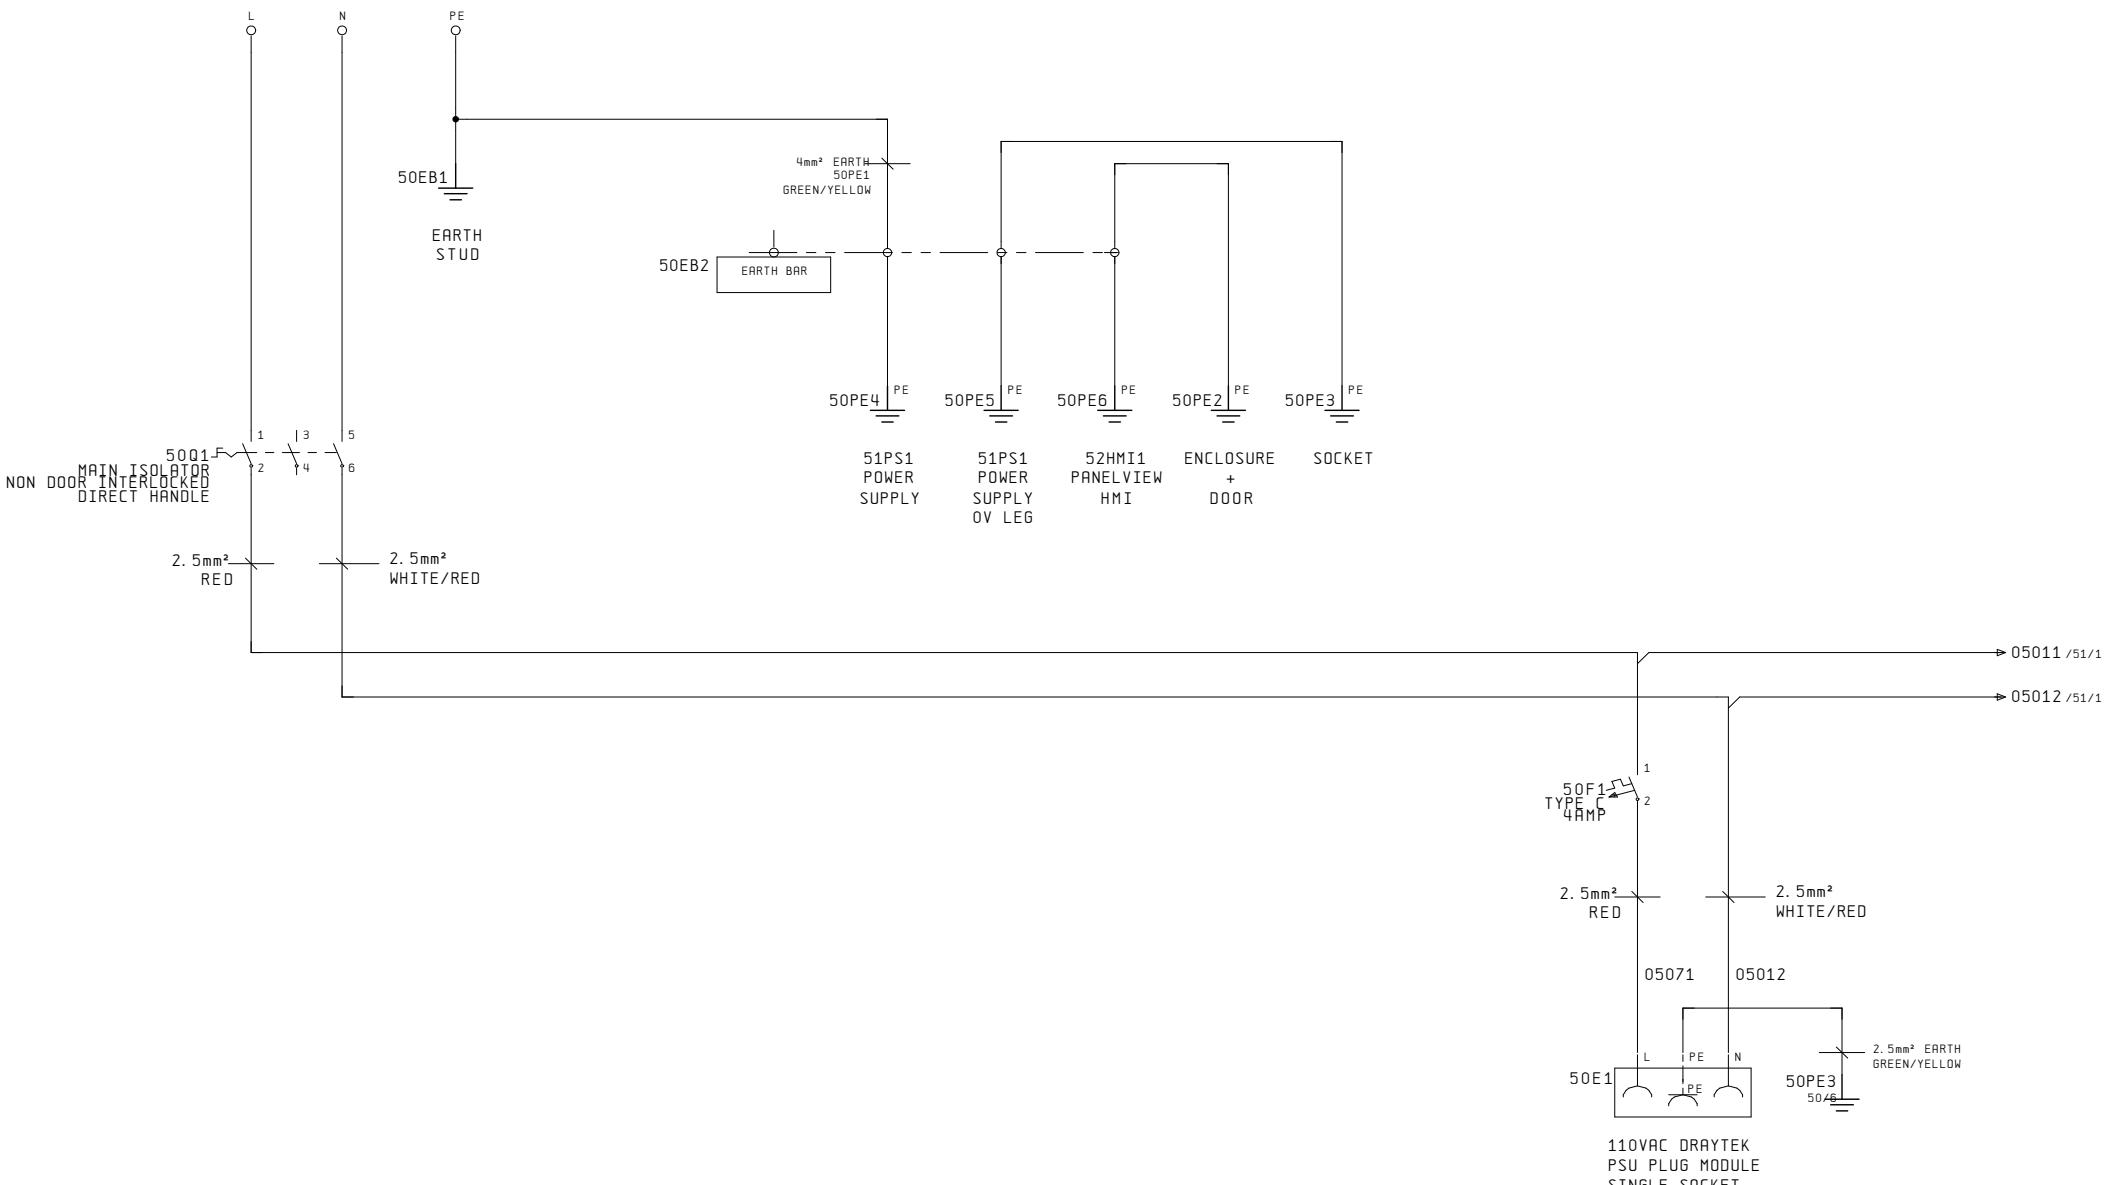


		Date	03. Nov. 2015	HMI	AQUA COOLING SOLUTIONS	110VAC Power Supply Distribution	P15033/HMI	
		Editor	M. CARMODY				=	
		Tested	04. Nov. 2015				+	
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.	REV. B	ISSUED FOR MANUFACTURE P. 50
							04/11/2015	61 P.

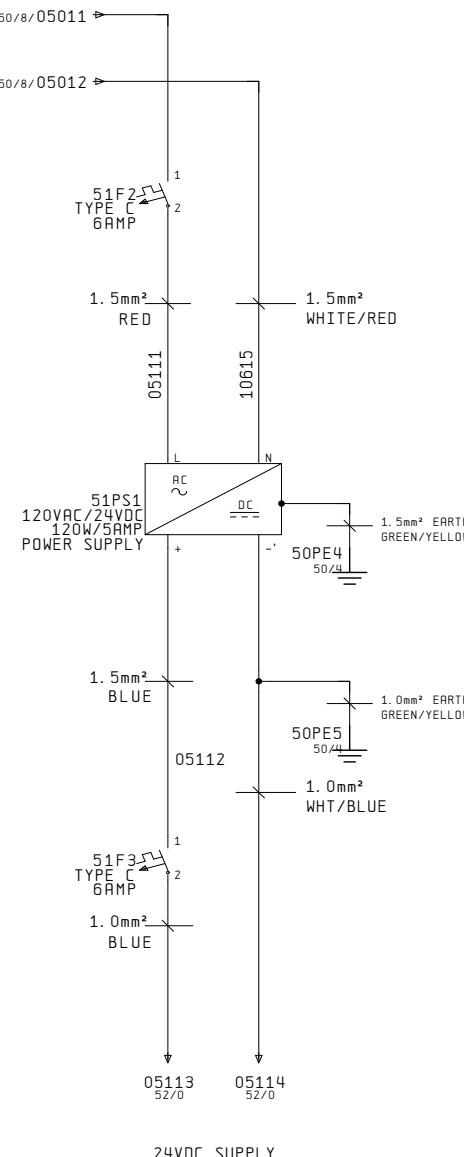

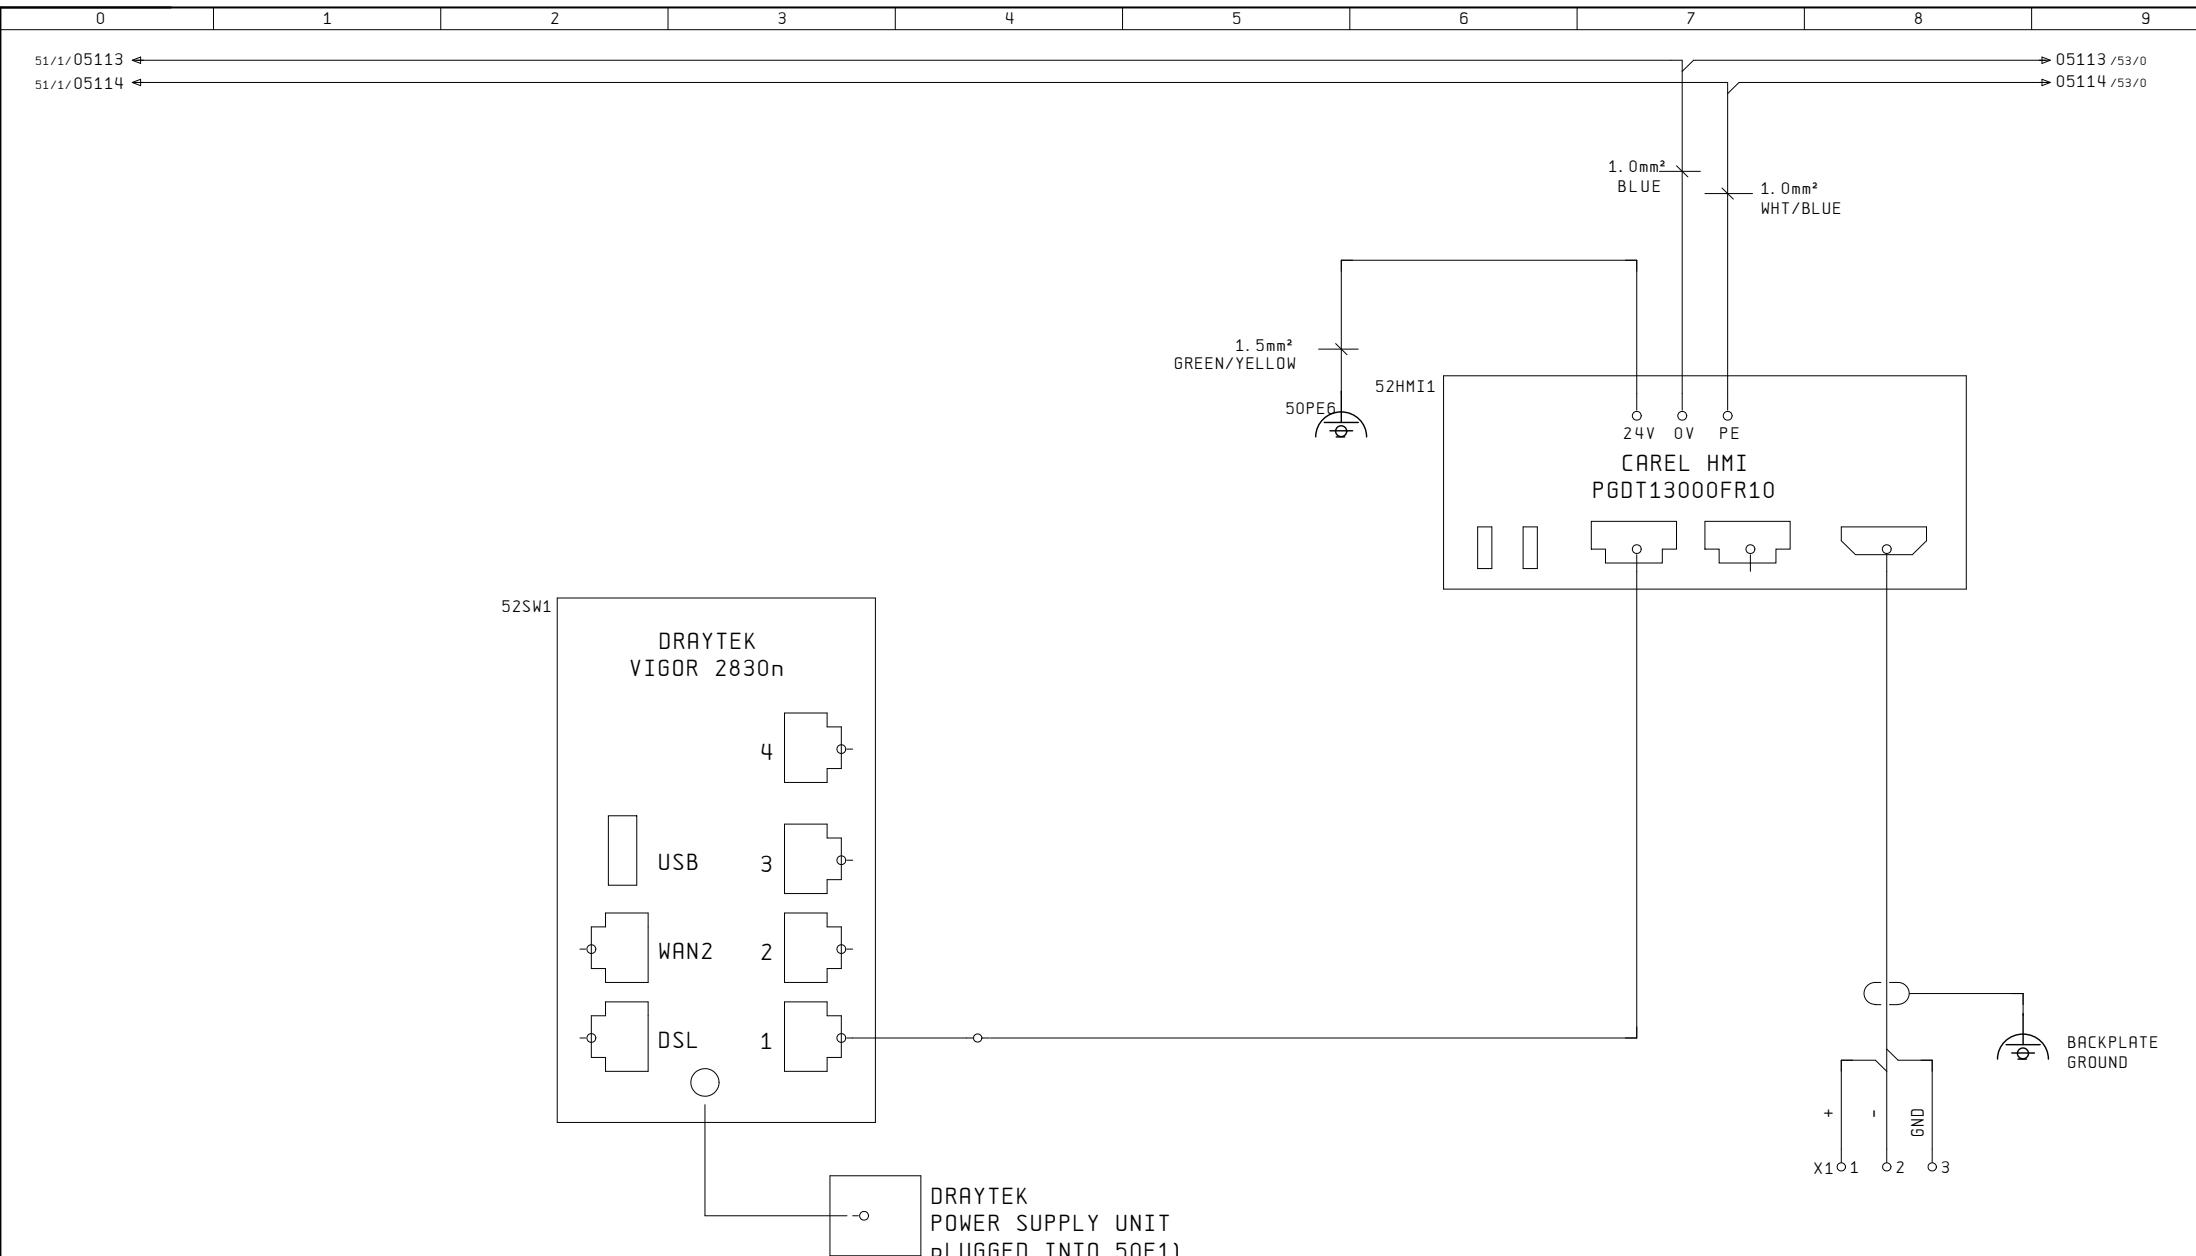

0 1 2 3 4 5 6 7 8 9

52/9/05113 ←
52/9/05114 ←

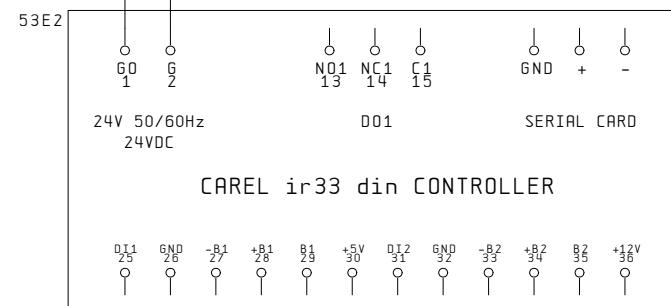

		Date		HMI	AQUA COOLING SOLUTIONS	Carel ir33 Controller	P15033/HMI	=	
		Editor	MDC					+	
		Tested	04.Nov.2015				REV. B	ISSUED FOR MANUFACTURE	P. 53
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		04/11/2015	61 P.

0	1	2	3	4	5	6	7	8	9	
DEVICE DESIGNATION	DESCRIPTION				MODEL TYPE/PART №	MANUFACTURER	UNIT QUANTITY	SCHEMATIC PAGE, PATH	LINE CODE	ITEM №
40ENC1	600x380x210mm AE ENCLOSURE				AE 1039.500	Rittal Ltd	1	40. 0		1
41TR1	40X80mm NARROW TRUNKING				E154	Lovato Electric	1	41. 2		2
41TR3	40X80mm NARROW TRUNKING				E154	Lovato Electric	1	41. 2		3
41DR1	35mm X 7.5mm TOP HAT SLOTTED RAIL NORMAL DUTY				TS35S	Lovato Electric	1	41. 5		4
41TR3	40X80mm NARROW TRUNKING				E154	Lovato Electric	1	41. 7		5
50Q1	3 POLE 25A SIRCO M LOADBREAK SWITCH				2200 3002	SOCOMEC	1	50. 1		6
50Q1	DIRECT HANDLE - BLUE 16...80				2299 5012	SOCOMEC	1	50. 1		7
50Q1	TERMINAL SHROUD 3 POLE 16-40A				2294 3005	SOCOMEC	1	50. 1		8
50EB1	M8x40mm BRASS HEX BOLT				M8X40	Merlin	1	50. 2		9
50EB1	M8 CUT WASHER				M8S	Merlin	1	50. 2		10
50EB1	M8 BRASS WASHER				M8W	Merlin	2	50. 2		11
50EB1	M8 BRASS NUT				M8N	Merlin	2	50. 2		12
50EB2	4mm PE Terminal				57.504.9055.0	WIELAND ELECTRIC	3	50. 3		13
50F1	4A 1 POLE AC C CURVE MCB				AB1489-M1C040	ALLEN BRADLEY	1	50. 7		14
50E1	SWITCHED SINGLE SOCKET				811 27	LEGRAND	1	50. 7		15
51F2	6A 1 POLE AC C CURVE MCB				AB1489-M1C060	ALLEN BRADLEY	1	51. 1		16
51PS1	85...264VAC 24VDC POWER SUPPLY 5A				AB1606XLE120E	ALLEN BRADLEY	1	51. 1		17
51F3	6A 1 POLE DC C CURVE MCB				AB1492-D1C060	ALLEN BRADLEY	1	51. 1		18
52SW1	ROUTER				VIGOR 2830N	Draytek	1	52. 2		19
RJ2	RJ45 TO RJ45 PATCHCORD				AB1585JM4TBJM2	ALLEN BRADLEY	1	52. 4		20

		Date	04. Nov. 2015	HMI	AQUA COOLING SOLUTIONS	Bill of Materials	P15033/HMI	=		
		Editor	TMC					+		
		Tested	04. Nov. 2015				REV. B	ISSUED FOR MANUFACTURE	P. 60	
Changes	Date	Name	Norm	Original	Sub. f.	Sub. b.		04/11/2015	61 P.	

		Date	04. Nov. 2015	HMI	AQUA COOLING SOLUTIONS	Bill of Materials	P15033/HMI		=
		Editor	TMC				REV. B		+ ISSUED FOR MANUFACTURE
		Tested	04. Nov. 2015		Original	Sub. f.	Sub. b.	04/11/2015	P. 61
Changes	Date	Name Norm							61 P.

NCSE Pump Manual



NSCE



NSCS



NSC2

Appicare qui il codice a barre

Apply the adhesive bar code nameplate here

it	Manuale di installazione, uso e manutenzione.....	2	pl	Podręcznik instalacji, eksploatacji i konserwacji.....	162
en	Installation, Operation, and Maintenance Manual.....	13	cs	Návod k instalaci, provozu a údržbě.....	173
fr	Manuel d'installation, d'utilisation et d'entretien.....	23	sk	Návod na inštaláciu, obsluhu a údržbu....	184
de	Montage-, Betriebs- und Wartungshandbuch	34	hu	Beszerelési, működtetési és karbantartási útmutató.....	194
es	Manual de instalación, funcionamiento y mantenimiento.....	46	ro	Manual de instalare, exploatare și întreținere	205
pt	Manual de Instalação, Operação e Manutenção.....	57	bg	Ръководство за Инсталациите, Експлоатация и Обслужване.....	216
nl	Handleiding voor installatie, bediening en onderhoud.....	68	sl	Navodila za vgradnjo, delovanje in vzdrževanje.....	228
da	Installations-, betjenings- og vedligeholdelseshåndbog	80	hr	Priručnik za instaliranje, rad i održavanje	238
no	Installasjons-, drifts- og vedlikeholdshåndbok.....	90	sr	Priručnik za instaliranje, rad i održavanje	249
sv	Installations-, drift- och underhållsmanual	100	el	Εγχειρίδιο εγκατάστασης, λειτουργίας και συντήρησης.....	259
fi	Asennus-, käyttö- ja huolto-opas.....	110	tr	Kurulum, Çalıştırma ve Bakım Kılavuzu..	271
is	Handbók um uppsetningu, rekstur og viðhald.....	121	ru	Руководство по установке, эксплуатации и техническому обслуживанию.....	281
et	Paigaldamise, kasutamise ja hooldamise juhend.....	130	uk	Посібник зі встановлення, експлуатації та технічного обслуговування	293
lv	Uzstādīšanas, ekspluatācijas un tehniskās apkopes rokasgrāmata.....	140	ar	دليل التركيب والتشغيل والصيانة	305
lt	Montavimo, eksplotavimo ir techninės priežiūros vadovas.....	151			



Causa	Soluzione
I cuscinetti del motore sono usurati.	Rivolgersi al rappresentante di vendita e assistenza di zona.
Presenza di corpi estranei	Rivolgersi al rappresentante di vendita e assistenza di zona.

Causa	Soluzione
all'interno della pompa.	
Il girante striscia contro l'anello di usura	Rivolgersi al rappresentante di vendita e assistenza di zona.

Per ogni situazione non contemplata, fare riferimento al rappresentante di vendita e assistenza di zona.

1 Introduction and Safety



1.1 Introduction

Purpose of this manual

The purpose of this manual is to provide necessary information for:

- Installation
- Operation
- Maintenance



CAUTION:

Read this manual carefully before installing and using the product. Improper use of the product can cause personal injury and damage to property, and may void the warranty.

NOTICE:

Save this manual for future reference, and keep it readily available at the location of the unit.

1.1.1 Inexperienced users



WARNING:

This product is intended to be operated by qualified personnel only.

Be aware of the following precautions:

- This product is not to be used by anyone with physical or mental disabilities, or anyone without the relevant experience and knowledge, unless they have received instructions on using the equipment and on the associated risks or are supervised by a responsible person.
- Children must be supervised to ensure that they do not play on or around the product.

1.2 Safety terminology and symbols

About safety messages

It is extremely important that you read, understand, and follow the safety messages and regulations carefully before handling the product. They are published to help prevent these hazards:

- Personal accidents and health problems
- Damage to the product and its surroundings
- Product malfunction

Hazard levels

Hazard level	Indication
DANGER:	A hazardous situation which, if not avoided, will result in death or serious injury
WARNING:	A hazardous situation which, if not avoided, could result in death or serious injury
CAUTION:	A hazardous situation which, if not avoided, could result in minor or moderate injury
NOTICE:	Notices are used when there is a risk of equipment damage or decreased performance, but not personal injury.

Special symbols

Some hazard categories have specific symbols, as shown in the following table.

Electrical hazard	Magnetic fields hazard
Electrical Hazard:	CAUTION:

Hot surface hazard

Hot surface hazards are indicated by a specific symbol that replaces the typical hazard level symbols:



CAUTION:

Description of user and installer symbols

	Specific information for personnel in charge of installing the product in the system (plumbing and/or electrical aspects) or in charge of maintenance.
	Specific information for users of the product.

Instructions

The instructions and warnings that are provided in this manual concern the standard version, as descri-

bed in the sales document. Special version pumps may be supplied with supplementary instruction leaflets. Refer to sales contract for any modifications or special version characteristics. For instructions, situations, or events that is not considered in this manual or the sales document, contact the nearest Service Center.

1.3 Disposal of packaging and product

Observe the local regulations and codes in force regarding sorted waste disposal.

1.4 Warranty

For information about warranty, see the sales contract.

1.5 Spare parts



WARNING:

Only use original spare parts to replace any worn or faulty components. The use of unsuitable spare parts may cause malfunctions, damage, and injuries as well as void the guarantee.



CAUTION:

Always specify the exact product type and part number when requesting technical information or spare parts from the Sales and Service Department.

For more information about the product's spare parts, visit sales network's website.

1.6 DECLARATIONS OF CONFORMITY

1.6.1 EC Declaration of Conformity (Original)

Xylem Service Italia S.r.l., with headquarters in Via Vittorio Lombardi 14 - 36075 Montecchio Maggiore VI - Italy, hereby declares that the product:

Electric pump unit (see label on first page)

fulfills the relevant provisions of the following European directives:

- Machinery 2006/42/EC (ANNEX II - natural or legal person authorised to compile the technical file: Xylem Service Italia S.r.l.)
- Eco-design 2009/125/EC, Regulation (EC) No 640/2009 & Regulation (EU) No 4/2014 (Motor 3 ~, 50 Hz, PN ≥ 0,75 kW) if IE2 or IE3 marked, Regulation (EU) No 547/2012 (Water pump) if MEI marked

and the following technical standards

- EN ISO 12100:2010, EN 809:1998+A1:2009, EN 60204-1:2006+A1:2009
- EN 60034-30:2009, EN 60034-30-1:2014

Montecchio Maggiore, 11.03.2016

Amedeo Valente
(Director of Engineering and R&D)
rev.01

1.6.2 EU Declaration of Conformity (No EMCD01)

1. Apparatus model/Product:

see label on first page

2. Name and address of the manufacturer:

Xylem Service Italia S.r.l.

Via Vittorio Lombardi 14

36075 Montecchio Maggiore VI

Italy

3. This declaration of conformity is issued under the sole responsibility of the manufacturer.

4. Object of the declaration:

electric pump

5. The object of the declaration described above is in conformity with the relevant Union harmonisation legislation:

Directive 2014/30/EU of 26 February 2014 (electromagnetic compatibility)

6. References to the relevant harmonised standards used or references to the other technical specifications, in relation to which conformity is declared:

EN 61000-6-1:2007, EN 61000-6-3:2007 +A1:2011

7. Notified body: -

8. Additional information: -

Signed for and on behalf of:

Xylem Service Italia S.r.l.

Montecchio Maggiore, 11.03.2016

Amedeo Valente

(Director of Engineering and R&D)

rev.01

Lowara is a trademark of Xylem Inc. or one of its subsidiaries.



2 Transportation and Storage

2.1 Inspect the delivery

1. Check the outside of the package for evident signs of damage.
2. Notify our distributor within eight days of the delivery date, if the product bears visible signs of damage.

Unpack the unit

1. Follow applicable step:
 - If the unit is packed in a carton, then remove the staples and open the carton.
 - If the unit is packed in a wooden crate, then open the cover while paying attention to the nails and straps.
2. Remove the securing screws or the straps from the wooden base.

2.1.1 Inspect the unit

1. Remove packing materials from the product. Dispose of all packing materials in accordance with local regulations.
2. Inspect the product to determine if any parts have been damaged or are missing.

3. If applicable, unfasten the product by removing any screws, bolts, or straps.
For your personal safety, be careful when you handle nails and straps.
4. Contact the local sales representative if there is any issue.

2.2 Transportation guidelines

Precautions



WARNING:

- Observe accident prevention regulations in force.
- Crush hazard. The unit and the components can be heavy. Use proper lifting methods and wear steel-toed shoes at all times.

Check the gross weight that is indicated on the package in order to select proper lifting equipment.

Position and fastening

The pump or pump unit can be transported only horizontally. Make sure that the pump or pump unit is securely fastened during transportation and cannot roll or fall over.



WARNING:

Do not use eyebolts screwed on the motor for handling the whole electric pump unit.

Do not use the shaft end of the pump or of the motor to handle the pump, the motor or the unit.

- Eyebolts screwed onto the motor may be exclusively used to handle the individual motor or, in case of a not balanced distribution of weights, to partially lift the unit vertically starting from a horizontal displacement.

Pump unit must always be fixed and transported as shown in *Figure 5* (page 333), and the pump without motor must be fixed and transported as shown in *Figure 6* (page 333).

In this last case remove coupling guards from drive lantern and cross the lifting ropes/bands.

2.3 Storage guidelines

Storage location

The product must be stored in a covered and dry location free from heat, dirt, and vibrations.

NOTICE:

Protect the product against humidity, heat sources, and mechanical damage.

NOTICE:

Do not place heavy weights on the packed product.

2.3.1 Long-term storage

If the unit is stored for more than 6 months, these requirements apply:

- Store in a covered and dry location.
- Store the unit free from heat, dirt, and vibrations.
- Rotate the shaft by hand several times at least every three months.

For questions about possible long-term storage treatment services, please contact your local sales and service representative.

Ambient temperature

The product must be stored at an ambient temperature from -5°C to +40°C (23°F to 104°F).



3 Product Description

3.1 Pump design

The pump is a horizontal pump with volute casing close coupled to standard electric motors.

The pump can be used for handling:

- Cold or warm water
- Clean liquids
- Liquids which are not chemically and mechanically aggressive to the pump materials.

Intended use

The pump is suitable for:

- Water supply and water treatment
- Cooling and hot water supply in industries and building services
- Irrigation and sprinkler systems
- Heating systems

Additional uses for optional material:

- District heating
- General industry

Improper use



WARNING:

Improper use of the pump may create dangerous conditions and cause personal injury and damage to property.

An improper use of the product leads to the loss of the warranty.

Examples of improper use:

- Liquids not compatible with the pump construction materials
- Hazardous liquids (such as toxic, explosive, flammable, or corrosive liquids)
- Potable liquids other than water (for example, wine or milk)

Examples of improper installation:

- Hazardous locations (such as explosive, or corrosive atmospheres).
- Location where the air temperature is very high or there is poor ventilation.
- Outdoor installations where there is no protection against rain or freezing temperatures.



DANGER:

Do not use this pump to handle flammable and/or explosive liquids.

NOTICE:

- Do not use this pump to handle liquids containing abrasive, solid, or fibrous substances.
- Do not use the pump for flow rates beyond the specified flow rates on the data plate.

Special applications

Contact the local sales and service representative in the following cases:

- If the density and/or viscosity value of the pumped liquid exceeds the value of water, such as water with glycol; as it may require a more powerful motor.
- If the pumped liquid is chemically treated (for example softened, deionized, demineralized etc.).
- Any situation that is different from the ones that is described and relate to the nature of the liquid.

3.2 Pump denomination

See [Figure 2](#) (page 318) for an explanation of the denomination code for the pump and one example.

3.3 Nameplate

The nameplate is a metal label that is located on the pump body or on drive lantern depending on model. The name plate lists key product specifications. For more information, see [Figure 1](#) (page 313).

The nameplate provides information regarding the impeller and casing material, the mechanical seal and their materials. For more information, see [Figure 3](#) (page 328).

IMQ or TUV or IRAM or other marks (for electric pump only)

Unless otherwise specified, for products with a mark of electrical-related safety approval, the approval refers exclusively to the electrical pump.

3.4 Pump description

- Connection dimensions according EN 733 (models 32-125...-200; 40-125...-250; 50-125...-250; 65-125...-315; 80-160...-315; 100-200...-400; 125-250...-400; 150-315...-400).
- Volute casing pump with back pull out power end.

3.5 Material

The metallic parts of the pump that come in contact with water are made of the following:

Material code	Material casting / impeller	Standard/Optional
CC	Cast iron/Cast iron	Standard
CB	Cast iron/Bronze	Standard
CS	Cast iron/Stainless steel	Standard
CN	Cast iron/Stainless steel	Standard
DC	Ductil iron / Cast iron	Standard
DB	Ductil iron / Bronze	Standard

Material code	Material casting / impeller	Standard/Optional
DN	Ductil iron / Stainless steel	Standard
NN	Stainless steel / Stainless steel	Standard
RR	Duplex/Duplex	Opzional

3.6 Mechanical seal

Unbalanced single mechanical seal acc. EN 12756, version K.

3.7 Application limits

Maximum working pressure

[Figure 4](#) (page 332) shows the maximum working pressure depending on the pump model and the temperature of the pumped liquid.

$$P_{1\max} + P_{\max} \leq PN$$

$P_{1\max}$ Maximum inlet pressure

P_{\max} Maximum pressure generated by the pump

PN Maximum operating pressure

Liquid temperature intervals

[Figure 4](#) (page 332) shows the working temperature ranges.

For special requirements, contact the Sales and Service Department.

Maximum number of starts per hour

kW	0.25	4.00	11	18.5	30	45	90
-	-	-	-	-	-	-	-
3.00	7.50	15	22	37	75	160	
Starts per hour	60	40	30	24	16	8	4

Noise level

For the sound pressure levels of pump equipped with standard supplied motor, see [Table 7](#) (page 333).

4 Installation



Precautions



WARNING:

- Observe accident prevention regulations in force.
- Use suitable equipment and protection.
- Always refer to the local and/or national regulations, legislation, and codes in force regarding the selection of the installation site, plumbing, and power connections.



Electrical Hazard:

- Make sure that all connections are performed by qualified installation

technicians and in compliance with the regulations in force.

- Before starting work on the unit, make sure that the unit and the control panel are isolated from the power supply and cannot be energized. This applies to the control circuit as well.

Grounding (earthing)



Electrical Hazard:

- Always connect the external protection conductor to ground (earth) terminal before making other electrical connections.
- You must ground (earth) all electrical equipment. This applies to the pump equipment, the driver, and any monitoring equipment. Test the ground (earth) lead to verify that it is connected correctly.
- If the motor cable is jerked loose by mistake, the ground (earth) conductor should be the last conductor to come loose from its terminal. Make sure that the ground (earth) conductor is longer than the phase conductors. This applies to both ends of the motor cable.
- Add additional protection against lethal shock. Install a high-sensitivity differential switch (30 mA) [residual current device RCD].

4.1 Facility requirements

4.1.1 Pump location



DANGER:

Do not use this unit in environments that may contain flammable/explosive or chemically aggressive gases or powders.

Guidelines

Observe the following guidelines regarding the location of the product:

- Make sure that no obstructions hinder the normal flow of the cooling air that is delivered by the motor fan.
- Make sure that the installation area is protected from any fluid leaks, or flooding.
- If possible, place the pump slightly higher than the floor level.
- The ambient temperature must be between 0°C (+32°F) and +40°C (+104°F).
- The relative humidity of the ambient air must be less than 50% at +40°C (+104°F).
- Contact the Sales and Service Department if:
 - The relative air humidity conditions exceed the guidelines.
 - The room temperature exceeds +40°C (+104°F).
 - The unit is located more than 1000 m (3000 ft) above the sea level. The motor performance may need to be de-rated or replaced with a more powerful motor.

For information about which value to de-rate the motor with, see [Table 8](#) (page 337).

Pump positions and clearance

Provide adequate light and clearance around the pump. Make sure that it is easily accessible for installation and maintenance operations.

Installation above liquid source (suction lift)

The theoretical maximum suction height of any pump is 10.33m. In practice, the following affect the suction capacity of the pump:

- Temperature of the liquid
- Elevation above the sea level (in an open system)
- System pressure (in a closed system)
- Resistance of the pipes
- Own intrinsic flow resistance of the pump
- Height differences

The following equation is used to calculate the maximum height above the liquid level which the pump can be installed:

$$(p_b * 10.2 - Z) \geq NPSH + H_f + H_v + 0.5$$

p_b Barometric pressure in bar (in closed system is system pressure)

NPSH Value in meter of the pump intrinsic flow resistance

H_f Total losses in meters caused by passage of liquid in the suction pipe of the pump

H_v Steam pressure in meters that correspond to the temperature of the liquid T °C

0.5 Recommended safety margin (m)

Z Maximum height at which the pump can be installed (m)

$(p_b * 10.2 - Z)$ must always be a positive number.

For more information, see [Figure 9](#) (page 337).

NOTICE:

Do not exceed the pumps suction capacity as this could cause cavitation and damage the pump.

4.1.2 Piping requirements

Precautions



WARNING:

- Use pipes suited to the maximum working pressure of the pump. Failure to do so can cause the system to rupture, with the risk of injury.
- Make sure that all connections are performed by qualified installation technicians and in compliance with the regulations in force.

NOTICE:

Observe all regulations issued by authorities having jurisdiction and by companies managing the public water supplies if the pump is connected to a public water system. If required, install appropriate back-flow-prevention device on the suction side.

Piping checklist

Check that the following requirements are met:

- All piping is independently supported, piping must not place a burden on the unit.
- Flexible pipes or unions are used, in order to avoid transmission of pump vibrations to the pipes and vice versa.
- Use wide bends, avoid using elbows which cause excessive flow resistance.
- The suction piping is perfectly sealed and airtight.
- If the pump is used in an open circuit, then the diameter of the suction pipe is suited to the installation conditions. The suction pipe must not be smaller than the diameter of the suction port.
- If the suction piping must be larger than the suction side of the pump, then an eccentric pipe reducer is installed.
- If the pump is placed above liquid level, a foot valve is installed at the end of the suction piping.
- The foot valve is fully immersed into the liquid so that air cannot enter through the suction vortex, when the liquid is at the minimum level and the pump is installed above the liquid source.
- Appropriately sized on-off valves are installed on the suction piping and on the delivery piping (downstream to the check valve) for regulation of the pump capacity, for pump inspection, and for maintenance.
- Appropriately sized on-off valve is installed on the delivery piping (downstream to the check valve) for regulation of the pump capacity, for pump inspection, and for maintenance.
- In order to prevent back flow into the pump when pump is turned off a check valve is installed on the delivery piping.

WARNING:

Do not use the on-off valve on the discharge side in the closed position in order to throttle the pump for more than a few seconds. If the pump must operate with the discharge side closed for more than a few seconds, a bypass circuit must be installed to prevent overheating of the liquid inside the pump.

For illustrations that show the piping requirements, see [Figure 10](#) (page 338) and [Figure 11](#) (page 338).

4.2 Electrical requirements

- The local regulations in force overrule these specified requirements.
- In the case of fire fighting systems (hydrants and/or sprinklers), check the local regulations in force.

Electrical connection checklist

Check that the following requirements are met:

- The electrical leads are protected from high temperature, vibrations, and collisions.
- The power supply line is provided with:
 - A short-circuit protection device
 - A mains isolator switch with a contact gap of at least 3 mm

The electrical control panel checklist

NOTICE:

The control panel must match the ratings of the electric pump. Improper combinations could fail to guarantee the protection of the motor.

Check that the following requirements are met:

- The control panel must protect the motor against overload and short-circuit.
- Install the correct overload protection (thermal relay or motor protector).

Pump Type	Protection
Single phase standard electric pump $\leq 2.2 \text{ kW}$	<ul style="list-style-type: none"> – Built-in automatic reset thermal-amperelectric protection (motor protector) – Short circuit protection (must be supplied by the installer)³
Three phase electric pump ⁴	<ul style="list-style-type: none"> – Thermal protection (must be supplied by the installer) – Short circuit protection (must be supplied by the installer)

- The control panel must be equipped with a dry-running protection system to which a pressure switch, float switch, probes, or other suitable device is connected.
- The following devices are recommended for use on the suction side of the pump:
 - When the liquid is pumped from a water system, use a pressure switch.
 - When the liquid is pumped from a storage tank or reservoir, use a float switch or probes.
- When thermal relays are used, relays that are sensitive to phase failure are recommended.

The motor checklist

**WARNING:**

- Read the operating instructions in order to ensure whether a protection device is provided if another motor other than the standard is used.
- If the motor is equipped with automatic thermal protectors, be aware of the risk of unexpected starts in connection to overload. Do not use such motors for fire-fighting applications.

NOTICE:

- Only use dynamically balanced motors with a half-sized key in the shaft extension (IEC 60034-14) and with normal vibration rate (N).
- The mains voltage and frequency must agree with the specifications on the data plate.

In general, motors can operate under the following mains voltage tolerances:

³ fuses aM (motor starting), or magneto-thermal switch with curve C and $I_{cn} \geq 4,5 \text{ kA}$ or other equivalent device.

⁴ Overload thermal relay with trip class 10A + fuses aM (motor starting) or motor protection magneto-thermal switch with starting class 10A.

Frequency Hz	Phase ~	UN [V] ± %
50	1	220 – 240 ± 6
	3	230/400 ± 10
		400/690 ± 10
60	1	220 – 230 ± 6
	3	220/380 ± 5
		380/660 ± 10

Use cable according to rules with 3 leads (2+earth/ground) for single phase versions and with 4 leads (3+earth/ground) for three phase version.

4.3 Install the pump



4.3.1 Mechanical installation

Check the following before installation:

- Use a concrete of compressive strength class C12/15 which meets the requirements of exposure class XC1 to EN 206-1.
- The mounting surface must have set and must be completely horizontal and even.
- Observe the weights indicated.

Install the pump set

For examples of horizontal and vertical installations, see *Figure 12* (page 340).

Check that the foundation has been prepared in accordance with the dimensions given in the outline drawing/general arrangement drawing.

Type	Motor Size	Number of Poles	Type of Fastening
A	Up to 132	2– and 4-pole	Mount on ground using the volatile casing feet.
B	From 160 to 200	2-pole	Mount on ground using the pump and motor feet. Shims are required under the pump and motor feet.
	From 160 to 280	4-pole	
C	250	2-pole	Mount on ground using the pump and motor feet. Shims are required under the pump and motor feet.
D	Up to 132	2– and 4-pole	Mount on ground using the volatile casing feet.

Type	Motor Size	Number of Poles	Type of Fastening
E	From 160 to 280	2– and 4-pole	Mount on ground using the motor feet

1. Position the pump set on the foundation and level it with the help of a spirit level that is placed on the discharge port.

The permissible deviation is 0.2 mm/m.

2. Remove the plugs covering the ports.
3. Align the pump and piping flanges on both sides of the pump. Check the alignment of the bolts.
4. Fasten the piping with bolts to the pump. Do not force the piping into place.
5. Use shims for height compensation, if necessary.
6. Tighten the foundation bolts evenly and firmly.

Note:

- If the transmission of vibrations can be disturbing, provide vibration-damping supports between the pump and the foundation.

4.3.2 Piping checklist

Check that the following are adhered to:

- The suction lift line has been laid with a rising slope, at positive suction head line with a downward slope towards the pump.
- The nominal diameters of the pipelines are at least equal to the nominal diameters of the pump ports.
- The pipelines have been anchored in close proximity to the pump and connected without transmitting any stresses or strains.



CAUTION:

Welding beads, scale and other impurities in the piping damage the pump.

- Free the piping from any impurities.
- If necessary, install a filter.

4.3.3 Electrical installation

1. Remove the screws of the terminal box cover.
2. Connect and fasten the power cables according to the applicable wiring diagram.

For wiring diagrams, see *Figure 13* (page 341). The diagrams are also available on the back of the terminal box cover.

- a) Connect the ground (earth) lead.
Make sure that the ground (earth) lead is longer than the phase leads.
- b) Connect the phase leads.
3. Mount the terminal box cover.

NOTICE:

Tighten the cable glands carefully to ensure protection against cable slipping and humidity entering the terminal box.

4. If the motor is not equipped with automatic reset thermal protection, then adjust the overload protection according to the list below.
 - If the motor is used with full load, then set the value to the nominal current value of electric pump (data plate)
 - If the motor is used with partial load, then set the value to the operating current (for example measured with a current pincer).
 - If the pump has a star-delta starting system, then adjust the thermal relay to 58% of the nominal current or operating current (only for three-phase motors).



5 Commissioning, Startup, Operation, and Shutdown

Precautions



WARNING:

- Make sure that the drained liquid does not cause damage or injuries.
- The motor protectors can cause the motor to restart unexpectedly. This could result in serious injury.
- Never operate the pump without the coupling guard correctly installed.



CAUTION:

- The outer surfaces of the pump and motor can exceed 40°C (104°F) during operation. Do not touch with any part of the body without protective gear.
- Do not put any combustible material near the pump.

NOTICE:

- Never operate the pump below the minimum rated flow, when dry, or without prime.
- Never operate the pump with the delivery ON-OFF valve closed for longer than a few seconds.
- Never operate the pump with the suction ON-OFF valve closed.
- Do not expose an idle pump to freezing conditions. Drain all liquid that is inside the pump. Failure to do so can cause liquid to freeze and damage the pump.
- The sum of the pressure on the suction side (mains, gravity tank) and the maximum pressure that is delivered by the pump must not exceed the maximum working pressure that is allowed (nominal pressure PN) for the pump.
- Do not use the pump if cavitation occurs. Cavitation can damage the internal components.

5.1 Fill the pump

For information about additional pump connections, see [Figure 14](#) (page 341).

Installations with liquid level above the pump (suction head)

For an illustration that shows where pump plugs are, see [Figure 15](#) (page 343).

1. Close the on-off valve located downstream from the pump.
2. Remove the fill (3) or gauge plug (1) and open the on/off valve upstream until the water flows out of the hole.
- a) Close the fill (3) or gauge plug (1).

Installations with liquid level below the pump (suction lift)

For an illustration that shows where pump plugs are, see [Figure 16](#) (page 345).

1. All pipe system empty:
 - a) Open the on-off valve located upstream from the pump.
 - b) Remove the fill plug (3) and the gauge plug (1). Use a funnel to fill the pump through the fill hole until the water flows out of this hole.
 - c) Tighten the fill plug (3) and the gauge plug (1).
2. Filled discharge pipe system:
 - a) Open the on-off valve located upstream from the pump and open the on-off valve downstream.
 - b) Remove the gauge plug (1) until water flows out of this hole.
 - c) Tighten the gauge plug (1).

5.2 Check the rotation direction (three-phase motor)

Follow this procedure before start-up.

1. Locate the arrows on the adaptor or the motor fan cover to determine the correct rotation direction.
2. Start the motor.
3. Quickly check the direction of rotation through the coupling guard or through the motor fan cover.
4. Stop the motor.
5. If the rotation direction is incorrect, then do as follows:
 - a) Disconnect the power supply.
 - b) In the terminal board of the motor or in the electric control panel, exchange the position of two of the three wires of the supply cable.

For the wiring diagrams, see [Figure 13](#) (page 341).
- c) Check the direction of rotation again.

5.3 Start the pump

The responsibility for checking the correct flow and the temperature of the pumped liquid rests with the installer or owner.

Before starting the pump, make sure that:

- The pump is correctly connected to the power supply.
- The pump is correctly filled according to instructions in [Fill the pump](#) (chapter 5).
- The on-off valve located downstream from the pump is closed.

- Start the motor.
 - Gradually open the on-off valve on the discharge side of the pump.
- At the expected operating conditions, the pump must run smoothly and quietly. If not, refer to **Troubleshooting** (page 21).

6 Maintenance



Precautions



Electrical Hazard:

Disconnect and lock out electrical power before installing or servicing the unit.



WARNING:

- Maintenance and service must be performed by skilled and qualified personnel only.
- Observe accident prevention regulations in force.
- Use suitable equipment and protection.
- Make sure that the drained liquid does not cause damage or injuries.

6.1 Service

If the user wishes to schedule regular maintenance deadlines, they are dependent on the type of pumped liquid and on the operating conditions of the pump.

Contact the local sales and service representative for any requests or information regarding routine maintenance or service.

Extraordinary maintenance may be necessary to clean the liquid end and/or replace worn parts.

Motor bearings

After approximately five years, the grease in the motor bearings is so aged that a replacement of the bearings is recommended. The bearings must be replaced after 25000 operating hours or according to the motor supplier maintenance instructions, whichever is shorter.

Motor with regreasable bearings

Follow motor supplier maintenance instructions.

6.2 Inspection checklist

Check for leakage of the mechanical seal. Replace the mechanical seal if leakage is found.

6.3 Disassemble and replace the pump parts

For more information about spare parts and assembly and disassembly of the pump, contact the local sales and service representative.

7 Troubleshooting



7.1 Troubleshooting for users

The main switch is on, but the electric pump does not start.

Cause	Remedy
The thermal protector incorporated in the pump (if any) has tripped.	Wait until the pump has cooled down. The thermal protector will automatically reset.
The protective device against dry running has tripped.	Check the liquid level in the tank, or the mains pressure.

The electric pump starts, but the thermal protection trips a varying time after.

Cause	Remedy
There are foreign objects (solids or fibrous substances) inside the pump which have jammed the impeller.	Contact the Sales and Service Department.
The pump is overloaded because it is pumping liquid that is too dense and viscous.	Check the actual power requirements based on the characteristics of the pumped liquid and then contact the Sales and Service Department.

The pump runs but delivers too little or no liquid.

Cause	Remedy
The pump is clogged.	Contact the Sales and Service Department.

The troubleshooting instructions in the tables below are for installers only.

7.2 The main switch is on, but the electric pump does not start



Cause	Remedy
There is no power supply.	<ul style="list-style-type: none"> Restore the power supply. Make sure all electrical connections to the power supply are intact.
The thermal protector incorporated in the pump (if any) has tripped.	Wait until the pump has cooled down. The thermal protector will automatically reset.
The thermal relay or motor protector in the electric control panel has tripped.	Reset the thermal protection.
The protective device against dry running has tripped.	Check the: <ul style="list-style-type: none"> liquid level in the tank, or the mains pressure protective device and its connecting cables
The fuses for the pump or auxiliary circuits are blown.	Replace the fuses.

7.3 The electric pump starts, but the thermal protector trips or the fuses blow immediately after



Cause	Remedy
The power supply cable is damaged.	Check the cable and replace as necessary.
The thermal protection or fuses are not suited for the motor current.	Check the components and replace as necessary.
The electric motor is short circuit.	Check the components and replace as necessary.
The motor overloads.	Check the operating conditions of the pump and reset the protection.

7.4 The electric pump starts, but the thermal protector trips or the fuses blow a short time after



Cause	Remedy
The electrical panel is situated in an excessively heated area or is exposed to direct sunlight.	Protect the electrical panel from heat source and direct sunlight.
The power supply voltage is not within the working limits of the motor.	Check the operating conditions of the motor.
A power phase is missing.	Check the <ul style="list-style-type: none"> • power supply • electrical connection

7.5 The electric pump starts, but the thermal protector trips a varying time after



Cause	Remedy
There are foreign objects (solids or fibrous substances) inside the pump which have jammed the impeller.	Contact the local sales and service representative.
The pumps delivery rate is higher than the limits specified on the data plate.	Partially close the on-off valve down stream until the delivery rate is equal or less than the limits specified on the data plate.
The pump is overloaded because it is pumping liquid that is too dense and viscous.	Check the actual power requirements based on the characteristics of the pumped liquid and replace the motor accordingly.
The motor bearings are worn.	Contact the local sales and service representative.

7.6 The electric pump starts, but the system's general protection is activated



Cause	Remedy
A short circuit in the electrical system.	Check the electrical system.

7.7 The electric pump starts, but the system's residual current device (RCD) is activated



Cause	Remedy
There is an ground (earth) leakage.	Check the insulation of the electrical system components.

7.8 The pump runs but delivers too little or no liquid



Cause	Remedy
There is air inside the pump or the piping.	<ul style="list-style-type: none"> • Bleed the air
The pump is not correctly primed.	Stop the pump and repeat the prime procedure. If the problem continues: <ul style="list-style-type: none"> • Check that the mechanical seal is not leaking. • Check the suction pipe for perfect tightness. • Replace any valves that are leaking.
The throttling on the delivery side is too extensive.	Open the valve.
Valves are locked in closed or partially closed position.	Disassemble and clean the valves.
The pump is clogged.	Contact the local sales and service representative.
The piping is clogged.	Check and clean the pipes.
The rotation direction of the impeller is wrong .	Change the position of two of the phases on the terminal board of the motor or in the electric control panel.
The suction lift is too high or the flow resistance in the suction pipes is too great.	Check the operating conditions of the pump. If necessary, do the following: <ul style="list-style-type: none"> • Decrease the suction lift • Increase the diameter of the suction pipe

7.9 The electric pump stops, and then rotates in the wrong direction



Cause	Remedy
There is a leakage in one or both of the following components: <ul style="list-style-type: none">• The suction pipe• The foot valve or the check valve	Repair or replace the faulty component.
There is air in the suction pipe.	Bleed the air.

7.10 The pump starts up too frequently



Cause	Remedy
There is a leakage in one or both of the following components: <ul style="list-style-type: none">• The suction pipe• The foot valve or the check valve	Repair or replace the faulty component.
There is a ruptured membrane or no air pre-charge in the pressure tank.	See the relevant instructions in the pressure tank manual.

7.11 The pump vibrates and generates too much noise



Cause	Remedy
Pump cavitation	Reduce the required flow rate by partially closing the on-off valve downstream from the pump. If the problem persists check the operating conditions of the pump (for example height difference, flow resistance, liquid temperature).
The motor bearings are worn.	Contact the local sales and service representative.
There are foreign objects inside the pump.	Contact the local sales and service representative.
Impeller rubs on the wear ring	Contact the local sales and service representative.

For any other situation, refer to the local sales and service representative.



Xylem Service Italia S.r.l.
Via Vittorio Lombardi 14
Montecchio Maggiore VI
36075
Italy
Contact your supplier or local
sales and service
representative

© 2016 Xylem Inc

FCSE Inverter Manual

5.1.2 Mechanical Dimensions

A2	A3	A4	A5	B1	B2	B3	B4	C1	C2	C3	C4
IP20/21	IP20/21	IP55/66	IP55/66	IP21/55/66	IP20	IP20	IP20	IP21/55/66	IP21/55/66	IP20	IP20
130BA810.10	130BA811.10	130BA812.10	130BA813.10	130BA814.10	130BA815.10	130BA816.10	130BA817.10	130BA818.10	130BA819.10	130BA820.10	130BA821.10
Accessory bags containing necessary brackets, screws and connectors are included with the adjustable frequency drives upon delivery.											
* A5 in IP55/66 only											
Top and bottom mounting holes (B4, C3 and C4 only)											

Table 5.1 Mechanical Dimensions

Enclosure Type	A2	A3	A4	A5	B1	B2	B3	B4	C1	C2	C3	C4
Rated Power (hp [kW])	200–240 V [1.1–2.2]	1.5–3 [3–3.7]	4–5 [1.1–2.2]	1.5–3 [1.1–3.7]	7.5–15 [5.5–11]	20 [15]	7.5–15 [5.5–11]	11–25 [15–18]	25–40 [18–30]	50–60 [37–45]	30–40 [22–30]	50–60 [37–45]
380–480/ 500 V	1.5–5 [1.1–4.0]	7.5–10 [5.5–7.5]	1.5–5 [1.1–4]	1.5–10 [1.1–7.5]	15–25 [11–18]	30–40 [22–30]	15–25 [11–18]	30–50 [22–37]	50–75 [37–55]	100–125 [75–90]	60–75 [45–55]	100–125 [75–90]
525–600 V	1.5–10 [1.1–7.5]	1.5–10 [1.1–7.5]	1.5–10 [1.1–7.5]	1.5–10 [1.1–7.5]	15–25 [11–18]	30–40 [22–30]	15–25 [11–18]	30–50 [22–37]	50–75 [37–55]	100–125 [75–90]	60–75 [45–55]	100–125 [75–90]
525–690 V	20 Chassis Type 1	21 Chassis Type 1	20 Chassis Type 1	21 Chassis Type 12	55/66 Type 12	21/55/66 Type 12	21/55/66 Type 1/ Type 12	20 Chassis Type 1/ Type 12	15–40 [11–30]	50–125 [37–90]		
IP NEMA												
Height (in [mm])												
Height of backplate A	10.60 [268]	14.76 [375]	10.6 [268]	14.76 [375]	15.35 [390]	16.54 [420]	18.90 [480]	25.59 [650]	15.71 [399]	20.47 [520]	26.77 [680]	30.32 [770]
Height with decoupling plate for serial communication bus cables	14.72 [374]	14.72 [374]	—	—	—	—	—	—	16.54 [420]	23.43 [595]		24.8 [630]
Distance between mounting holes a	10.12 [257]	13.80 [350]	10.12 [257]	13.80 [350]	15.80 [401]	15.83 [402]	17.87 [454]	24.57 [624]	14.96 [380]	19.50 [495]	25.51 [648]	29.1 [739]
Width (in [mm])												
Width of backplate B	3.54 [90]	3.54 [90]	5.12 [130]	5.12 [130]	7.87 [200]	9.53 [242]	9.53 [242]	6.5 [165]	9.06 [230]	12.13 [308]	14.57 [370]	12.13 [308]
Width of backplate with one C option	B [130]	5.12 [130]	6.69 [170]	6.69 [170]	9.53 [242]	9.53 [242]	9.53 [242]	8.07 [205]	9.06 [230]	12.13 [308]	14.57 [370]	12.13 [308]
Width of backplate with two C options	B [150]	5.91 [150]	7.48 [190]	7.48 [190]	9.53 [242]	9.53 [242]	9.53 [242]	8.86 [225]	9.06 [230]	12.13 [308]	14.57 [370]	12.13 [308]
Distance between mounting holes b	2.76 [70]	2.76 [70]	4.33 [110]	4.33 [110]	6.73 [171]	8.47 [210]	8.27 [210]	5.51 [140]	7.87 [200]	10.71 [272]	13.15 [334]	10.63 [270]
Depth (in [mm])												
Depth without option A/B	C [205]	8.07 [207]	18.15 [205]	8.07 [207]	18.15 [175]	6.89 [200]	7.87 [200]	10.24 [260]	9.8 [249]	9.53 [310]	12.21 [335]	12.99 [333]
With option A/B	C [220]	8.66 [222]	8.74 [220]	8.69 [175]	8.74 [222]	6.89 [200]	7.87 [200]	10.24 [260]	10.32 [262]	9.53 [310]	12.21 [335]	12.99 [333]

Enclosure Type	A2	A3	A4	A5	B1	B2	B3	B4	C1	C2	C3	C4
Rated Power (hp [kW])	200-240 V [1.1-2.2]	1.5-3 [3-3.7]	4-5 [1.1-2.2]	1.5-3 [1.1-3.7]	1.5-5 [5.5-11]	7.5-15 [15]	20 [5.5-11]	7.5-15 [5.5-11]	11-25 [18-30]	25-40 [37-45]	50-60 [22-30]	30-40 [37-45]
380-480/ 500 V	1.5-5 [1.1-4.0]	7.5-10 [5.5-7.5]	1.5-5 [1.1-4]	1.5-10 [1.1-7.5]	15-25 [11-18]	30-40 [22-30]	15-25 [11-18]	30-50 [22-37]	50-75 [37-55]	100-125 [75-90]	60-75 [45-55]	100-125 [75-90]
525-600 V		1.5-10 [1.1-7.5]		1.5-10 [1.1-7.5]	15-25 [11-18]	30-40 [22-30]	15-25 [11-18]	30-50 [22-37]	50-75 [37-55]	100-125 [75-90]	60-75 [45-55]	100-125 [75-90]
525-650 V							15-40 [11-30]			50-125 [37-90]		
IP NEMA	20 Chassis Type 1	21 20 Chassis Type 1	21 Type 12	55/66 Type 12	21/ 55/66 Type 1/ Type 12	20 Type 1/ Type 12	20 Chassis Type 12	20 Chassis Type 12	21/55/66 Type 1/ Type 12	20 Chassis Type 12	20 Chassis Type 12	20 Chassis Type 12
Screw holes (in [mm])												
c	0.32 [8.0]	0.32 [8.0]	0.32 [8.0]	0.32 [8.0]	0.33 [8.25]	0.33 [8.25]	0.33 [8.25]	0.47 [12]	0.47 [12]	8 [12.5]	0.49 [12.5]	
d	ø0.43 [ø11]	ø0.43 [ø11]	ø0.43 [ø11]	ø0.43 [ø11]	ø0.47 [ø12]	ø0.47 [ø12]	ø0.47 [ø12]	ø0.75 [ø19]	ø0.75 [ø19]	ø0.75 [ø19]	ø0.75 [ø19]	
e	ø0.22 [ø5.5]	ø0.22 [ø5.5]	ø0.22 [ø5.5]	ø0.22 [ø5.5]	ø0.26 [ø6.5]	ø0.26 [ø6.5]	ø0.26 [ø6.5]	ø0.35 [ø9]	ø0.35 [ø9]	0.27 [8.5]	0.34 [ø9]	0.34 [8.5]
f	0.35 [9]	0.35 [9]	0.26 [6.5]	0.26 [6.5]	0.24 [6]	0.24 [6]	0.24 [6]	0.35 [9]	0.35 [9]	0.31 [7.9]	0.39 [9.8]	0.67 [17]
Max weight lbs [kg]	10.8 [4.9]	11.68 [5.3]	14.6 [6.6]	15.5 [7.0]	21.5 [9.7]	30/31.5 [13.5/14.2]	50.7 [23]	59.53 [27]	26.5 [12]	52 [23.5]	99.21 [65]	143.3 [35]
Front cover tightening torque [Nm]												
Plastic cover (low IP)	Click	Click	-	-	Click	Click	Click	Click	Click	Click	Click	Click
Metal cover (IP55/66)	-	-	1.5	1.5	2.2	2.2	-	-	2.2	2.2	2.0	2.0

Table 5.2 Weight and Dimensions

Datasheets

Fact Sheet

VLT® HVAC Drive FC 102



The VLT® HVAC Drive series is available in a wide power range designed for all HVAC applications. An advanced drive built on HVAC dedication.

The VLT® HVAC Drive is a full-featured, HVAC dedicated drive with built-in intelligence. The VLT® HVAC Drive has a vast number of functions developed to meet the diverse needs of the HVAC business. It is the perfect match for pumps, fans and compressors in modern buildings that are fitted with increasingly sophisticated solutions.

NABERS compliance

Thanks to its built-in energy meter, the VLT® HVAC Drive is certified as fully compliant with National Australian Built Environment Rating System (NABERS)

98%
energy efficiency

Save energy and
money with up to
98% efficiency VLT®
drives.

requirements. This means you save on installation time and cost, because there is no need to install a separate energy meter.

Product range

3 x 200 – 240 V.....	1.1 – 45 kW
3 x 380 – 480 V.....	1.1 – 1000 kW
3 x 525 – 600 V.....	1.1 – 90 kW
3 x 525 – 690 V.....	1.1 – 1400 kW

With 110% overload torque

Available protection ratings

IP 00	355 – 630 kW
IP 20.....	1.1 – 400 kW
IP 21(Type 1)	1.1 – 1400 kW
IP 54 (Type 12).....	75 – 1400 kW
IP 55 (Type 12).....	1.1 – 90 kW
Type 3R.....	1.1 – 400 kW
IP 66 (Type 4X indoor)	1.1 – 90 kW

Optional coating providing extra protection for aggressive environments.

Feature	Benefit
All built-in – low investment	
Modular product concept with a wide range of options	Low initial investment – max. flexibility, later upgrade possible
Dedicated HVAC I/O functionality for temperature sensors etc.	External conversion saved
Decentral I/O control via serial communication	Reduced wiring costs, and external controller I/O saved
Wide range of HVAC protocols for BMS controller connectivity	Less extra gateway solutions needed
4 x auto tuned PID's	No external PID controller needed
Smart Logic Controller	Often makes PLC unnecessary
Real Time Clock	Enables daily and weekly settings
Integrated fan, pump and compressor functionality i.e.	Saves external control and conversion equipment
Fire Override Mode, Dry run Detection, Constant Torque etc.	Protects equipment and saves energy
Back-channel cooling for frame D, E and F frame	Prolonged lifetime of electronics
Save energy – less operation cost	
Automatic Energy Optimizer function, advanced version	Saves 5 – 15% energy
Advanced energy monitoring	Overview on energy consumption
Energy saving functions i.e. flow compensation, sleep mode etc.	Saves energy
Unequalled robustness – maximum uptime	
Robust single enclosure	Maintenance-free
Unique cooling concept with no ambient air flow over electronics	Problem-free operation in harsh environments
Max ambient temp. 50°C without derating (D-frame 45°C)	No external cooling or oversize necessary
User-friendly – save commissioning and operating cost	
Smart Start	Quick and precise start-up
Awarded graphical display, 27 languages	Effective commissioning and operation
USB plug and play connection	Easy to use PC software tools
Global HVAC support organisation	Local service – globally
Built-in DC coils and RFI filters – no EMC concerns	
Integrated DC link harmonic filters	Small power cables. Meets EN 61000-3-12
IntegratedEMC filters	Meets EN 55011 Class B, A1 or A2 and IEC61800-3 Category C1, C2 and C3

Application options

A wide range of integrated HVAC options can be fitted in the drive:

VLT® General Purpose I/O MCB 101

3 digital inputs, 2 digital outputs,
1 analog current output,
2 analog voltage inputs.

VLT® Relay Card MCB 105

Adds 3 relay outputs.

VLT® Extended Relay Card MCB 113

7 digital inputs, 2 analog outputs
4 SPDT relays, Meets NAMUR recommendations, Galvanic isolation capability

VLT® Analog I/O MCB 109

3 Pt1000/Ni1000 inputs, 3 analogue voltage outputs and back-up power for Real-Time Clock.

VLT® 24 V External Supply MCB 107

24 VDC external supply can be connected to supply, control and option cards.

VLT® Sensor Input MCB 114

Sensor input card for motor protection with 2 or 3 PT100 or PT1000 inputs

Brake chopper (IGBT) option

Connected to an external brake resistor, the built-in brake chopper limits the load on the intermediate circuit in situations where the motor acts as a generator.

VLT® BACnet/IP MCA 125

Use this option for fast access to information and reduced overall cost of ownership in building management systems. It enables communication via the BACnet/IP protocol, and BACnet over Ethernet.

Power options

A wide range of external power options are available for VLT® HVAC Drives in critical networks or applications:

■ VLT® Advanced Harmonic Filter

For critical demands on harmonic distortion

Specifications

Mains supply (L1, L2, L3)

Supply voltage	200 – 240 V ±10%
	380 – 480 V ±10%
	525 – 600 V ±10%
	525 – 690 V ±10%
Supply frequency	50/60 Hz
Displacement power factor ($\cos \phi$)	> 0.98 near unity
Switching on input supply L1, L2, L3	1–2 times/min.

Output data (U, V, W)

Output voltage	0–100% of supply voltage
Switching on output	Unlimited
Ramp times	1–3600 s
Output frequency	0–590 Hz
Digital inputs	
Programmable digital inputs	6*
Logic	PNP or NPN
Voltage level	0–24 VDC

* 2 can be used as digital outputs

Pulse inputs

Programmable pulse inputs	2*
Voltage level	0–24 VDC (PNP positive logic)
Pulse input accuracy	(0.1–110 kHz)

* Utilize some of the digital inputs

Analog input

Analog inputs	2
Modes	Voltage or current
Voltage level	0 V to +10 V (scaleable)
Current level	0/4 to 20 mA (scaleable)

Analog output

Programmable analog outputs	1
Current range at analog output	0/4–20 mA

Relay outputs

Programmable relay outputs	2 (240 VAC, 2 A and 400 VAC, 2 A)
----------------------------	-----------------------------------

Fieldbus communication

Standard built-in: FC Protocol N2 Metasys FLN Apogee Modbus RTU BACnet embedded	Optional: VLT® LonWorks MCA 108 VLT® BACnet MCA 109 VLT® BACnet/IP MCA 125 VLT® DeviceNet MCA 104 VLT® PROFIBUS DP MCA 101
--	---

■ VLT® dU/dt Filter

For special demands on motor isolation protection

■ VLT® Sine Wave Filter

HVAC PC software tools

■ VLT® Motion Control Tool MCT 10

Ideal for commissioning and servicing the drive

■ VLT® Energy Box

Comprehensive energy analysis tool. Energy consumption with and without drive can be calculated (drive payback time). Online function for accessing drives energy log.

■ VLT® Motion Control Tool MCT 31

Harmonics calculation tool

High power options

■ IEC Emergency stop with Safety Relay

■ Safety Stop with Safety Relay

■ RFI filter

■ NAMUR terminals

■ RCD

■ IRM

■ Mains shielding

■ Regen terminals

Please see the VLT® High Power Drive Selection Guide for the complete range of options.

Danfoss Drives, Ulsnaes 1, DK-6300 Graasten, Denmark, Tel. +45 74 88 22 22, Fax +45 74 65 25 80, drives.danfoss.com, E-mail: info@danfoss.com

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequent changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

100mm Diameter Glycerine Filled Pressure Gauge

Application

For the measurement of fluid liquids that are not:- highly viscous, high temperature (over 60°C), likely to solidify/crystallize or corrosive to copper or tin alloys.

Also suitable for non-oxidising gases (such as oxygen or acetylene) up to 25 bar maximum.

Glycerine filled gauges are particularly suited to applications where oscillating/surging pressures or vibration are present. The damping effect of the glycerine will steady the pointer making it easier to take a reading against the scale.



Description

Nominal Size
100mm

Accuracy
+/- 1.6% FSD

Scales
PSI Outer (Black) & BAR Inner (Red) - Pressure
"HG Outer (Black) & BAR Inner (Red) - Vacuum
"HG+PSI Outer (Black) & BAR Inner (Red) - Compound

Ranges
-30/0"HG Vacuum to 0/10000 PSI Pressure
-30"HG/+15 PSI to -30"HG/+160 PSI Compound

Mounting Options
Bottom - Direct Mounting (standard)
Bottom - Surface Mounting Rear 3 Hole Flange

Centre Back - Direct Mounting (standard)
Centre Back - Panel Mounting Rear Bracket
Centre Back - Panel Mounting Front 3 Hole Flange

Operating Temperature
Ambient: -20/+60°C
Medium: +60°C maximum

Temperature Effect
Variation in indication caused by temperature
 $\pm 0.04 \times (t_2 - t_1)\%$ of the span
t₁ is the reference ambient temperature in °C
t₂ is the ambient temperature in °C

Ingress Protection
IP 65 as per EN 60529

Case & Crimped Bezel
304 Stainless Steel

Window
Polycarbonate - Crystal clear

Pressure Element
CU Alloy - Sealed Bourdon tube
C-Type <100 BAR
Coiled Type >100 BAR

Joints
Soldered with tin/silver alloy

Movement
High Precision Brass

Process Connection & Block
Brass - 3/8" BSP (parallel) male (standard)
Brass - 1/2" BSP (parallel) male (standard)
Brass - 22mm Hexagon block

Pointer
Aluminium - Black

Dial
Aluminium - White

Filling
FDA Approved food grade glycerine

Special Options
Other scales/ranges
Customer logo on dial
Other process connections
Rubber gauge cover

Sondex UK PHE - Design & Datalist

QuotationNo : 754

Att : Mike West

Ref : 168

Item :1
23 March 2015

V10A34

PHE-Type	S47-IG10-146-TML86-LIQUII		Hot side	Cold side
Flowrate	(kg/s)		23.88	23.88
Inlet temperature	(°C)		24.00	18.00
Outlet temperature	(°C)		19.00	23.00
Pressure drop	(kPa)		50.78	50.77
Heat exchanged	(kW)			500
Thermodynamic properties:			Water	Water
Density	(kg/m³)		997.38	997.60
Specific heat	(kJ/kg*K)		4.19	4.19
Thermal conductivity	(W/m*K)		0.60	0.60
Mean viscosity	(mPa*s)		0.97	0.99
Wall viscosity	(mPa*s)		0.99	0.97
Fouling factors	(m²*K/kW)			
Dimensioning factor	(%)			
Inlet branch			F1	F3
Outlet branch			F4	F2
Design of Frame / Plates:				
Plate arrangement (passes*channel)		1	×	73
Plate arrangement (passes*channel)		1	×	72
Number of plates		146		
Effective heat surface	(m²)	74.04		
Overall K-value Duty/Clean	(W/m²*K)	6754 / 6754		
Plate material		0.4 mm AISI 304		
Gasket material / Max. temp.	(°C)	NITRIL HT SONDER LOCK (S)	/	140
Max. design temperature	(°C)	100.00		
Max. Working/test pressure	(MPa)	1,00 /	ACC. to PED 97/23/EC Art 3.3	
Max. Differential pressure	(MPa)	1.00		
Frame type	/ Paint Specification	IG No 4 / Category C2L		BLUE RAL 5010
Connections HOT side	(F1->F4)	DN 100 Flange rubberlined PN16 HT		
Connections COLD side	(F3->F2)	DN 100 Flange rubberlined PN16 HT		
Liquid volume	(dm³)	167		
Frame length	(mm)	1034	Max. No. of Plates	155
Net weight	(kg)	716		
PRICE EACH	GBP	3623	Approval	
TERMS OF DELIVERY			Ex works Freight and Packing extra @ GBP	
TERMS OF PAYMENT			30 Days	
DELIVERY TIME			30 Days	
VALIDITY OF QUOTATION			Peter Cole	
DESIGNED BY				
Skid Base (2000x800)		92		
Accessories:	GBP	92		

Sondex UK LTD

Tlf : +44 208 573 6276

Swallowfield Way

Hayes, UB3 1AW

Fax : +45 75538968/75505019

Rosemount 2110 Compact Vibrating Fork Liquid Level Switch

- Function virtually unaffected by flow, turbulence, bubbles, foam, vibration, solids content, coating, properties of the liquid, and product variations
- No need for calibration and requires minimum installation procedures
- Polarity insensitive and short circuit protection
- Industry standard plug/socket connection
- No moving parts or crevices means virtually no maintenance
- Electronic, self-checking, and condition monitoring - Heartbeat LED gives status and health information
- Magnetic test point makes functional test easy
- Compact design, small in size and weight
- "Fast Drip" Fork Design gives quicker response time especially with viscous liquids
- Hygienic connections



DIBt

Contents

Reliable Performance...In Challenging Applications	page 2
Rosemount 2110 Compact Vibrating Fork Liquid Level Switch.	page 4
Specifications	page 5
Product Certifications	page 6
Dimensional Drawing	page 7

Reliable Performance...In Challenging Applications

MEASUREMENT PRINCIPLE

The Rosemount 2110 is designed using the principle of a tuning fork. A piezo-electric crystal oscillates the forks at their natural frequency. Changes to this frequency are continuously monitored. The frequency of the vibrating fork sensor changes depending on the medium in which it is immersed. The denser the liquid, the lower the frequency.

When used as a **low level alarm**, the liquid in the tank or pipe drains down past the fork, causing a change of natural frequency that is detected by the electronics and switches the output state.

When the 2110 is used as a **high level alarm**, the liquid rises in the tank or pipe, making contact with the fork which then causes the output state to switch.

KEY FEATURES AND BENEFITS

- Virtually unaffected by turbulence, foam, vibration, solids content, coating, or liquid properties
- Stainless steel housing and plug/socket connection for the fast fit, high volume user
- Compact and lightweight design for side or top mounting
- The industry standard DIN 43650 plug/socket is used for a fast connection. The polarity insensitivity and short circuit protection make electrical hook-up safe and easy
- The 2110 is designed for operation in temperatures from -40 to 302 °F (-40 to 150 °C)
- The 'heartbeat' LED gives status and health information on the 2110
- 'Fast Drip' fork design gives quicker response time, especially with viscous liquids
- Rapid wet-to-dry time for highly responsive switching
- Fork shape is optimized for hand polishing to meet hygienic requirements
- No moving parts or crevices for virtually no maintenance

Threaded Process Connection

Tri-Clamp Process Connection



Compact And Lightweight

'Fast Drip' Forks



Product Data Sheet

00813-0100-4029, Rev DA

November 2010

Rosemount 2110

Fit and Forget

- Once installed, the 2110 is ready to go.
It needs no calibration and requires minimum installation
- The 'heartbeat' LED gives an instant visual indication that the unit is operational
- Functional testing of the instrument and system is easy with a magnetic test point
- You can install, and forget it

Superior Performance


- Functionality is virtually unaffected by flow, turbulence, bubbles, foam, or vibration
- The 'Fast Drip' design allows the liquid to be quickly drawn away from the fork tip, making the 2110 quicker and more responsive in high density or viscous liquid applications
- With a user-selectable time delay feature, the risk of false switching is minimized in turbulent or splashing applications

APPLICATIONS


- Overfill protection
- High and low level alarms
- Leak detection
- Run dry or pump protection
- Pump control or limit detection
- Hygienic applications



Overfill Protection



High And Low Level Alarm

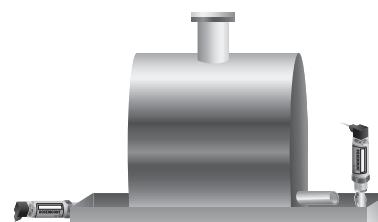

Leak Detection



Pump Protection

Rosemount 2110

Compact Vibrating Fork Liquid Level Switch



2110 Level Switch

Rosemount 2110 capabilities include:

- Rugged stainless steel body and fork, the ideal choice for OEM applications
- Compact design, small and lightweight, perfect for small tank or pipe installations
- Short fork or semi-extended lengths
- Direct load switching or PNP/PLC electronics
- Safe area only

Additional Information

Specifications: page 5
Certifications: page 6

Dimensions: page 7

TABLE 1. 2110 Ordering Information

★The Standard offering represents the most common options. The starred options (★) should be selected for best delivery.
The Expanded offering is subject to additional delivery lead time.

Model	Product Description	
2110	Compact Vibrating Fork Liquid Level Switch	
Electronic Type		
Standard		Standard
0	Direct load switching with plug connection (2 wire) 21 to 264 Vac 50/60Hz, 21 to 264 Vdc	★
1	PNP/PLC low voltage switching with plug connection 18 to 60 Vdc	★
Process Connection Size / Type		
Standard		Standard
0A	3/4-in. BSPT (R) thread	★
1A	1-in. BSPT (R) thread	★
0D	3/4-in. NPT thread	★
2R	2-in. (51 mm) Tri-clamp	★
1B	1-in. BSPP (G) thread	★
1L	1-in. BSPP (G) Semi-extended 4.6 in. (116 mm)	★
Product Certificates		
Standard		Standard
NA	No hazardous locations certifications (safe area use only)	★
U1	DIBt/WHG Overfill protection	★
OPTIONS		
Calibration Data Certificate		
Standard		Standard
Q4	Certificate of functional test	★
Tag Plate		
Standard		Standard
ST	Tag plate SST engraved plate (maximum 16 digits)	★
WT	Tag plate laminated paper (maximum 40 digits)	★
Typical Model Number: 2110 0 2R NA		

TABLE 2. Spare Parts and Accessories

★The Standard offering represents the most common options. The starred options (★) should be selected for best delivery.
The Expanded offering is subject to additional delivery lead time.

Spares and Accessories		
Standard		Standard
02100-1000-0001	Seal for 1-in. BSPP (G1A). Material: Non-asbestos BS7531 grade X carbon fiber with rubber binder	★
02100-1010-0001	Hygienic adaptor boss for 1-in. BSPP model. Material: 316 SST fitting. Fluorocarbon (FPM/FKM) O-ring	★
02100-1020-0001	Hygienic mounting kit for 2-in. (51 mm) Tri-clamp model. Includes vessel fitting, clamp ring, and seal. Material: 316 SST and NBR Nitrile	★
02100-1030-0001	Telescopic test magnet	★

Product Data Sheet

00813-0100-4029, Rev DA

November 2010

Rosemount 2110

Specifications

PHYSICAL

Product

Rosemount 2110 Compact Liquid Level Switch

Measuring principle

Vibrating Fork

Applications

Most liquids including coating liquids, aerated liquids, and slurries

Mechanical

Process Material

316L Stainless Steel (1.4404)

For Tri-Clamp connection, hand polished to better than 0.8 µm. Gasket material for 1 in. BSPP (G1) is Non-asbestos BS7531 Grade X carbon fiber with rubber binder.

Housing Materials

Body: 304 SST with polyester label

LED window:

Flame retardant Polyamide (Pa12) UL94 V2

Plug: Polyamide glass reinforced

Plug seals: Nitrile butadiene rubber

Mounting

- 3/4-in. BSPT (R) or NPT
- 1-in. BSPT (R) or BSPP (G) thread, or
- Hygienic 2-in. (51 mm) Tri-clamp fitting

Dimensional Drawings

See "Dimensional Drawing" on page 7

Ingress of Protection Rating

IP66/67 to EN60529

PERFORMANCE

Hysteresis (water)

±0.039-in. (± 1 mm) nominal.

Switching Point (water)

0.5 in. (13 mm) from fork tip if mounted vertically.

0.5 in. (13 mm) from the fork edge if mounted horizontally.

The switch point varies with different liquid densities.

FUNCTIONAL

Maximum Operating Pressure

(The final rating depends on the process connection)


Threaded Connection

See Figure 1

Hygienic Connection

435 psig (30 barg)


Figure 1. Process Pressure

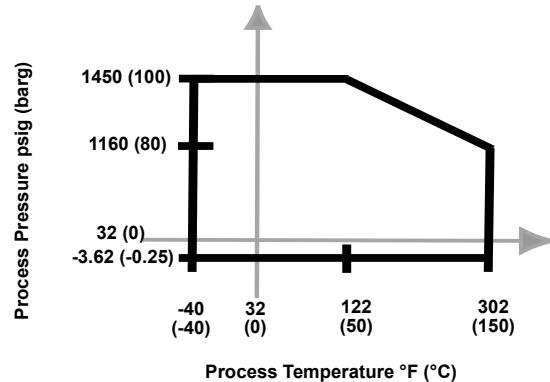

Temperature

See Figure 2 for the maximum and minimum operating temperatures.

Figure 2. Temperature

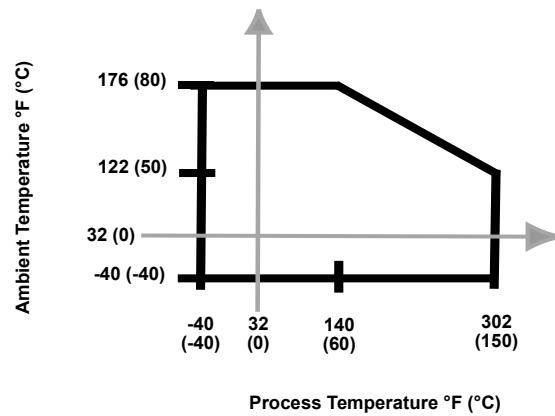

Liquid Density

Minimum 37.5 lb/ft³ (600 kg/m³)

Liquid Viscosity Range

0.2 to 10000 cP (centiPoise)

Solids Content and Coating

Maximum recommended diameter of solid particles in the liquid is 0.2 in. (5 mm).

For coating product, avoid 'bridging' of forks.

Switching Delay

1 second dry-to-wet or wet-to-dry

CIP (Clean In Place) Cleaning

Withstands steam cleaning routines up to 302 °F (150 °C)

Electrical

Switching Mode

User selectable (Dry=on or Wet=on) by selecting plug wiring

Cable Connection

Via 4-way plug provided (DIN43650).

Max. conductor size is 15AWG.

4-position orientation (90/180/270/360 deg.).

Conductor Size

Maximum 0.06 in.² (1,5 mm²)

Cable Gland

PG9 provided. Cable diameter 0.24 to 0.31 in. (6 to 8 mm)

Protection


Polarity insensitive. Over-current, short circuit, and load-missing protection. Surge protection to IEC61326.

Grounding

The 2110 should always be grounded either through the terminals or using the external ground connection provided.


Direct Load Switching (Electronics Type Code 0)

Operating Voltage	21 to 264 Vac (50 to 60 Hz)/dc
Maximum switched load	500 mA
Maximum peak load	5 A for 40 ms max.
Minimum switched load	20 mA continuous
Voltage drop	6.5 V @ 24 Vdc / 5 V @ 240 Vac
Current draw (load off)	<3.0 mA continuous

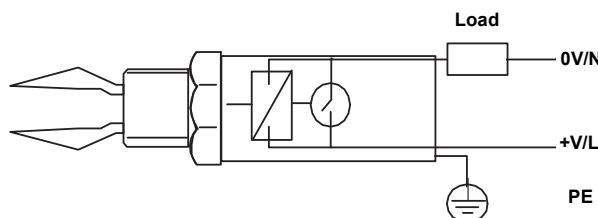

PNP Switching (Electronics Type Code 1)

Operating Voltage	18 to 60 Vdc
Maximum switched load	500 mA
Maximum peak load	5 A for 40 ms max.
Voltage drop	<3 V
Supply Current	3 mA nominal
Output current (load off)	<0.5 mA

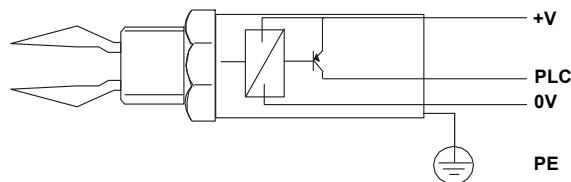

Product Certifications

L.V. Directive

EN61010-1 Pollution degree 2,
Category II (264V max),
Pollution degree 2, Category III (150 V maximum)

Electro Magnetic Compatibility (EMC) Directive

EN61326

Overfill Protection

If required, select Product Certificates code U1 for DIBt/WHG overfill protection.

The approval number is Z-65.11-236.

Canadian Registration Number (CRN)

The CRN is 0F04227.2C for model numbers with a NPT threaded process connection selected.


Product Data Sheet

00813-0100-4029, Rev DA

November 2010

Rosemount 2110

Dimensional Drawing

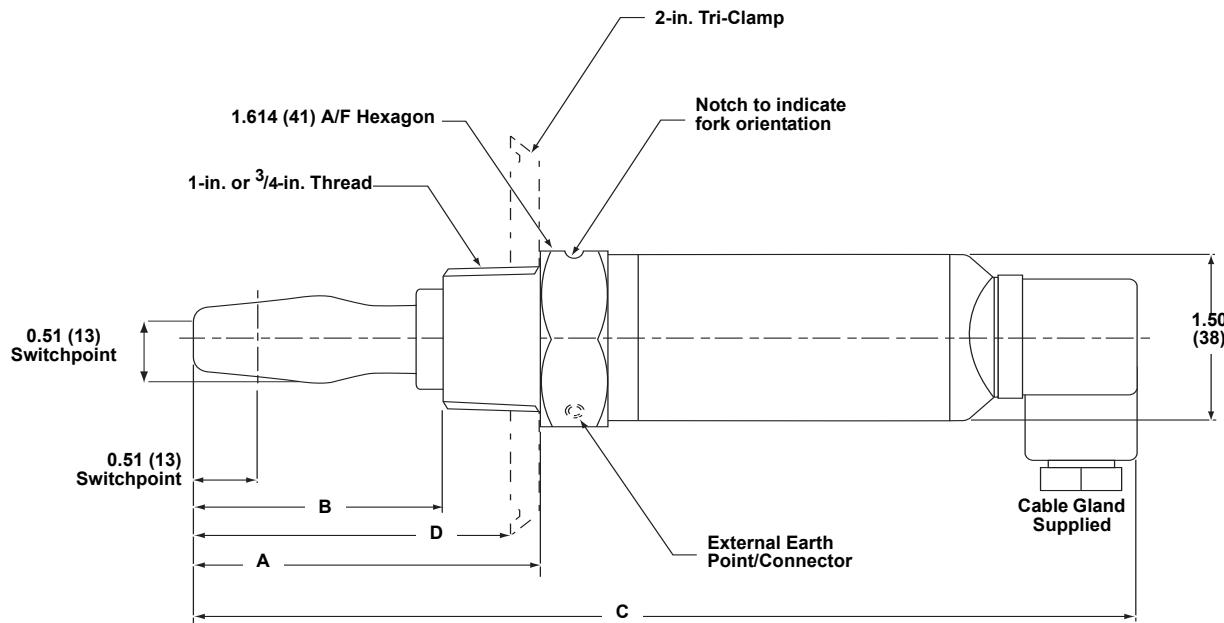

Process Connections	A	B	C	D
3/4-in. BSPT (R)	2.72 (69)	1.97 (50)	7.40 (188)	N/A
3/4-in. NPT	2.72 (69)	1.97 (50)	7.40 (188)	N/A
1-in. BSPT (R)	2.72 (69)	1.97 (50)	7.40 (188)	N/A
1-in. BSPP (G)	3.07 (78)	2.36 (60)	7.91 (201)	N/A
2-in. (51 mm) Tri-Clamp	2.72 (69)	1.97 (50)	7.40 (188)	2.52 (64)
1-in. Semi-extended	4.57 (116)	3.86 (98)	9.41 (239)	N/A

Rosemount 2110

Rosemount Level Solutions

Emerson provides a complete range of Rosemount products for level measurement applications.

Vibrating Fork Switches – Point Level Detection

For high and low alarms, overfill protection, pump control, including wide pressure and temperature requirements, and hygienic applications. Flexible mounting. Immune to changing process conditions and suitable for most liquids.

The product line consists of:

- Rosemount 2160 Wireless
- Rosemount 2130 Enhanced
- Rosemount 2120 Full-featured
- Rosemount 2110 Compact

Differential Pressure – Level or Interface Measurement

Flexible mounting for liquid tank levels, including those with wide temperature and pressure requirements. Can be isolated by valves. Unaffected by: vapor space changes, surface conditions, foam, corrosive fluids, internal tank equipment. Optimize performance with direct mount, Tuned-System Assemblies:

- Rosemount DP Level Transmitters and Remote Seals
- Rosemount 3051S_L, 3051L, and 2051L Liquid Level Transmitters

Ultrasonic – Level Measurement

Top mounted, non-contacting for simple tank and open air level measurements. Unaffected by fluid properties such as: density, viscosity, dirty coating, and corrosiveness. Appropriate for routine applications outside of explosion proof areas.

The product line consists of:

- Rosemount 3100 Series Ultrasonic Process Level Transmitters

Guided Wave Radar – Level and Interface Measurement

Top mounted, direct level and interface measurement of liquids or solids, including those with wide temperature and pressure requirements. Unaffected by changing process conditions. Good fit for small spaces and easy swap for older technologies. The product line consists of:

- Rosemount 5300 Series – Accurate, superior performance transmitter in most applications including process vessels and control
- Rosemount 3300 Series – Versatile and easy-to-use transmitter in most liquid storage and monitoring applications

Non-contacting Radar – Level Measurement

Top mounted, direct level measurement for liquids or solids, including those with wide temperature and pressure requirements. Can be isolated by valves. Unaffected by changing process conditions. Good for dirty, coating, and corrosive applications. The product line consists of:

- Rosemount 5400 Series – Accurate, superior performance 2-wire transmitters for most liquid level applications and process conditions
- Rosemount 5600 Series – 4-wire transmitters with maximum sensitivity and performance for solids, challenging reactors, rapid level changes, and excessive process conditions

Chambers for Process Level Instrumentation

- Rosemount 9901 – High quality chambers for external mounting of level measurement and control instrumentation on process vessels

The Emerson logo is a trademark and service mark of Emerson Electric Co.
Rosemount and the Rosemount logotype are registered trademarks of Rosemount Inc.
All other marks are the property of their respective owners.
Standard Terms and Conditions of Sale can be found at www.rosemount.com/terms_of_sale

© 2010 Rosemount, Inc. All rights reserved.

Emerson Process Management
Rosemount Measurement
8200 Market Boulevard
Chanhassen, MN 55317 USA
Tel (USA) 1 800 999 9307
Tel (International) +1 952 906 8888
Fax +1 952 949 7001
www.rosemount.com

Emerson Process Management
Blegistrasse 23
P.O. Box 1046
CH 6341 Baar
Switzerland
Tel +41 (0) 41 768 6111
Fax +41 (0) 41 768 6300

Emerson FZE
P.O. Box 17033
Jebel Ali Free Zone
Dubai UAE
Tel +971 4 811 8100
Fax +971 4 886 5465

Emerson Process Management
Asia Pacific Pte Ltd
1 Pandan Crescent
Singapore 128461
Tel +65 6777 8211
Fax +65 6777 0947
Service Support Hotline: +65 6770 8711
Email: Enquiries@AP.EmersonProcess.com



EMERSON
Process Management

pCO5+ Controllo elettronico programmabile / Electronic programmable control



pGDE*


ITA DESCRIZIONE

ENG DESCRIPTION

pCO5+ è un controllo elettronico programmabile a microprocessore sviluppato da CAREL per offrire molteplici applicazioni nel settore del condizionamento dell'aria, della refrigerazione e in generale del settore HVAC/R. Può essere collegato in rete pLAN a tutti i controlli della famiglia pCO sistema ed ai terminali della gamma pGD. Il programma applicativo, creato nell'ambiente di sviluppo 1Tool, è caricato sul controllo tramite il programma pCO Manager, disponibile sul sito <http://ksa.carel.com>. Vedere il man. cod. +0300020EN, che can be downloaded from www.carel.com.

ITA DIMENSIONI (mm)

ENG DIMENSIONS (mm)

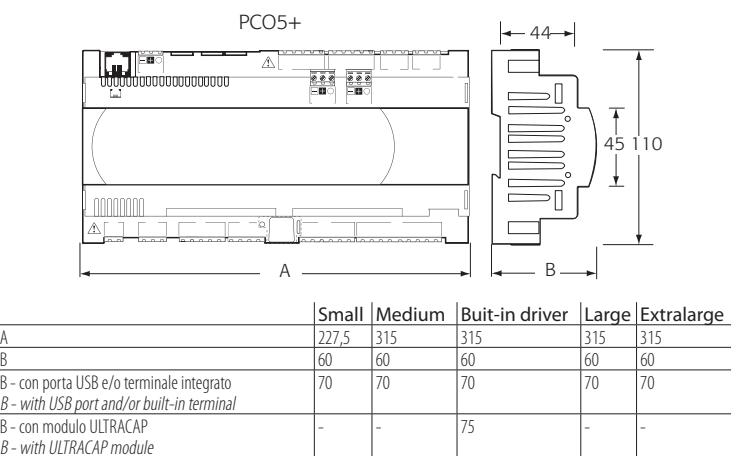

ITA MODELLI (vedere listino per codici di acquisto ordinabili)

ENG MODELS (see the list price for purchase codes, that can be ordered)

Codice	Descrizione	Classific.
P+5*****	Memoria 9MB (7MB programma applicativo +2MB Bios) +4MB storici	Memoria
P+3*****	Memoria 5MB (3MB programma applicativo +2MB Bios) +2MB storici (♦)	
P+5****0****	Uscite digitali tutte a relè	Tipo di uscita digitale
P+5****0...6****	1..6 uscite SSR a 24V	
P+5****A...F****	1..6 uscite SSR a 230V	
P+5****0****	Standard	
P+5****A****	BMS2 non optois. - Fieldbus2 non optois.	Connettività
P+5****B****	BMS2 optois. / Fieldbus2 non optoisolata	
P+5****C****	BMS2 optoisolata / Fieldbus2 optoisolata	
P+5***0****	No porta USB	Porta USB
P+5****A****	Porta USB	
P+5****0****	Senza driver valvola	Driver valve
P+5****1****	1 driver valvola CAREL	
P+5****2****	2 driver valvola CAREL	
P+5****0****	Senza terminale	Terminale integrato
P+5****0****	Con terminale	
P+5****S*	Small	Size
P+5****M*	Medium	
P+5****L*	Large	
P+5****Z*	Extralarge	
P+5****0/1	Singolo - multiplo	Packaging

(♦) I modelli previsti sono P+3**B00*0(0,E)(S,M,L,Z).

Codice	Descrizione
PGE000*	Terminale utente PGDE
PGD0400F***	Termin. utente pGD Touch 4,3"
PGD070F***	Termin. utente pGD Touch 7"
PCOSOWUC20	Modulo ultracap per pCO5+ - built-in driver
S90CONNO*	Cavo telefonico

WARNING: separate as much as possible the probe and digital input signal cables from the cables carrying inductive loads and power cables to avoid possible electromagnetic disturbance. Never run power cables (including the electrical panel wiring) and signal cables in the same conduits.

Disposal of the product: the appliance (or the product) must be disposed of separately in accordance with the local waste disposal legislation in force.

ITA

Caratteristiche tecniche

Contenitore plastico

Montaggio agganciabile su guida DIN secondo DIN 43880 CEI EN 50022

Materiale tecnopolimero

Autoestinguenza V2 (secondo UL94) e 850 °C (secondo IEC 60695)

Temperatura per la prova con la sfera 125 °C

Resistenza alle correnti strisciante ≥ 250 V

Colore Bianco RAL 9016

Terminale integrato Tipo PGD1 (132x64 pixel) con tastiera retroilluminata

Altre caratteristiche

Condizioni di funzionamento P+(3,5)*****0** (no terminale integrato): -40T70 °C, 90% UR non condens. (*)

(*) con modulo Ultracap montato: -40T60 °C P+(3,5)*****0** (con terminale integrato): -20T60 °C, 90% UR non condens. (*)

Condizioni di immagazzinamento P+(3,5)*****0** (no terminale integrato): -40T70 °C, 90% UR non condens.

P+(3,5)*****0** (con terminale integrato): -30T70 °C, 90% UR non condens.

Grado di protezione Mod. con porta USB e/o con modulo Ultracap: IP20 nel solo frontalino

Situaz. di inquinam. del disp. di comando Mod. senza porta USB e senza modulo Ultracap: IP40 nel solo frontalino

Classe secondo la protezione contro le scosse 2

da integrare su apparecchiature di Classe I e/o II nelle versioni senza driver valvola, classe I nelle versioni con driver valvola

PTI dei materiali per isolamento PCB: PTI 250V; materiale di isolamento: PTI 175

Periodo delle sollec. elett. delle parti isolanti lungo

Tipo azioni 1C, Y1 per le versioni a SSR

Tipo di disconnessione o microinterruzione microinterruzione

Categoria di resistenza al calore e al fuoco Categoria D (UL94-V2)

Caratter. di invecchiamento (ore funzionam.) 80.000

N.ro di cicli di manovra operazioni automatiche 100.000 (EN 60730-1); 30.000 (UL 60730)

Tensione impulsiva nominale 2500 V

Caratteristiche elettriche:

Alimentazione

Small, Medium, Large, Extralarge: utilizzare un trasformatore dedicato di sicurezza in classe 2 da 50 VA.

Built-in driver: utilizzare un trasformatore dedicato di sicurezza in classe II da 100 VA.

Vac P (Vac) Vdc P (Vdc)

Small 24 Vac (+10/-15%), 50/60 Hz, fusibile esterno da 2,5 A 45 VA 28...36 Vdc (-20/+10%) 30 W

Medium 24 Vac (+10/-15%), 50/60 Hz, fusibile esterno da 2,5 A 45 VA 28...36 Vdc (-20/+10%) 30 W

Large 24 Vac (+10/-15%), 50/60 Hz, fusibile esterno da 2,5 A 45 VA 28...36 Vdc (-20/+10%) 30 W

Extralarge 24 Vac (+10/-15%), 50/60 Hz, fusibile esterno da 2,5 A 45 VA 28...36 Vdc (-20/+10%) 30 W

Built-in driver Non ammesso

Attenz.: per la versione "pCO5+ built-in driver" sono obbligatorie l'alimentazione in alternata e il collegamento del secondario del trasformatore a terra (G0 a terra).

Morsettiera con connettori maschio/femmina estraibili

Sezione cavi min 0,5 mm² - max 2,5 mm²

Orologio con batteria di serie, precisione 100 ppm

Buzzer abilitabile da software, solo con terminale integrato

Batteria Di tipo "botton" al litio cod. CR2430 tensione 3 Vdc (dimen. 24x3 mm)

Classe e struttura del software Classe A

Categ. di immunità ai surge (CEI EN 61000-4-5) Categoria III

Dispositivo non destinato ad essere tenuto in mano quando alimentato

Ingressi / Uscite

Ingressi/uscite universali:

Ingressi analogici, Lmax = 30 m, numero massimo

Small, Medium/Built-in driver/Extralarge, Large

10ptisolati 30 m

nr. ingr. optoisol. a 24 Vac o 24 Vdc o 24 Vac

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc

nr. ingr. optoisol. a 24 Vac o 24 Vdc


nr. ingr. optoisol. a 24 Vac o 24 Vdc

ITA MORSETTI DI COLLEGAMENTO

1	Connettore per l'alimentazione [G(+), G(-)]
2	+Vterm: alimentazione per terminale aggiuntivo
	+5VREF alimentazione per sonde raziometriche
3	Ingressi/uscite universali
4	+VDC: alimentazione per sonde attive
5	pLAN impostazione indirizzi pLAN, display secondario, LED
6	VG: aliment. a tensione A (*) per uscita analogica optois.
	VG0: aliment. per uscita analogica optoisolata a 0 Vac/Vdc
7	Uscite analogiche
8	ID: ingressi digitali a tensione A (*)
9	ID..: ingressi digitali a tensione A (*)
10	IDH..: ingressi digitali a tensione B (**)
11	Connettore telefonico pLAN per terminale/ download programma applicativo
12, 13, 14	Riservato
15	Uscite digitali a relè
16	Connettore BMS2
17	Connettore Fieldbus2
18	Microinterruttori selezione Fieldbus/BMS
19	Connettore Fieldbus2
20	Connettore valvola elettronica A
21	Connettore valvola elettronica B
22	Connettore per modulo Ultracap esterno
23	Ingressi analogici e digitali driver esterno
24	LED segnalazione stato valvola
	(*) Tensione A: 24 Vac o 28...36 Vdc
	(**) Tensione B: 230 Vac - 50/60 Hz

Struttura

A	Tasto selezione indirizzo pLAN
B	Display indirizzo pLAN (*)
C	LED presenza alimentazione
D	LED sovraccarico
E	Microinterruttori Fieldbus/BMS su porta J26 (*)
F	Porta USB Host (master) (*)
G	USB Host (master) Port (*)
H	USB Slave (device) port (*)
	H Main Display
	(*) presente nei modelli P+5..., non nei modelli P+3...

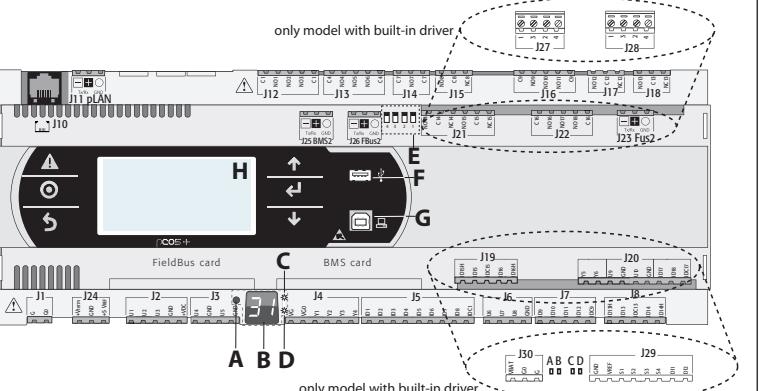

ITA TASTIERA (BUILT-IN e PGDE)

Tasto	Descriz.	Retro-illum.	Funzioni
!	Alarm	Bianco/Rosso	Premuto insieme a UP fornendo alimentazione permette di cambiare l'indirizzo del controllo; premuto insieme a Enter permette di accedere alle maschere gestite da BIOS
○	Prg	Bianco/Giallo	-
↶	Esc	Bianco	Ritorno livello superiore
↑	UP	Bianco	Premuto insieme a DOWN e ENTER permette di cambiare l'indirizzo del terminale (solo per terminali PGDE); aumenta valore
↑	Enter	Bianco	Conferma valore
↓	DOWN	Bianco	Premuto insieme a UP e ENTER permette di cambiare l'indirizzo del terminale (solo per terminali PGDE); diminuisce valore
○	Selezione indirizzo pLAN	-	• Pressione breve: visualizzazione indirizzo pLAN • Pressione lunga (> 5s): procedura di modifica indirizzo pLAN

ENG KEYBOARD (BUILT-IN and PGDE)

Key	Descriz.	Backlight	Functions
!	Alarm	White/Red	• Pressed together with UP and supplying power allows the controller address to be changed; • pressed together with Enter accesses the BIOS page
!			
○	Prg	White/Yellow	-
↶	Esc	White	return high level
↑	UP	White	• Pressed together with DOWN and ENTER allows the terminal address to be changed (only for PGDE terminal); • increase value
↑	Enter	White	confirm value
↓	DOWN	White	• Pressed together with UP and ENTER allows the terminal address to be changed (only for PGDE terminal); • decrease value
○	pLAN address selection	-	• short press: shows pLAN address; • long press (> 5s): procedure for modifying the pLAN address

ITA CONFIGURAZIONE PORTA J26

Rispetto al pCO5, i controlli pCO5+ sono dotati di 4 microinterruttori per configurare la porta seriale J26 (figura):

- microinterruttori tutti "IN BASSO": porta J26 impostata con hardware Fieldbus;
- microinterruttori tutti "IN ALTO": porta J26 impostata con hardware BMS(*);

La configurazione di fabbrica è: porta Fieldbus. (*) La porta seriale rimane comunque la Fieldbus a livello software all'interno dell'ambiente di programmazione 1Tool.



ENG PORT J26 CONFIGURATION

In comparison to pCO5, the pCO5+ controllers are equipped with 4 micro-switches to configure the serial port J26 (figure):


- all micro-switches "DOWN": port J26 set with Fieldbus hardware;
- all micro-switches "UP": port J26 set with BMS(*) hardware;

The factory setting is: Fieldbus port.

(*) The serial port, however, remains Fieldbus2 at the software level inside the 1Tool programming environment.

ENG CONNECTION TERMINALS


1	Power supply connectors [G(+), G(-)]
2	+Vterm: alimentazione per terminale aggiuntivo
	+5VREF alimentazione per sonde raziometriche
3	Ingressi/uscite universali
4	+VDC: alimentazione per sonde attive
5	pLAN address setup key, secondary display, LED
6	VG: aliment. a tensione A (*) per uscita analogica optois.
	VG0: aliment. per uscita analogica optoisolata a 0 Vac/Vdc
7	Analogue outputs
8	ID: digital inputs at voltage A (*)
9	ID..: digital inputs at voltage A (*)
10	IDH..: digital inputs at voltage B (**)
11	pLAN telephone connector for terminal/download application programme
12, 13, 14	Reserved
15	Relay digital outputs
16	BMS2 connector
17	Fieldbus2 connector
18	Fieldbus/BMS selector micro-switch
19	Fieldbus2 connector
20	Electronic Valve A connector
21	Electronic Valve B connector
22	Connector for external Ultracap module
23	External driver analogue and digital inputs
24	Valve status signal LED
	(*) Voltage A: 24 Vac or 28...36 Vdc
	(**) Voltage B: 230 Vac - 50/60 Hz

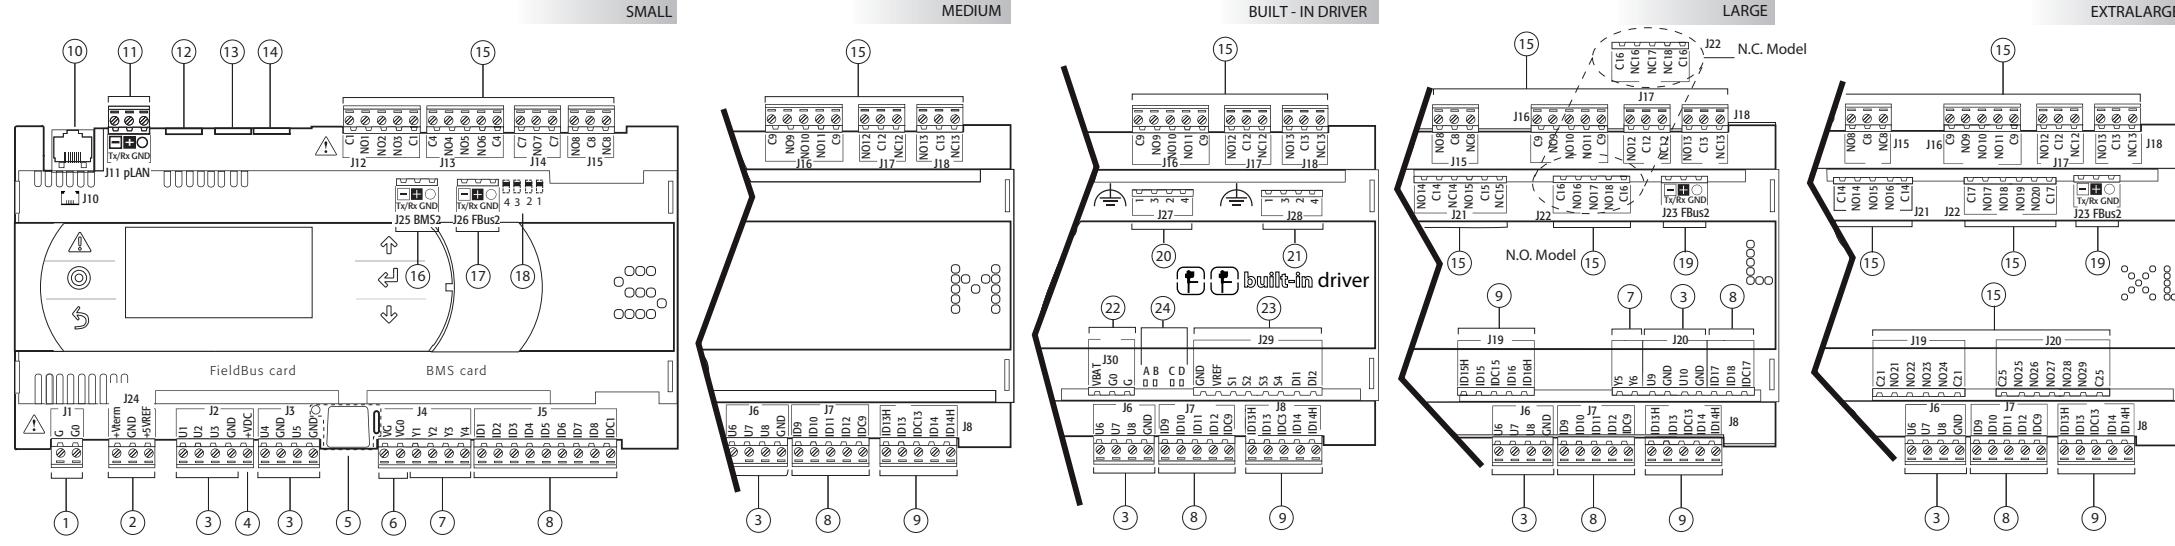

ITA PORTE SERIALI

ENG SERIAL PORTS

Rispetto al pCO3, i controlli pCO5+ (e pCO5) possiedono una seconda porta seriale BMS sul connettore J25 (BMS2) e una seconda porta Fieldbus sul connettore J26 (FBus2). Nelle schede pCO5+ versione Large e Extralarge è ancora presente il connettore J23 e riporta la scritta FBus2 come per il connettore J26. Dal punto di vista della gestione da applicativo 1Tool si tratta infatti della stessa linea seriale e si devono usare indirizzi diversi per i dispositivi connessi ai 2 connettori, mentre dal punto di vista elettrico le porte sono indipendenti (un guasto elettrico nella porta J26 non influenza la porta J23). Vedere la tab. caratteristiche tecniche.

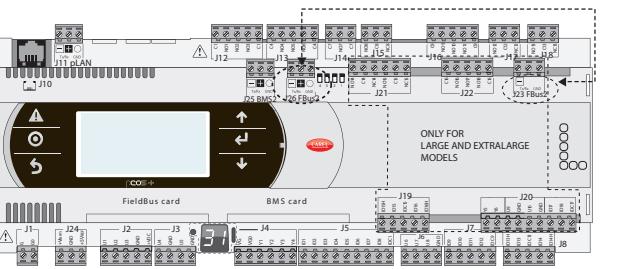

Porte seriali

Serie	Tipo/connettori	Caratteristiche
ZERO	pLAN/10, J11	Integrata su scheda base RS485 pLAN Non optoisolata Connettori: Jack telefonico 6 vie + Estrattibile 3 vie p. 5,08 Lunghezza massima: 500 m Numero massimo dispositivi collegabili: 32
ONE	BMS 1 Serial Card	Non integrata su scheda base
TWO	FieldBus 1 Serial Card	Non integrata su scheda base
THREE	BMS 2 / J25	Integrata su scheda base RS485 Slave Seriale optoisolata/non optoisolata(*) Connnettore estrattibile 3 vie p. 5,08 Lunghezza massima: 1000 m
FOUR	FieldBus 2 / J26 (and J23 su Large e J26 su versione Large e Extralarge)	Integrata su scheda base RS485 Master/Slave (**) J23: non optoisolata, J26: opt.-isolated/not opt.-isolated 3-way removable connector 5,08


Nota: utilizzare cavo schermato AWG 20-22 a coppia twistate per i +/-; (*) disponibili i 2 modelli; (**) J26 configurabile

ITA CONNESSIONE IN RETE TRA CONTROLLI

Nel pCO5+ ci sono tre tipi di seriali: pLAN, Fieldbus, BMS. La porta seriale Fieldbus RS485 ha hardware di tipo Master, mentre la porta seriale BMS RS485 ha hardware di tipo Slave. I protocolli da utilizzare sulla porta Fieldbus RS485 sono, per natura stessa della porta, di tipo Master (Carel Master o Modbus RTU Master), anche se possono essere utilizzati in casi particolari quelli di tipo Slave (Carel Slave o Modbus RTU Slave), con i dovuti accorgimenti. Analogamente sulla porta BMS RS485, i protocolli da utilizzare sono di tipo Slave, anche se con i dovuti accorgimenti è possibile avere protocolli di tipo Master.

Nota: la rete pLAN è multi-master: ogni controllo può essere contemporaneamente Master o Slave.

MASTER - SLAVE network

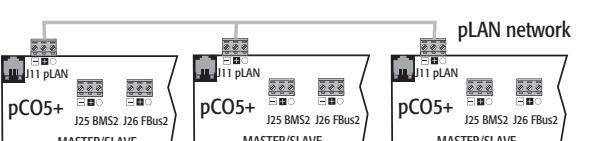

ITA ETICHETTAT. INGRESSI / USCITE

I controlli pCO5+ si differenziano per la taglia e sono provvisti di ingressi e uscite e alimentazione alle sonde attive adatte per le varie applicazioni. Le caratteristiche che dipendono dalla taglia sono:

- numero massimo e natura degli ingressi/uscite;
- presenza o meno del display integrato;
- presenza del driver integrato per valvola di espansione;

ITA INPUTS/ OUTPUTS LABEL

The pCO5+ controllers are differentiated by their size and are equipped with inputs and outputs and active probe power supplies that are suitable for the various applications. The size-related characteristics are:

- max. number and nature of the inputs/outputs;
- whether or not it has an integrated display;
- presence of the integrated driver for the expansion valve

Etich. Tipi di segnale

U...	Ingressi/uscite universali, configurabili via software come: Ingressi analogici: - sensori NTC, PTC, PT100, PT1000 - sensori PT100 - segnali 0...1 Vdc o 0...10 Vdc - segnali 0/4...20 mA - segnali 0...5 V per sonde raziometriche Ingressi digitali (non optoisolati): - contatti puliti (non optoisolati) - ingressi digitali veloci Uscite analogiche (non optoisolate): - segnali 0...10 Vdc - segnali PWM
Y...	Analogical outputs 0 to 10 Vdc, PWM outputs
ID...	Digital inputs to 24 Vac or 28...36 Vdc
ID..H	Digital inputs to 230 Vac
NO...	Relay outputs, contact normally open
NC...	Relay outputs, contact normally closed
C...	Relay outputs, common
Tx/Rx, GND	Serial port

ITA COLLEGAMENTO TERMINALE

Il controllo e il terminale sono connessi in rete pLAN.

1: controllo pCO singolo

Nel collegamento del controllo al terminale occorre tenere presente i seguenti vincoli:

- la lunghezza totale della rete pLAN non deve superare i 500 m. Quindi se il terminale è remoto la lunghezza del cavo del terminale entra nel computo totale della lunghezza;
- il cavo telefonico non schermato si può utilizzare per una lunghezza massima di 50 m. Oltre questa lunghezza utilizzare un cavo schermato tripolare;
- oltre i 200 m l'alimentazione del terminale deve essere fornita separatamente;
- è possibile collegare al massimo 3 terminal



Installazione e montaggio / Assembly and installation

Dimensioni e forature / Dimensions and drilling template (in mm/inc)

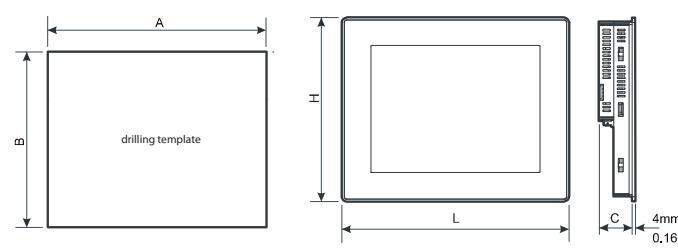


Fig.1

Model	A	B	C	H	L
pGD 10	276 (10.86")	221 (8.7")	56 (2.2")	232 (9.13")	287 (11.30")
pGD 13	326 (12.83")	256 (10.07")	56 (2.2")	267 (10.51")	337 (13.22")

Tab.1

Fissaggio supporti / Fixing bracket

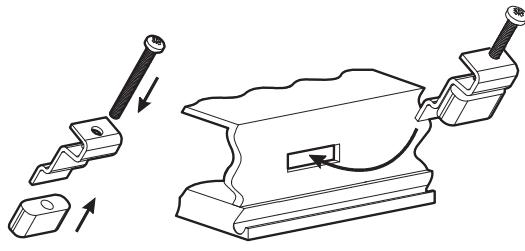


Fig.2

Nota: avvitare ogni vite di fissaggio fino a quando l'angolo della cornice poggerà sul pannello. / Screw each fixing screw until the bezel corner gets in contact with the panel.

Applicazione guarnizione / Applying the gasket

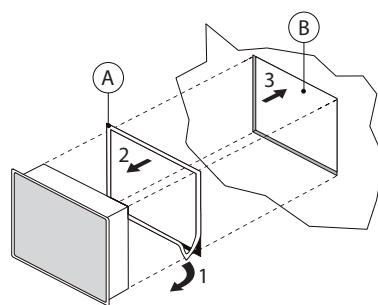


Fig.3

Legenda:

- A. Guarnizione / Gasket
- B. Foratura per il montaggio / Installation cut-out

Tab.3

Collegamento elettrico / Power supply connection

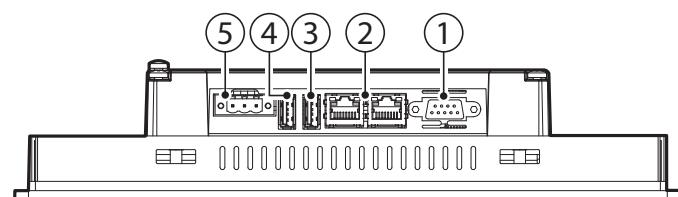


Fig.4

Legenda:

1. Porta seriale / Serial Port
2. 2x porta Ethernet / 2x Ethernet Port
3. porta USB (versione 2.0 - 1.1) / USB port (version 2.0 - 1.1)
4. porta USB (versione 2.0 solo alta velocità) / USB port (version 2.0 High speed only)
5. Alimentazione / Power Supply

Tab.2

 **WARNING:** separate as much as possible the probe and digital input signal cables from the cables carrying inductive loads and power cables to avoid possible electromagnetic disturbance. Never run power cables (including the electrical panel wiring) and signal cables in the same conduits.

IMPORTANT WARNINGS

The CAREL product is a state-of-the-art product, whose operation is specified in the technical documentation supplied with the product or can be downloaded, even prior to purchase, from the website www.carel.com. - The client (builder, developer or installer of the final equipment) assumes every responsibility and risk relating to the phase of configuration the product in order to reach the expected results in relation to the specific final installation and/or equipment. The lack of such phase of study, which is requested/indicated in the user manual, can cause the final product to malfunction of which CAREL can not be held responsible. The final client must use the product only in the manner described in the documentation related to the product itself. The liability of CAREL in relation to its own product is regulated by CAREL's general contract conditions edited on the website www.carel.com and/or by specific agreements with clients.

Descrizione

I terminali grafici pGD Touch da 10 e 13 pollici appartengono alla famiglia di terminali touch screen pensata per rendere semplice e intuitivo l'interfacciamento dell'utente con i controlli della famiglia pCO Sistemi.

La tecnologia elettronica utilizzata e il nuovo display a 65'000 colori permettono di gestire immagini ad alta risoluzione e funzionalità avanzate per ottenere un elevato standard estetico. Il pannello touch screen, inoltre, facilita l'interazione uomo-macchina rendendo, di fatto, più facile la navigazione tra le varie schermate.

Codici modelli

Codice	Dimensione display	Risoluzione
PGDT10000FR10	10.4 pollici	800x600 (SVGA)
PGDT13000FR10	13.3 pollici	1280x800 (WXGA)

Codici accessori

Codice	Descrizione
PGTA00TRFO	Alimentatore 230 VAC – 24 VDC per guida DIN
PGTA00CNVO	Cavo adattatore DB9 per RS485 lunghezza 2 m

Avvertenze per l'installazione

Evitare il montaggio delle schede in ambienti che presentino le seguenti caratteristiche:

- umidità relativa maggiore di quanto indicato nelle specifiche tecniche;
- forti vibrazioni o urti;
- esposizione ad atmosfere aggressive ed inquinanti (es.: gas solforici e ammoniacali, nebbie saline, fumi) con conseguente corrosione e/o ossidazione;
- elevate interferenze magnetiche e/o radiofrequenze (evitare quindi l'installazione delle macchine vicino ad antenne trasmettenti);
- esposizione all'irraggiamento solare diretto e agli agenti atmosferici in genere;
- ampie e rapide fluttuazioni della temperatura ambiente;
- ambienti ove sono presenti esplosivi o miscele di gas infiammabili;
- evitare di avvicinarsi con le dita ai componenti elettronici montati sulle schede per evitare scariche elettrostatiche (estremamente dannose) dall'operatore verso i componenti stessi.

Avvertenze generali


1. I terminale pGDTouch 10" e 13" possono essere alimentati solo in corrente continua.
2. Una tensione di alimentazione elettrica diversa da quella prescritta può danneggiare seriamente il sistema;
3. Utilizzare capicorda adatti per i morsetti in uso. Allentare ogni vite ed inserirvi i capicorda, quindi serrare le viti. Ad operazione ultimata tirare leggermente i cavi per verificarne il corretto serraggio;
4. L'uso a temperature particolarmente basse può causare una visibile diminuzione della velocità di risposta del display. Questo è da ritenersi normale e non è indice di malfunzionamento.

Aggiornamento Runtime

Copiare il pacchetto di aggiornamento contenente il Runtime in una chiave USB e successivamente collegare la chiave USB al pGDTouch. Tenere premuto il dito sullo schermo del terminale pGD Touch per alcuni secondi fino a che il menu di scelta rapida sarà visualizzato.



Selezionare "Update..." per avviare la procedura di aggiornamento Runtime. L'utilità per l'aggiornamento del Runtime si avvierà ed apparirà la seguente finestra.



Selezionare "Auto select best match" e premere next, in questo modo verrà avviata la procedura di aggiornamento.



Attendere che la procedura sia terminata e premere "Close".

Description

The pGD Touch 10 and 13 inch graphic terminals are part of the family of touchscreen terminals designed to simplify user interface with the pCO sistema family controllers.

The electronic technology used and the new 65,000 colour display means high resolution images and advanced functions are available for a superior appearance. The touchscreen panel makes interaction between the user and the unit much easier by simplifying navigation between the various screens.

Model codes

Code	Display size	Resolution
PGDT10000FR10	10.4 inches	800x600 (SVGA)
PGDT13000FR10	13.3 inches	1280x800 (WXGA)

Accessory codes

Code	Description
PGTA00TRFO	230 VAC – 24 VDC power supply for DIN rail
PGTA00CNVO	DB9 adapter cable for RS485, 2 m long

Installation warnings

Do not install the boards in environments with the following characteristics:

- relative humidity greater than the value specified in the technical specifications;
- strong vibrations or knocks;
- exposure to aggressive and polluting atmospheres (e.g.: sulphur and ammonia fumes, saline mist, smoke) so as to avoid corrosion and/or oxidation;
- strong magnetic and/or radio frequency interference (therefore avoid installing the units near transmitting antennae);
- exposure to direct sunlight or the elements in general;
- large and rapid fluctuations in the room temperature;
- environments where explosives or mixes of flammable gases are present;
- avoid touching or nearly touching the electronic components fitted on the boards to avoid electrostatic discharges (extremely damaging) from the operator to the components.


General warnings

1. The pGD Touch 10" and 13" terminals are for DC power supply only.
2. Power supplies other than those specified may seriously damage the system;
3. Use cable ends suitable for the corresponding terminals. Loosen each screw and insert the cable ends, then tighten the screws. When finished, slightly tug the cables to check they are sufficiently tight;
4. Operation at low temperatures may cause a visible decline in the response speed of the display. This should be considered normal and does not indicate a malfunction.


Runtime update

Copy the update package containing the Runtime to a USB pendrive and then plug the pendrive into the pGDTouch.

Touch and hold the pGD Touch terminal screen for a few seconds until the shortcut menu is displayed.



Select "Update..." to start the Runtime update procedure. The Runtime update utility will start and the following window will be displayed.



Select "Auto select best match" and then press next to start the update procedure.



Wait for the procedure to end and press "Close".

Alimentazione / Power supply

A Alimentatore a bassissima tensione di sicurezza/sorgente di potenza limitata / Extra low voltage power supply / Limited power source.




Fig.5

A Non aprire l'involucro dei pannelli quando sono alimentati / Don't open the panel rear cover when the power supply is applied.

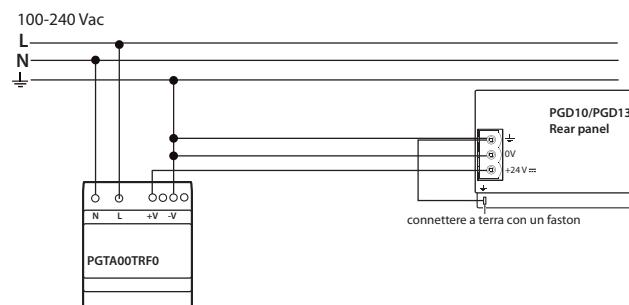


Fig.6

Verificare che l'alimentatore sia in grado di erogare la potenza necessaria per il corretto funzionamento dell'apparecchiatura. E' possibile ordinare l'alimentatore 230Vac/24Vdc - codice PGTA00TRFO. / Ensure that the power supply has enough power capacity for the operation of the devices. The 230 Vac/24Vdc power supply - code PGTA00TRFO can be ordered.

Collegamenti seriali / Serial connections

PLC PORT: Com 1 - PC/PRINTER PORT: Com2




Fig.7

Pin	Description
1	GND
2	-
3	TX/CHA-
4	RX/CHB-
5	-
6	+5 V output
7	CTS/CHB+
8	RTS/CHA+
9	-

Per effettuare il collegamento con gli strumenti Carel in RS485 utilizzare l'apposito cavo adattatore PGTA00CNVO. / To make the RS485 connection to Carel instruments use the special adapter cable code PGTA00CNVO.

Caratteristiche PGTA00CNVO

PGTA00CNVO Technical specifications

Lunghezza: 2 m	length: 2 m
Il cavo è dotato di connettore DB9 maschio e resistenze interne di polarizzazione linea	The cable is fitted with a DB9 male connector and internal resistance for line polarisation
terminazioni: Db9 maschio e fili squatinati con occhiello per collegamento a terra della calza	terminations: DB9 male and stripped wires with eyelet for earthing the shield

Per il collegamento al pCO seguono i colori indicati in figura:
To connect the pCO follow the colours indicated in the figure:

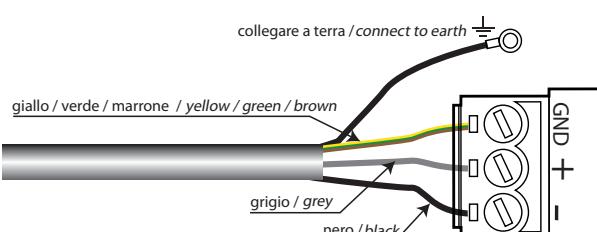


Fig.8

Regole per lo smaltimento / Guidelines for disposal

- Non smaltire il prodotto come rifiuto solido urbano ma smalitirlo negli appositi centri di raccolta.
- Il prodotto contiene una batteria ed è quindi necessario rimuoverla separandola dal resto del prodotto seguendo le istruzioni riportate di seguito prima di procedere al suo smaltimento.
- Un uso improprio o uno smaltimento non corretto potrebbe avere effetti negativi sulla salute umana e sull'ambiente.
- Per lo smaltimento vanno utilizzati i sistemi di raccolta pubblici o privati previsti dalle leggi locali.
- In caso di smaltimento abusivo dei rifiuti elettrici ed elettronici sono previste sanzioni stabilite dalle vigenti normative locali in materia di smaltimento.
- Do not dispose of the product as municipal waste; it must be disposed of through specialist waste disposal centres.*
- The product contains a battery that must be removed and separated from the rest of the product according to the instructions provided, before disposing of the product.*
- Improper use or incorrect disposal of the product may negative effects on human health and on the environment.*
- The public or private waste collection systems defined by local legislation must be used for disposal.*
- In the event of illegal disposal of electrical and electronic waste, the penalties are specified by local waste disposal legislation.*




Fig.9

Smaltimento del prodotto: l'apparecchiatura (o il prodotto) deve essere oggetto di raccolta separata in conformità alle vigenti normative locali in materia di smaltimento. / **Disposal of the product:** the appliance (or the product) must be disposed of separately in accordance with the local waste disposal legislation in force.

Caratteristiche tecniche

	pGD10"	pGD13"
Display		
Tipo	TFT	
Resoluzione	800x600, SVGA	1280x800, WXGA
Area display attiva	10.4" diagonal	13"3 diagonal
Colori	64 K	
Retro-illuminazione	LED	
Luminosità	300 Cd/m ² typ.	
Regolazione luminosità	Si	
Requisiti di sistema		
Sistema operativo	Microsoft Windows CE 6.0	
Memoria utente	256 MB Flash	
RAM CPU MIPS	256 MB DDR	
Interfaccia operativa		
Touchscreen	Analog resistive	
Indicatori LED utente	1 (dual core)	
Interfacce		
Porta Ethernet	2 10/100 Mbit with integrated switch	
Porta USB	Host interface, (1 vers. 2.0, 1 vers. 2.0 e 1.1)	
Porta Seriale 1: Com1	RS232, RS485, RS422, configurabile via software	
Memory card	SD Card Slot	
Funzionalità		
Grafica vettoriale	Si, incluso supporto SVG 1.0	
Oggetti dinamici	Si. Visibilità, opacità, posizione, dimensione, rotazione per molti tipi di oggetti	
Font-TrueType	Si	
Multi-Protocollo	Si, massimo 2 driver	
Storico e trend	Si. Limitato alla memoria della Flash memory	
Multi-lingue	Si, con impostazione della lingua run-time limitato solo dalla memoria disponibile	
Recipes (ricette)	Si. Limitato alla memoria della Flash memory	
Allarmi	Si	
Lista eventi	Si	
Passwords	Si	
Hardware Real Time Clock	Si, con batteria di back-up	
Screen saver	Si	
Buzzer	"Beep" alla pressione del touch (configurabile)	
Ratings		
Alimentazione	24 Vdc (18...30 Vdc)	
Corrente assorbita	0,95 A a 24 Vdc (max.) 1,15 A a 24 Vdc (max.)	
Fusibile	Automatico	
Peso	appross. 2,1 kg	appross. 2,8 kg
Batteria	Ricaricabile a litio, non sostituibile dall'utente	
Condizioni ambientali		
Temperatura di lavoro	0...50 °C (installazione verticale)	
Temperatura di immagazzinamento	-20...70 °C	
Umidità lavori e immagazzinamento	5 – 85 % umidità relativa, non-condensante	
Grado di protezione	IP65 (front panel) - IP20 (rear)	
Dimensioni		
Pannello frontale LxH	287x232 mm	337x267 mm (13.22x10.51")
Foratura AxB	276x221 mm	326x256 mm (12.83x10.07")
Profondità D+T	56mm + 4mm	56+4 mm (2.20+0.16")
L'utilizzo di queste apparecchiature in ambienti residenziali, commerciali e dell'industria leggera è permesso solo nel caso in cui vengano prese le misure speciali per ottenere la conformità alla IEC61000-6-3.		
CAREL si riserva la possibilità di apportare modifiche o cambiamenti ai propri prodotti senza alcun preavviso.		

Technical Specification

	pGD10"	pGD13"
Display		
Type	TFT	
Resolution	800x600, SVGA	1280x800, WXGA
Active display area	10.4" diagonal	13"3 diagonal
Colours	64 K	
Retro-illumination	LED	
Brightness	300 Cd/m ² typ.	
Dimming	Yes	
System resources		
Operating System	Microsoft Windows CE 6.0	
User memory	256 MB Flash	
RAM CPU MIPS	256 MB DDR	
Operator Interface		
Touchscreen	Analogue resistive	
User LED indicators	1 (dual core)	
Interfaces		
Ethernet port	2 10/100 Mbit with integrated switch	
USB port	Host interface, (1 vers. 2.0, 1 vers. 2.0 e 1.1)	
Serial Port 1: Com1	RS232, RS485, RS422, software configurable	
Memory card	SD Card Slot	
Functions and features		
Vector graphics	Yes, includes SVG 1.0 support	
Object dynamics	Yes. Visibility, opacity, position size, rotation for object types.	
TrueType fonts	Yes	
Multiple driver commun.	Yes, max 2 drivers	
Data acquisition	Yes. Flash memory storage limited only by available memory	
Multilanguage	Yes, number of run-time languages limited by available memory	
Recipes	Yes. Flash memory storage limited by available mem.	
Alarms	Yes	
Event list	Yes	
Passwords	Yes	
Hardware Real Time Clock	Yes, with battery back-up	
Screen saver	Yes	
Buzzer	Yes, audible feedback for touchscreen	
Ratings		
Power supply voltage	24 Vdc (18 to 30 Vdc)	
Current consumption	0,95 A a 24 Vdc (max.) 1,15 A a 24 Vdc (max.)	
Fuse	Automatic	
Weight	Approx 2.1 kg	Approx 2.8 kg
Battery	Rechargeable Lithium battery, not user-replaceable	
Environmental conditions		
Operating temperature	0...50 °C (vertical installation)	
Storage temperature	-20...70 °C	
Operating and storage humidity	5 – 85 % relative humidity, non-condensing	
Protection class	IP65 (front panel) - IP20 (rear)	
Dimensions		
Faceplate LxH	287x232 mm	337x267 mm (13.22x10.51")
Cutout AxB	276x221 mm	326x256 mm (12.83x10.07")
Depth D+T	56mm + 4mm	56+4 mm (2.20+0.16")
These devices may only be used in residential, commercial and light industrial environments if special measures are taken to ensure conformity to IEC61000-6-3.		
CAREL reserves the right to modify the features of its products without prior notice.		

Schema per collegamento a pCO⁵ / Connection to pCO⁵

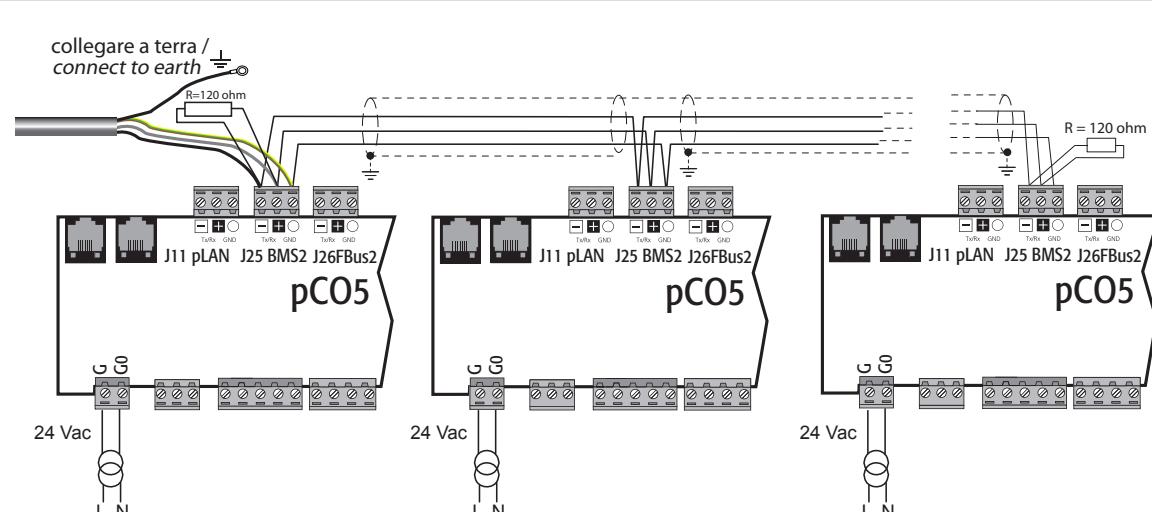


Fig.10

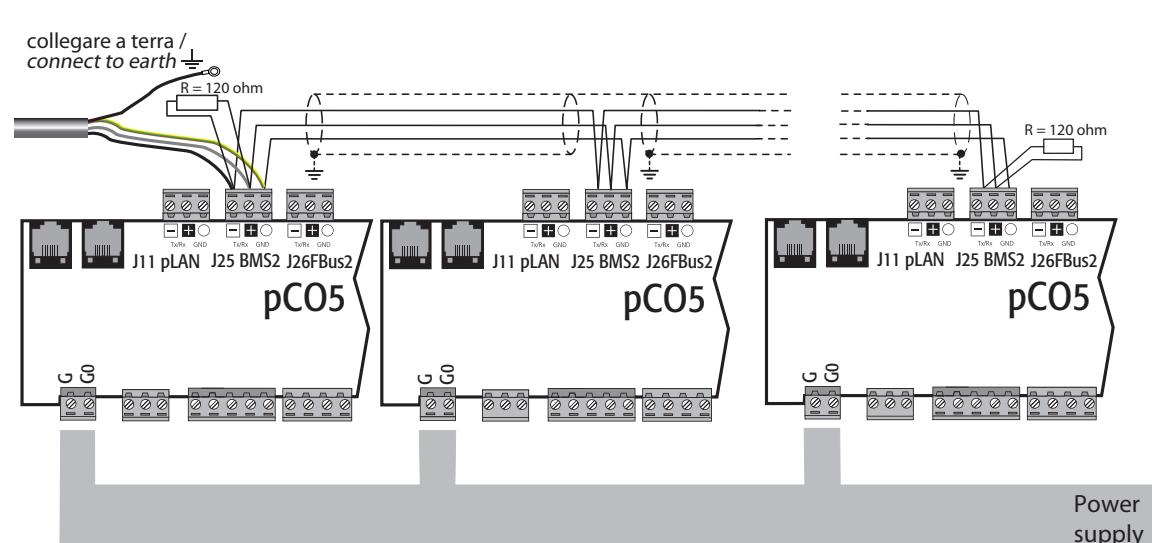


Fig.11

Power supply

CLEANVENT

Combined Air (Deaerator) &
Dirt Separator.



- 1 High capacity auto air vent
- 2 3-Way Valve / Bleed Valve
- 3 Drain Valve

Model No.	Dimensions (mm)							Tested to
	A	B	C	D	E	F	G	
CVAD-50	50	430	300	170	25	380	680	21 bar
CVAD-65	65	430	300	170	25	380	680	21 bar
CVAD-80	80	490	360	220	25	440	800	21 bar
CVAD-100	100	490	360	220	25	440	800	21 bar
CVAD-125	125	630	470	325	25	550	1020	21 bar
CVAD-150	150	630	470	325	25	550	1020	21 bar
CVAD-200	200	810	625	410	50	625	1250	21 bar
CVAD-250	250	880	775	510	50	775	1550	21 bar
CVAD-300	300	1100	875	610	50	875	1750	21 bar
CVAD-350	350	1500	950	770	50	950	1900	21 bar
CVAD-400	400	1500	1125	770	50	1125	2250	21 bar
CVAD-450	450	1750	1125	920	50	1125	225	21 bar
CVAD-500	500	2000	1175	1220	50	1175	2350	21 bar
CVAD-600	600	2000	1325	1220	50	1325	2650	21 bar

Dearation

The word Dearation describes the removal of dissolved gases from liquids such as air from water. When water is heated or the pressure reduced gas microbubbles are released into the system. Microbubbles can be the cause of major problems such as pump failure, corrosion and energy loss.

The Solution

As an aid to system cleaning the CleanVent range has been developed by Fabricated Products (UK) to remove potentially damaging particles from both hot and chilled water systems. It is comprised of a very fine stainless-steel Concentrator capable of stopping debris down to 5 micron. Through simple & cost effective maintenance the dirt can be flushed away to removing all the damaging particles in the system.

Features and Benefits

- It is comprised of a very fine stainless-steel Concentrator capable of stopping debris down to 5 micron.
- Greatly reduced commissioning times after initial fill.
- Longer system life (through air and dirt elimination)
- Low-pressure drop
- Bi-directional flow
- Maximum Temperature. 110 °c. Higher temperature units available on request.
- Tested to 21 bar
- All stainless steel construction.
- Air collects in the air chamber before being automatically vented
- Floating dirt can be removed by opening the valve situated under the air vent.
- The same valve is used for releasing air when filling the system
- Large collector ensures that flushing is only required now and then
- Can be flushed while fully operational (no need to shut down)
- An internal stainless steel concentrator to aid removal of air and dirt.
- Smooth surfaces with Stainless Steel lead to lower friction
- Stainless will not degrade in service thanks to its excellent resistance to corrosion.

- Stainless Steel is extensively more resistant to oxidation by water and biocides than carbon steel. Therefore Stainless Steels are not contributing to oxidation, sludge's etc;
- Thermal properties of stainless steel. They are far superior to iron or carbon steel.
- Maximum flow rate up to 3m/sec

Stainless Steel: Safe, Clean, Efficient and Hygienic

- Stainless is highly resistant against micro bacteria attacks plus lower bacteria colonization
- Hygienic and cleanable material (Smooth surface internally & externally). Due to their very high passive film (protecting the surface)
- Lower adhesion of deposits (dirt and sludge) with the smooth internals of Stainless Steels. Sludge & magnetite is washed/ removed from the collection chamber far easier than the inferior iron/ carbon steel
- Stability, Stainless Steel is basically inert in water. Leaching of alloying elements is within safe limits. As a result, they provide better quality water. No turbidity problems. All resulting in less bacterial slime, low energy consumption, low cleaning costs, good for conveying wet solids.
- Excellent durability and abrasion resistance, as Stainless Steels are resistant to crevice corrosion, cavitations and wear in pure and polluted waters as well as in atmosphere (even polluted), they are cost effective for long term use and do not cause environmental pollution.

CleanVent location

This combined unit (model ref CVAD) must be installed at the hottest part of the system (before the pumps). In a heating system this is the main flow from the boilers.

In a chilled water system the unit must be located in the return close to the chiller.

The static head must not exceed 60 metres in a Heating system.

Maximum static head must not exceed 40 metres in a chilled water system.

N.B. if the static head is greater than

Commissioning

The CleanVent requires no special commissioning. All units are fitted with a fast bleed valve, which should be used when initially filling the system. The same valve is used for draining off floating scum and also prevents the possibility of dirt clogging the air vent. Maintenance will be required to remove trapped dirt and sludge. Opening the ball valve at the bottom of the unit does this. The valve may be opened while the system is under pressure.

Scalding is a danger at high pressures

these figures the efficiency of the CleanVent & MagVent is reduced

and temperatures. Ensure that the water is safely piped to drain before opening the valve.

The system pressure will flush the dirt out. Leave the valve open until the collected dirt has been flushed out; repeat this operation every few days. Once the water is clear it may be possible to drain every 6 months or so depending on the size and age of the system.

Most of the dissolved air will be removed in a few days. However this may vary from system to system .In large systems it may take several weeks.

Dirt separators can only remove dirt that is circulating.

Flanges

All flanges are drilled to BS4504 PN16 as standard. Other flange ratings are available on request.

The CleanVent unit is maintenance free

Drain valve

All models are supplied with a ball valve for draining the collected dirt and sludge.

CLEANVENT

An Air (Deaerator) Separator.

- 1 High capacity auto air vent
- 2 Fast bleed Valve



Model No.	Dimensions (mm)						Tested to
	A	B	C	D	F	G	
CVA-50	50	430	114	170	390	504	21 bar
CVA-65	65	430	120	170	384	504	21 bar
CVA-80	80	490	141	220	459	600	21 bar
CVA-100	100	490	154	220	446	600	21 bar
CVA-125	125	630	193	325	585	778	21 bar
CVA-150	150	630	207	325	571	778	21 bar
CVA-200	200	810	251	410	649	900	21 bar
CVA-250	250	880	303	510	835	1138	21 bar
CVA-300	300	1100	353	610	947	1300	21 bar
CVA-350	350	1500	406	770	1025	1431	21 bar
CVA-400	400	1500	432	770	1262	1694	21 bar
CVA-450	450	1750	495	920	1218	1713	21 bar
CVA-500	500	2000	595	1220	1230	1825	21 bar

Dearation

The word Dearation describes the removal of dissolved gases from liquids such as air from water. When water is heated or the pressure reduced gas microbubbles are released into the system. Microbubbles can be the cause of major problems such as pump failure, corrosion and energy loss.

The Solution

The stainless steel CleanVent Air Separator Installed at the hottest point in the system the stainless steel CleanVent will eliminate these micro bubbles from heating and chilled water systems.

Features and Benefits

- Greatly reduced commissioning times after initial fill.
- Longer system life (through air elimination)
- Low-pressure drop
- Bi-directional flow
- Maximum Temperature. 110 °c. Higher temperature units available on request.
- Tested to 21 bar
- All stainless steel construction.
- Air collects in the air chamber before being automatically vented
- An internal stainless steel concentrator to aid removal of air
- Smooth surfaces with Stainless Steel lead to lower friction
- Stainless will not degrade in service thanks to its excellent resistance to corrosion.
- Stainless Steel is extensively more resistant to oxidation by water and biocides than carbon steel. Therefore Stainless Steels are not contributing to oxidation, sludge's etc;
- Thermal properties of stainless steel. They are far superior to iron or carbon steel.
- Maximum flow rate up to 3m/sec

Stainless Steel: Safe, Clean, Efficient and Hygienic

- Stainless is highly resistant against micro bacteria attacks plus lower bacteria colonization
- Hygienic and cleanable material (Smooth surface internally & externally). Due to their very high passive film (protecting the surface)
- Lower adhesion of deposits (dirt and sludge) with the smooth internals of Stainless Steels. Sludge & magnetite is washed/ removed from the collection chamber far easier than the inferior iron/ carbon steel
- Stability, Stainless Steel is basically inert in water. Leaching of alloying elements is within safe limits. As a result, they provide better quality water. No turbidity problems. All resulting in less bacterial slime, low energy consumption, low cleaning costs, good for conveying wet solids.
- Excellent durability and abrasion resistance, as Stainless Steels are resistant to crevice corrosion, cavitations and wear in pure and polluted waters as well as in atmosphere (even polluted), they are cost effective for long term use and do not cause environmental pollution.

CleanVent location

This unit (our model ref CVA) must be installed at the hottest part of the system (before the pumps). In a heating system this is the main flow from the boilers.

In a chilled water system the unit must be located in the return close to the chiller.

The static head must not exceed 60 metres in a Heating system.

Maximum static head must not exceed 40 metres in a chilled water system.

N.B. if the static head is greater than these figures the efficiency of the CleanVent & MagVent is reduced

Commissioning


The CleanVent requires no special commissioning. All units are fitted with a fast bleed valve, which should be used when initially filling the system. The same valve is used for draining off floating scum and also prevents the possibility of dirt clogging the air vent.

Most of the dissolved air will be removed in a few days. However this may vary from system to system, In large systems it may take several weeks.

Flanges

All flanges are drilled to BS4504 PN16 as standard. Other flange ratings are available on request.

1 YEAR
WARRANTY



User's Guide



Shop online at

omega.com®
ΩOMEGA®

omega.com
[e-mail: info@omega.com](mailto:info@omega.com)
For latest product manuals:
omegamanual.info

ISO 9001
CERTIFIED
CORPORATE QUALITY
STAMFORD, CT

ISO 9001
CERTIFIED
CORPORATE QUALITY
MANCHESTER, UK

FST-200 & FST-300 Series Thermal Dispersion Flow Switches

omega.com®

ΩMEGA®

OMEGAnet® Online Service
omega.com

Internet e-mail
info@omega.com

Servicing North America:

U.S.A.:
ISO 9001 Certified

Omega Engineering, Inc., One Omega Drive, P.O. Box 4047
Stamford, CT 06907-0047 USA
Toll Free: 1-800-826-6342
FAX: (203) 359-7700

TEL: (203) 359-1660
e-mail: info@omega.com

Canada:

976 Bergar
Laval (Quebec), Canada H7L 5A1
Toll-Free: 1-800-826-6342
FAX: (514) 856-6886

TEL: (514) 856-6928
e-mail: info@omega.ca

For immediate technical or application assistance:

U.S.A. and Canada: Sales Service: 1-800-826-6342/1-800-TC-OMEGA®
Customer Service: 1-800-622-2378/1-800-622-BEST®
Engineering Service: 1-800-872-9436/1-800-USA-WHEN®

Mexico: En Espanol: 001 (203) 359-7803
info@omega.com.mx

FAX: (001) 203-359-7807
e-mail: espanol@omega.com

Servicing Europe:

Benelux:

Managed by the United Kingdom Office
Toll-Free: 0800 099 3344
FAX: +31 20 643 46 43

TEL: +31 20 347 21 21
e-mail: sales@omega.nl

Czech Republic:

Frystatska 184
733 01 Karviná, Czech Republic
Toll-Free: 0800-1-66342
FAX: +420-59-6311114

TEL: +420-59-6311899
e-mail: info@omegashop.cz

France:

Managed by the United Kingdom Office
Toll-Free: 0800 466 342
FAX: +33 (0) 130 57 54 27

TEL: +33 (0) 161 37 29 00
e-mail: sales@omega.fr

Germany/Austria:

Daimlerstrasse 26
D-75392 Deckenpfronn, Germany
Toll-Free: 0 800 6397678
FAX: +49 (0) 7056 9398-29

TEL: +49 (0) 7059 9398-0
e-mail: info@omega.de

United Kingdom:

ISO 9001 Certified

OMEGA Engineering Ltd.
One Omega Drive, River Bend Technology Centre, Northbank
Irlam, Manchester M44 5BD England
Toll-Free: 0800-488-488
FAX: +44 (0)161 777-6622

TEL: +44 (0)161 777-6611
e-mail: sales@omega.co.uk

It is the policy of OMEGA Engineering, Inc. to comply with all worldwide safety and EMC/EMI regulations that apply. OMEGA is constantly pursuing certification of its products to the European New Approach Directives. OMEGA will add the CE mark to every appropriate device upon certification.

The information contained in this document is believed to be correct, but OMEGA accepts no liability for any errors it contains, and reserves the right to alter specifications without notice.

WARNING: These products are not designed for use in, and should not be used for, human applications.

Offered in liquid and gas sensor types, the general purpose flow switch provides reliable low or no-flow detection of relatively clean, non-coating media with one 1A relay output. Liquid examples in clued water and acetic acid. Available in Polypropylene-PPS or PVDF, the short flow sensor is used in pipe or ducting from ½" to 1-1/2", and the long flow sensor is used in 2" and up. The flow switch set point may be adjusted from 0.,04 to 3 fps in liquids or 1 to 90 fps in gases as a low-flow alarm. The flow sensor is best applied in applications with relatively constant temperatures.




New Features

- Rugged Polypropylene-PPS or PVDF sensor for corrosive liquids and gasses.
- Adjustable set point with LED for flow or no-flow status indication.
- 60VA relay selectable NO or NC via power supply wiring polarity
- Solid State sensor is not damaged by over-ranging flow velocities.



Table of Contents

Specifications:	4
Make a Fail-Safe System:	4
Dimensions:	5
Configurations:	5
Safety Precautions:	6
Introduction:	7
Technology:	7
Initializing Sequence for FST-200 Series:	7
Set Points:	7
Installation:	8
Wiring:	9
Supply Voltage:	9
Signal Output:	9
Wiring to an Omega Engineering Controller:	9
Wiring the Relay Output:	10
Wiring as a P-Channel or N-Channel Output:	11
Calibration:	12
Set Point:	12
Maintenance:	13
Cleaning Procedure:	13
Testing the Sensor (FST-200 Series Only):	13
Testing the Sensor (FST-300 Series Only):	14

Set point range:	FST-200: .04 to 3 fps (.012 to .91 mps)
	FST-300: 1 to .90 fps (.3 to 27 mps)
Factory set point:	FST-200: .2 fps (.06 mps)
	FST-300: 10 fps (3 mps)
Repeatability:	$\pm 5\%$ of set point @ fixed temp.
Response time:	1-10 seconds
Set point adjust.:	Potentiometer
LED indication:	Flow Status
Viscosity range:	1-200 centipoise (FST-200 series only)
Supply Voltage:	14-36 VDC
Consumption:	70 mA maximum
Contact type:	(1) SPST relay
Contact rating:	60 VA, 1A max
Contact output:	Selectable NO/NC
Process temp.:	F: 32° to 140° C: 0° to 60°
Electronics temp.	F: -40° to 140° C: -40° to 60°
Pressure:	150 psi (10 bar) @ 25°C., derated @ 1.667 psi (.113 bar) per °C. Above 25°C.
Sensor rating:	NEMA 4X (IP65)
Sensor Material:	FST-211/-221/-321/-323: PP-PPS FST-212/-222/-322/-324: PVDF
Cable jacket mat.:	FST-211/-221/-321/-323: PP FST-212/-222/-322/-324: PFA
Cable type:	4-conductor, #22 AWG (shielded)
Cable length:	10' (3m)
Process mount:	3/4" NPT (3/4" G/Rp)
Mount. Gasket:	FKM (G version only)
Classification:	General purpose
CE compliance:	EN 61326 EMC EN 61010-1 safety

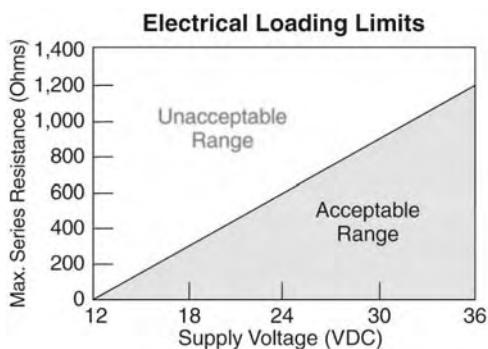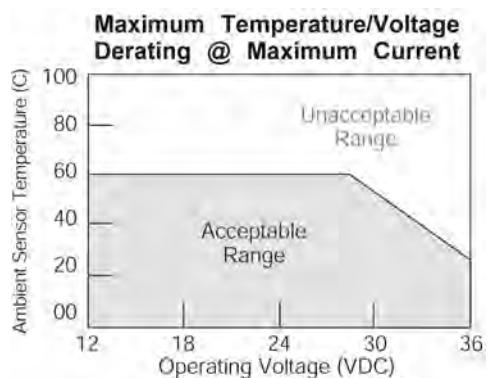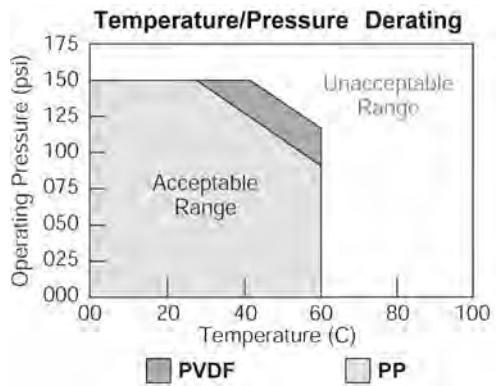

⚠ Make a Fail-Safe System: Design a fail-safe system that accommodates the possibility of switch and/or power failure. OMEGA ENGINEERING recommends the use of redundant backup systems and alarms in addition to the primary system. Adding a redundant alarm switch to the system is a cost effective means to prevent costly run-dry issues.

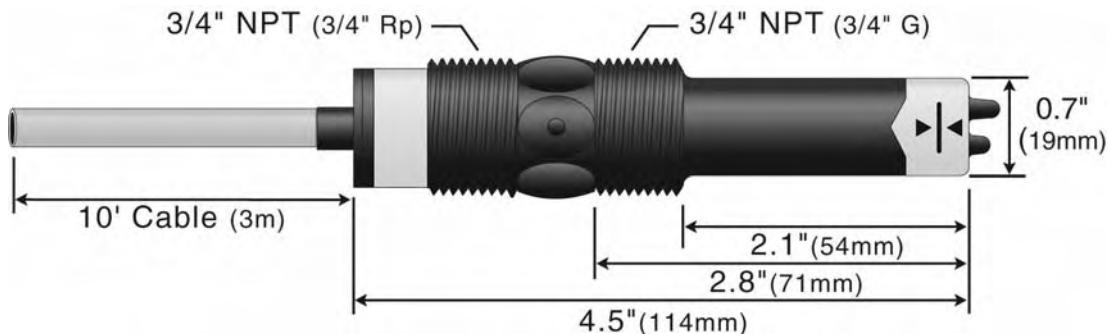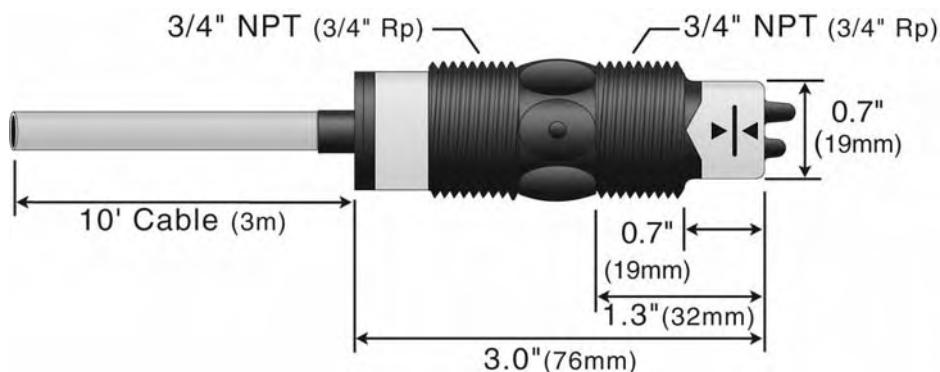Long Sensor (FST-221/-222/-323/-324)**Short Sensor (FST-211/-212/-321/-322)****Configurations (Liquid Flow Switches):**

Part Number	Length	Material (body)	Material (cable)	Thread (inside x outside)
FST-211-SPST	Short (3")	PP-PPS	Polypropylene	3/4" NPT x 3/4" NPT
FST-212-SPST	Short (3")	PVDF	PFA	3/4" NPT x 3/4" NPT
FST-221-SPST	Long (4.5")	PP-PPS	Polypropylene	3/4" NPT x 3/4" NPT
FST-222-SPST	Long (4.5")	PVDF	PFA	3/4" NPT x 3/4" NPT

Configurations (Gas Flow Switches):

Part Number	Length	Material (body)	Material (cable)	Thread (inside x outside)
FST-321-SPST	Short (3")	PP-PPS	Polypropylene	3/4" NPT x 3/4" NPT
FST-322-SPST	Short (3")	PVDF	PFA	3/4" NPT x 3/4" NPT
FST-323-SPST	Long (4.5")	PP-PPS	Polypropylene	3/4" NPT x 3/4" NPT
FST-324-SPST	Long (4.5")	PVDF	PFA	3/4" NPT x 3/4" NPT

Note: The above products ship with a standard 10' cable length. Adding “-25” to the end of the part number indicates that the product has a 25' cable length (ex. FST-211-SPST-25). Adding “-50” to the end of the part number indicates that the product has a 50' cable length (ex. FST-321-SPST-50).

! About this Manual: PLEASE READ THE ENTIRE MANUAL PRIOR TO INSTALLING OR USING THIS PRODUCT. This manual includes information on all models of Omega Engineering Thermal Dispersion Flow Switches: FST-200 and FST-300 series. Please refer to the part number located on the switch label to verify the exact model which you have purchased.

! User's Responsibility for safety: Omega Engineering manufactures a wide range of flow switches and technologies, while each of these sensors is designed to operate in a wide variety of applications; it is the user's responsibility to select a sensor model that is appropriate for the application, install it properly, perform tests of the installed system, and maintain all components. The failure to do so could result in property damage or serious injury.

! Proper Installation and Handling: Because this is an electrically operated device, only properly trained staff should install and/or repair this product. Use a proper sealant with all installations. **Note:** Always install the 3/4" FKM gasket with all versions of Flow switches with metric threads. The G threaded version will not seal unless the gasket is properly installed. Never over tighten the sensor within the fitting, beyond a maximum of 80 inch-pounds torque. Always check for leaks prior to system start-up.

! Material Compatibility: The FST-200 and FST-300 series sensors are available in two different wetted materials. Models FST-211/-221/-321/-323 are made of Polypropylene (PP) with PPS tips. Models FST-212/-222/-322/-324 are made of Polyvinylidene Fluoride (PVDF). Make sure that the model you have selected is compatible with the application liquid. To determine the chemical compatibility between the sensor and its application liquids, refer to an industry reference such as the Compass Corrosion.

! Wiring and Electrical: The supply voltage used to power the sensor should never exceed a maximum of 36 volts DC. Electrical wiring of the sensor should be performed in accordance with all applicable national, state, and local codes.

! Flammable, Explosive and Hazardous Applications: DO NOT USE THE FST-200 or FST-300 SERIES GENERAL PURPOSE FLOW SWITCHES IN HAZARDOUS LOCATIONS.

! Warning !

- ! The rating for the relay is 60 VA, 1Amp max.**
- ! Omega Engineering's Thermal Dispersion flow switches are not recommendable for use with electrically charged application liquids. For most reliable operation, the liquid being measured may need to be electrically grounded.**
- ! The sensing tip of the sensor must always be submersed in the liquid and never exposed to air.**
- ! The liquid temperature must remain constant and not change throughout the process.**

Technology: The Thermal Dispersion flow switches measure liquid or gas temperature to determine changes in flow velocity. As fluid flows across the sensing tips, the temperature is reduced proportionately as a function of the flow rate. When a temperature or velocity shift reaches the user defined set point, the switch changes state indicating the appropriate flow condition (flow or no-flow).


OMEGA ENGINEERING's sophisticated electronics convert the temperature shift into a signal which indicates whether a flow or no-flow condition occurs. Depending on how the sensor is wired, this signal may be wired for normally open or normally closed circuits.

OMEGA ENGINEERING's Thermal Dispersion flow switches have no moving parts to clog or foul, making them suitable for a verity of applications, including non-coating and non-scaling liquids. The FST-200 series directly measure mass flow and can operate over board range of liquids from 0.4 to 1.2 specific gravity and 1 to 300 cp.


Initializing Sequence for FST-200 series: When the flow switch is powered up while submersed, the FST-200 series will immediately indicate flow before switching to its correct state. A time delay may be used to eliminate the initialization sequence. Omega Engineering's thermal dispersion relay controllers feature a 0 to 60 second time delay for your convenience.

Set Points: The FST-200 series liquid flow switch set point is factory calibrated to 0.2 fps and the FST-300 gas flow switch are set to 10 fps. To convert feet/sec to GPM, please refer to the chart below.

**FST-200 Series
Flow Rate vs. Velocity
(gpm vs. fps)**

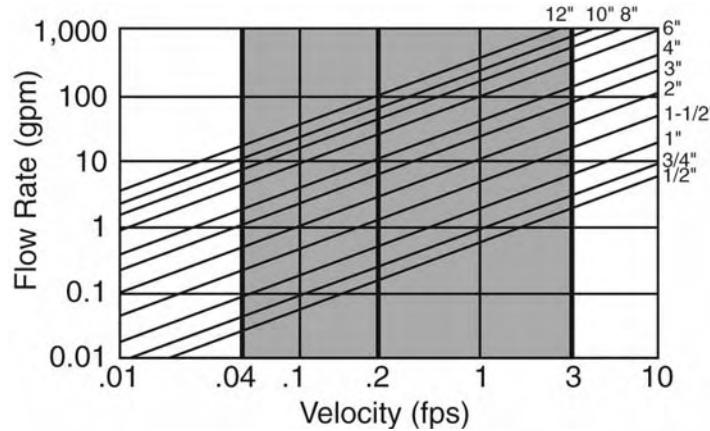


**FST-300 Series
Flow Rate vs. Velocity
(scfm vs. fps)**

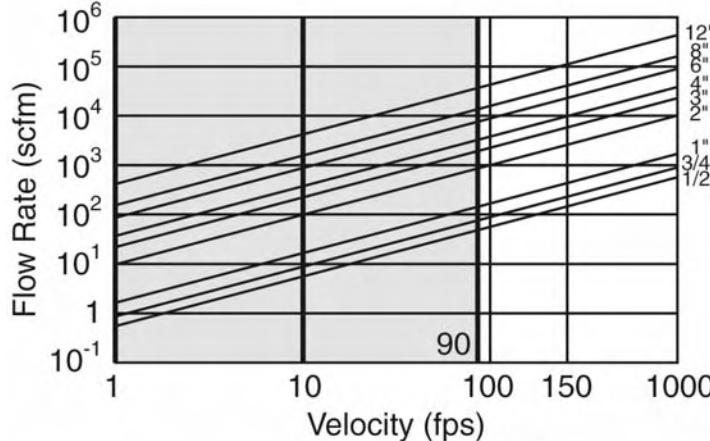


The FST-200 series flow switch must always be in contact with the liquid being measured. The FST-300 series flow switch must never be submerged in liquid. Both flow switches feature a 3/4" NPT threads which will allow it to be used with various types of fittings. Be sure to check the insertion depth of the flow switch in the fitting after it is installed. See the diagram to the right for the recommended insertion depth.

- The two tip of the sensor are to be perpendicular to the flow (as seen to the right). Never mount the tips with one in front of the other.

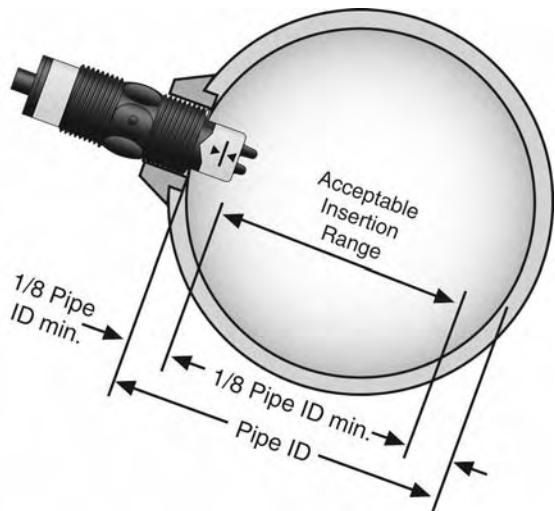

When using any type of fitting, the orientation as well as the insertion depth of the flow switch in the pipe is critical. See the diagram to the right for the recommended orientation.

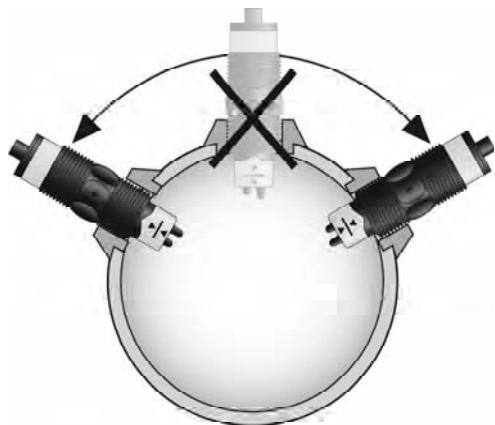

⚠ Warning !

- ⚠ The flow switch tips have a thin plastic wall which may be damaged if dropped or installed improperly.
- ⚠ The FST-200 series flow switch is designed for use in liquid. For best results, avoid installing the FST-200 series where bubbles are present or where the tips of the switch may be out of the liquid.
- ⚠ The FST-300 series flow switch is designed for use in gas applications. For best results, avoid installing the FST-300 series where it may be submerged in liquid.
- ⚠ Always install the FKM gasket with all versions of the model FST-212/-222/-322/-324. The G threaded version will not seal unless the gasket is properly installed.
- ⚠ The two temperature probes (tips) must always be perpendicular to the flow (see the flow at the same time).

Supply Voltage: The supply voltage to the Thermal Dispersion flow switch should never exceed a minimum output of 14 VDC or maximum output of 36 VDC.

Required Cable Length: Determine the length of the cable required between the Thermal Dispersion flow switch and its point of termination. Allow enough slack to ensure the easy installation, removal and/or maintenance of the sensor. The cable length may be extended up to a maximum of 1000 ft, using a well-insulated 14 to 20 gauge shielded four conductor cable.

Wire Stripping: Using a 10 gauge wire stripper, carefully remove the outer layer of insulation from the last 1-1/4" of the sensor's cable. Unwrap and discard the exposed foil shield from around the signal wires, leaving the drain wire attached if desired. With a 20 gauge wire stripper, remove the last 1/4" of the colored insulation from the signal wires.


Signal Output (Relay Switching):

Allows the sensor to switch a small load on or off directly, using an internal relay rated below 60 VA. The NO/NC status is set by the polarity of the voltage feeding the red and black wires. The green wire is the common for the relay and the white wire is the NO or NC, depending on the polarity of red and black.




Wiring to an Omega Engineering Controller:

LVCN-131/-141 Series Controller

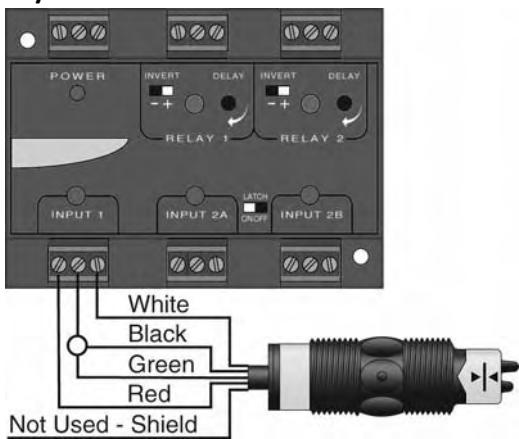


FLCN-100 Series Controller

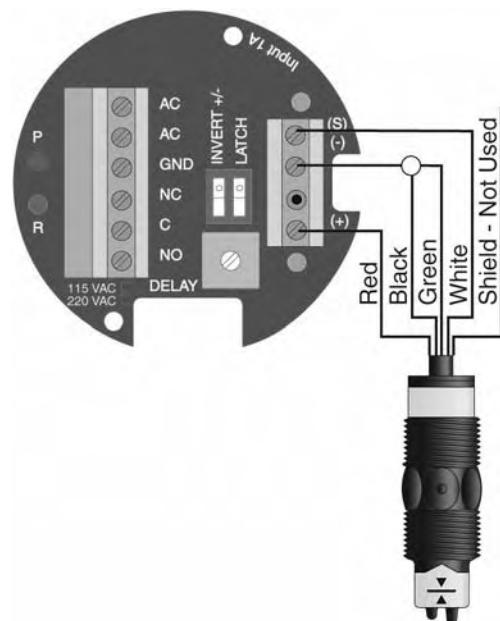

Wiring the Relay Output: The Flow switch relay output can be wired as a dry contact to a VDC or VAC power source. The flow switch does require 14-36 VDC power to operate the sensor and switch the relay. All installations below identify a dry switch state as the normal position of the relay.


Switching a Normally Open DC Load (Open during Flow, Closed during No-Flow):

The Red wire connects to Positive (+) of the power supply and the Black wire connects to Negative (-). The LOAD can be attached to either the Green or White wires. Complete the circuit by connecting the Green to (+) VDC power or White to (-) VDC power (see illustration to the right).

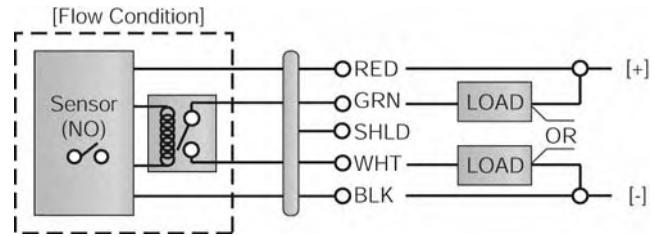


Switching a Normally Closed DC Load (Closed during Flow, Open during No-Flow):

The Black wire connects to positive (+) of the power supply and the Red wire connects to Negative (-). The Load can be attached to either the Green or White wires. Complete the circuit by connecting the Green to (+) VDC power or White to (-) VDC power (see illustration to the right).

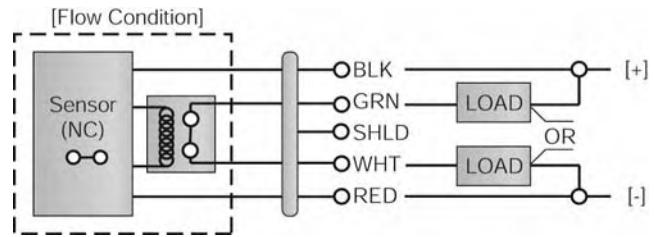


Switching a Normally Open AC Load (Open during Flow, Closed during No-Flow):

The Red wire connects to Positive (+) of the DC power supply and the Black wire connects to Negative (-). The LOAD can be attached to the Green wire and the Hot of the VAC power. Connect the white to the Neutral of the VAC power (see illustration to the right). Low voltage VAC is less than 36 VAC.

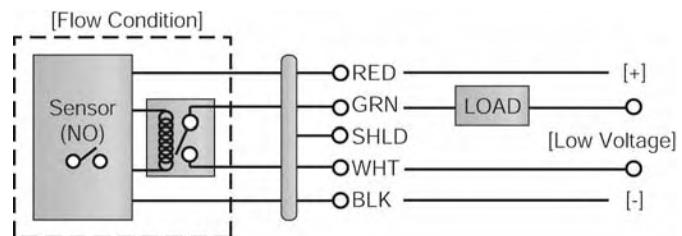

Switching a Normally Closed AC Load (Closed during Flow, Open during No-Flow):

The Black wire connects to Positive (+) of the DC power supply and the Red wire connects to Negative (-). The LOAD can be attached to the Green wire and the Hot of the VAC power. Connect the White to the Neutral of the VAC power (see illustration to the right). Low voltage VAC is less than 36 VAC.

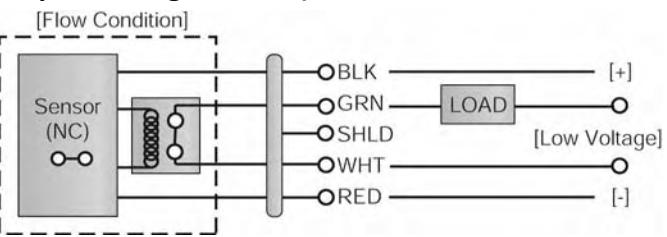

For all Sensor Wiring diagrams above:


Sensor Power: Red and Black Wires (36 VDC Max.)

Relay Rating: Green and White Wires (60VA, 1A Max.)

Wiring as a P-Channel or N-Channel output: The Flow switch can be substituted for either a P-Channel (PNP, Sourcing) output or N-Channel (NPN, sinking) output.


Normally Open DC Load as a P-Channel Output (Open during Flow, Closed during No-Flow):

To wire as a NO P-Channel output follow the directions below. The Red Wire connects to Positive (+) of the power supply and the Black wire connects to Negative (-). The Green wire is jumping to the Red wire while the White wire is connected to the LOAD. Jumper the LOAD back to the Negative (-) to complete the circuit.

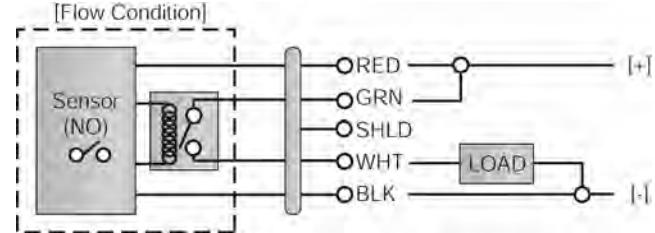


Normally Closed DC Load as a P-Channel Output (Closed during Flow, Open during No-Flow):

To wire as a NC P-Channel output, follow the directions below. The Black wire connects to Positive (+) of the power supply and the Red wire connects to Negative (-). The Green wire is jumping to the Black wire while the White wire is connected to the LOAD. Jumper the LOAD back to the Negative (-) to complete the circuit.

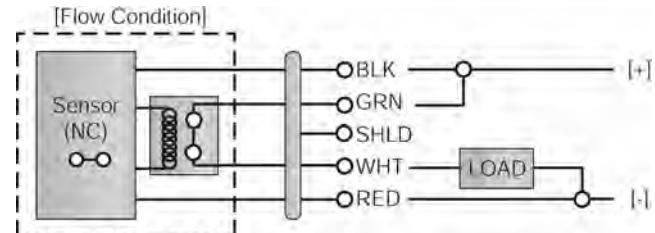


Normally Open DC Load as a N-Channel Output (Open during Flow, Closed during No-Flow):

To wire as a NO N-Channel output, follow the directions below. The Red wire connects to Positive (+) of the power supply and the Black wire connects to Negative (-). The white wire is jumping to the Black wire while the Green wire is connected to the LOAD. Jumper the LOAD back to the Positive (+) to complete the circuit.

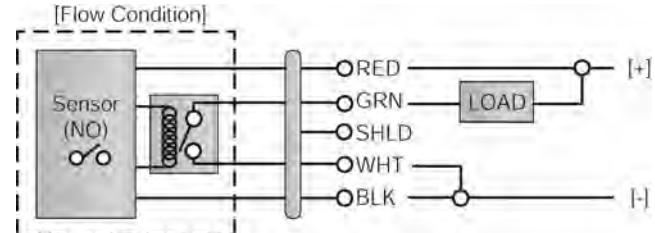

Normally Closed DC Load as a N-Channel Output (Closed during Flow, Open during No-Flow):

To wire as a NC N-Channel output, follow the directions below. The Black wire connects to Positive (+) of the power supply. The Black Wire connects to Negative (-). The white wire is jumping to the Red wire while the White wire is connected to the LOAD. Jumper the LOAD back to Positive (+) to complete the circuit.

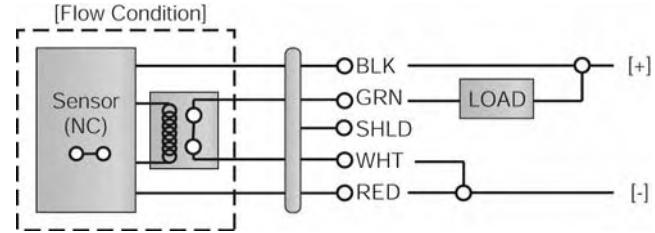

For all Sensor Wiring diagrams above:

Sensor Power: Red and Black Wires (36 VDC Max.)


Relay Rating: Green and White Wires (60VA, 1A Max.)

Set Point: If the preset factory calibration is not adequate for your application, follow the calibration steps listed below.

Note: The switch's internal LED will be on when the switch detects no-flow and will off when the switch detects flow, regardless of the polarity of the Red and Black wires. Reversing the Red and Black wires will reverse the polarity of the relay switch, but not the internal LED.

1. Install the fitting and flow switch as described in the Installation section of this manual. Turn the flow switch and controller power on and adjust the flow rate to the application setting. If the medium to be sensed is likely to be subject to any temperature variation, the flow switch should be set as the highest normal temperature likely to be encountered.
2. Locate the potentiometer knob at the top of the flow switch. The red LED is visible through the potentiometer. The adjustment is a single turn 270° potentiometer. The initial response time of the flow switch after adjustment is 1 to 10 seconds. Adjust the potentiometer in slow increments and wait for the response.
 - a. LED is ON - If the LED is on, slowly adjust the potentiometer counter-clockwise, with a small flat head screwdriver until the LED turn off.
 - b. LED is OFF - If the LED is off, slowly adjust the potentiometer clockwise, with a small flat head screwdriver until the light turns on.
3. Adjust the potentiometer back and forth where the LED is switching, eventually settling for where the LED is OFF (this is the low flow state for the switch).
 - a. If the flow is increased, the LED will remain OFF indicating a flow condition
 - b. If the flow is decrease, the LED will turn ON indicating a no-flow condition.
4. Verify that the new calibration is correct by lowering the system flow rate below the set point and check to see that the red LED turns on. Then increase the flow rate above the set point and verify that the red LED turns off accordingly.


**FST-200 Series Flow Switch
(Liquid Only)**

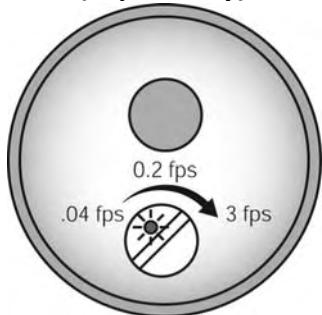

Potentiometer Location



**FST-300 Flow Switch
(Gas Only)**

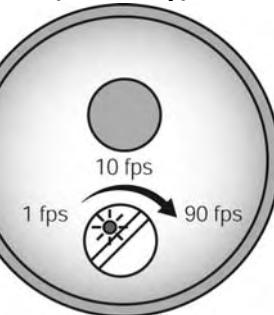

General: The Flow switch requires no periodic maintenance except to clean off any deposits or scaling from the sensor tip as necessary. It is the responsibility of the user to determine the appropriate maintenance schedule, based on the specific characteristics of the application liquids.

Cleaning Procedure:

1. **Power:** Make sure that all power to the sensor, controller and/or power supply is completely disconnected.
2. **Sensor Removal:** *Make sure that the flow is off and the pressure is down prior to removing the Flow switch.* Carefully, remove the sensor from the installation. Replace the sensor with a 3/4" NPT plug to insure that the liquid does not leak out during this procedure. *Do not re-install the Flow switch if the threads are damaged.*
3. **Cleaning the sensor:** Use a soft bristle brush and mild detergent, carefully wash the Thermal Dispersion flow switch. Do not use harsh abrasives such as steel wool or sandpaper, which might damage the surface sensor. Do not use incompatible solvents which may damage the surface sensor. Do not use incompatible solvents which may damage the sensor's PP/Ryton or PVDF plastic body.
4. **Sensor Installation:** Follow the appropriate steps of installation as outlined in the installation section of this manual.

Testing the Sensor (FST-200 Series Only):

1. **Immersing the switch:** Place the switch in a cup of water. Make sure the tips are submersed in the water.
2. **Power:** Turn on power to the switch with Red to (+) and Black to (-). You can reverse the polarity if desired.
3. **No-Flow/Flow Test:** With the switch setting still in the cup, wait until the Red LED turns ON (no-flow condition).
 - a. Swirl the switch in the cup and wait until the Red LED turn OFF (flow condition).
 - b. Stop swirling the sensor and let it rest in the cup waiting for the Red LED to turn ON again (no-flow condition).
 - c. Repeat the above two steps.
4. **Relay Test:** Connect a multimeter (set to read Ohms) to the White and Green Wires. Perform the above No-Flow/Flow test with the multimeter connect to observe the actuation of the relay.
 - a. With Red to (+) and Black to (-), the multimeter will read a small resistance during no-flow (closed relay) and OL during a flow condition (open relay).
 - b. Reverse Polarity [Red to (-) and Black to (+)] to see the multimeter read OL during a no-flow state (open relay) and a small resistance during a flow condition (closed relay).

The No-Flow/Flow test determines if the switch is capable of sensing the changes between no-flow and flow. The Relay test determines the ability of the relay to switch between a no-flow and flow condition. This is the basic test to determine functionality of the sensor.

Testing the Sensor (FST-300 Series Only):

1. **Creating a No-Flow Test Point:** The purpose of this step is to create a no-flow state for the sensor to be tested against. Since this is a low flow switch, even a buildings HVAC system can create a flow that the sensor can read.
 - a. Place the switch on a table and place an empty cup over the sensing tips.
 - b. The cup will act like a shield to protect the sensor from air flow.
2. **Power:** Turn on power to the switch with Red to (+) and Black to (-). You can reverse the polarity if desired.
3. **No-Flow/Flow Test:** With the switch setting still under the cup, wait until the Red LED turns ON (no-flow condition).
 - a. Remove the cup and move the sensor in air and observe when the Red LED turn OFF (flow condition).
 - b. Place the sensor on the table and place the cup over the sensor and let it rest waiting for the Red LED to turn ON again (no-flow condition).
 - c. Repeat the above two steps.
4. **Relay Test:** Connect a multimeter (set to read Ohms) to the White and Green Wires. Perform the above No-Flow/Flow test with the multimeter connect to observe the actuation of the relay.
 - a. With Red to (+) and Black to (-), the multimeter will read a small resistance during no-flow (closed relay) and OL during a flow condition (open relay).
 - b. Reverse Polarity [Red to (-) and Black to (+)] to see the multimeter read OL during a no-flow state (open relay) and a small resistance during a flow condition (closed relay).

The No-Flow/Flow test determines if the switch is capable of sensing the changes between no-flow and flow. The Relay test determines the ability of the relay to switch between a no-flow and flow condition. This is the basic test to determine functionality of the sensor.



WARRANTY/DISCLAIMER

OMEGA ENGINEERING, INC. warrants this unit to be free of defects in materials and workmanship for a period of **13 months** from date of purchase. OMEGA's WARRANTY adds an additional one (1) month grace period to the normal **one (1) year product warranty** to cover handling and shipping time. This ensures that OMEGA's customers receive maximum coverage on each product.

If the unit malfunctions, it must be returned to the factory for evaluation. OMEGA's Customer Service Department will issue an Authorized Return (AR) number immediately upon phone or written request. Upon examination by OMEGA, if the unit is found to be defective, it will be repaired or replaced at no charge. OMEGA's WARRANTY does not apply to defects resulting from any action of the purchaser, including but not limited to mishandling, improper interfacing, operation outside of design limits, improper repair, or unauthorized modification. This WARRANTY is VOID if the unit shows evidence of having been tampered with or shows evidence of having been damaged as a result of excessive corrosion; or current, heat, moisture or vibration; improper specification; misapplication; misuse or other operating conditions outside of OMEGA's control. Components in which wear is not warranted, include but are not limited to contact points, fuses, and triacs.

OMEGA is pleased to offer suggestions on the use of its various products. However, OMEGA neither assumes responsibility for any omissions or errors nor assumes liability for any damages that result from the use of its products in accordance with information provided by OMEGA, either verbal or written. OMEGA warrants only that the parts manufactured by the company will be as specified and free of defects. OMEGA MAKES NO OTHER WARRANTIES OR REPRESENTATIONS OF ANY KIND WHATSOEVER, EXPRESSED OR IMPLIED, EXCEPT THAT OF TITLE, AND ALL IMPLIED WARRANTIES INCLUDING ANY WARRANTY OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY DISCLAIMED. LIMITATION OF LIABILITY: The remedies of purchaser set forth herein are exclusive, and the total liability of OMEGA with respect to this order, whether based on contract, warranty, negligence, indemnification, strict liability or otherwise, shall not exceed the purchase price of the component upon which liability is based. In no event shall OMEGA be liable for consequential, incidental or special damages.

CONDITIONS: Equipment sold by OMEGA is not intended to be used, nor shall it be used: (1) as a "Basic Component" under 10 CFR 21 (NRC), used in or with any nuclear installation or activity; or (2) in medical applications or used on humans. Should any Product(s) be used in or with any nuclear installation or activity, medical application, used on humans, or misused in any way, OMEGA assumes no responsibility as set forth in our basic WARRANTY/DISCLAIMER language, and, additionally, purchaser will indemnify OMEGA and hold OMEGA harmless from any liability or damage whatsoever arising out of the use of the Product(s) in such a manner.

RETURN REQUESTS/INQUIRIES

Direct all warranty and repair requests/inquiries to the OMEGA Customer Service Department. BEFORE RETURNING ANY PRODUCT(S) TO OMEGA, PURCHASER MUST OBTAIN AN AUTHORIZED RETURN (AR) NUMBER FROM OMEGA'S CUSTOMER SERVICE DEPARTMENT (IN ORDER TO AVOID PROCESSING DELAYS). The assigned AR number should then be marked on the outside of the return package and on any correspondence.

The purchaser is responsible for shipping charges, freight, insurance and proper packaging to prevent breakage in transit.

FOR **WARRANTY** RETURNS, please have the following information available BEFORE contacting OMEGA:

1. Purchase Order number under which the product was PURCHASED,
2. Model and serial number of the product under warranty, and
3. Repair instructions and/or specific problems relative to the product.

FOR **NON-WARRANTY** REPAIRS, consult OMEGA for current repair charges. Have the following information available BEFORE contacting OMEGA:

1. Purchase Order number to cover the COST of the repair,
2. Model and serial number of the product, and
3. Repair instructions and/or specific problems relative to the product.

OMEGA's policy is to make running changes, not model changes, whenever an improvement is possible. This affords our customers the latest in technology and engineering.

OMEGA is a registered trademark of OMEGA ENGINEERING, INC.

© Copyright 2009 OMEGA ENGINEERING, INC. All rights reserved. This document may not be copied, photocopied, reproduced, translated, or reduced to any electronic medium or machine-readable form, in whole or in part, without the prior written consent of OMEGA ENGINEERING, INC.

Where Do I Find Everything I Need for Process Measurement and Control? OMEGA...Of Course!

Shop online at omega.comSM

TEMPERATURE

- Thermocouple, RTD & Thermistor Probes, Connectors, Panels & Assemblies
- Wire: Thermocouple, RTD & Thermistor
- Calibrators & Ice Point References
- Recorders, Controllers & Process Monitors
- Infrared Pyrometers

PRESSURE, STRAIN AND FORCE

- Transducers & Strain Gages
- Load Cells & Pressure Gages
- Displacement Transducers
- Instrumentation & Accessories

FLOW/LEVEL

- Rotameters, Gas Mass Flowmeters & Flow Computers
- Air Velocity Indicators
- Turbine/Paddlewheel Systems
- Totalizers & Batch Controllers

pH/CONDUCTIVITY

- pH Electrodes, Testers & Accessories
- Benchtop/Laboratory Meters
- Controllers, Calibrators, Simulators & Pumps
- Industrial pH & Conductivity Equipment

DATA ACQUISITION

- Data Acquisition & Engineering Software
- Communications-Based Acquisition Systems
- Plug-in Cards for Apple, IBM & Compatibles
- Datalogging Systems
- Recorders, Printers & Plotters

HEATERS

- Heating Cable
- Cartridge & Strip Heaters
- Immersion & Band Heaters
- Flexible Heaters
- Laboratory Heaters

ENVIRONMENTAL MONITORING AND CONTROL

- Metering & Control Instrumentation
- Refractometers
- Pumps & Tubing
- Air, Soil & Water Monitors
- Industrial Water & Wastewater Treatment
- pH, Conductivity & Dissolved Oxygen Instruments

Rosemount 2110 Compact Vibrating Fork Liquid Level Switch

- Function virtually unaffected by flow, turbulence, bubbles, foam, vibration, solids content, coating, properties of the liquid, and product variations
- No need for calibration and requires minimum installation procedures
- Polarity insensitive and short circuit protection
- Industry standard plug/socket connection
- No moving parts or crevices means virtually no maintenance
- Electronic, self-checking, and condition monitoring - Heartbeat LED gives status and health information
- Magnetic test point makes functional test easy
- Compact design, small in size and weight
- "Fast Drip" Fork Design gives quicker response time especially with viscous liquids
- Hygienic connections



DIBt

Contents

Reliable Performance...In Challenging Applications	page 2
Rosemount 2110 Compact Vibrating Fork Liquid Level Switch.	page 4
Specifications	page 5
Product Certifications	page 6
Dimensional Drawing	page 7

Reliable Performance...In Challenging Applications

MEASUREMENT PRINCIPLE

The Rosemount 2110 is designed using the principle of a tuning fork. A piezo-electric crystal oscillates the forks at their natural frequency. Changes to this frequency are continuously monitored. The frequency of the vibrating fork sensor changes depending on the medium in which it is immersed. The denser the liquid, the lower the frequency.

When used as a **low level alarm**, the liquid in the tank or pipe drains down past the fork, causing a change of natural frequency that is detected by the electronics and switches the output state.

When the 2110 is used as a **high level alarm**, the liquid rises in the tank or pipe, making contact with the fork which then causes the output state to switch.

KEY FEATURES AND BENEFITS

- Virtually unaffected by turbulence, foam, vibration, solids content, coating, or liquid properties
- Stainless steel housing and plug/socket connection for the fast fit, high volume user
- Compact and lightweight design for side or top mounting
- The industry standard DIN 43650 plug/socket is used for a fast connection. The polarity insensitivity and short circuit protection make electrical hook-up safe and easy
- The 2110 is designed for operation in temperatures from -40 to 302 °F (-40 to 150 °C)
- The 'heartbeat' LED gives status and health information on the 2110
- 'Fast Drip' fork design gives quicker response time, especially with viscous liquids
- Rapid wet-to-dry time for highly responsive switching
- Fork shape is optimized for hand polishing to meet hygienic requirements
- No moving parts or crevices for virtually no maintenance

Threaded Process Connection

Tri-Clamp Process Connection



Compact And Lightweight

'Fast Drip' Forks



Product Data Sheet

00813-0100-4029, Rev DA

November 2010

Rosemount 2110

Fit and Forget

- Once installed, the 2110 is ready to go.
It needs no calibration and requires minimum installation
- The 'heartbeat' LED gives an instant visual indication that the unit is operational
- Functional testing of the instrument and system is easy with a magnetic test point
- You can install, and forget it

Superior Performance


- Functionality is virtually unaffected by flow, turbulence, bubbles, foam, or vibration
- The 'Fast Drip' design allows the liquid to be quickly drawn away from the fork tip, making the 2110 quicker and more responsive in high density or viscous liquid applications
- With a user-selectable time delay feature, the risk of false switching is minimized in turbulent or splashing applications

APPLICATIONS


- Overfill protection
- High and low level alarms
- Leak detection
- Run dry or pump protection
- Pump control or limit detection
- Hygienic applications



Overfill Protection



High And Low Level Alarm

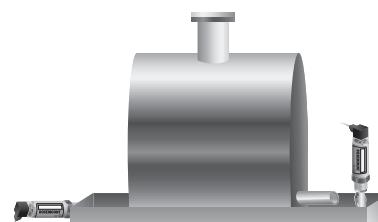

Leak Detection



Pump Protection

Rosemount 2110

Compact Vibrating Fork Liquid Level Switch



2110 Level Switch

Rosemount 2110 capabilities include:

- Rugged stainless steel body and fork, the ideal choice for OEM applications
- Compact design, small and lightweight, perfect for small tank or pipe installations
- Short fork or semi-extended lengths
- Direct load switching or PNP/PLC electronics
- Safe area only

Additional Information

Specifications: page 5
Certifications: page 6

Dimensions: page 7

TABLE 1. 2110 Ordering Information

★The Standard offering represents the most common options. The starred options (★) should be selected for best delivery.
The Expanded offering is subject to additional delivery lead time.

Model	Product Description	
2110	Compact Vibrating Fork Liquid Level Switch	
Electronic Type		
Standard		Standard
0	Direct load switching with plug connection (2 wire) 21 to 264 Vac 50/60Hz, 21 to 264 Vdc	★
1	PNP/PLC low voltage switching with plug connection 18 to 60 Vdc	★
Process Connection Size / Type		
Standard		Standard
0A	3/4-in. BSPT (R) thread	★
1A	1-in. BSPT (R) thread	★
0D	3/4-in. NPT thread	★
2R	2-in. (51 mm) Tri-clamp	★
1B	1-in. BSPP (G) thread	★
1L	1-in. BSPP (G) Semi-extended 4.6 in. (116 mm)	★
Product Certificates		
Standard		Standard
NA	No hazardous locations certifications (safe area use only)	★
U1	DIBt/WHG Overfill protection	★
OPTIONS		
Calibration Data Certificate		
Standard		Standard
Q4	Certificate of functional test	★
Tag Plate		
Standard		Standard
ST	Tag plate SST engraved plate (maximum 16 digits)	★
WT	Tag plate laminated paper (maximum 40 digits)	★
Typical Model Number: 2110 0 2R NA		

TABLE 2. Spare Parts and Accessories

★The Standard offering represents the most common options. The starred options (★) should be selected for best delivery.
The Expanded offering is subject to additional delivery lead time.

Spares and Accessories		
Standard		Standard
02100-1000-0001	Seal for 1-in. BSPP (G1A). Material: Non-asbestos BS7531 grade X carbon fiber with rubber binder	★
02100-1010-0001	Hygienic adaptor boss for 1-in. BSPP model. Material: 316 SST fitting. Fluorocarbon (FPM/FKM) O-ring	★
02100-1020-0001	Hygienic mounting kit for 2-in. (51 mm) Tri-clamp model. Includes vessel fitting, clamp ring, and seal. Material: 316 SST and NBR Nitrile	★
02100-1030-0001	Telescopic test magnet	★

Product Data Sheet

00813-0100-4029, Rev DA

November 2010

Rosemount 2110

Specifications

PHYSICAL

Product

Rosemount 2110 Compact Liquid Level Switch

Measuring principle

Vibrating Fork

Applications

Most liquids including coating liquids, aerated liquids, and slurries

Mechanical

Process Material

316L Stainless Steel (1.4404)

For Tri-Clamp connection, hand polished to better than 0.8 µm. Gasket material for 1 in. BSPP (G1) is Non-asbestos BS7531 Grade X carbon fiber with rubber binder.

Housing Materials

Body: 304 SST with polyester label

LED window:

Flame retardant Polyamide (Pa12) UL94 V2

Plug: Polyamide glass reinforced

Plug seals: Nitrile butadiene rubber

Mounting

- 3/4-in. BSPT (R) or NPT
- 1-in. BSPT (R) or BSPP (G) thread, or
- Hygienic 2-in. (51 mm) Tri-clamp fitting

Dimensional Drawings

See "Dimensional Drawing" on page 7

Ingress of Protection Rating

IP66/67 to EN60529

PERFORMANCE

Hysteresis (water)

±0.039-in. (± 1 mm) nominal.

Switching Point (water)

0.5 in. (13 mm) from fork tip if mounted vertically.

0.5 in. (13 mm) from the fork edge if mounted horizontally.

The switch point varies with different liquid densities.

FUNCTIONAL

Maximum Operating Pressure

(The final rating depends on the process connection)


Threaded Connection

See Figure 1

Hygienic Connection

435 psig (30 barg)


Figure 1. Process Pressure

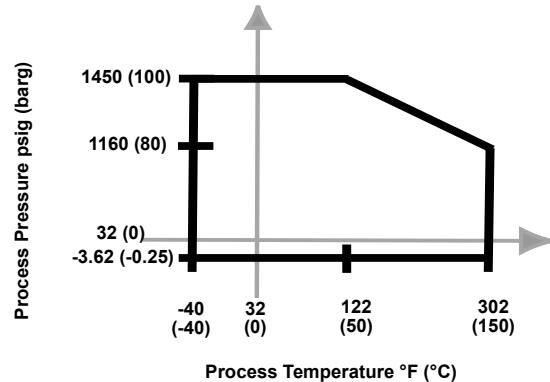

Temperature

See Figure 2 for the maximum and minimum operating temperatures.

Figure 2. Temperature

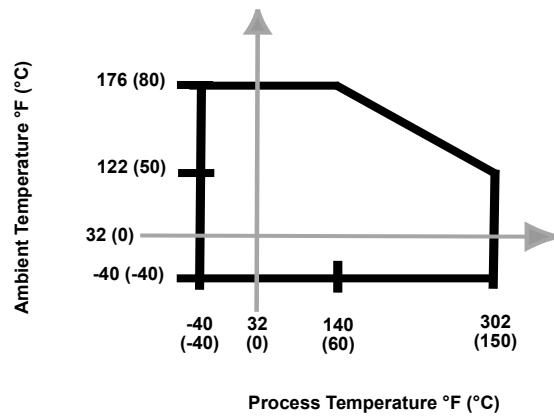

Liquid Density

Minimum 37.5 lb/ft³ (600 kg/m³)

Liquid Viscosity Range

0.2 to 10000 cP (centiPoise)

Solids Content and Coating

Maximum recommended diameter of solid particles in the liquid is 0.2 in. (5 mm).

For coating product, avoid 'bridging' of forks.

Switching Delay

1 second dry-to-wet or wet-to-dry

CIP (Clean In Place) Cleaning

Withstands steam cleaning routines up to 302 °F (150 °C)

Electrical

Switching Mode

User selectable (Dry=on or Wet=on) by selecting plug wiring

Cable Connection

Via 4-way plug provided (DIN43650).

Max. conductor size is 15AWG.

4-position orientation (90/180/270/360 deg.).

Conductor Size

Maximum 0.06 in.² (1,5 mm²)

Cable Gland

PG9 provided. Cable diameter 0.24 to 0.31 in. (6 to 8 mm)

Protection


Polarity insensitive. Over-current, short circuit, and load-missing protection. Surge protection to IEC61326.

Grounding

The 2110 should always be grounded either through the terminals or using the external ground connection provided.


Direct Load Switching (Electronics Type Code 0)

Operating Voltage	21 to 264 Vac (50 to 60 Hz)/dc
Maximum switched load	500 mA
Maximum peak load	5 A for 40 ms max.
Minimum switched load	20 mA continuous
Voltage drop	6.5 V @ 24 Vdc / 5 V @ 240 Vac
Current draw (load off)	<3.0 mA continuous

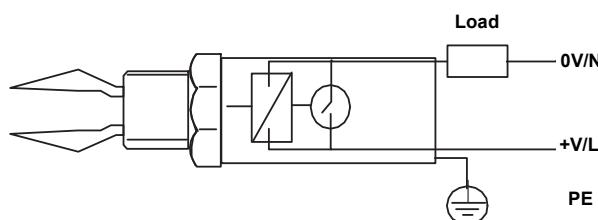

PNP Switching (Electronics Type Code 1)

Operating Voltage	18 to 60 Vdc
Maximum switched load	500 mA
Maximum peak load	5 A for 40 ms max.
Voltage drop	<3 V
Supply Current	3 mA nominal
Output current (load off)	<0.5 mA

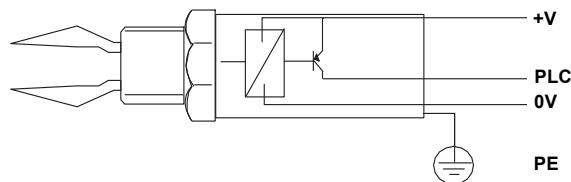

Product Certifications

L.V. Directive

EN61010-1 Pollution degree 2,
Category II (264V max),
Pollution degree 2, Category III (150 V maximum)

Electro Magnetic Compatibility (EMC) Directive

EN61326

Overfill Protection

If required, select Product Certificates code U1 for DIBt/WHG overfill protection.

The approval number is Z-65.11-236.

Canadian Registration Number (CRN)

The CRN is 0F04227.2C for model numbers with a NPT threaded process connection selected.


Product Data Sheet

00813-0100-4029, Rev DA

November 2010

Rosemount 2110

Dimensional Drawing

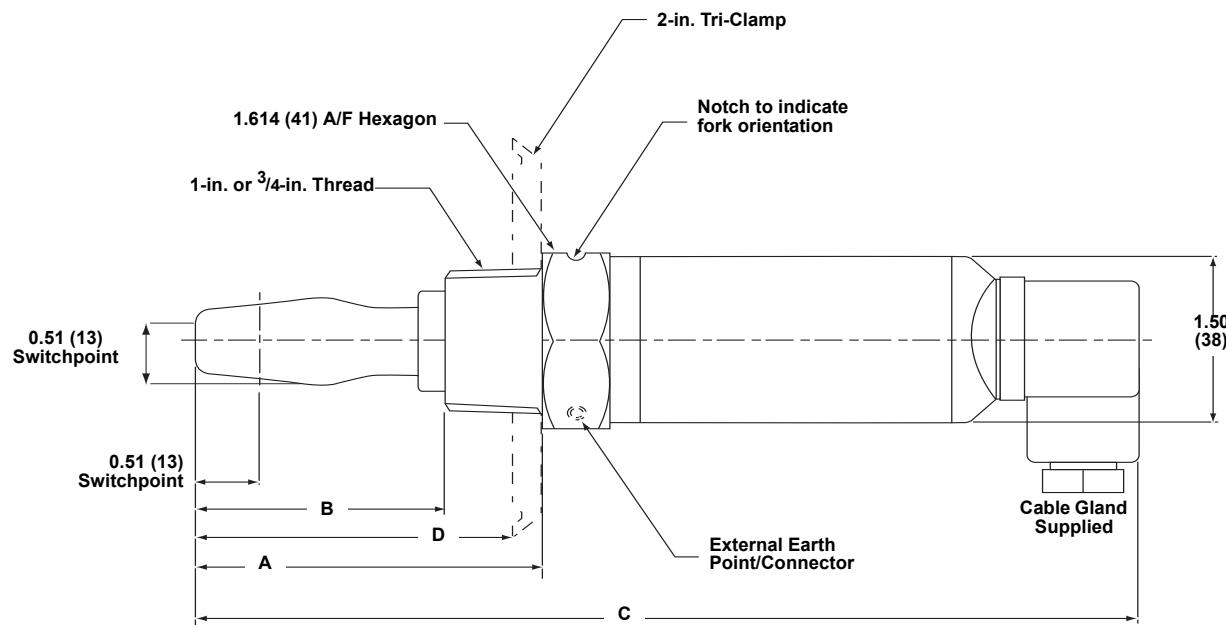

Process Connections	A	B	C	D
3/4-in. BSPT (R)	2.72 (69)	1.97 (50)	7.40 (188)	N/A
3/4-in. NPT	2.72 (69)	1.97 (50)	7.40 (188)	N/A
1-in. BSPT (R)	2.72 (69)	1.97 (50)	7.40 (188)	N/A
1-in. BSPP (G)	3.07 (78)	2.36 (60)	7.91 (201)	N/A
2-in. (51 mm) Tri-Clamp	2.72 (69)	1.97 (50)	7.40 (188)	2.52 (64)
1-in. Semi-extended	4.57 (116)	3.86 (98)	9.41 (239)	N/A

Rosemount 2110

Rosemount Level Solutions

Emerson provides a complete range of Rosemount products for level measurement applications.

Vibrating Fork Switches – Point Level Detection

For high and low alarms, overfill protection, pump control, including wide pressure and temperature requirements, and hygienic applications. Flexible mounting. Immune to changing process conditions and suitable for most liquids.

The product line consists of:

- Rosemount 2160 Wireless
- Rosemount 2130 Enhanced
- Rosemount 2120 Full-featured
- Rosemount 2110 Compact

Differential Pressure – Level or Interface Measurement

Flexible mounting for liquid tank levels, including those with wide temperature and pressure requirements. Can be isolated by valves. Unaffected by: vapor space changes, surface conditions, foam, corrosive fluids, internal tank equipment. Optimize performance with direct mount, Tuned-System Assemblies:

- Rosemount DP Level Transmitters and Remote Seals
- Rosemount 3051S_L, 3051L, and 2051L Liquid Level Transmitters

Ultrasonic – Level Measurement

Top mounted, non-contacting for simple tank and open air level measurements. Unaffected by fluid properties such as: density, viscosity, dirty coating, and corrosiveness. Appropriate for routine applications outside of explosion proof areas.

The product line consists of:

- Rosemount 3100 Series Ultrasonic Process Level Transmitters

Guided Wave Radar – Level and Interface Measurement

Top mounted, direct level and interface measurement of liquids or solids, including those with wide temperature and pressure requirements. Unaffected by changing process conditions. Good fit for small spaces and easy swap for older technologies. The product line consists of:

- Rosemount 5300 Series – Accurate, superior performance transmitter in most applications including process vessels and control
- Rosemount 3300 Series – Versatile and easy-to-use transmitter in most liquid storage and monitoring applications

Non-contacting Radar – Level Measurement

Top mounted, direct level measurement for liquids or solids, including those with wide temperature and pressure requirements. Can be isolated by valves. Unaffected by changing process conditions. Good for dirty, coating, and corrosive applications. The product line consists of:

- Rosemount 5400 Series – Accurate, superior performance 2-wire transmitters for most liquid level applications and process conditions
- Rosemount 5600 Series – 4-wire transmitters with maximum sensitivity and performance for solids, challenging reactors, rapid level changes, and excessive process conditions

Chambers for Process Level Instrumentation

- Rosemount 9901 – High quality chambers for external mounting of level measurement and control instrumentation on process vessels

The Emerson logo is a trademark and service mark of Emerson Electric Co.
Rosemount and the Rosemount logotype are registered trademarks of Rosemount Inc.
All other marks are the property of their respective owners.
Standard Terms and Conditions of Sale can be found at www.rosemount.com/terms_of_sale

© 2010 Rosemount, Inc. All rights reserved.

Emerson Process Management
Rosemount Measurement
8200 Market Boulevard
Chanhassen, MN 55317 USA
Tel (USA) 1 800 999 9307
Tel (International) +1 952 906 8888
Fax +1 952 949 7001
www.rosemount.com

Emerson Process Management
Blegistrasse 23
P.O. Box 1046
CH 6341 Baar
Switzerland
Tel +41 (0) 41 768 6111
Fax +41 (0) 41 768 6300

Emerson FZE
P.O. Box 17033
Jebel Ali Free Zone
Dubai UAE
Tel +971 4 811 8100
Fax +971 4 886 5465

Emerson Process Management
Asia Pacific Pte Ltd
1 Pandan Crescent
Singapore 128461
Tel +65 6777 8211
Fax +65 6777 0947
Service Support Hotline: +65 6770 8711
Email: Enquiries@AP.EmersonProcess.com



EMERSON
Process Management

THERMAL DISPERSION FLOW SWITCHES FOR LIQUIDS

FST-200 Series



- ✓ **High Reliability—
No Moving Parts**
- ✓ **Very Low Flow
Detection—Down to
0.04 FPS Liquids**
- ✓ **Use in $\frac{1}{8}$ to
12" Pipe or Tubing**
- ✓ **SPST Relay Standard**
- ✓ **Excellent for Pump
and Valve Monitoring
of Critical Flows**

OMEGA® FST-200 Series flow switches use thermal dispersion technology to create a very accurate and economical method of sensing flow. Monitor fluids from 0.4 to 1.2 specific gravity, 1 to 300 cp, and pulsating flow from 10 to 100 pulses per minute. The sensors incorporate two temperature probes, one of which is heated. The flow of liquid reduces the temperature of the heated probe, decreasing the temperature differential with the non-heated probe. OMEGA's LVCN Series of controllers can easily be interfaced to perform a variety of control functions.

SPECIFICATIONS

Range: 0.04 to 3 fps (liquids)

Accuracy: $\pm 5\%$ of setpoint at constant temperature and flowrate

Response Time: 10 sec after initial 30 sec warm up

Setpoint Drift With Fluid

Temperature: 0.5% per °C

Voltage Input: 12 to 36 Vdc @ 70 mA

Contact Output Mode:

Selectable, NO or NC states

Fluid Temperature: 0 to 60°C

(32 to 140°F)

Maximum Fluid Pressure: PP or PVDF: 150 psi @ 25°C (77°F) derated @ 1.667 psi per °C above 25°C (77°F)

Wetted Materials: PP and PVDF

Cable Specifications: 3 m (10')

Maximum Cable Length: 305 m (1000')

Dimensions:

76.2 or 114.3 L x 26.7 mm diameter
(3.0 or 4.5 x 1.05")

FST-221-SPST
shown actual size.

114 mm
(4.5")

114 mm
(4.5")

76 mm
(3")

FST-211-SPST
shown actual size.

To Order

Model No.	Description	Material	Size	Use With Pipe Size
FST-211-SPST	Thermal dispersion flow switch	PP/ PVDF	3.0 x $\frac{3}{4}$ NPT	$\frac{3}{4}$ to 1 $\frac{1}{2}$ "
FST-212-SPST	Thermal dispersion flow switch	PVDF	3.0 x $\frac{3}{4}$ NPT	$\frac{3}{4}$ to 1 $\frac{1}{2}$ "
FST-221-SPST	Thermal dispersion flow switch	PP/ PVDF	4.5 x $\frac{3}{4}$ NPT	2 to 12"
FST-222-SPST	Thermal dispersion flow switch	PVDF	4.5 x $\frac{3}{4}$ NPT	2 to 12"

Flow Switch Fittings For Use with 76 mm (3") Sensor Only (Also For Pulsating Flow Applications)


Model No.	Wetted Material	Range (GPM)	Use With Pipe/Tube ID
FT-51	PP	0.05 to 1.53	$\frac{1}{8}$ to $\frac{1}{2}$ "
FT-52	PVDF	0.05 to 1.53	$\frac{1}{8}$ to $\frac{1}{2}$ "

Comes complete with operator's manual.

Two extended cable lengths available: for 7.62 m (25') add suffix **-25** for PP/PVDF, or PVDF; for 15.24 m (50') add suffix **-50** for PP/PVDF or PVDF, for additional cost.

Note: Sizes above $\frac{1}{2}$ " fit into $\frac{3}{4}$ NPT fitting adaptor.

Ordering Examples: **FST-211-SPST**, flow switch, 3.0 x $\frac{3}{4}$ NPT size, plus **FT-51**, fitting.
FST-221-SPST, flow switch, 4.5 x $\frac{3}{4}$ NPT.



ABO valve

ABsolute flow control

SERIES 900

- // PN 6/10/16/Class 150
- // DN 32 - 1600 (1" ¼ - 64")
- // Industrial applications
- // Water, chemicals, gas
- // Oil & gas, air



CE

DW
VG

Lloyd's
Register



INTERFLANGES BUTTERFLY VALVES

GENERAL INFORMATION

GENERAL CHARACTERISTICS

- Concentric design
- Shut-off and regulating device
- Split shaft
- Pivot fixed by pin (or screw - option) allows demounting (demountable version)
- Long neck of the body according to Heating Systems Regulation standards
- Orange epoxy painting RAL 2002 - 80 µm
- Vacuum max 0,2 bar absolute
- Movement of disc ensured by four-squared endstem
- Certificate ATEX (Group II, Category 1/2 GD TX)
- Approved for demanding **GAS** applications by certificate DVGW

APPLICATIONS

Butterfly valves series 900 are suited for many applications where tight shut-off is required, such as:

- Industrial Processing
- Water and Wastewater
- Dry Bulk Conveying
- Light Slurry Handling
- Paper Mills
- Food and Beverage
- HVAC (Heating, Ventilating & Air Conditioning)
- Non-mining environments and explosive atmosphere consisting of dust and gas (zones 0, 1, 20 and 21)

STANDARDS

LEAK TEST:

- EN 12266-1, Rate A
- ISO 5208, Rate A
- API 598, TAB. 5

FACE TO FACE ACC.:

- EN 558, SERIES 20
- ISO 5752, SERIES 20
- API 609, TAB. 2

TOP FLANGE:

- EN ISO 5211

CONNECTION

BETWEEN FLANGES:

- EN 1092-1
- DIN 2631
- ASME B16.5

WORKING STANDARD:

- EN 593 + A1

TYPE DESIGNATION

9 2 4 B

Version of body

- B = wafer
- T = lug
- F = double flange

Material of disc

- 0 – Brass 2.0402
- 1 – Aluminium bronze 2.0966
- 2 – Stainless steel 1.4308 (CF8)*
- 3 – Ductile iron 0.7040 (GGG40)*
- 4 – Stainless steel 1.4408 (CF8M)*
- 5 – HASTELLOY
- 6 – Stainless steel 1.4539 (Uranus B6)
- 7 – Titanium
- * Halar + Rilsan Coating optional

Material of seat

- 1 – NBR
- 2 – EPDM
- 3 – Carboxylic NBR
- 4 – VITON (FPM)
- 5 – Silicone Steam (MQV)
- 6 – Silicone (VMQ)
- 7 – Epichlorohydrin
- 8 – HYPALON® (CSM)
- 9 - other variant

Series name

Series 900

Models

Wafer type B



Lug type T



Double flanged type F for DN 700 – DN 1600



PRODUCT QUALITY AND CONTROL



- ABO production facilities are certified in accordance to ISO 9001 quality system
- Test procedures are established according to: EN 12266-1, ISO 5208, API 598, ANSI/FCI 70-2
- Manufacture according to the requirements of the European Directive 97/23/CE – Equipment under pressure (Category III, modul B)
- All ABO valves pass pressure tests to 110% of rated pressure to ensure bubble tight shutoff
- All actuators are calibrated and cycle tested before shipment
- Material Traceability Rule – Certification is provided for all supplied valves as per customer's request
- Positive Material Identification
 - All materials are subjected to PMI testing in order to verify Material Traceability Certificate
- Certificates - Complete list of certificates can be found on www.abovalve.com



DESIGN BENEFITS

1) INTERNATIONAL STANDARD COMPATIBILITY

Top flange according to Standard ISO 5211 enables direct mounting of manual operators and power actuators. Longer necks of ABO butterfly valves result in insulation of ISO top flange (protection of mounted actuator) and meeting Heating Systems Regulation standards.

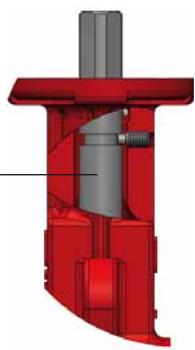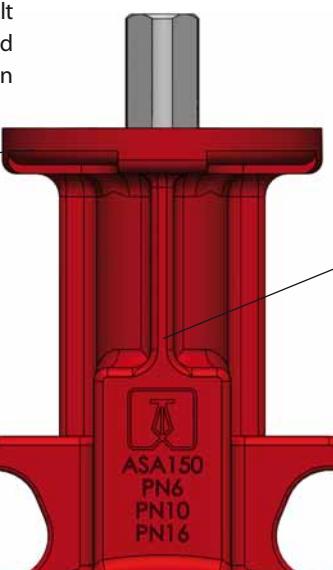

2) BLOW-OUT PROOF STEM SYSTEM

No up-movement of stem is ensured by securing pin in the body neck.


3) SEAT DESIGN

Seat is anchored in the body (groove and tongue design) and its movement is ensured by four-squared endstem.



5) 2-PIECED STEM SYSTEM

Split stem and pivot system and highly profiled disc ensure high Kv/Cv and lower pressure drop.

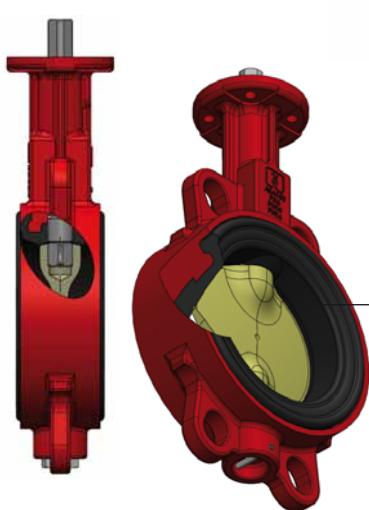


4) DEMOUNTABLE DESIGN

Pivot fitted by pin or screw according to customer's request allows demounting.

MATERIALS & TECHNICAL INFORMATION

DRAWING & MATERIALS

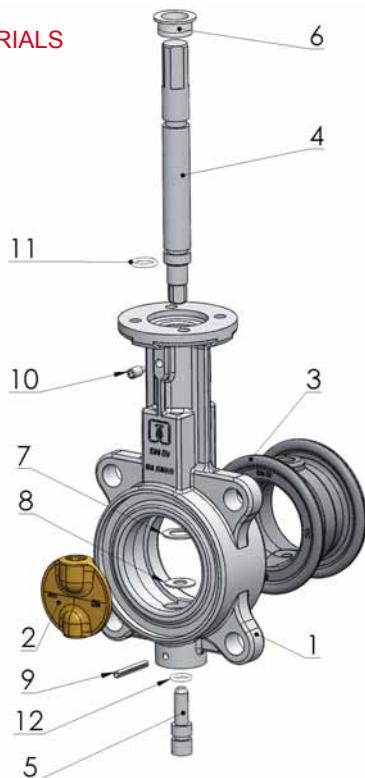

Execution in other material types can be provided upon request. Choice of the seat and disc materials for various media will be recommended upon specific enquiry. Max. temperatures for each material of seat are accepted only for a specific medium and short time exposure.

Item	Name	Material
1	Body	Ductile iron 0.7040 (GGG40) epoxy coated Carbon steel 1.0446 (A216 WCB) Low carbon content steel 1.1156 (A352 LCC) Stainless steel 1.4408 (CF8M)
2	Disc	0 - Brass 2.0402 1 - Aluminium bronze 2.0966 2 - Stainless steel 1.4308 (CF8) 3 - Ductile iron 0.7040 (GGG40) 4 - Stainless steel 1.4408 (CF8M) 5 - HASTELLOY 6 - Stainless steel 1.4539 (Uranus B6) 7 - Titanium
3	Seat	1 - NBR - 10°C + 100°C 2 - EPDM - 25°C + 125°C 3 - Carboxylic NBR - 10°C + 100°C 4 - VITON (FPM) - 15°C + 150°C* 5 - Silicone Steam (VMQ) - 30°C + 140°C 6 - Silicone (VMQ) - 30°C + 150°C 7 - Epichlorohydrin - 30°C + 70°C 8 - HYPALON® (CSM) - 25°C + 120°C 9 - NBR 70-AG - 10°C + 60°C - NBR conduct - 10°C + 80°C
4	Shaft	Stainless steel 1.4021 (AISI 420)
5	Pivot	Stainless steel 1.4021 (AISI 420)
6	Bushing	Delrin (up to DN 300) Brass (from DN 350)
7	Distance ring	Stainless steel
8	Distance ring	Stainless steel
9	Pin	Stainless steel 1.4401 (AISI 316)
10	Retaining screw	Stainless steel
11	Shaft O-ring	NBR, EPDM, VITON is an option
12	Pivot O-ring	NBR, EPDM, VITON is an option


* Max. temperature for water services only up to 80 °C.

INSTALLATION BETWEEN FLANGES (DN 32-600)

Vers.	PN / DN	32/40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
B	PN 6											●	●	●	●	●
	PN10															
	PN16													●		
	Class 150											●	●	●	●	●
T	PN 6	●	●	●	●	●	●	●	●	●	●	●	●	X	X	X
	PN10													●	●	●
	PN16								●	●	●	●	●	●	●	●
	Class 150	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●

INSTALLATION BETWEEN FLANGES (DN 700 – 1600)

Vers.	PN/DN	700	800	900	1000	1100	1200	1300	1400	1500	1600
F	PN 6	●	●	●	●	●	●	●	●	●	●
	PN 10										
	PN 16	●	●	●	●	●	●	●	●	●	●
	Class 150	●	●	●	●	●	●	●	●	●	●



* For JIS 5K/10K, please consult with ABO.

WORKING CONDITIONS

- **Max working pressure**
 - o DN 32 - 600: 16 bar
 - o DN 700 - 1600: 10 bar (16 bar upon request)
- **Temperature range - max:** - 30°C + 150°C (- 22°F + 302°F), depends on material selection

When temperature of medium increases over + 120 °C, the max allowed pressure falls from 16 bar to 14,4 bar and from 10 bar to 9 bar

COATING

- Standard coating is orange epoxy painting RAL 2002 - 80 µm
- Based on customer's request, it is possible to modify the colour or provide higher degree of coating

ACTUATION & TORQUES


ACTUATION POSSIBILITIES

All ABO handles, manual gear operators, pneumatic and electric actuators can be mounted directly to ABO butterfly valves, thus eliminating brackets or couplings. This allows for simple installation in the field, minimizes possible misalignment and decreases overall height.


MANUAL ACTUATION: HANDLEVER

For manual actuation, ABO offers levers in carbon steel material with protective coating for excellent corrosion, abrasion and impact resistance. A lever in stainless steel material is an option. ISO top flange connection is F05 for sizes DN 50 and 65, and F07 for sizes DN 80-200, respectively. Handlever in regulating design optional.

DN 32 - 200

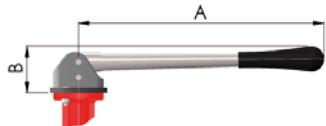

DN 250 - 300

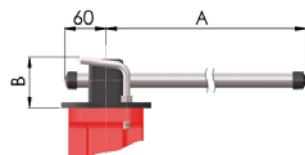


DN	32 - 100	125	150 - 200	250	300
A	270	270	362	450	750
B	75	80	90	135	135
Weight	1,24	1,26	1,4	2,2	3,1

Dimensions mentioned in mm, weight in kg.

Type L (only up to 6 bar)

MANUAL GEARBOX WITH HANDWHEEL

ABO gearbox series of manual actuators combines state of art production technology, with cast iron and pressed steel construction, to provide a smooth and trouble-free operation for heavy duty on-off and throttling service of ABO valves. The rugged, cast iron body seals is weatherproof to IP65. A self-locking gearing holds the valve in the desired position. Further features include a readily accessible handwheel, adjustable stopcrew for closed position, removable splined drive bush with indexing facility and a facility to lock handwheel with padlock and chain. Gearboxes, as well as handlevers, can be supplemented with contacts for signalization of endpoints.

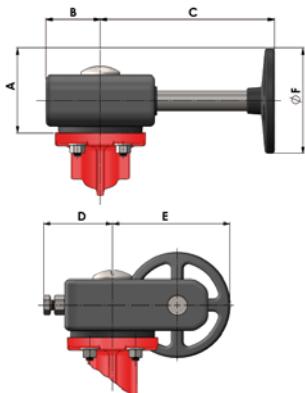

DN	32 – 150	200	250-300	350	400	450	500	600
A	89	89/127**	155	213	263	275	275	350
B	51	51	66	83	83	99	99	126
C	152	152/185**	272	302	334	279	279	360
D	44	44	59	70	70	96	96	118
E	101	101/138,5**	177	242	292	314	314	423
F	125	125/200*	250	350	450	450	450	600
Weight	1,6	1,6	3,7	6,6	6,6	14,5	14,5	27,2
Wheel	SR5	SR5/SR8*	SR10	R14	R18	R18	R18	R24

Dimensions mentioned in mm, weight in kg. Valid for SE Series (DN 32 - 400), M Series (DN 450 - 600).

*Optional

**Acc. to handwheel choice

ACTUATORS

- PNEUMATIC ACTUATORS - ABO pneumatic actuators Series 95 are rack and pinion, opposed-piston actuators available in two versions: single acting & double acting
- ELECTRIC ACTUATORS - ABO series 97 electric actuators are designated for quarter turn operating application. Electric actuators of 24V, 230V and 400V can be installed on ABO butterfly valves.

OPERATING TORQUES UPON WORKING PRESSURE (NM)*


DN	32/40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
PMA 6 bar	6	8	15	20	38	55	70	100	150	235	480	750	1180	1380	2050
PMA 10 bar	8	10	17	25	46	70	80	125	220	290	530	1200	1550	2050	2700
PMA 16 bar	10	12	20	30	55	85	100	150	290	380	580	1650	2100	2700	3750

DN	700	800	900	1000	1200	1400	1600
PMA 10 bar	3500	4500	6000	8950	12600	18500	24400

The above mentioned torques are valid for valves with EPDM seat only, and under the condition that the working medium is liquid. While actuating the valve, the above mentioned figures should be multiplied by a coefficient of 1,2. Using a NBR seat, it is necessary to apply a coefficient of 1,8 for dimensions up to DN 300 and a coefficient of 1,32 for dimensions DN 350 and above. In case the medium is gaseous, or if it contains abrasive particles, it is necessary to apply a secondary coefficient of 1,35. If the working conditions are specific, it is recommended to discuss the selection of the actuator with the manufacturer.

DIMENSIONS DN 32 - 1600 (1¹/₄ - 64")

DN 32 - 600 (1¹/₄ - 24") PN 6/10/16/Class 150

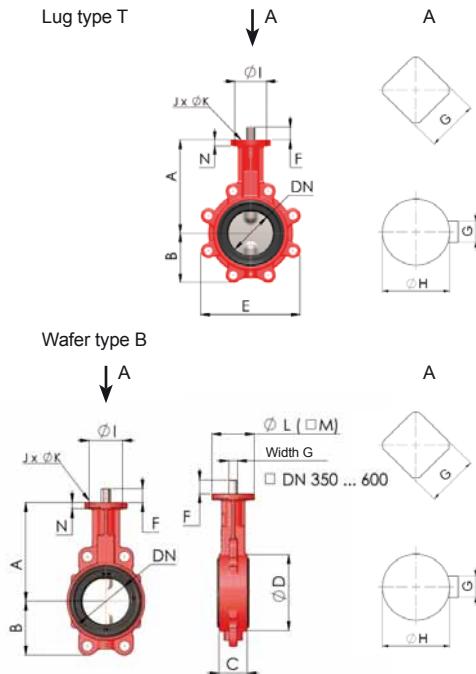


DN		mm	32	40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
	inch	1 ¹ / ₄	1 ¹ / ₂	2"	2 ¹ / ₂	3"	4"	5"	6"	8"	10"	12"	14"	16"	18"	20"	24"	
Version	B	A	136	136	146	153,5	163	172,5	192,5	205	234	270	310	325	365	375	482	562
	T																485	565
	B		54	54	64	72	89	105	118	128	166	202	237	271	314	330	363	464
	C		33	33	43	46	46	52	56	56	60	68	78	78	102	114	127	154
	D		78	78	96	113	128	150	184	212	268	320	378	435	488	544	590	695
	E		110	110	115	129	174	204	234	255	319	396	465	509	590	610	682	810
	F		25	25	25	25	25	25	25	25	25	30	30	36	36	80	80	80
	G																	
	H		-	-	-	-	-	-	-	-	-	-	-	-		Ø38	Ø42	Ø50
	I		50/70		50						70		102	102	125	140	140	165
	J																	
	K																	
	L		-	-		70					-	-	-	-	-	175	175	210
	M		70	70	-	-	-	-	-	75	75	75	105	105	130	140	-	-
	N		8	8	8	8	8	8	9,5	9,5	14	17	17	21	22	25	25	
Weight (kg)	Type B		1,9	1,9	2,7	3,2	3,7	4,7	6,7	8,4	13,3	22,0	29,3	46,4	69,8	83,0	112	216
	Type T		2,3	2,3	3,0	3,7	4,8	6,1	9,2	10,2	15,3	28,4	41,2	62	96,3	130	149	288
	ISO Flange		F05/F07		F05						F07		F10	F12		F14		F16

DN 700 - 1600 (28" - 64") PN 10

DN	mm	700	800	900	1000	1200	1400	1600
	inch	28"	32"	36"	40"	48"	56"	64"
Version - F	A	629	666	720	800	940	1009	1150
	B	537	601	656	720	844	1014	1045
	C	165	190	203	216	254	279	318
	D	940	1060	1168	1255	1485	1685	1930
	F	95	95	130	130	150	150	180
	G	16	16	20	22	28	32	40
	H	55	55	75	85	105	120	140
	M	63	63	84	95	117	134	178
	I	254	254	254	254	298	356	356
	J	8	8	8	8	8	8	8
	K	18	18	18	18	22	33	33
	L	300	300	300	300	350	415	415
Weight (kg)		350	580	700	850	1080	1922	2350
ISO Flange		F25	F25	F25	F25	F30	F35	F35

For version PN 16 / Class 150 upon request.

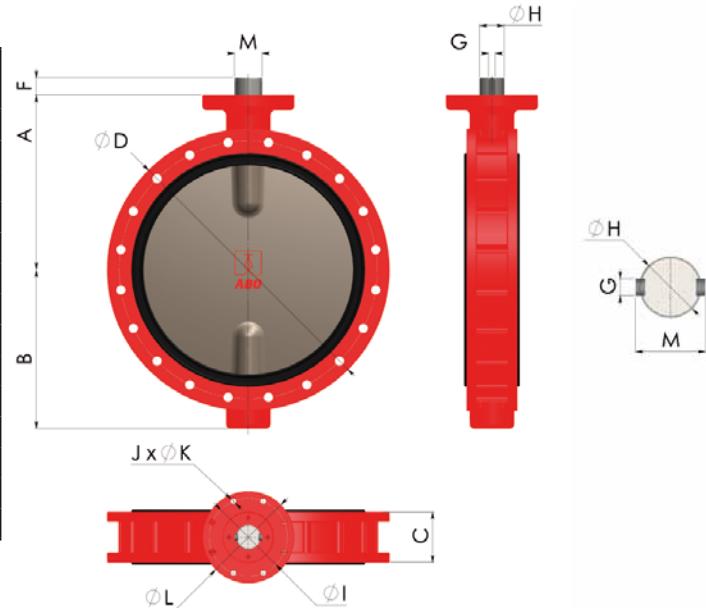

All statements, technical information in this brochure are tentative and for general use only and do not constitute a recommendation or guarantee for any specific service or application requirement. Consult ABO representative or factory for specific requirements and material selection for your intended application. The right to change or modify product design or product without prior notice is reserved. Binding specification will be provided in each offer. ABO valve accepts no liability for damages caused by bad interpretation or use of the information included in this brochure.

30. 9. 2014

Data subject to change.

Company HQ – Czech Republic:
ABO valve, s.r.o.
Dalimilova 285/54, 783 35 Olomouc
Tel: +420 585 202 226, +420 585 224 087
Email: export@abovalve.com
www.abovalve.com

Slovakia:
ABO Slovakia, s.r.o.
Banská Bystrica
Tel: +421 484 145 633
Email: aboslovakia@aboslovakia.sk
www.aboslovakia.sk

Russia:
ABO ARMATURA Ltd.
Smolensk
Tel: +7 481 31 28 27
Email: aboarmatura@yandex.ru
www.aboarmatura.ru

Singapore:
ABO Valve Pte. Ltd.
Singapore
Tel: +65 6383 4368
Email: lsw@abovalve.com
www.abovalve.com

China:
ABO Flow Control
Beijing
Tel: +86 13601522831
Email: wen@abovalve.com
www.abovalve.com


Bahrain:
ABO Middle East
Kingdom of Bahrain
Tel.: +973 - 7700 2436
Email: jimmichen@abovalve.com
www.abovalve.com

Serie L9

LUG butterfly valve



Shut-off valves

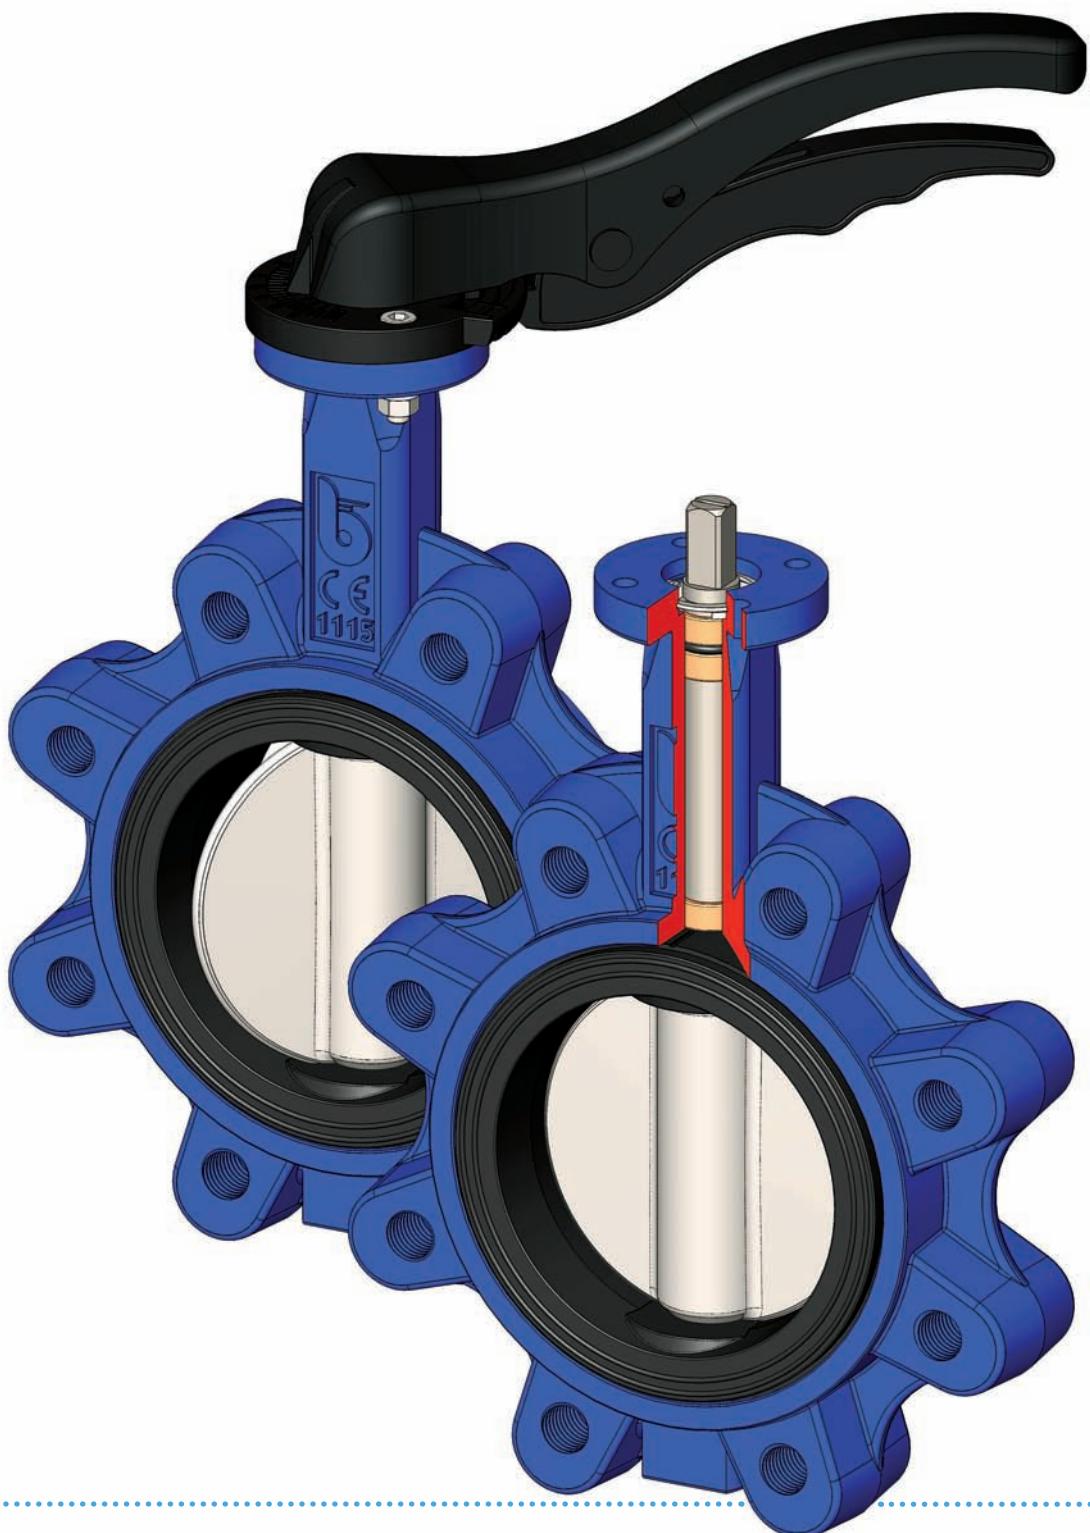

Application fields



WATER



CONDITIONING



GAS



HEATING



DRINKING WATER



INDUSTRY



FIRE FIGHTING

The shut-off LUG butterfly valves in Series L9, with a centred Disc and LUG type body, are made of ductile iron, manufactured in accordance with severe product norms and in conformity to EN ISO 9001.


These valves are suitable for heating and conditioning (HVAC), water treatment and water distribution, industrial applications, agricultural purposes, for compressed air, gas, oils and hydrocarbon.

(Please ensure the choice of the corresponding item)

YES: for in line and end of line installation with frequent actuation; the integrated support, in accordance with ISO 5211, allows easy mounting of a wide range of actuators and drives.

They are suitable for choking and regulating the flow.

NO: for steam.

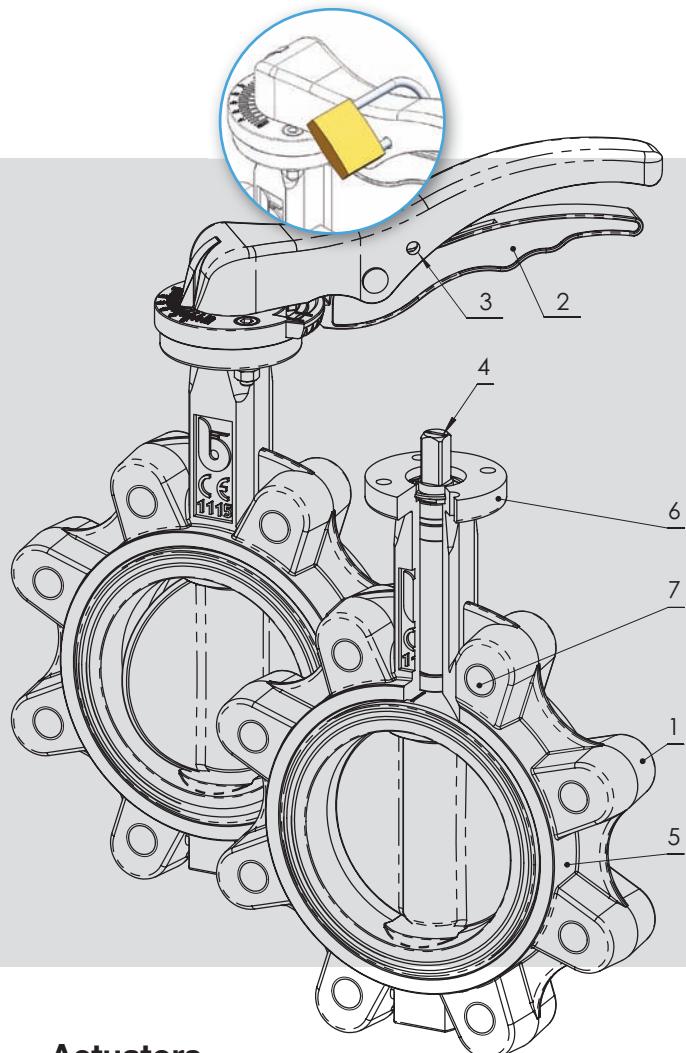

1. Epoxy coating.
2. Lever suitable for intermediate regulation.
3. Lockable operation lever.
4. A notch machined at the top of the stem indicates the position of the disc and allows adjusting the command to the correct position, when the command/lever is removed.
5. Compact design.
6. Integrated ISO 5211 flange.
7. Threaded holes suitable for mounting between PN16 for DN25-300 flanges (on request PN 10) and for mounting between PN 10 for DN 350-600 flanges.

Accessories

- ➔ Extension for water main system connection
- ➔ Position indicator and padlocking for gear box
- ➔ Micro-switch for gear box
- ➔ Kit: micro-switches for ON/OFF position indicator

Refer to specifications on page 75



In conformity with directive 97/23/CE PED
In conformity with D.M. 174 (directive 97/83/CE)

Actuators

- ➔ Double acting and single acting pneumatic actuators
On request: micro-switches, position indicators
- ➔ Electric actuators
- ➔ Gear box
- ➔ Chain driven control

Construction and testing norms (correspondences):

Face-to-face: EN558/1-20 (ISO 5752-20, DIN 3202K1)

Flanges: EN1092, ANSI B16.5 #150


Design: EN593, EN13445, ISO 5211, EN12570

Marking: EN19

Testing: 100% testing in accordance with EN 12266 cat. A (ISO 5208 cat. A)

LUG butterfly valve

Shut-off valves

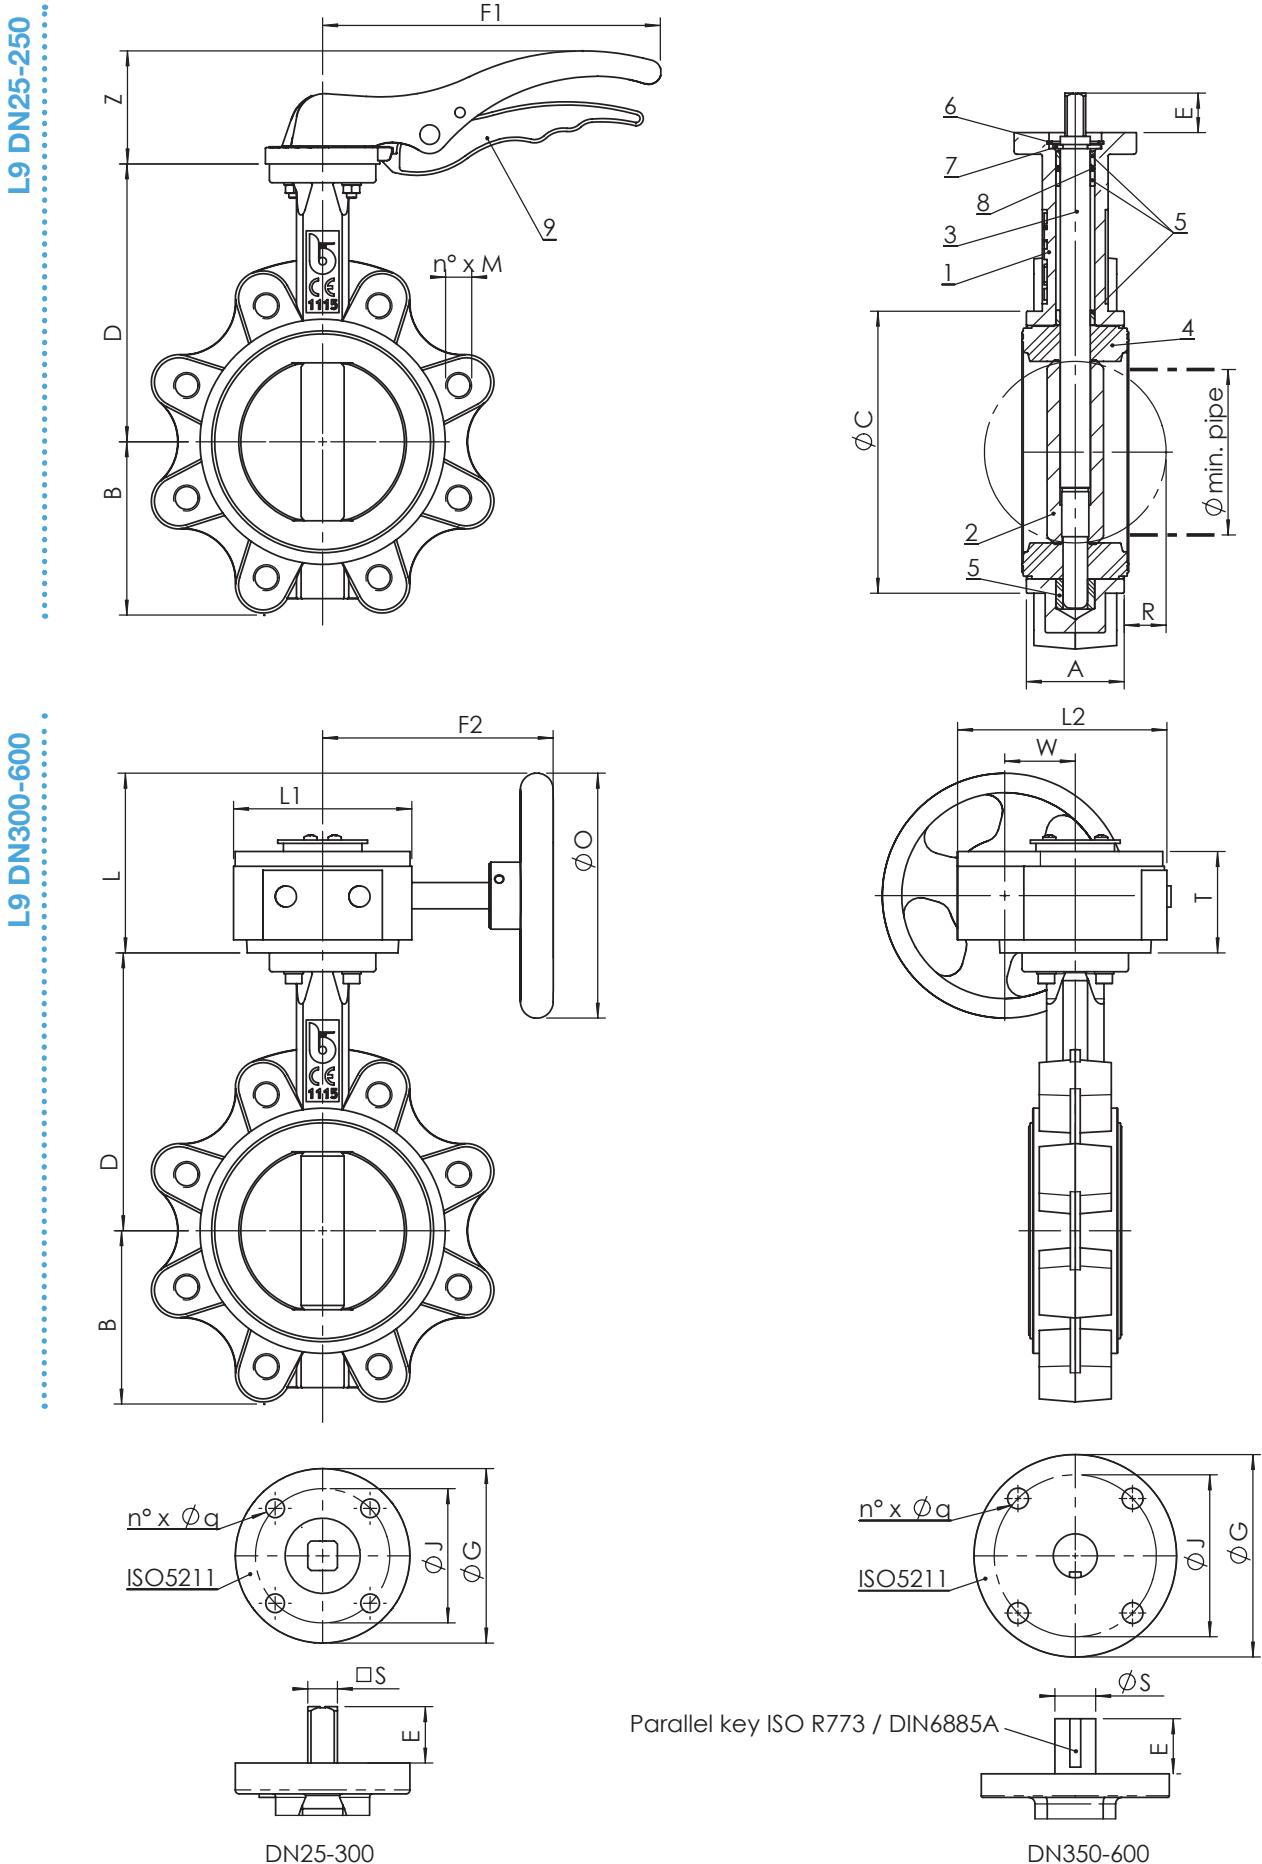

Materials

	Component	Material
1	Body	EN GJS 400 - 15
2	Disc	EN GJS 400 - 15 nickel plated / ASTM A351 gr. CF8-M / CuAl11Fe4 ASTM B148 C94500
3	Stem	AISI 420
4	Liner	EPDM / NBR / FKM (Viton®) / PTFE
5	Bushing	PTFE
6	Washer	Galvanized carbon steel
7	Circlip ISO3075	Spring steel
8	O-ring	FKM (Viton®)
9	Lever	DN25-150 aluminium / DN 200-250 EN GJS 400-15
10	Bolts	Galvanized carbon steel

Shut-off valves

Dimensions (mm)

DN	25	32	40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
A	33	33	33	43	46	46	52	56	56	60	68	78	78	102	114	127	154
ØC	65	73	82	89	102	118	150	174	205	260	318	376	438	489	539	594	695
D	104	110	116	126	136	150	170	180	200	230	266	292	368	400	422	480	562
B	51	56	63	62	69	90	106	119	131	166	202	235	267	297	318	355	444
F1	192	192	170	170	170	206	206	285	285	400	530	-	-	-	-	-	-
Z	68	68	50	50	50	69	69	90	90	72	72	-	-	-	-	-	-
F2	130	130	130	130	130	130	130	130	130	235	226	226	216	216	216	256	285
L	102,5	102,5	102,5	102,5	102,5	102,5	102,5	102,5	102,5	190	190	190	183	183	183	311	386
T	65	65	65	65	65	65	65	65	65	78	80	80	80	80	80	125	136
L1	110	110	110	110	110	110	110	110	110	155	170	170	151	151	151	214	262
L2	130	130	130	130	130	130	130	130	130	176	200	195	188	188	188	275	324
W	45	45	45	45	45	45	45	45	45	63	81	81	80	80	80	168	293
O	150	150	150	150	150	150	150	150	150	300	300	300	285	285	285	385	
R	-	1	5	5	9	17	26	34	50	71	91	112	128	144	163	182	219
D min pipe	-	12	27	31	45	65	90	110	146	194	241	291	324	379	428	475	573

Mounting between flanges ¹

EN 1092 PN16

n x M	4 x M12	4 x M16	4 x M16	4 x M16	4 x M16	8 x M16	8 x M16	8 x M16	8 x M20	12 x M20	12 x M24	12 x M24	16 x M20	16 x M24	20 x M24	20 x M24	20 x M27
ISO 5211	F05	F07	F07	F10	F12	F12	F12	F14	F14	F14	F16						
G	65	65	65	65	65	65	65	90	90	125	150	150	150	150	175	175	210
J	50	50	50	50	50	50	50	70	70	102	125	125	125	125	140	140	165
n x q	4 x 7	4 x 7	4 x 7	4 x 7	4 x 7	4 x 7	4 x 7	4 x 9	4 x 9	4 x 11	4 x 13	4 x 13	4 x 13	4 x 18	4 x 18	4 x 18	4 x 22
S	7	7	9	9	9	11	11	14	14	17	27	27	31,6	33,15	38	41,15	50,65
E	32	32	21	21	21	21	21	27	27	27	27	27	45	51,2	51,2	64,2	70,2

Weight (kg)

L9 with lever	2,6	2,6	2,3	3,2	4,1	5,4	6,7	9,6	10,8	21,1	32,7	41,2	-	-	-	-	
L9 with gear box	6,2	6,2	6,1	7,0	7,9	9,2	10,5	12,9	14,1	28,4	42,0	50,5	79,3	122,6	254,8	228,3	308,6

1: please refer to Instruction and Recommendations

Operating torque (Nm)

DP bar																	
3	2,9	4,7	7,8	11,3	17	23	33	48	68	120	189	290	298	481	930	1250	2270
6	3,1	5,1	8,4	12	18	25	36	54	78	134	212	316	347	551	980	1350	2500
10	3,3	5,4	8,8	13	20	26	40	61	88	148	234	342	396	622	1200	1500	2700
16	3,4	5,7	9,2	13	21	28	44	68	99	162	257	367	-	-	-	-	-

N.B.: In order to choose the right actuator, we recommend multiplying the operating torque figure by a safety coefficient, K=1,5

LUG butterfly valve

Maximum pressure

Fluids *	Mounting	
	BETWEEN FLANGES	END OF LINE
Hazardous gases	16 bar DN25-200 10 bar DN250-350 NO DN400-600	10 bar DN25-100 NO DN125-600
Non-hazardous gases	16 bar DN25-300 10 bar DN350-500 6 bar DN600	10 bar DN25-300 6 bar DN350-500 4 bar DN600
Hazardous fluids	16 bar DN25-400 10 bar DN450-600	10 bar DN25-400 6 bar DN450-600
Non-hazardous fluids	16 bar DN25-400 10 bar DN450-600	10 bar DN25-400 6 bar DN450-600


*: Hazardous gas, liquids (explosive, inflammable, toxic) in accordance with 97/23/CE PED and 67/548/EEC

Temperature

Temperature	min °C	Max°C	
		continuous	peak
EPDM	-10	120	130
NBR	-10	80	90
FKM (Viton®)	-10	150	170
PTFE	-10	120	120

NB: the maximum working pressure decreases while the temperature increases; please refer to "pressure/temperature" chart

Pressure/temperature chart

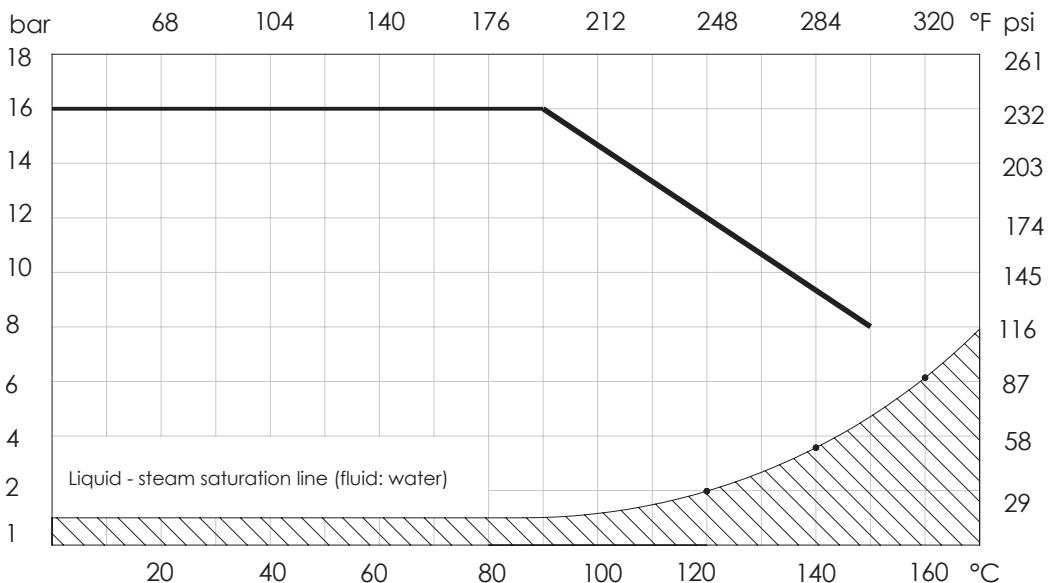


RANGE NOT SUITABLE FOR STEAM. DO NOT use when temperature and pressure are below the liquid-steam saturation line (hatched area)




Head loss

Fluid: water (1m H₂O = 0,098bar) - Head loss with shutter completely open

m H₂O

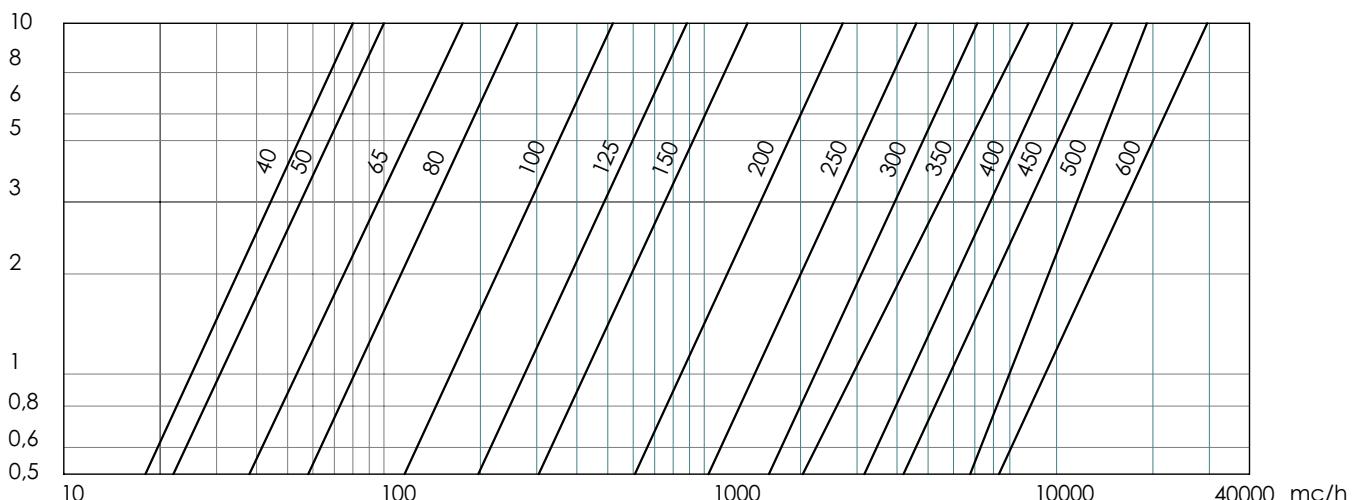

Flow rate / opening position chart Flow percentage on the flow at full opening under the same loss of head.

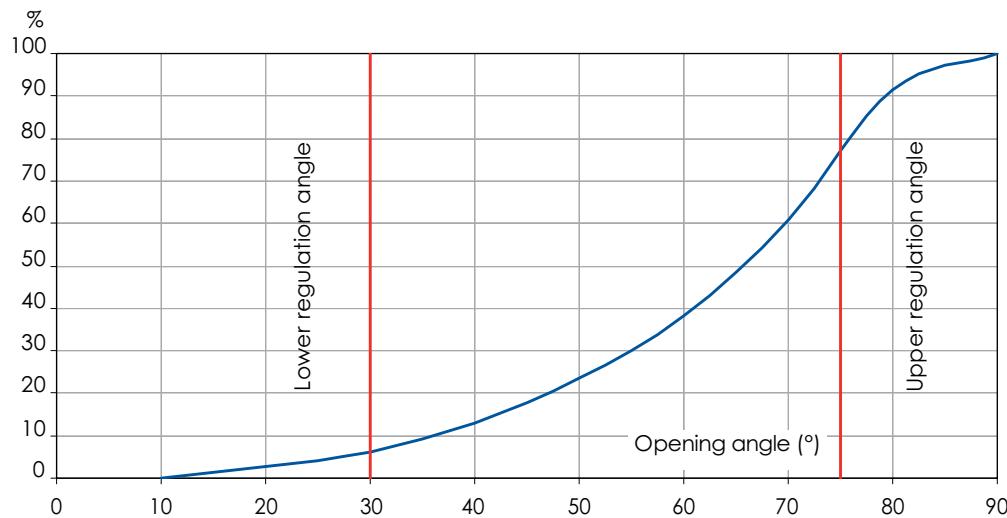

Kv - DN chart (mc/h per bar)

DN	mm	40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
	ins	1" 1/2	2"	2" 1/2	3"	4"	5"	6"	8"	10"	12"	14"	16"	18"	20"	24"
10°	0,04	0,05	0,09	0,17	0,26	0,43	0,69	1,73	2,6	3,5	5,2	6,9	9,5	12	19	
20°	2,1	2,6	5,2	7,8	15	25	39	77	130	202	292	401	531	683	1055	
30°	4,8	6	10	16	31	53	82	162	276	427	617	849	1124	1445	2234	
40°	10	13	22	34	67	115	177	352	599	926	1376	1839	2437	3133	4840	
50°	19	23	39	60	120	205	316	628	1068	1650	2384	3279	4342	5609	8626	
60°	30	38	65	100	199	339	522	1038	1768	2730	3945	5425	7185	9238	14272	
70°	48	60	103	158	314	535	827	1643	2798	4322	6243	8585	11371	14620	22587	
80°	73	91	161	237	471	803	1241	2465	4196	6483	9364	12878	17057	21930	33882	
90°	79	99	169	261	518	883	1364	2708	4611	7124	10291	14152	18743	24099	37232	

LUG butterfly valve

Shut-off valves

Versions

EPDM liner



0

EN GJL 250
GJS400 nickel plated
PDM
-10 +120°C

L9.100

Body: EN GJS 400 -15
Disc: EN GJS400 nickel plated
Liner: EPDM
Temp: -10 +120°C

L9.120

Body: EN GJS 400 -15
Disc: AISI 316
Liner: EPDM
Temp: -10 +120°C

L9.170

Body: EN GJS 400 -15
Disc: Aluminium-bronze
Liner: EPDM
Temp: -10 +120°C

Coating: **RAL 5002** colour



CE PG



NBR liner



01

EN GJS 400 -15
EN GJS400 nickel plated
NBR
-10 +80°C

L9.121

Body: EN GJS 400 -15
Disc: AISI 316
Liner: NBR
Temp: -10 +80°C

L9.171

Body: EN GJS 400 -15
Disc: Aluminium-bronze
Liner: NBR
Temp: -10 +80°C

Coating: **RAL 5002** colour - GAS version (DN 25-350) with yellow lever



CE PG



FKM or PTFE liner



12

EN GJS 400 -15
GJS400 nickel plated
KM
-10 +150°C

L9.122

Body: EN GJS 400 -15
Disc: AISI 316
Liner: FKM
Temp: -10 +150°C

L9.172

Body: EN GJS 400 -15
Disc: Aluminium-bronze
Liner: FKM
Temp: -10 +150°C

L9.123

Body: EN GJS 400 -15
Disc: AISI 316
Liner: PTFE
Temp: -10 +120°C

L9.173

Body: EN GJS 400 -15
Disc: Aluminium-bronze
Liner: PTFE
Temp: -10 +120°C

Coating: **RAL 5002** colour




CE PG



Special versions on request

Accessories for series J9 - L9

Stem extension for water main system connection

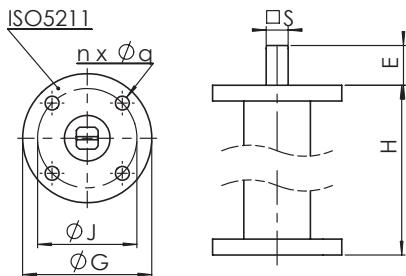


DN	40-100	125-150	200	250-300
H 250-500-800-1000				
ISO5211	F05	F07	F10	F12
G	65	90	125	150
J	50	70	102	125
n° x Ø q	4 x 7	4 x 9	4 x 11	4 x 13
E	20	26	26	26
S	11	14	17	27




Shut-off valves

Position indicator and padlocking for gear box

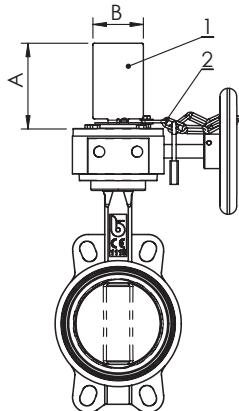


DN	25-150	200-400
A	100	120
B	60	80


1) Position indicator
2) Chain for padlocking

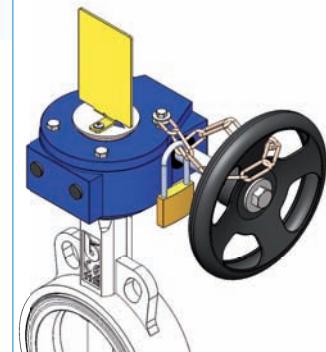


Limit switches box for gear box

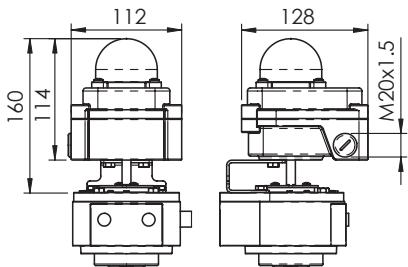


Mechanical switches per standard.
Available on request: proximity switches,
ATEX explosion proof proximity switches.

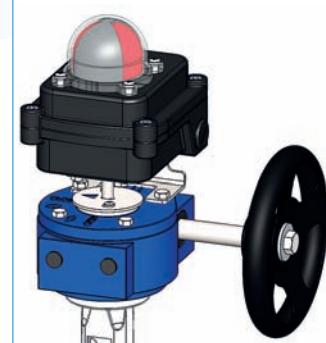

Limit switches kit for ON-OFF indication

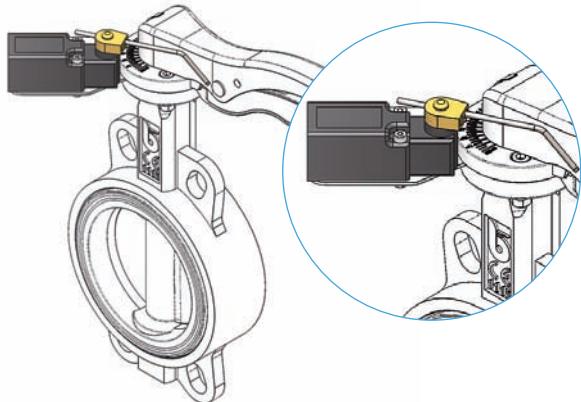

Chain driver kit

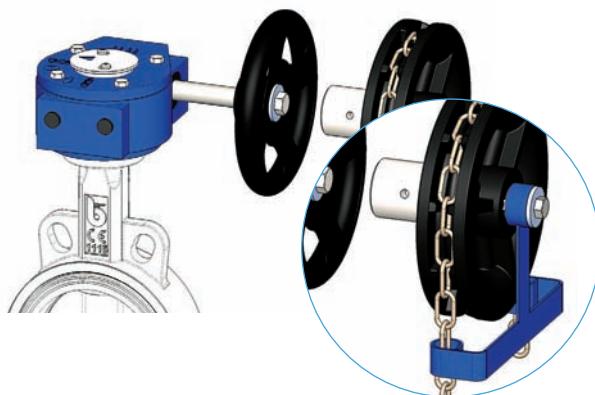

Butterfly valves

Instruction and Recommendations for series J9 - L9

The information provided here is delivered with each product, and contains "Instructions for use and maintenance"; it is also available on our website: www.brandoni.it (download section)

INSTALLATION AND TRANSPORT

- Keep in dry and closed place.
- While stored, the disc must be partially open (Fig. 1).
- Avoid knocks, take special care to protect lever, hand wheel, gear boxes/actuators.
- Do not use lever or hand wheel to lift the valve.

MAINTENANCE

The valve does not require maintenance.

RECOMMENDATIONS

Before carrying out maintenance or dismantling the valve, be sure that the pipes, valves and liquids have cooled down, that the pressure has decreased and that the lines and pipes have been drained in case of toxic, corrosive, inflammable or caustic liquids.

Temperatures above 50°C and below 0°C might cause damage to people.

INSTALLATION

- Handle with care.
- Do not weld the flanges to the piping after installing the valve.
- Water hammers might cause damage and ruptures. Inclination, twisting and misalignments of the piping may subject the valve to stress, once installed. It is recommended that elastic joints be used in order to reduce these effects as much as possible. The disc must be partially open (Fig. 1).

FIG. 1

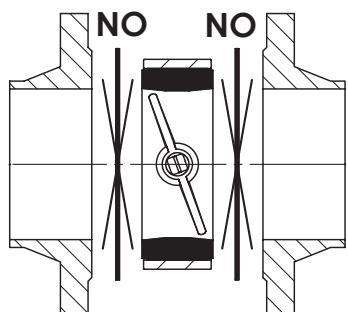


FIG. 2





FIG. 3

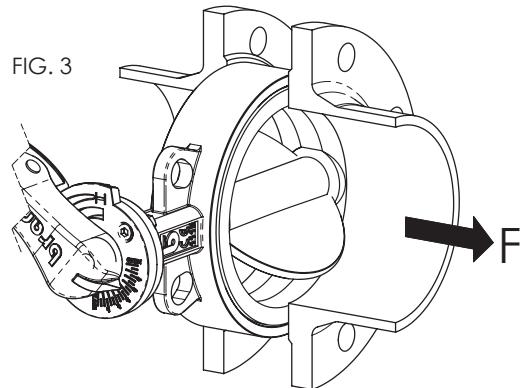

The stem has a machined notch N (Fig. 2), which indicates the position of the disc; consider this indication, in order to mount the levers and actuators correctly.

The mounting can be made with the stem axis in a horizontal or vertical position. In case the fluid contains suspended solid particles (for example, sand, impurities, etc.) or solid particles that may leave deposits, it is recommend that the valve be installed with its axis horizontal, and in such a way that the bottom end of the disc opens in the direction of flow, F. (Fig. 3) The item L9 allows the dismantling of the pipes downstream, for pressures below 6 bar. For end of line installation:

- SERIES J9 (all pressures), series L9 (pressure > 6 bar): counter flange MUST be installed
- SERIES L9 (pressure < 6 bar): it is recommended that a counter flange be installed.

Verify maximum working pressure and limits of use under section "maximum pressure".

Place the valve between two flanges. While placing the valve, ensure there is sufficient space in order not to damage the rubber. Do not mount seals between valve and flanges (Fig. 1). Carefully clean the contact surface. Do not install the butterfly valve in direct contact with a rubber surface (for example, expansion joints); the best installation is when the rubber is in contact with metal (Fig. 4).

In order to achieve correct working, the internal diameter of the pipe must be greater than the value indicated in the chart. Do not weld the flanges to the tube if the valve has already been installed. It is recommended that the flanges listed in the chart be used. As far as possible, avoid flat flanges for welding (EN 1092 01 type); if these flanges are used, ensure perfect centring between the flange and valve, and be sure to weld exactly edgewise to the flange. Do not let protrusions or sharp edges on the piping cause damage to the rubber surface of the valve (Fig. 5).

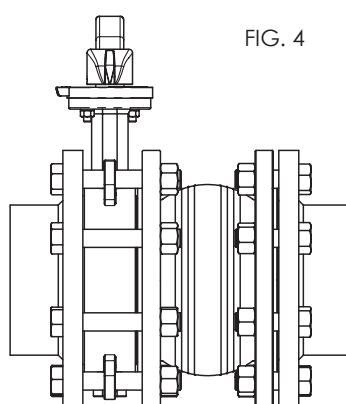


FIG. 4

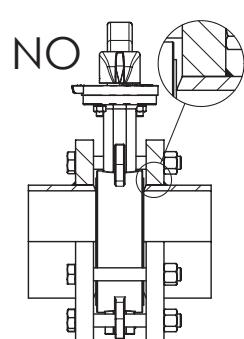


FIG. 5

Centre the valve on holes while using wafer type valves.
Tighten the bolts crosswise and progressively, in order to distribute the pressure equally before the body and flanges come into contact with each other. (Fig. 6)

With regard to the Lug version, check that the screws are the correct length, in order to allow complete compression of the lining rubber.

Turbulences of the fluid might increase erosion and reduce the life-cycle of the valve. Install the valve at a distance of at least $1 \times DN$ upstream, and at a distance of $2-3 \times DN$ downstream, away from fittings or bends.

In the open position, the valve is larger than the nominal Face to Face value.

Check that no other components of the piping interfere or create damage or malfunction (Fig. 7A).

If they do, a spacer should be inserted for the valve to operate correctly (Fig. 7B).

FIG. 6

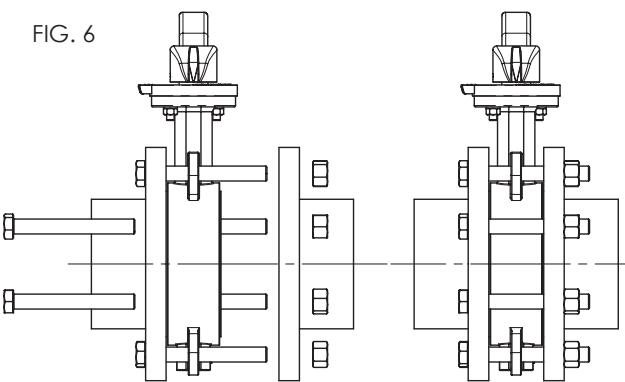


FIG. 7A


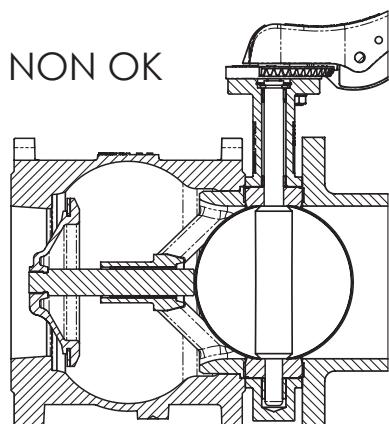


FIG. 7B

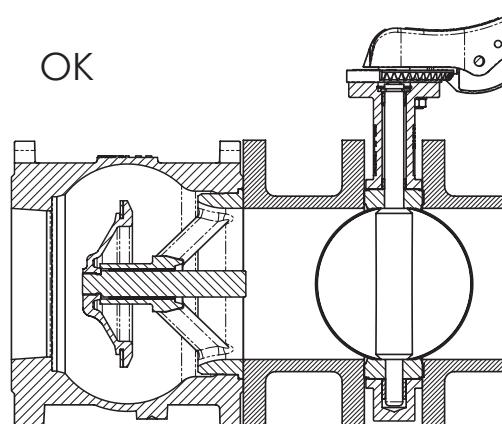

FLANGES CHART

Norms	Type
EN 1092-1 PN6/10/16	Type 11 weld neck
	Type 21 integral
	Type 02 + 35 loose plate with weld ring neck
	Type 02 + 36 loose plate with pressed collar
	Type 04 + 34 loose plate with weld neck collar
ANSI B16.1 #150* ANSI B16.5 #150*	flat face
	raised face
	lap joint

CHART MINIMUM DIAMETER OF PIPES

DN	25	32	40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
Ø min. pipe	-	12	27	31	45	65	90	110	146	194	241	291	324	379	428	475	573

Customer Contact Phone number Email	Date 2015-03-11 Project Project no.
--	---

NSCS 100-250/150/W46VCC4**Operating data**

Pump type	Single head pump	Fluid	Water
No. of pumps / Reserve	1 / 0	Operating temperature t A	°C 4
Nominal flow	m³/h 189.2	pH-value at t A	7
Nominal head	m 20.4	Density at t A	kg/dm³ 1
Static head	m 0	Kin. viscosity at t A	mm²/s 1.569
Inlet pressure	bar 0.098	Vapor pressure at t A	bar 0.0234
Environmental temperature	°C 20	Solids	0
Available system NPSH	m 0	Altitude	m 1000

Pump data

Make	Lowara	Nominal	m³/h 196	(196)
Speed	1/min 1765	Flow	m³/h 249	
Number of stages	1	Max-	m³/h 29.6	
Max. casing pressure	bar 16	Min-	m 21.9	
Max. working pressure	bar 2.9	Nominal	m 15.9	
Head H(Q=0)	m 28	Head	at Qmax	m 28.2
Weight	kg		at Qmin	
Max.	mm 259	Shaft power	kW 14.2	(14.2)
Impeller R	designed mm 245	Max. shaft power	kW 14.8	
Min.	mm 222	Efficiency	% 82.14	
Suction nozzle	DN125 PN10/16 EN1092-2 (NSC)	NPSH 3%	m 2.6	
		Discharge nozzle	DN100 PN10/16 EN1092-2 (NSC)	

Pump Materials

Impeller	Cast iron, 0.6020
Casing	Cast iron, 0.6025
casing cover	Cast iron, 0.6025
Wear ring	stainless steel, 1.4301
Shaft	Stainless steel, 1.4057
Bearing frame	Cast iron, 0.6025

Shaft Seal

Mechanical Seal	
e-NSC, e-LNE - MG1S2	Burgmann
Rotating Assembly	B-Resin impregnated carbon
Fixed Assembly	Q1-Silicon carbide
Elastomers	E - EPDM
Springs	G-AISI 316
Other Components	G-AISI 316

Motor data

Manufacturer	WEG	Electric voltage	460 V
Specific design IE3 motors - Cast Iron Frame - Premium Efficiency			
Type	W22 - 160 L - 15kW	Electric current	25 A
Rated power	15 kW	Degree of protection	IP55
Speed	1775 1/min	Insulation class	F
Frame size	160 L	Weight	145 kg
Shaft diameter	42 mm	Colour	RAL 5010

Coupling

Manufacturer	
Series	
Type	
Frame size	
Spacer length	
Weight	
Coupling protection	

Base plate

Description	
Weight	

Remarks:

Customer Contact Phone number Email	Date Project Project no.	2015-03-11
--	--------------------------------	------------

NSCS 100-250/150/W46VCC4


Hydraulic data

Operating Data Specification	Hydraulic data (duty point)	Impeller design
Flow 189.2 m³/h Head 20.4 m Static head 0 m	Flow 196 m³/h Head 21.9 m	Impeller R 245 mm Frequency 60 Hz Speed 1765 1/min

Power data referenced to:

Water [100%] ; 4°C; 1kg/dm³; 1.57mm²/s

Performance according to ISO 9906 - Annex A

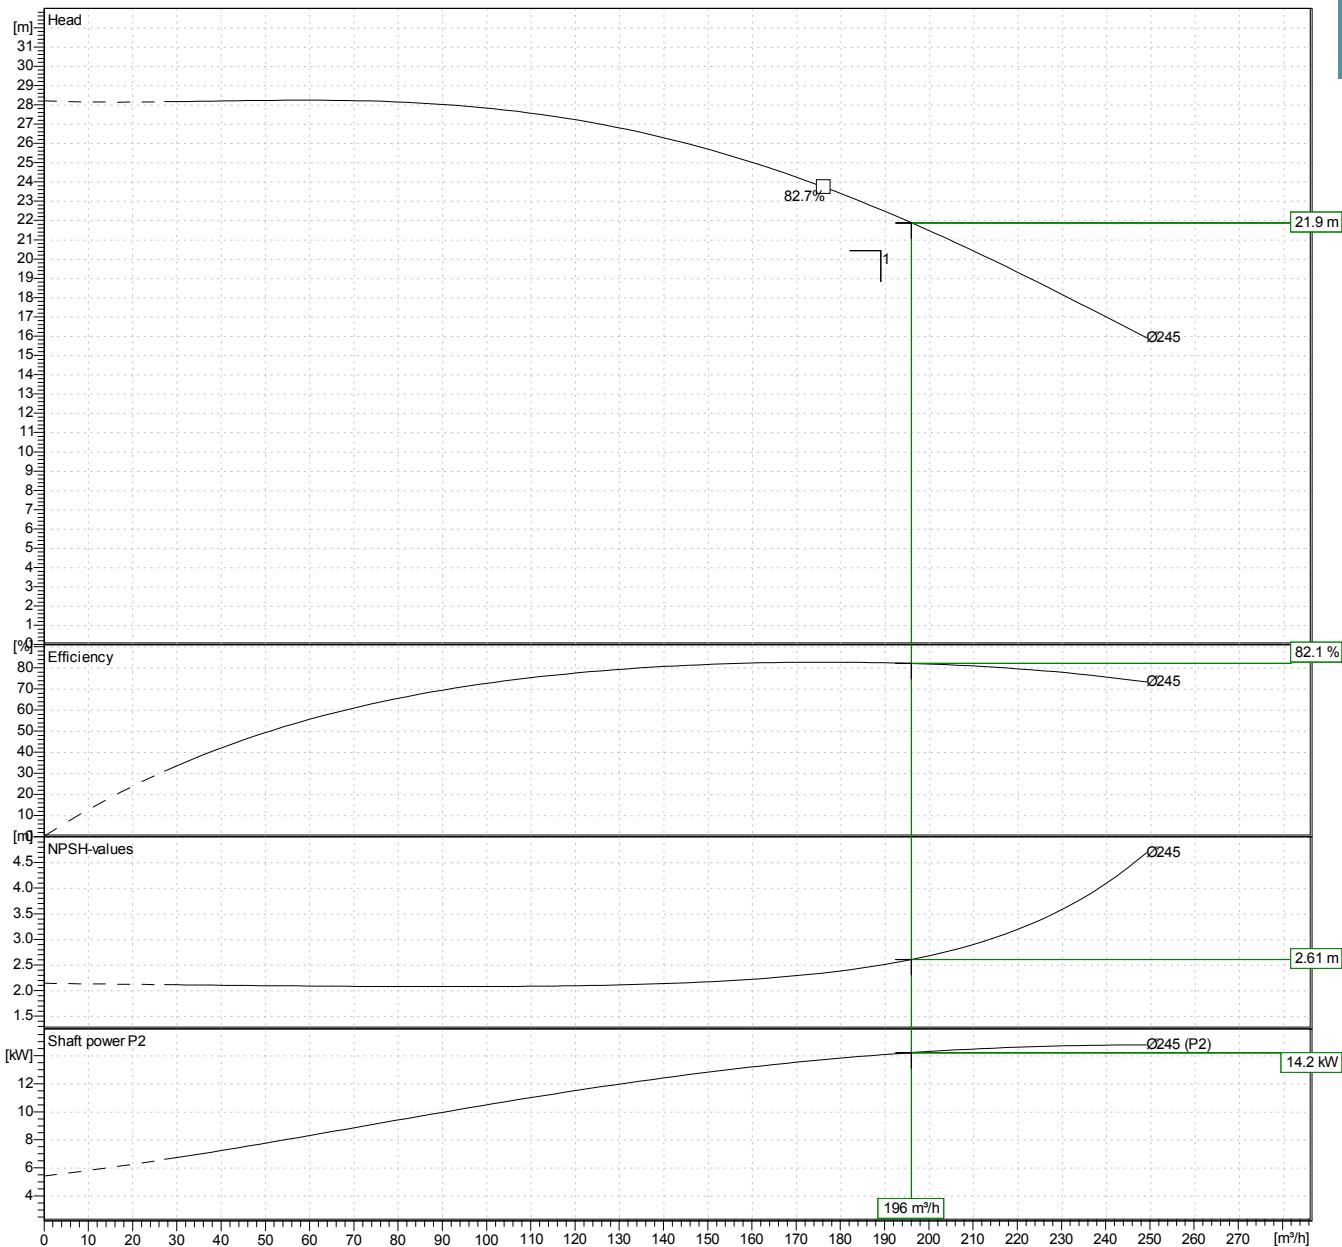


Customer Contact Phone number Email	Date Project Project no.	2015-03-11
--	--------------------------------	------------

NSCS 100-250/150/W46VCC4

Dimensions mm/m³			
a	140	m2	120
A	254	n1	400
AA	64	n2	315
AB	308	PM1	1/4"
AD	264	s1	19
B	254	s2	14.5
b	80	Trim	0
BB	298	Type	B
Bmax	431	Volumen	0.1985
DNd	100	w	348
DNs	125	x	140
E	3/8"		
f	240		
F	3/8"		
g1	26		
H	160		
h1	225		
h2	280		
h3	65		
HA	22		
Hmax	505		
L	912		
m1	160	Total weight	235 kg

Connections mm			
Suction nozzle		Discharge nozzle	
DN125		DN100	
PN10/16		PN10/16	
EN1092-2 (NSC)		EN1092-2 (NSC)	
C	26	C	24
D	255	D	230
d1	184	d1	157
K	210	K	180
L	19	L	19
z	8	z	8

Value C, D may vary from Standard

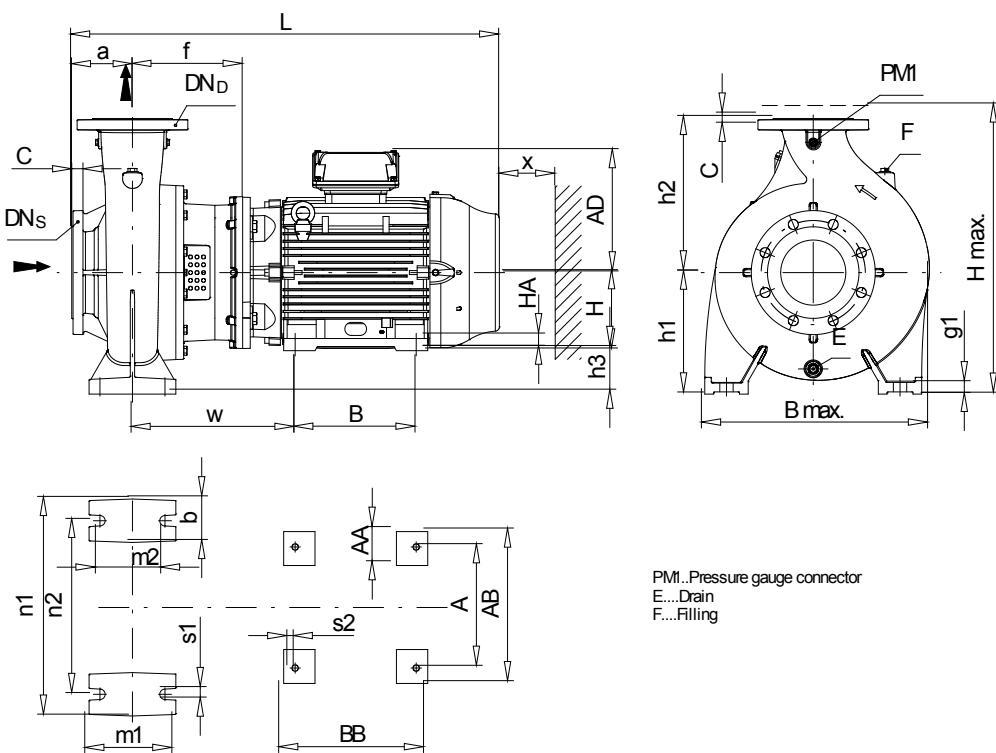Drawing

Customer Contact Phone number Email	Date 2015-03-11 Project Project no.
--	---

NSCS 100-160/40/W46VCC4

Operating data

Pump type	Single head pump	Fluid	Water
No. of pumps / Reserve	1 / 0	Operating temperature t A	°C 4
Nominal flow	m³/h 86	pH-value at t A	7
Nominal head	m 10.2	Density at t A	kg/dm³ 1
Static head	m 0	Kin. viscosity at t A	mm²/s 1.569
Inlet pressure	bar 0.098	Vapor pressure at t A	bar 0.0234
Environmental temperature	°C 20	Solids	0
Available system NPSH	m 0	Altitude	m 1000

Pump data

Make	Lowara	Nominal	m³/h 84.6	(84.6)
Speed	1/min 1760	Flow	m³/h 187	
Number of stages	1		m³/h 28.5	
Max. casing pressure	bar 16	Head	m 9.9	
Max. working pressure	bar 1.1	at Qmax	m 4.7	
Head H(Q=0)	m 10	at Qmin	m 10.2	
Weight	kg	Shaft power	kW 3.5	(3.5)
Max.	mm 190	Max. shaft power	kW 3.9	
Impeller R designed	mm 156	Efficiency	% 65.45	
Min.	mm 156	NPSH 3%	m 2	
Suction nozzle	DN125 PN10/16 EN1092-2 (NSC)	Discharge nozzle	DN100 PN10/16 EN1092-2 (NSC)	

Pump Materials

Impeller	Cast iron, 0.6020
Casing	Cast iron, 0.6025
casing cover	Cast iron, 0.6025
Wear ring	stainless steel, 1.4301
Shaft	Stainless steel, 1.4057
Bearing frame	Cast iron, 0.6025

Shaft Seal

Mechanical Seal	
e-NSC, e-LNE - MG1S2	Burgmann
Rotating Assembly	B-Resin impregnated carbon
Fixed Assembly	Q1-Silicon carbide
Elastomers	E - EPDM
Springs	G-AISI 316
Other Components	G-AISI 316

Motor data

Manufacturer	WEG	Electric voltage	460 V
Specific design IE3 motors - Cast Iron Frame - Premium Efficiency			
Type	W22 - 112 M - 4kW	Electric current	7.1 A
Rated power	4 kW	Degree of protection	IP55
Speed	1755 1/min	Insulation class	F
Frame size	112 M	Weight	44 kg
Shaft diameter	28 mm	Colour	RAL 5010

Coupling

Manufacturer	
Series	
Type	
Frame size	
Spacer length	
Weight	
Coupling protection	

Base plate

Description
Weight

Remarks:

Customer Contact Phone number Email	Date Project Project no.	2015-03-11
--	--------------------------------	------------

NSCS 100-160/40/W46VCC4


Hydraulic data

Operating Data Specification	Hydraulic data (duty point)	Impeller design
Flow 86 m ³ /h Head 10.2 m Static head 0 m	Flow 84.6 m ³ /h Head 9.87 m	Impeller R Frequency 60 Hz Speed 1760 1/min

Power data referenced to:

Water [100%] ; 4°C; 1kg/dm³; 1.57mm²/s

Performance according to ISO 9906 - Annex A

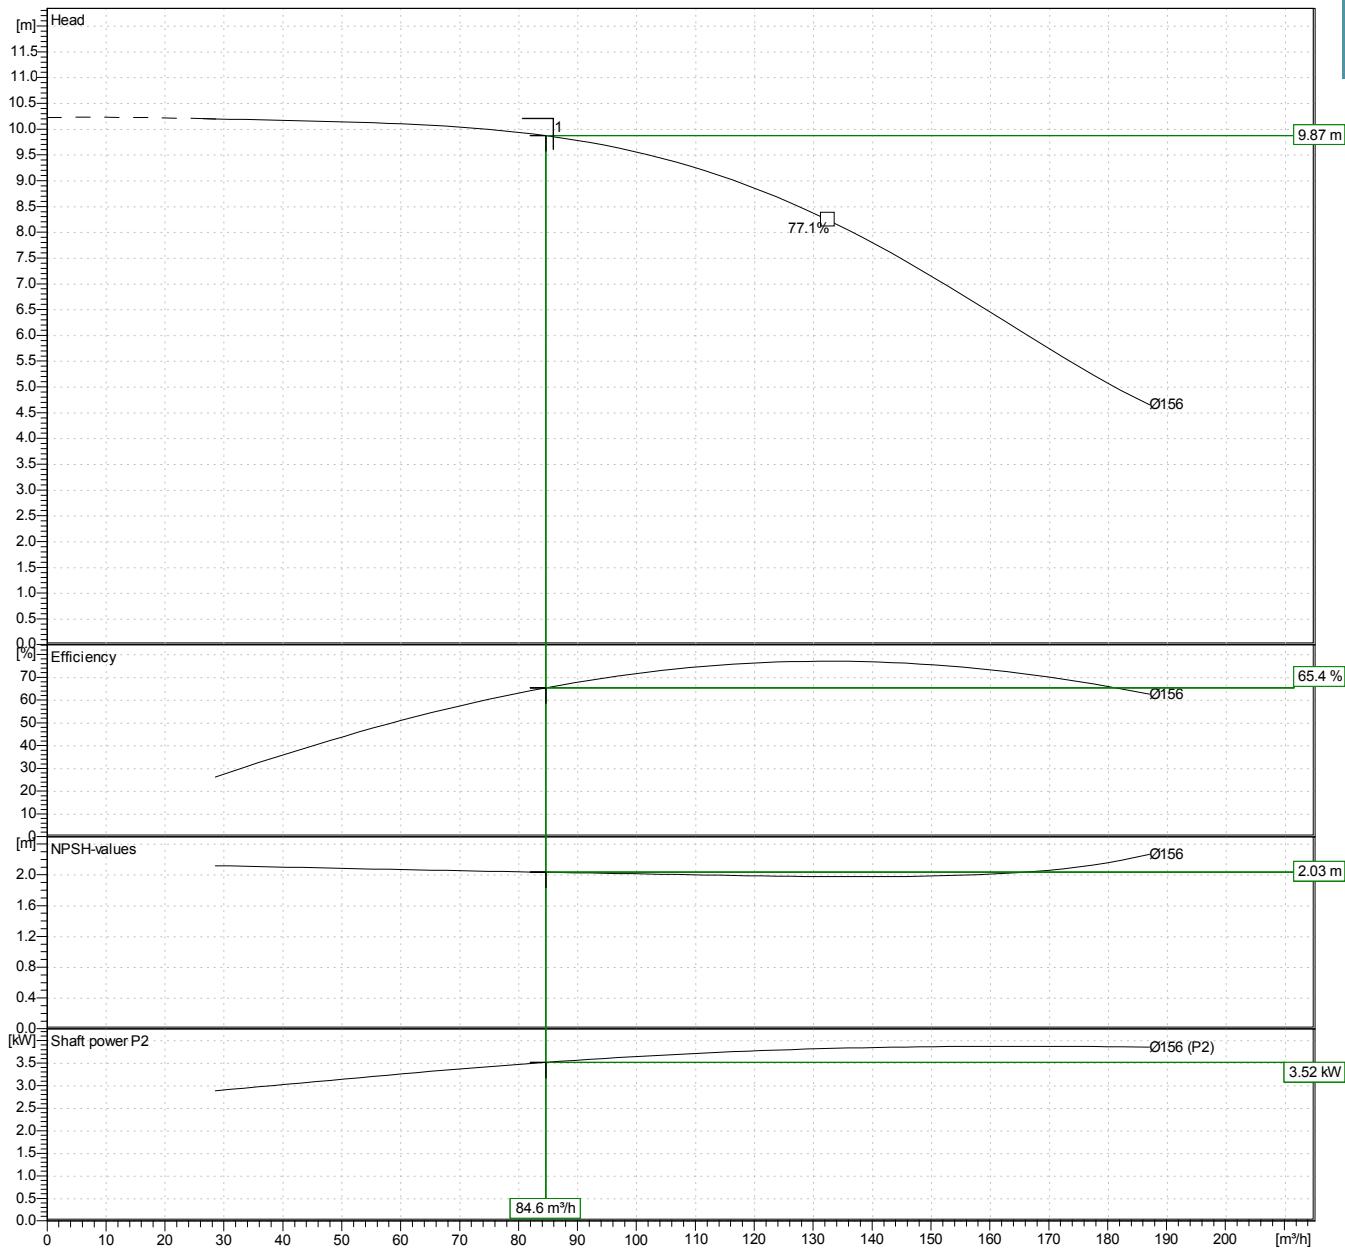

Customer Contact Phone number Email	Date Project Project no.	2015-03-11
--	--------------------------------	------------

NSCS 100-160/40/W46VCC4**Dimensions mm/m³**


a	125	Volumen	0.11938
AD	192	x	140
b	80		
Bmax	388		
DNd	100		
DNs	125		
E	3/8"		
f	183		
F	3/8"		
g1	26		
h1	200		
h2	280		
h3	88		
Hmax	480		
L	641		
m1	160		
m2	120		
n1	360		
n2	280		
PM1	1/4"		
s1	19		
Trim	0		
Type	A	Total weight	119 kg

Connections mm

Suction nozzle	Discharge nozzle
DN125	DN100
PN10/16	PN10/16
EN1092-2 (NSC)	EN1092-2 (NSC)

C	26	C	24
D	255	D	230
d1	184	d1	157
K	210	K	180
L	19	L	19
z	8	z	8

Value C, D may vary from Standard

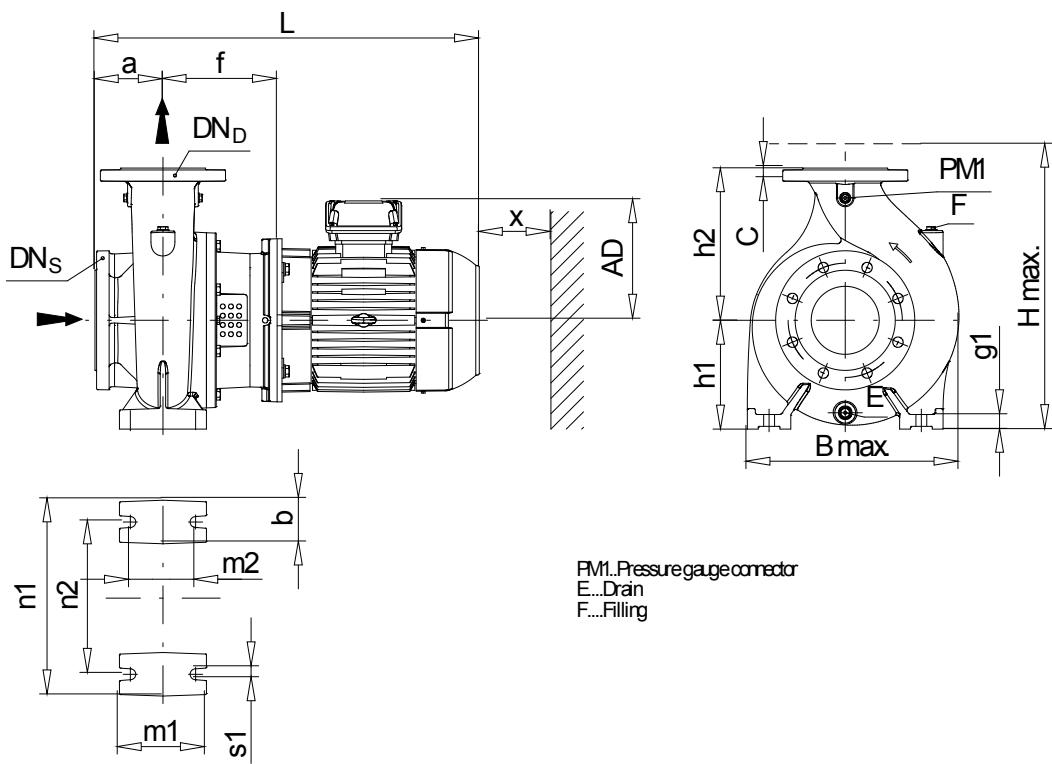Drawing

Customer Contact Phone number Email	Date 2015-08-27 Project Project no.
--	---

NSCS 100-160/40/W45VCC4

703740820

Operating data

Pump type	Single head pump	Fluid	Water, pure
No. of pumps / Reserve	1 / 0	Operating temperature t A	K 277
Nominal flow	m³/h 0	pH-value at t A	7
Nominal head	m 0	Density at t A	kg/m³ 1000
Static head	m 0	Kin. viscosity at t A	mm²/s 1.569
Inlet pressure	kPa 9.8	Vapor pressure at t A	kPa 2.34
Environmental temperature	K 293	Solids	0
Available system NPSH	m 0	Altitude	m 1000

Pump data

Make	Lowara	Nominal	m³/h	()
Speed	1/min 1450	Flow	m³/h 193	
Number of stages	1	Max-	m³/h 25	
Max. casing pressure	kPa 1600	Min-	m	
Max. working pressure	kPa 105.9	Head	at Qmax m 4.6	
Head H(Q=0)	m 11	at Qmin	m 10.7	
Weight	kg	Shaft power	kW ()	
Max.	mm 190	Max. shaft power	kW 3.7	
Impeller R designed	mm 190	Efficiency	%	
Min.	mm 144	NPSH 3%	m	
Suction nozzle	DN125 PN10/16 EN1092-2 (NSC)	Discharge nozzle	DN100 PN10/16 EN1092-2 (NSC)	

Pump Materials

Impeller	Cast iron, 0.6020
Casing	Cast iron, 0.6025
casing cover	Cast iron, 0.6025
Wear ring	stainless steel, 1.4301
Shaft	Stainless steel, 1.4057
Bearing frame	Cast iron, 0.6025

Shaft Seal

Mechanical Seal	
e-NSC, e-LNE - MG1S2	Burgmann
Rotating Assembly	B-Resin impregnated carbon
Fixed Assembly	Q1-Silicon carbide
Elastomers	E - EPDM
Springs	G-AISI 316
Other Components	G-AISI 316

Motor data

Manufacturer	WEG	Electric voltage	400 V
Specific design IE3 motors - Cast Iron Frame - Premium Efficiency			
Type	W22 - 112 M - 4kW	Electric current	8 A
Rated power	4 kW	Degree of protection	IP55
Speed	1450 1/min	Insulation class	F
Frame size	112 M	Weight	44 kg
Shaft diameter	28 mm	Colour	RAL 5010

Coupling

Manufacturer	
Series	
Type	
Frame size	
Spacer length	
Weight	
Coupling protection	

Base plate

Description
Weight

Remarks:

Customer Contact Phone number Email	Date Project Project no.	2015-08-27
--	--------------------------------	------------

NSCS 100-160/40/W45VCC4

703740820


Hydraulic data

Operating Data Specification	Hydraulic data (duty point)	Impeller design
Flow 0 m³/h	Flow	Impeller R 190 mm
Head 0 m	Head	Frequency 50 Hz
Static head 0 m		Speed 1450 1/min

Power data referenced to:

Water, pure [100%] ; 277K; 1000kg/m³; 1.57mm²/s

Performance according to ISO 9906 - Annex A

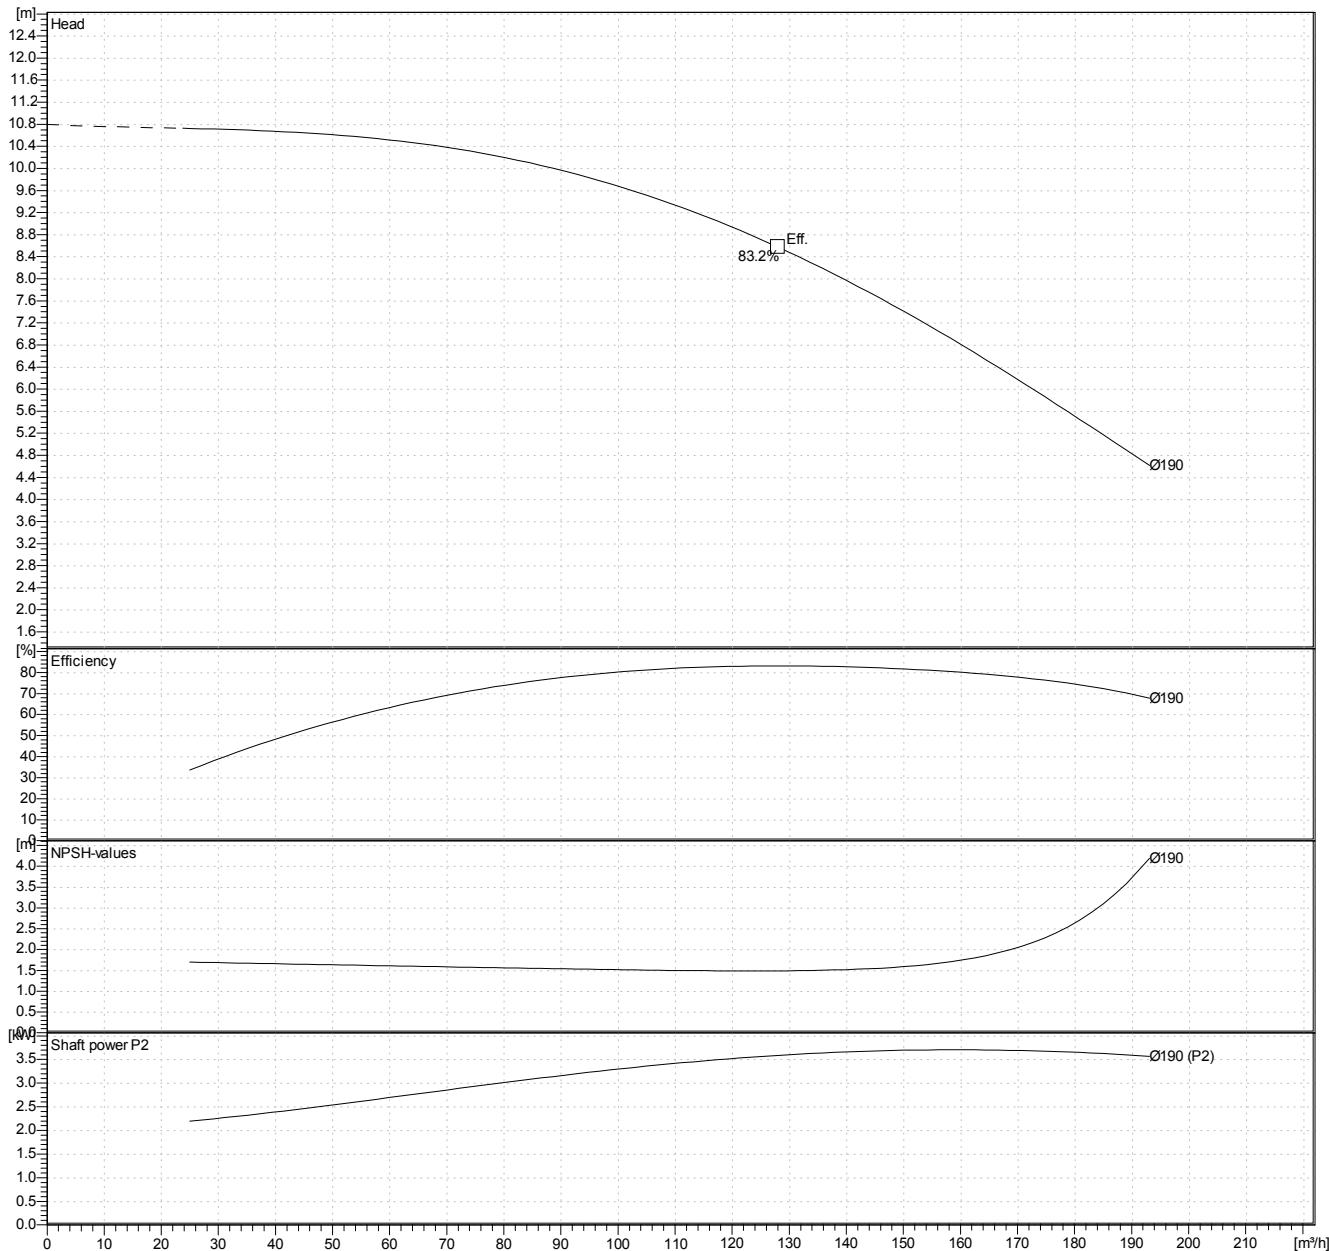

Customer Contact Phone number Email	Date Project Project no.
	2015-08-27

NSCS 100-160/40/W45VCC4

703740820

Dimensions mm/l


a	125	Volumen x	0.11938
AD	192		140
b	80		
Bmax	388		
DNd	100		
DNs	125		
E	3/8"		
f	183		
F	3/8"		
g1	26		
h1	200		
h2	280		
h3	88		
Hmax	480		
L	641		
m1	160		
m2	120		
n1	360		
n2	280		
PM1	1/4"		
s1	19		
Trim	0		
Type	A	Total weight	119 kg

Connections mm

Suction nozzle	Discharge nozzle
DN125	DN100
PN10/16	PN10/16
EN1092-2 (NSC)	EN1092-2 (NSC)

C	26	C	24
D	255	D	230
d1	184	d1	157
K	210	K	180
L	19	L	19
z	8	z	8

Value C, D may vary from Standard

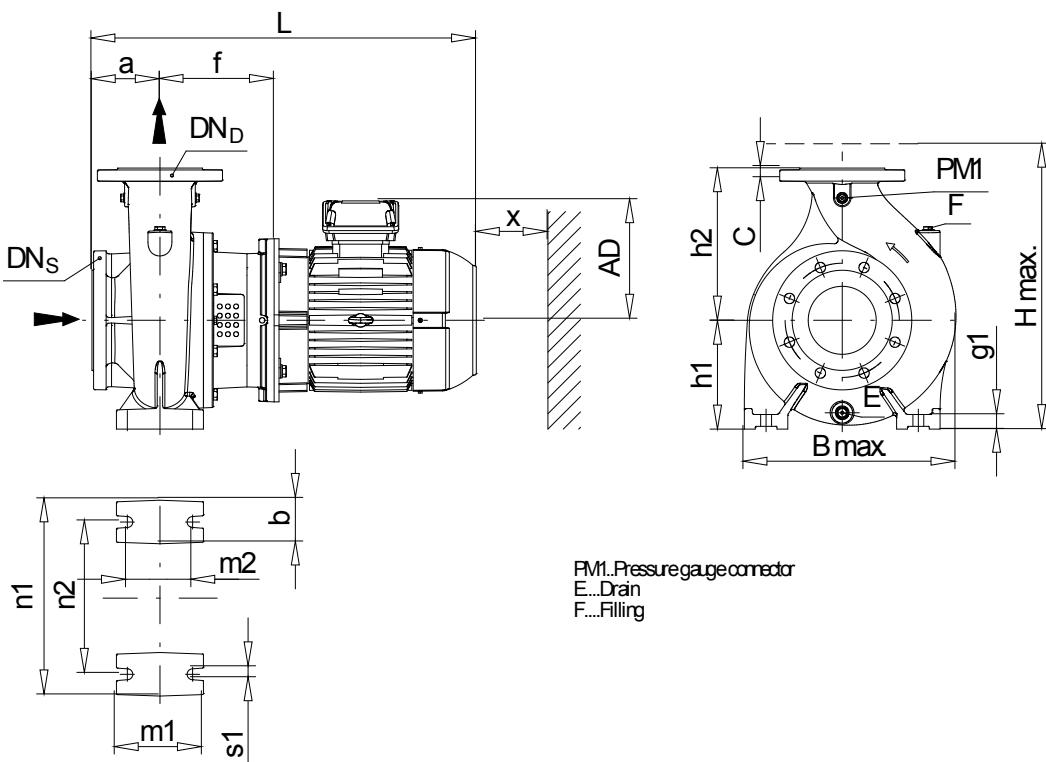Drawing



SONDEX

S21/S22 + S36+S47 + S64

Plate Heat Exchanger



Recommended Applications:

The **S21/S22, S36+S47 and S64** range of **Sondex** plate heat exchangers is specially designed for the HVAC area, the geothermal-, marine- and heat recovery area as well as for the industrial- and chemical market.

Design Principle:

The **Sondex** plate range with lengths up to 1.9 m and up to extra "long" thermal pattern, will cover many duties up to 150 m³/h in a single pass solution, which means that all connections are on the head side. This will ensure easy pipe- and service work, and by dismantling the exchanger for service, no pipes need to be removed.

The heat transfer is obtained, when the warm medium transfers energy through the thin, strong flow plates between the channels and delivers it to the cold opposing medium without mixing the two media. Countercurrent flow creates the optimum efficiency.

The plate- and inlet design allows an effective and easy CIP (Cleaning In Place) of all "flow" surfaces.

Flow Plates:

The corrugated "herringbone" pattern ensures turbulent flow in the whole effective area. Furthermore, this pattern brings "metallic" contact between the plates, and together with lock devices on the gaskets, the plate pack is easily assembled.

The plate pack is held firm and safely between the fixed head and movable follower of the frames.

Data Required for Correct Quotation:

Duty, flow rate, type of media, temperatures, working pressure, pressure losses and thermodynamic properties determine the choice of exchanger type, size of heat surface and plate pattern.

Technical Information

Frame:

Painted frame with the clamping bolts placed around the frame edge.

Standard colour by painted frame:
Blue RAL 5010.

Available in other colours.

Working pressure:

The painted frames are designed for working pressure: 0.6/1.0/1.6/2.5 MPa

Intermediate Frames:

Intermediate frames and corner blocks for IS and FS frames in stainless steel.

Construction Standard:

According to PED 97/23/EC:

A-D "Merkblätter"

According to ASME CODE:

ASME VIII, DIV. 1

Connections:

DN100 flange Carbon steel, rubberlined or cladded, with

AISI316 or titanium.

According to all known standards.
3" & 4"/DN80/100 dairy unions.

According to all known standards.

Gaskets:

The gaskets are the unique "Sonder Lock" or "hang-on", non-glued type. Standard material: Nitrile, EPDM and Viton.

Plates:

Standard material
AISI 304, AISI 316 and titanium, 254 SMO.

Also 2 x 0.4 mm "Sonder Safe" plates.

Not standard: Hastelloy C 276 and other pressable materials.


Extra Equipment:

Safety covers in stainless steel.


Insulating jacket.

Assembling spanner.


Foundation feet for frame.




F1-F4 AND B1-B4
DN100 DIN2632/2633
CLADDED OR RUBBERLINED








F1-F4
DN100 DIN2632/2633
UNCLADDED

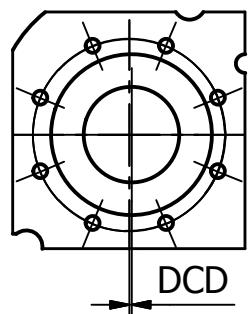

F1-F4 AND B1-B4
4 INCH ANSI CL150
DCD 2,5 MM
CLADDED OR RUBBERLINED

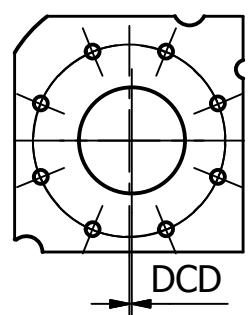


F1-F4
4 INCH ANSI CL150
DCD 2,5 MM
UNCLADDED

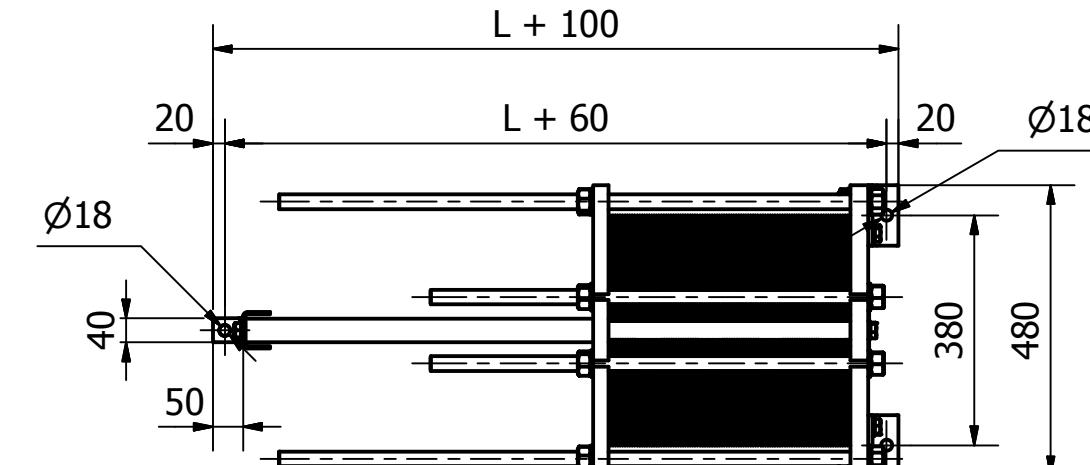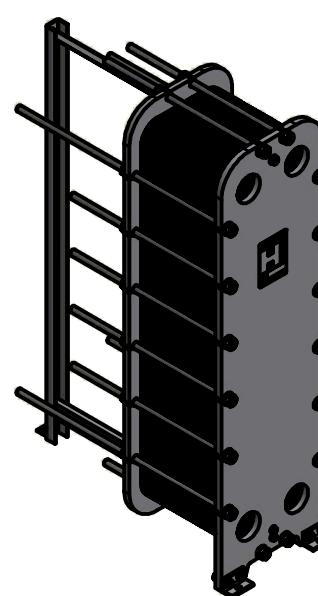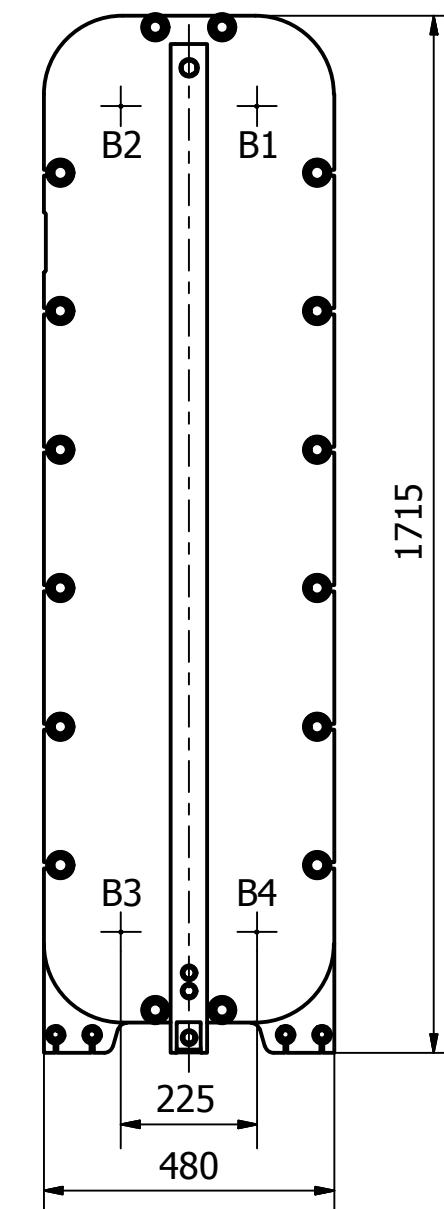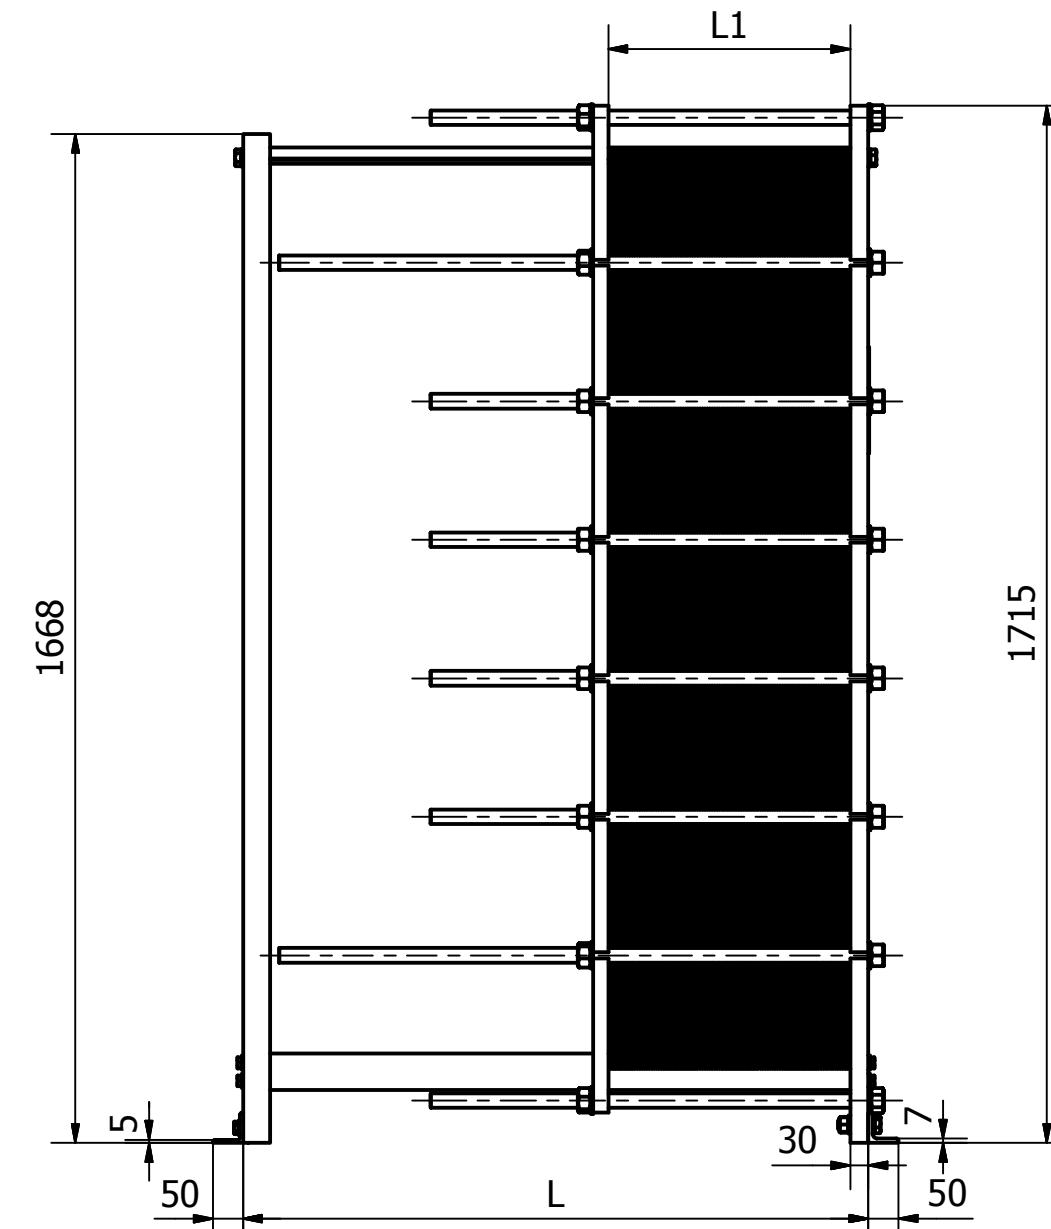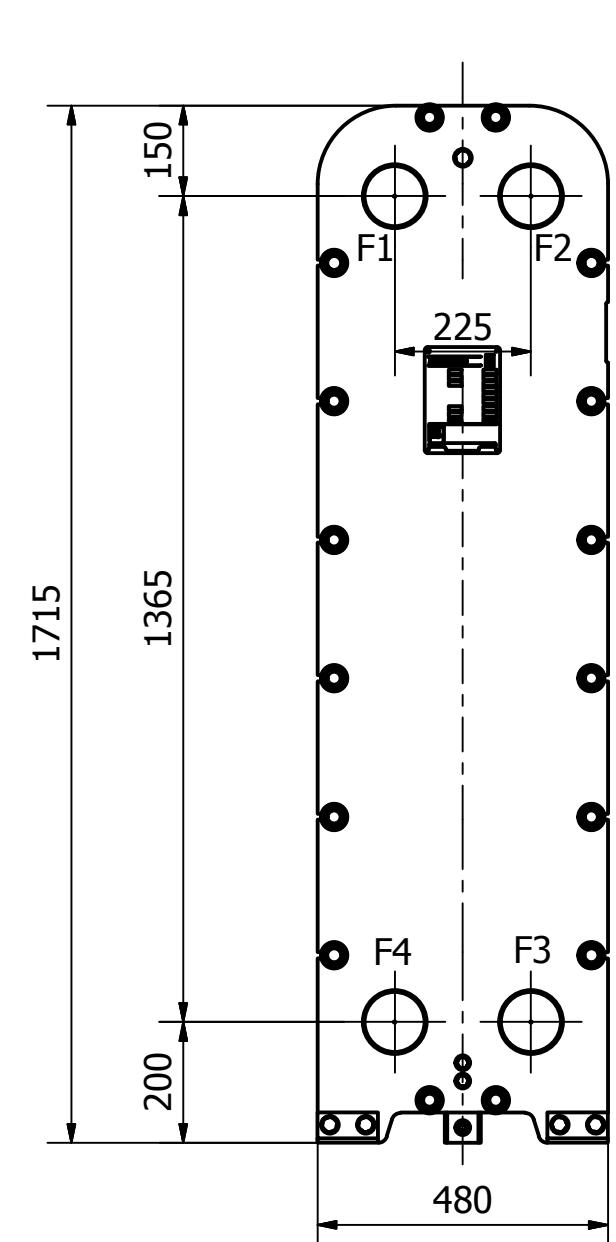

Dimensions without tolerance	Designed by	Date	Approved by	Date	Rev. no.	Revision Text
ISO 2768-m	JKO	08-11-2010	JRD	16-07-2012	03	CHANGED HEAD-FOLL-COLUMN-CARR BAR
ISO projekton						Description:
S47 IG PN10 DN100 DIM DRAWING						LENGTH 400-1000 MM
Rev. date	Rev. by	Drawing no.				
13-07-2012	LGK	S47IGPN10DN100L400-1000				
Sheet						1 / 1

Media: air – water – light oil – vacuum
 Pressure range: 0 to 10 bar max
 Media temperature: 90° C max
 Ambient temperature: -20° to +60° C max
 Media viscosity: 50 centistokes max
 Mounting: coil upright
 Opening / Closing Time: 50 mSec Max



IN NC

2/2 Brass

N/CLOSED 2 WAY ASSISTED LIFT

TYPE PU220 & AD



PRESSURE

Ø Port	Ø Orifice (mm)	Flow Rate Cv Ltr/ min	Coil Size	Pressure Rating (bar)				Seals	Max Media Temp. °C	Part Number	
				Min	Max ΔP DC	Max ΔP AC	Max Working				
3/8 BSP	13	35	22003	0	5	8.5	10	NBR FKM EPDM	90 120 120	PU22003 + voltage PU22003V + voltage PU22003E + voltage	
1/2 BSP	13	35	22003	0	5	8.5	10	NBR FKM EPDM	90 120 120	PU22004A + voltage PU22004AV + voltage PU22004AE + voltage	
3/4 BSP	20	72	22003	0	5	8.5	10	NBR FKM EPDM	90 120 120	PU22006A + voltage PU22006AV + voltage PU22006AE + voltage	
1 BSP	25	183	22003	0	5	7	10	NBR FKM EPDM	90 120 120	PU22008A + voltage PU22008AV + voltage PU22008AE + voltage	
1 1/4 BSP	35	400	WPA2	0	7	10	10	NBR FKM EPDM Silicone	90 120 120 120	AD35N + voltage AD35V + voltage AD35E + voltage AD35S + voltage	
1 1/2 BSP	35	400	WPA2	0	7	10	10	NBR FKM EPDM Silicone	90 120 120 120	AD40N + voltage AD40V + voltage AD40E + voltage AD40S + voltage	
2 BSP	51	580	WPA2	0	5	7	10	NBR FKM EPDM Silicone	90 120 120 120	AD50N + voltage AD50V + voltage AD50E + voltage AD50S + voltage	

OPTIONS

Connector PG9 – DIN 43650 A

IP65 Coil

Explosion Proof Coil: EExmIIT4 ATEX IIG IP65 T 130°C (Optional T6 T 85°C)

NPT

HTA2 Coil 200°C N Rated (WPA2 size only)

ELECTRICAL DATA

Voltage (-10% + 10%) Continuous duty 100%	Coil Size	Power		Insulation class	Enclosure	Electrical connections		
		Inrush	Holding					
~ 24 - 48 - 110 - 240 - 380 (50 or 60 Hz)	22003	23VA	17VA	H 180°C	IP 65 with connector	3 spades DIN 43650A DIN 40050 VDE 0110		
= 12 - 24 - 48 - 110 (DC)		15 Watts						
~ 24 - 110 - 230 (50 or 60 Hz)		40VA	24.2VA	F 155°C				
= 12 - 24 (DC)		18 Watts						

CONSTRUCTION

Body: Brass

Tube and internal parts: Stainless steel

Seals and gaskets: NBR (Optional EPDM or FKM)

Moulded coil: Resin

REPAIR KIT

Diaphragm seal

Valve part number + material


Coil

Coil size (22003 or WPA2) + voltage

Complete plunger + O' rings

KIT+ valve part number

OVERALL DIMENSIONS



Model	PU220 03	PU220 04A	PU220 06A	PU220 08A	AD35	AD40	AD50
Port R	3/8	1/2	3/4	1	11/4	11/2	2
A	66.5	66.5	71.0	96.0	120	120	150
B	101.0	101.0	107.0	120.5	140	140	160
C	48.0	48.0	58.0	70.0	90	90	120
Kg	0.74	0.715	0.92	1.4	2.87	2.77	4.81



N/Open
Page 22

Dial Thermometer – Rigid Stem

Nominal Size

63mm • 100mm • 160mm • 250mm

Accuracy

± 1% FSD

Case Material

304 stainless steel.

Stem Material

316 stainless steel.

Stem Length

From 100mm - 2 metres (depending on range)

Other Options

Dual Scale

Electrical Contacts, single or double

Max. indicating pointers

Glycerine Filled Heads

Anti-vibration Springs (Pyrometers)

Plastic Window

Various ranges available.

Various fittings available.

Non-toxic system available.

Bimetallic also available



TEMPERATURE PROBES & ACCESSORIES

- STANDARD OR CUSTOM PROBES
- RTD, TC OR THERMISTOR
- CHOICE OF TERMINATION STYLES
- TRANSMITTER OPTIONS
- FULL RANGE OF THERMOWELLS



INTRODUCTION

Status Instruments Ltd provide a complete range of sensors for temperature measurement. Our sensors include:

- PLATINUM RESISTANCE TEMPERATURE DETECTORS
- THERMOCOUPLES
- THERMISTORS

Our experience has enabled us to offer a comprehensive range of styles to provide the ideal sensor for every application and all manufactured under our ISO 9001 quality procedures. Complete sensor assemblies may be ordered by simply specifying the respective order code for each component required. Unless you specifically request that the components are to be supplied separately, we will assemble the components into a complete unit.

SENSOR SENSITIVITY

This may be defined as the change in sensor output relative to the temperature change it is detecting. Thermocouples produce a non-linear voltage output proportional to the temperature difference between the Hot or measuring junction and the Cold or reference junction, sensitivities vary typically from about (20 to 50) $\mu\text{V}/^\circ\text{C}$. Pt100 Platinum resistance sensors change their resistance as a function of temperature. The most commonly used exhibit a $0.385 \Omega/^\circ\text{C}$ change. Thermistors provide a much higher change of resistance with temperature, but have restricted ranges and are very non-linear unless used over narrow temperature spans.

STANDARD TEMP. SENSORS (STS) SERIES


Temperature sensors can be supplied in a variety of styles and configurations, utilising thermocouple or thermistor elements as an alternative to Pt100 elements. If your exact requirements are not readily identified please contact our sales staff who will be pleased to discuss your application and provide a quotation.

(All dimensions in mm unless otherwise stated)

STS STYLE 1

Welded 316 ST/STEEL construction for screw fitting into process connections or STW series pockets (except style 2).


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 75, 100, 150, 200, 250 immersion
Process Thread	1/2" BSP parallel
Extension	12.7 dia x 75 long
Head Thread	M24 x 1.5
Tails	3 wire 7/0.2 Cu PTFE insulated, 150 long
Temp. Range	(-50 to 200) $^\circ\text{C}$ (at tip)

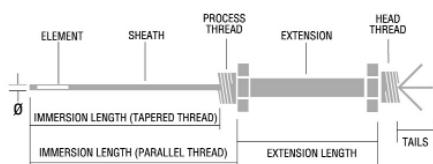

STS STYLE 2

All welded 316 ST/STEEL construction sensor for fitting into a compression gland.

Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 75, 100, 150, 200, 250 immersion
Head Thread	M24 x 1.5
Tails	3 wire 7/0.2 Cu PTFE insulated, 150 long
Temp. Range	(-50 to 200) $^\circ\text{C}$ (at tip).

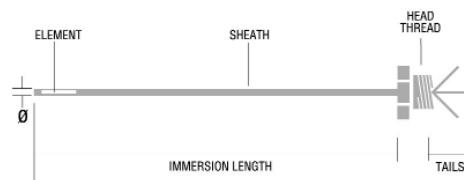


TEMPERATURE PROBES & ACCESSORIES

STS STYLE 3

All welded 316 ST/STEEL construction combined inset sensor and pocket. This sensor is designed to be used with a spring mounting kit fitted to the transmitter or terminal block to provide faster response times. The type of transmitter/terminal block and connecting head required must be specified when ordering.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	7.9 dia x 75, 100, 150, 200, 250 immersion
Process Thread	½" BSP parallel
Extension	12.7 dia x 75 long
Head Thread	M24 x 1.5
Tails	3 wire 7/0.2 Cu PTFE insulated, 150 long (-50 to 200) °C (at tip)
Temp. Range	

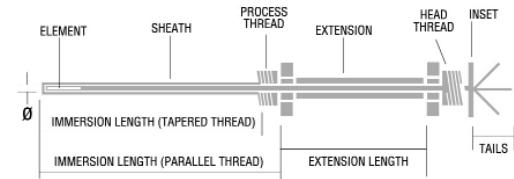

STS STYLE 4

Flying lead sensor with 316 ST/STEEL sheath for fitting into a compression gland.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 75, 100, 150, 200, 250 immersion
Cable	3 wire 7/0.2 Cu PTFE insulated, 1 m long
Temp. Range	(-50 to 200) °C (at tip)

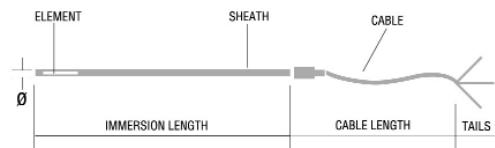

STS STYLE 5

Square aluminium block, strap-on-sensor with flying lead for clamping directly to pipes.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	¼" square x 50 long
Extension	4.0 dia x 19 long
Cable	3 wire 7/0.2 Cu PTFE insulated, 1 m long
Temp Range	(-50 to 200) °C (at tip)

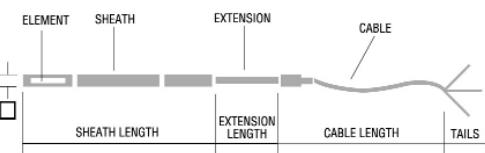

STS STYLE 6

316 ST/STEEL sensor suitable for energy management applications such as duct air and outside air temperature. This sensor can ONLY be used in conjunction with the SCH4 series connecting head.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 50, 150, 305 immersion
Flange	20.0 A/F Hex x 1.6 thick
Tails	3 wire 7/0.2Cu PTFE insulated, 75 long
Temp. Range	(-50 to 150) °C (at tip)

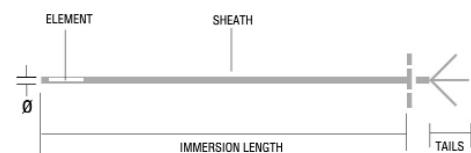

STS STYLE 7

All welded 316 ST/STEEL sensor with protective sheath suitable for energy management applications such as outside air temperature. This sensor can ONLY be used in conjunction with the SCH4 or DM500 (M16 entry) series connecting heads.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	12.7 dia x 50 long
Head Thread	M16 x 1.5
Tails	3 wire 7/0.2 Cu PTFE insulated, 75 long (-50 to 50) °C (at tip)

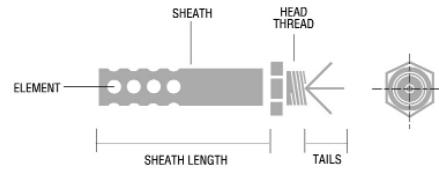

STS STYLE 8

Flying lead sensor with a 316 ST/STEEL sheath designed to be used as a direct replacement for mechanical thermometers in conjunction with the DM400 and DM500 series local indicators, see Instrument section.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	12.7 dia x 200 immersion length
Head Thread	M16 x 1.5
Cable	Flexible PVC sheath over cable 3 wire 7/0.2 Cu PTFE insulation, 1 m long (-50 to 200) °C (at tip)
Temp. Range	

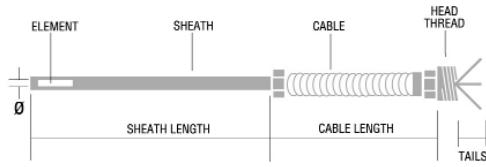

STS STYLE 9

All welded 316 ST/STEEL sensor for screw fitting into process connections or STW series pockets. Designed to be used with the Status SCH4 connecting head or the DM400/500 local indicators it features a "running nut" head which enables the indicator to be orientated to the optimum viewing position.

Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 75,100,150,200,250 immersion
Process Thread	½" BSP parallel
Extension	9.5 dia x 75 long
Head Thread	M16 x 1.5
Tails	3 wire 7/0.2 Cu PTFE insulated, 150 long (-50 to 200) °C (at tip)
Temp. Range	

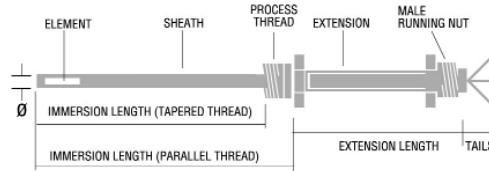


TEMPERATURE PROBES & ACCESSORIES

STS STYLE 10

All welded 316 ST/STEEL sensor for screw fitting into an internal thread hygienic type process connection.


Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 75,100,150,200,250 immersion
Process Thread	¾" BSP parallel male running nut
Extension	12.7 dia x 75 long
Head Thread	M24 x 1.5
Tails	3 wire 7.0.2 Cu PTFE insulated, 150 long
Temp. Range	(-50 to 200) °C (at tip)

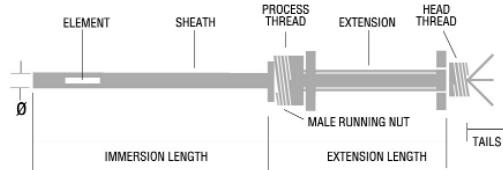

STS STYLE 11


All welded 316 ST/STEEL sensor for screw fitting into an external thread hygienic type process connection.

Element	Pt100 to BS.EN 60751 IEC751 Class B*
Sheath	6.0 dia x 75,100,150,200,250 immersion
Process Thread	¾" BSP parallel female running nut
Extension	12.7 dia x 75 long
Head Thread	M24 x 1.5
Tails	3 wire 7.0.2 Cu PTFE insulated, 150 long
Temp. Range	(-50 to 200) °C (at tip)

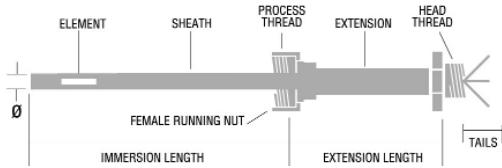

STS STYLE 12

All welded 316 ST/STEEL sensor for fitting to various hygienic process connections e.g. IDF, RJT, SMS patterns. Due to the wide variety of type and size of fittings, all sensors to this style are manufactured to customers specifications.

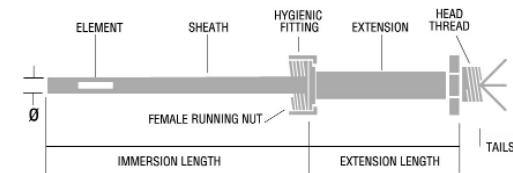

STW SERIES POCKETS/ THERMOWELLS

Some sensors can be fitted directly into the process by means of an integral process connection or by using an appropriate compression fitting. Other applications require a pocket or thermowell which is a permanent fitting into the process yet allows the sensor to be inserted or removed without interruption.

Pockets invariably increase the response time and obviously the thicker and heavier the pocket the more the response time will be increased. Some styles use spring loading which keeps the inset in permanent contact with the pocket. However, it is the radial clearance between the inset and pocket which has the greatest influence on response time.


For improved response the inset should be assembled into the pocket using thermally conductive grease. The following illustrations show the six most popular styles of pockets/thermowells.

NOTE: Pocket immersion lengths are relative to the probe lengths shown.

STW STYLE 1

All welded 316 ST/STEEL construction for screw fitting into process connection, suitable for STS sensors Style 1 and 9.


Sheath	7.9 dia x 71, 96, 146, 196, 246 immersion
Probe lengths	75, 100, 150, 200, 250
Process thread	¾" BSP Parallel
Internal thread	1½" BSP

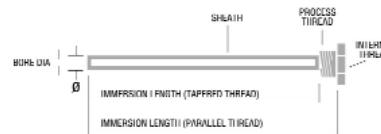

STW STYLE 2

All welded 316 ST/STEEL construction with brass compression gland, suitable for style 2, 4 & 6 sensors.


Sheath	7.9 dia x 23, 48, 98, 148, 198 immersion
Probe lengths	75, 100, 150, 200, 250
Process thread	1½" BSPT
Compression fitting	¼" BSPT x 6.0 dia.

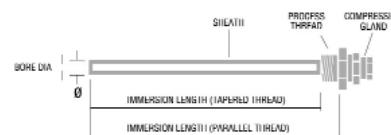

STW STYLE 3

All welded 316 ST/STEEL construction 'weld-in' pocket, suitable for Style 1,9 and Style 2, 4 & 6 sensors when used in conjunction with a compression gland.

Sheath	7.9 dia x 55, 80, 130, 180, 230 immersion
Probe lengths	75, 100, 150, 200, 250
Head	25.4 dia x 26 long typical
Internal Thread	1½" BSP Parallel

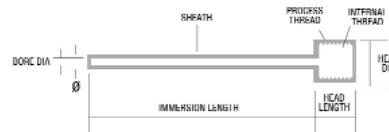


TEMPERATURE PROBES & ACCESSORIES

STW STYLE 4


Solid turned 316 ST/STEEL construction sensor for screw fitting into process connection, suitable for Style 1 sensors.

Parallel Sheath	13.4 dia x 57 & 82 immersion
Probe lengths	75 & 100
Tapered Sheath	13.4 to 19.0 dia x 132, 182, 232 immersion
Probe lengths	150, 200, 250
Process Thread	3/4" BSP Parallel
Internal Thread	1/2" BSP Parallel

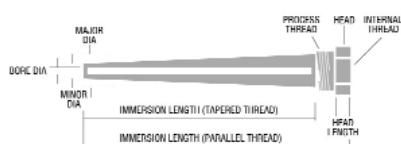

STW STYLE 5

All welded 316 ST/STEEL construction for bolting to a flanged process connection. Due to the wide variety of, dimensional, material, pressure and pipe size requirements, all thermowells of this style are manufactured to customers specifications.

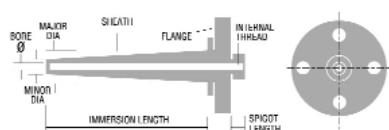

ORDER CODE




EXAMPLE: STS2 / 075 - Style 2, 75 mm Immersion

*NOTE: Pt100 sensors are supplied as standard to Class B. They can be supplied to Class A or 1/10 Class B on request. Sensors are also available with THERMOCOUPLE or THERMISTOR elements.

For special requirements please specify (where applicable) all details shown in diagrams, i.e. immersion length & diameter, extension length, element type, process thread, head thread, material & temperature range and in the case of hygienic sensors, the type and size of the fitting.


ORDER CODE

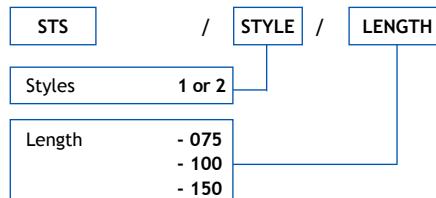

EXAMPLE: EXT1 /150 - Style 1, 150 mm long


For special requirements please specify, style, process thread, extension length, head thread and any other relevant details.

ORDER CODE

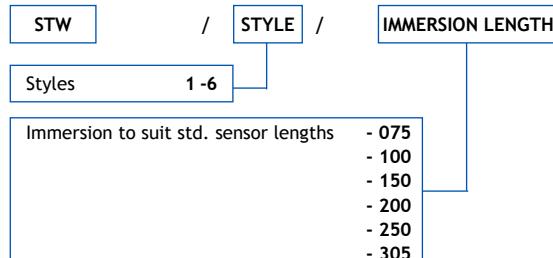

Example: STW2/075 - Style 2 pocket to suit 75 mm standard probe.

Note: For Styles 5 & 6 or special requirements on other styles, please specify (where applicable) all details shown in diagrams.

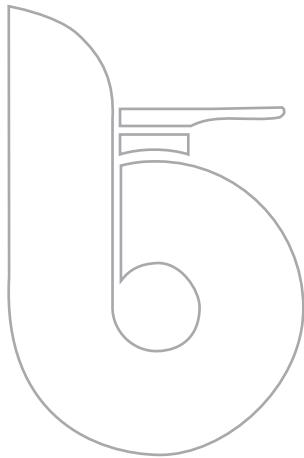

Via Novara, 199 - 28078 Romagnano Sesia (No) ITALY
Tel. +39.0163.828.111 - Fax. +39.0163.828.130

E-mail: info@brandoni.it
Internet: www.brandoni.it
P. IVA/VAT NUMBER 00113680037


REV. 11-05-2009



MANUALE D'USO E MANUTENZIONE
MAINTENANCE AND USE HANDBOOK
CE
1115

VALVOLE DI RITEGNO A CLAPET WAFER WAFER CHECK VALVES

SERIE 06-M6 - SERIES 06-M6

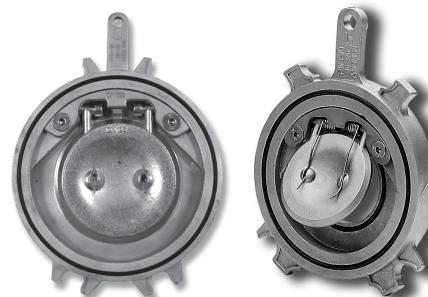

Art. 06 senza molla -
without spring

Art. M6 con molla -
with spring

Conformi alla Direttiva Europea 97/23/CE (PED)
Complying with European Directive 97/23/CE

Per impianti idrici, condizionamento, riscaldamento,
applicazioni industriali ed agricole, aria compressa
For chemical, food and industrial applications

CONDIZIONI DI IMPIEGO CONDITION OF USE

TEMPERATURA/TEMPERATURE	min °C	max °C
NBR	-10	100
VITON	-20	150
PTFE	-20	200
PRESSEIONE/PRESSURE		
Liquidi pericolosi - Hazardous liquids *	25 bar (DN32÷200) 16 bar (DN250÷300) 12 bar (DN350÷400)	
Liquidi non pericolosi - Non hazardous liquids *	25 bar (DN32÷200) 16 bar (DN250÷400)	
Gas non pericolosi - Non hazardous gases *	25 bar (DN32÷200) 16 bar (DN250÷400)	

* Secondo/according to: 97/23/CE - 67/548/EEC

INSTALLAZIONE INSTALLATION

- Maneggiare con cura.
- Montare nel senso corretto.
- Evitare colpi d'arie che possono provocare danni irreparabili.
- In caso di utilizzo con fluidi a temperatura elevata prestare attenzione al rischio di ustioni al contatto.
- Non smontare o eseguire interventi di manutenzione con impianto in pressione.
- Utilizzare il foro "O" per l'imbragatura- sollevamento.

Montaggio: avvicinare le controflange lasciando un gioco G adeguato al montaggio della valvola. Posizionare un bullone in uno dei fori inferiori delle flange (1) in corrispondenza delle alette presenti sul lato della valvola e posizionare la valvola appoggiando sul bullone una delle alette (2). Montare i restante i bulloni e serrarli a croce.


- Handle with care.
- Mount in the correct sense.
- Avoid pressure shock that can cause irreparable damages.
- Use hole "O" for the lifting.
- In case of use with hot fluids pay attention to the risk of scald.
- Do not dismantle or execute maintenance with pressure in the plant.

Mounting: draw near the flanges leaving a space G suitable for the mounting. Position a bolt in one of the inferior holes of the flange (1) corresponding to the tongue on the side of the valve and position the valve leaning one of the tongue the bolt.

STOCCAGGIO STORING

Conservare in luogo asciutto
Keep in a dry and cold place

fig. 1

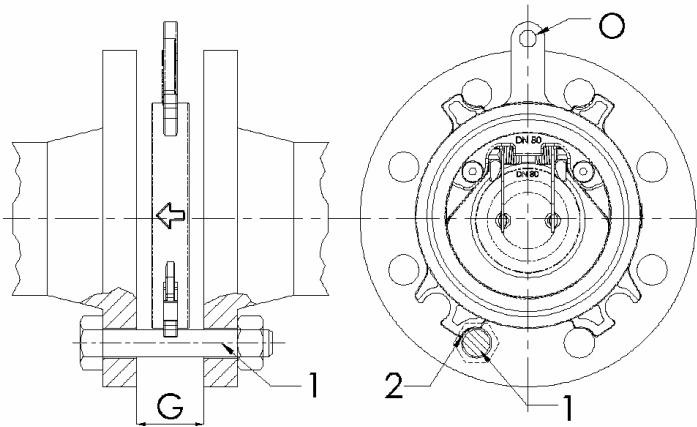

INSTALLAZIONE
INSTALLAZIONE
INSTALLAZIONE

AVVERTENZE
WARNING
ADVERTENCIA IMPORTANTE

CONDIZIONI DI IMPIEGO

CONDITION OF USE

CONDICIONES DE USO

TEMPERATURA	min °C	max °C
TEMPERATURE		
TEMPERATURA		
NBR	-10	80
EPDM	-10	120
VITON	-10	140
PTFE	-10	120

Pressione massima / Maximum allowable pressure		
Tipo fluido per / Fluid type acc. to 97/23/CE - 67/548/EEC	Montaggio / Mounting	
	tra flange / between flange	fine linea / end of line
G1 Gas pericolosi Hazardous gases	16 bar DN25-200 10 bar DN250-350 NO DN400-1000	10 bar DN25-100 NO DN125-1000
G2 Gas non pericolosi Non hazardous gases	16 bar DN25-300 10 bar DN350-500 6 bar DN600-800 5 bar DN900-1000	10 bar DN25-300 6 bar DN350-500 4 bar DN600-800 3 bar DN900-1000
L1 Liquidi pericolosi Hazardous liquids	16 bar DN25-400 10 bar DN450-1000	10 bar DN25-400 6 bar DN450-1000
L2 Liquidi non pericolosi Non hazardous liquids	16 bar DN25-400 10 bar DN450-1000	10 bar DN25-400 6 bar DN450-1000

Headquarters: Via Novara, 199 - 28078 Romagnano Sesia (No) ITALY
Tel. +39 0163 828 111 - Fax. +39 0163 828 130



E-mail: info@brandoni.it
Internet: www.brandoni.it

Internet: www.brandoni.it

P. IVA/VAT NUMBER 00113680037

EV. 11-06-2009

MANUTENZIONE
MAINTENANCE
MANTENIMENTO

Non è richiesta manutenzione (non effettuare interventi).
No maintenance required (do not service).
No requiere de ningún tipo de mantenimiento especial.




Fig. 1

MANTENIMENTO
MAINTENANCE
MANUTENZIONE

STOCKAGGI E TRASPORTO
STORING AND TRANSPORT
ALMACENAJE Y TRANSPORTE



MANUALE D'USO E MANUTENZIONE

MAINTENANCE AND USE HANDBOOK

INSTALACIÓN Y MANTENIMIENTO

VALVOLE A FARFALLA

BUTTERFLY VALVES

VÁLVULAS DE MARIPOSA



Conformi alla Direttiva Europea 97/23/CE (PED)
Complying with European Directive 97/23/CE
Conforme a 97/23/CE (PED)

Per impianti idrici, riscaldamento, condizionamento, antincendio e gas. Non adatta per vapore. In caso di utilizzi particolari richiedere al produttore la compatibilità con l'applicazione.
For water systems, heating, conditioning, fire prevention and gas.
Not suitable for steam. For specific uses ask the manufacturer about product compatibility.
Para sistemas de agua, aire acondicionado, calefacción, anti-incendio y gas. Usos industriales, químicos y alimentación.
Consultar listado de fluidos. No válido para vapores.

INSTALLAZIONE INSTALLATION INSTALACIÓN

Per le versioni Wafer centrare la valvola sugli occhielli. Serrare i bulloni a croce e progressivamente distribuendo uniformemente la pressione prima del contatto fra corpo e flangia (Fig. 6). I colpi d'ariete possono causare danni e rotture. Raccomandiamo di evitarli o adottare giunti elastici per ridurne gli effetti.

Per la versione LUG, verificare che le viti d'installazione siano della giusta lunghezza, in modo da permettere la compressione completa della gomma manicotto "Liner". La turbolenza del fluido può aumentare l'usura e ridurre la vita della valvola. Per ridurre il fenomeno si raccomanda di installare la valvola ad una distanza minima di almeno 1 volta il DN a monte e 2-3 DN a valle di raccordi e curve.

In posizione aperta la valvola presenta un ingombro maggiore dello scartamento nominale. Verificare che non vi siano interferenze con altri elementi della tubazione che possano provocare danni o malfunzionamenti (Fig. 7A). Nel caso installare un distanziatore per consentire il corretto funzionamento (Fig. 7B).

Avoid inclinations, torques and non-alignments of the piping which could stress the valve once installed.

Do not use the softest parts (handle, wheel) to lift the valve.

The valve disc must be half open (Fig. 1).

Place the valve between two flanges. When placing valves between flanges, make sure that there is enough space not to damage rubber.

Do not install gaskets between valve and flanges. (Fig. 2).

Protruded sharp ends shall be strictly avoided as it causes damage on/off rubber seating surfaces of the butterfly valve (Fig. 3).

Do not install the butterfly valve on a rubber to rubber surface (e.g. expansion joints); the perfect installation shall be on rubber to metal surface (Fig. 4).

Do not place joints between flange and body - We recommend the use of flanges of the WELDING NECK type (Fig 5A).

When using flat flanges make sure the pipe is welded exactly edgewise with the flange (Fig. 5B).

Centre the valve by bolting the body locator first (Wafer type). Tighten bolts and nuts in progressive and crosswise with bolting pressure evenly distributed until the contact between valve body and flange faces (Fig. 6).

Pressure shocks can cause damages and breakage. We recommend to avoid them if possible or adopt expansion joints that could reduce pressure shocks' effects.

For the LUG type, please verify that the installation screws are of the right longness, in order to allow the complete compression of the liner rubber.

The fluid turbulence may increase the wear and reduce the valve endurance. In order to reduce the instance it is recommended to install the valve at a distance equal to at least 1 time the DN upstream and 2-3 DN downstream of fittings and bends.

In open position the valve shows a greater space occupied than the nominal face to face. You need to verify that there aren't interferences with other elements of the piping which could cause damages or malfunctions (Fig. 7A). In this case you need to set up a spacer to permit the right functioning (Fig. 7B).

Evitare inclinaciones, torsiones o desalinamientos de la tubería que puedan presionar a la válvula una vez instalada.

No utilizar las partes débiles (palanca, volante) para manipular-transportar la válvula.

El disco debe estar en posición semi-abierta (Fig. 1).

Situar la válvula entre dos bárdas. Estar seguro que durante el posicionamiento de la válvula hay

suficiente espacio entre las bárdas para evitar daños en el anillo. No instalar otros elementos o guarniciones entre válvula y bárdas. (Fig. 2).

Los tubos pueden causar daños en la superficie del anillo (Fig. 3).

No instalar la válvula en contacto directo con una superficie de goma (por ejemplo: juntas de expansión). La instalación requiere un contacto metal-goma. (Fig. 4).

No soldar la brida al tubo si la válvula está ya instalada. Se recomienda usar bárdas tipo WELDING NECK (Fig 5A).

Con bárdas planas, asegurarse que la brida está soldada hasta el final de la misma (Fig. 5B).

Para la versión wafer centrar la válvula sobre las orejetas. Los bulones deben ser apretados en cruz distribuyendo uniformemente la presión después del contacto entre el cuerpo y las bárdas (Fig. 6).

Los golpes de ariete pueden causar serios daños. Para evitarlos, se recomienda el uso de juntas de expansión para reducir los efectos del mismo.

Para la versión LUG, verificar que la tornillería utilizada tenga la largura justa, de modo que se permita la total compresión del anillo de cierre. La turbolenza del fluido podría aumentar el desgaste y limitar la vida de la válvula. Para reducir el fenómeno se recomienda instalar la válvula a una distancia de una vez de DN, por lo menos, aguas arriba y de 2-3 DN aguas abajo de empalmes y curvas.

Al estar abierta la válvula ocupa un espacio mayor que el de la anchura nominal. Comprueben que no hayan interferencias con otros elementos de la tubería que pudieran provocar daños o funcionamientos defectuosos (Fig. 7A). En tal caso habrá que instalar un distanciador para permitir un fucionamiento correcto (Fig. 7B).

Fig. 2

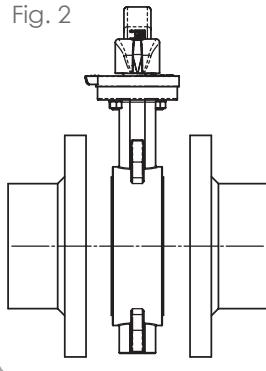


Fig. 4

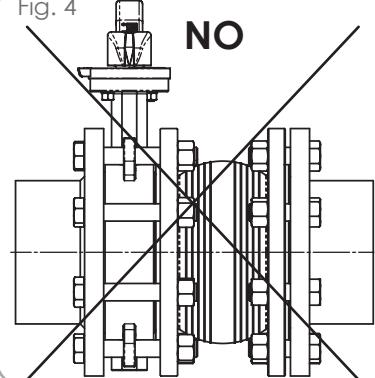


Fig. 3

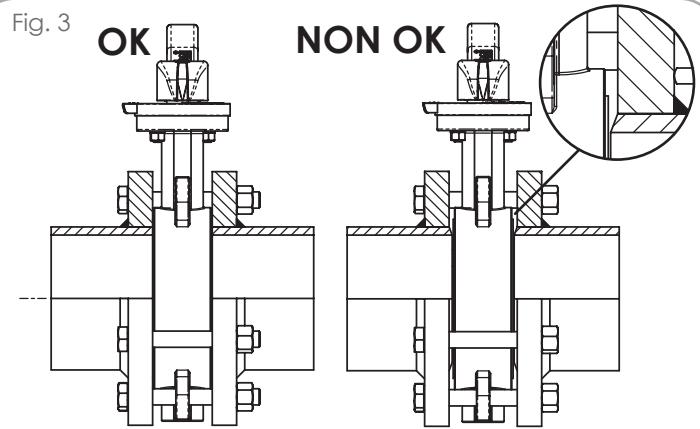


Fig. 5

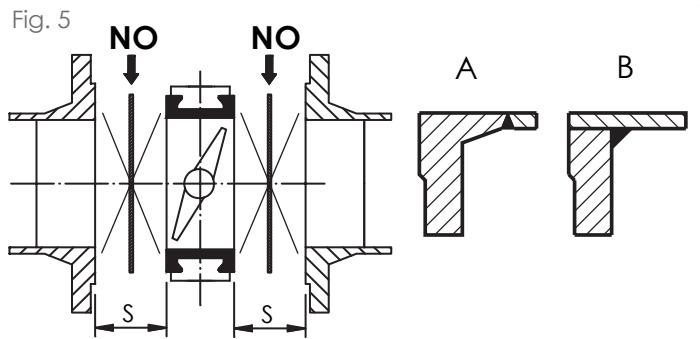


Fig. 6


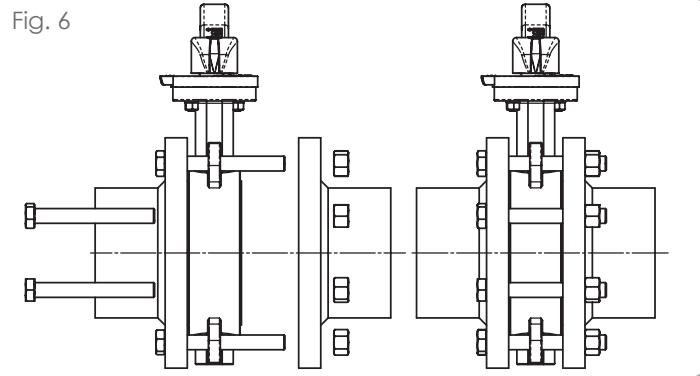


Fig. 7

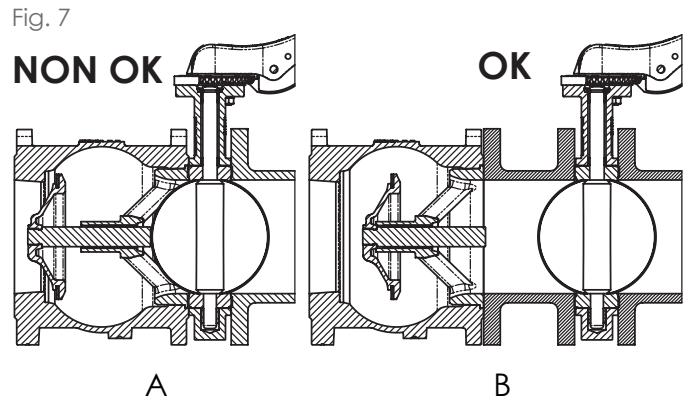


Epoxy Coated Ductile Iron Body, Stainless Steel 316 Disc
Direct Mount of Electric/Pneumatic Actuator, complies w/
1 1/2" to 12" to fit PN16, Other drillings available
1 1/4" to 2 1/4" to fit PN16 Flanges

Epoxy Coated Ductile Iron Body, Stainless Steel 316 Disc, EPDM Liner, Locking Lever upto 12", Gearbox Operation Available for All Sizes, ISO 5211 Top Works for Direct Mount of Electric/Pneumatic Actuator, complies with 97/23/CE (PED) Directive CE 1115.

Pressure/temperature:		
Pressure	1½" to 12"	PN 16
Temperature	14" to 24"	PN 10

-10°C to 120°C

Material List	Body	Epoxy Coated Ductile Iron
Disc	Stainless Steel	
Liner	EPDM	
Shaft	Stainless Steel	
Bushing	PTFE	
Washer	Galvanized Carbon Steel	
Girclip ISO 3075	Steel	
O-Ring	Viton	
Lever	Aluminum upto 6"	Ductile Iron 8" and above


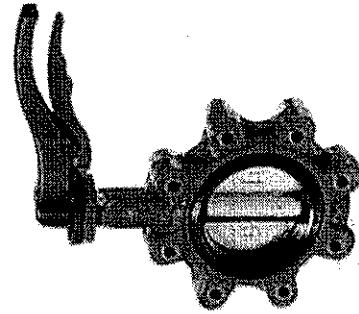


* ALSO OFFER ANSI 150, SAME DIMENSION
OF VALVE AS LISTED FOR PN16 *

Operating Pressure (bar)	Torque Figures										Speed Figures						
	25	32	40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
3	2.9	4.7	7.8	11.3	17	23	33	48	68	120	189	290	298	481	930	1250	2270
6	3.1	5.1	8.4	12	18	25	36	54	78	134	212	316	347	551	980	1350	2500
10	3.3	5.4	8.8	13	20	26	40	61	88	148	234	342	396	396	1200	1500	2100
16	3.4	5.7	9.7	13	21	28	44	68	99	162	257	367	-	-	-	-	-

Continued on Page 2

1½" to 10" Lever Operated

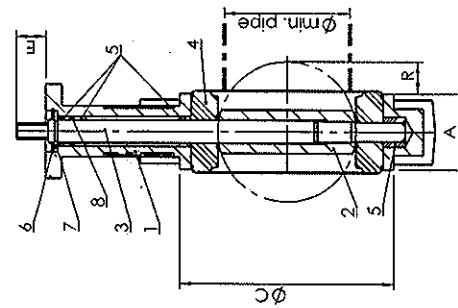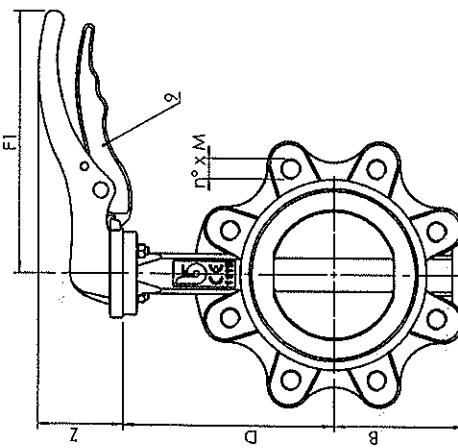


200

Dimensions	Sizes	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W	X	Y	Z	R	S	Unpiped	Welded	Dimensions
114"	33	82	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	4 x M16	4 x M16		
22"	43	89	126	62	170	50	5	27	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	4 x M16	4 x M16		
21½"	46	102	136	69	170	50	9	45	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	4 x M16	4 x M16		
3"	46	118	150	90	206	69	17	65	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	8 x M16	8 x M16		
4"	52	150	170	106	206	69	26	90	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	8 x M16	8 x M16		
5½"	56	174	180	119	285	90	34	110	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	8 x M16	8 x M16		
6"	56	205	200	131	285	90	50	146	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	8 x M20	8 x M20		
8"	60	260	230	166	400	72	71	194	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	12 x M20	12 x M20		
10"	60	310	266	207	520	72	91	241	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	12 x M20	12 x M20		


Dimensions

Dimensions	Size	150	175	190	195	210	215	230
1 1/2"	F05	65	50	4x7	9	21		
2"	F05	65	50	4x7	9	21		
2 1/2"	F05	65	50	4x7	9	21		
3"	F05	65	50	4x7	9	21		
4"	F05	65	50	4x7	11	21		
5"	F07	90	70	4x9	14	27		
6"	F07	90	70	4x9	14	27		
8"	F10	25	102	4x11	17	27		

卷之三


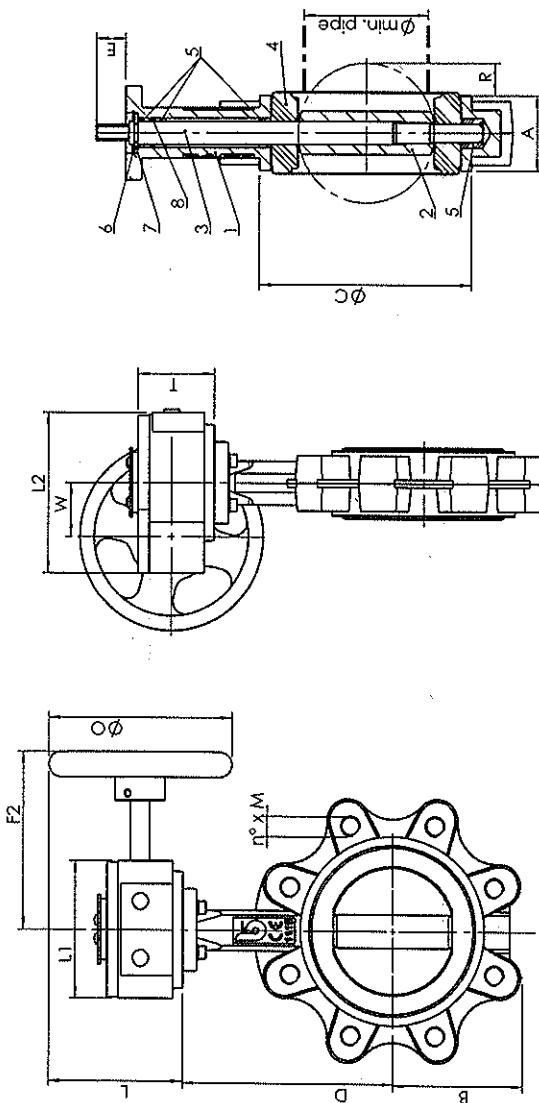
1½" to 10" Gearbox Operated

Dimensions	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	min. pipe (mm)	min. pipe (mm)
Size																						
1½"	33	82	116	63	130	102.5	65	110	130	45	150	5	27	4 x M16								
2"	43	89	126	62	130	102.5	65	110	130	45	150	5	31	4 x M16								
2½"	46	102	136	69	130	102.5	65	110	130	45	150	9	45	4 x M16								
3"	46	118	150	90	130	102.5	65	110	130	45	150	17	65	8 x M16								
4"	52	150	170	106	130	102.5	65	110	130	45	150	26	90	8 x M16								
5"	56	174	180	119	130	102.5	65	110	130	45	150	34	110	8 x M16								
6"	56	205	200	131	130	102.5	65	110	130	45	150	50	146	8 x M20								
8"	60	260	230	166	235	190	78	155	176	63	300	71	194	12 x M20								
10"	68	318	266	202	226	190	80	170	195	81	300	91	241	24 x M20								

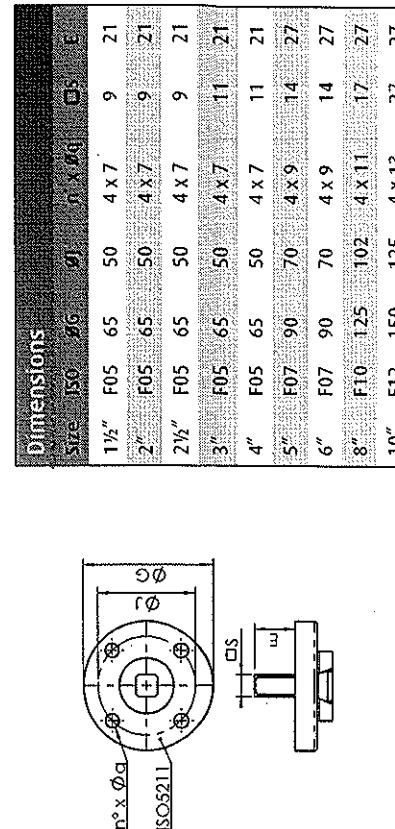

Continued on Page 4

12" to 24" Gearbox Operated

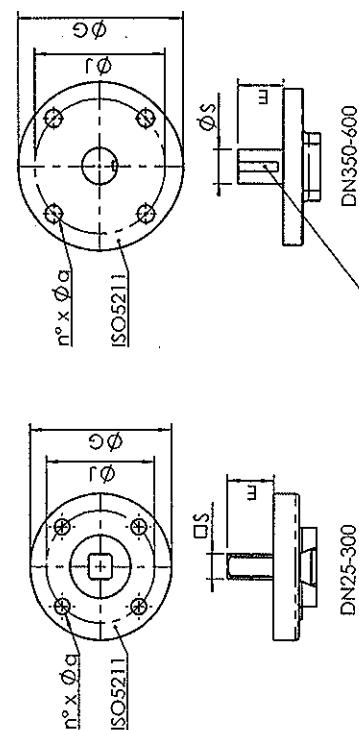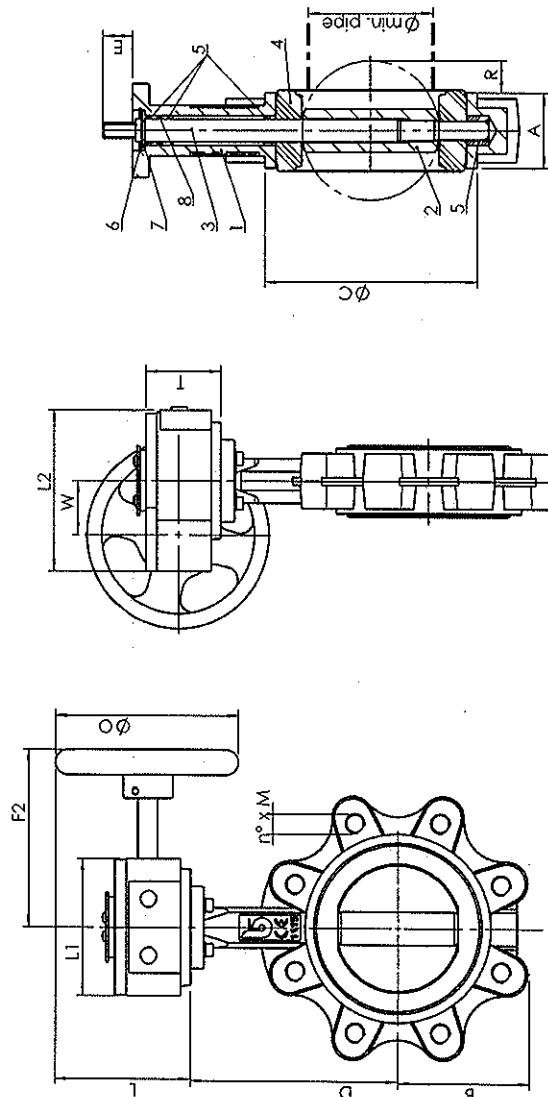


Dimensions	Size	A	B	C	D	E	F	G
12"	F12	150	125	4 x 13	27	27		
14"	F12	150	125	4 x 13	45	31.6		
16"	F14	175	140	4 x 18	51.2	33.15		
18"	F14	175	140	4 x 18	51.2	38		
20"	F14	175	140	4 x 18	64.2	41.15		
					15.5	12.25	78.2	54.75
					15.5	12.25	78.2	54.75

Epoxy Coated Ductile Iron Body, Stainless Steel 316 Disc, EPDM Liner, Locking Lever up to 12", Gearbox Operation Available for All Sizes, ISO 5211 Top Works for 1 1/2" to 16" to fit PN6/10/16, ANSI 150, Table D & E Flanges Direct Mount of Electric/Pneumatic Actuator, complies with 97/23/CE (PED) Directive CE 1115.

1 1/2" to 16" to fit PN6/10/16, ANSI 150, Table D & E Flanges
18 to 24" to fit PN16 Flanges

Pressure/Temperature	1 1/2" to 12"	PN 6
Temperature	14° to 24°	PN 0



Material List	Epoxy Coated Ductile Iron	Stainless Steel
Body	EPDM	
Shaft	Stainless Steel	
Bushing	PTFE	
Washer	Galvanized Carbon Steel	
Disc	Circlip ISO 3075 Steel	
O-Ring	Viton	
Lever	Aluminum up to 6" Ductile Iron 8" and above	
Bolts	Galvanized Carbon Steel	

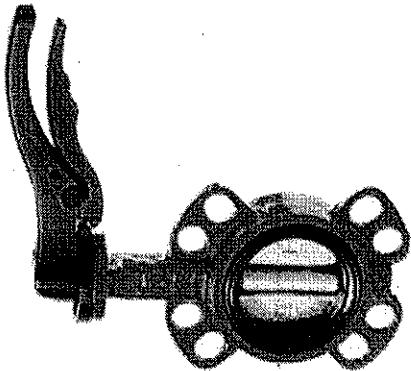

Operating Torque Figures	DP (Bar)	25	32	40	50	65	80	100	125	150	200	250	300	350	400	450	500	600
	3	2.9	4.7	7.8	11.3	17	23	33	48	68	120	189	290	298	481	930	1250	2270
	6	3.1	5.1	8.4	12	18	25	36	54	78	134	212	316	347	551	980	1350	2500
	10	3.3	5.3	5.4	8.8	13	20	26	40	61	88	148	234	342	396	396	1200	1500
	16	3.4	5.7	9.2	13	21	28	44	68	99	162	257	367	-	-	-	-	-

Continued on Page 2

1½" to 10" lever Operated

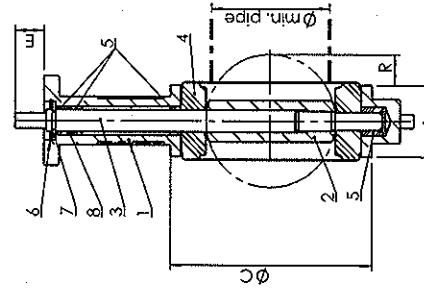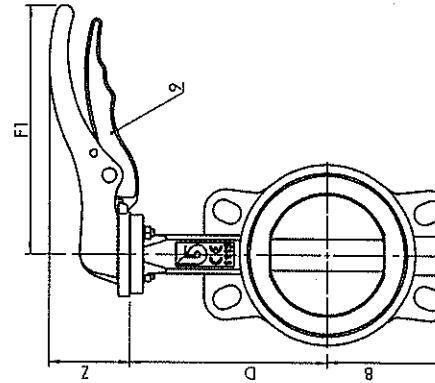


Dimensions

Size	A	B	C	D	E	F	G	H	I	J	K	L	M	N
1½"	33	82	116	63	170	50	5	27						
2"	43	89	126	62	170	50	5	31						
2½"	46	102	136	69	170	50	9	45						
3"	46	118	150	90	206	69	17	65						
4"	52	150	170	106	206	69	26	90						
5"	56	174	180	119	285	90	34	110						
6"	56	205	200	131	285	90	50	146						
8"	60	260	230	166	400	72	71	194						
10"	68	318	266	202	530	72	91	241						




Dimensions

Size	A	B	C	D	E	F	G	H	I	J	K	L	M	N
1½"	F05	65	50	4x7	9	21								
2"	F05	65	50	4x7	9	21								
2½"	F05	65	50	4x7	9	21								
3"	F05	65	50	4x7	11	21								
4"	F05	65	50	4x7	11	21								
5"	F07	90	70	4x9	14	27								
6"	F07	90	70	4x9	14	27								
8"	F10	125	102	4x11	17	27								
10"	F12	150	125	4x13	27	27								




Continued on Page 3

1½" to 10" Gearbox Operated

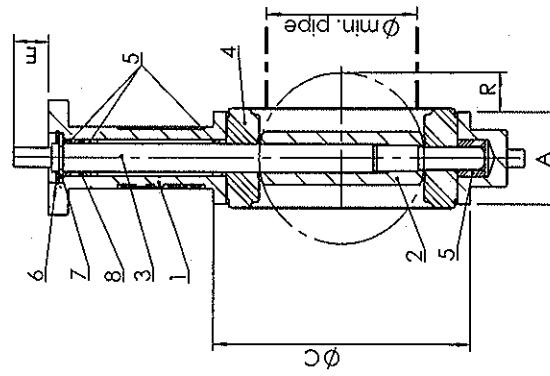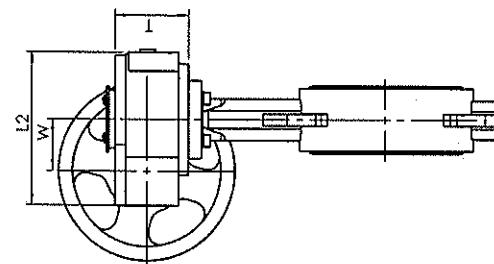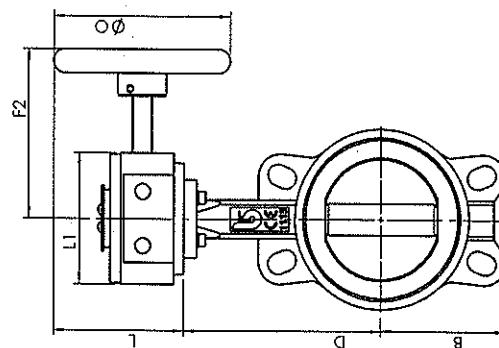

Dimensions




Size	A	B	C	D	E	F1	F2	G	H	I	J	K	L	M	N	O	P	Ø min. pipe	Ø min. pipe
1½"	33	82	116	'63	170	102.5	65	110	130	45	150	5	27						
2"	43	88	126	'62	170	102.5	65	110	130	45	150	5	31						
2½"	46	102	136	'69	170	102.5	65	110	130	45	150	9	45						
3"	46	118	150	'90	170	102.5	65	110	130	45	150	17	65						
4"	52	150	170	'106	170	102.5	65	110	130	45	150	26	90						
5"	56	174	180	'119	170	102.5	65	110	130	45	150	34	110						
6"	56	205	200	'131	170	102.5	65	110	130	45	150	50	146						
8"	60	260	230	'166	235	190	78	155	176	63	300	71	194						
10"	68	318	266	'202	226	190	80	170	195	81	300	91	241						



Dimensions		Size		S1		S2		S3		S4		S5		S6		S7		S8	
1½"	F05	65	50	4x7	9	21													
2"	F05	65	50	4x7	9	21													
2½"	F05	65	50	4x7	9	21													
3"	F05	65	50	4x7	11	21													
4"	F05	65	50	4x7	11	21													
5"	F07	90	70	4x9	14	27													
6"	F07	90	70	4x9	14	27													
8"	F10	125	102	4x11	17	27													
10"	F12	150	125	4x13	27	27													

Continued on Page 4

12" to 24" Gearbox Operated

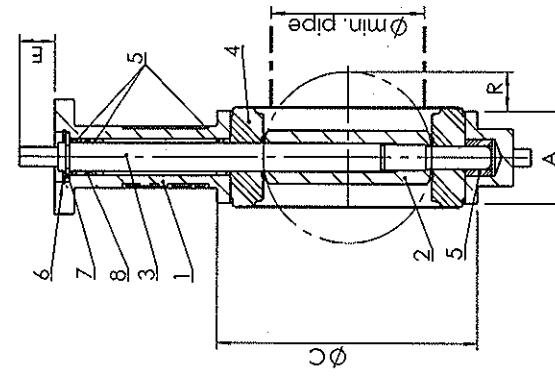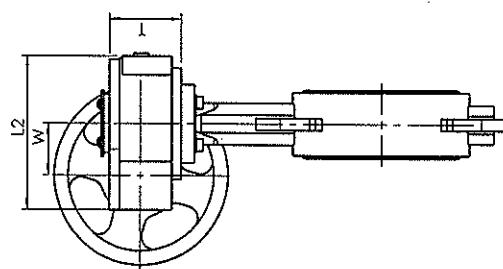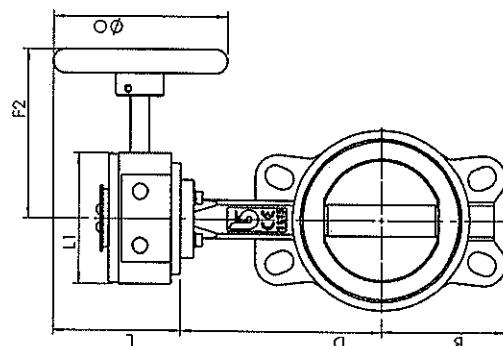

Dimensions


Size	A	B	C	D	E	F	G	H	I	J	K
12"	78	376	292	235	226	190	80	170	195	81	300
14"	78	406	335	257	226	190	80	170	195	81	300
16"	102	471	360	292	226	190	80	170	195	81	300
18"	114	539	422	318	216	183	30	151	188	80	282
20"	127	594	480	355	256	311	125	214	275	168	285
24"	154	695	562	444	285	386	136	262	324	293	385

Dimensions

Size	A	B	C	D	E	F	G	H	I	J	K
12"	78	376	292	235	226	190	80	170	195	81	300
14"	78	406	335	257	226	190	80	170	195	81	300
16"	102	471	360	292	226	190	80	170	195	81	300
18"	114	539	422	318	216	183	30	151	188	80	282
20"	127	594	480	355	256	311	125	214	275	168	285
24"	154	695	562	444	285	386	136	262	324	293	385



Dimensions

Size	A	B	C	D	E	F	G	H	I	J	K
12"	F12	150	125	4x13	27	27					
14"	F12	150	125	4x13	27	27					
16"	F12	150	125	4x13	27	27					
18"	F14	175	140	4x18	51.2	38					
20"	F14	175	140	4x18	64.2	41.15					
24"	F16	210	165	4x22	70.2	50.65					





Parallel key ISO R773 / DIN6885A

DN450-600

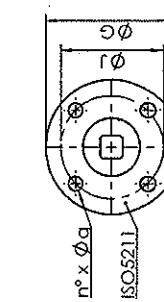

DN25-400

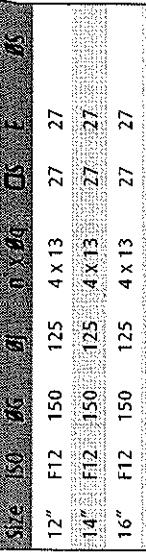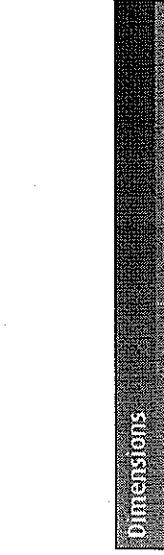

ISO5211

DN25-400

Stainless Steel Spring Check Valve (Wafer Type)



To fit PN6/10/16/25, ANSI 150 Flanges, Stainless Steel Body, Disc & Spring

Pressure/Temperature Ratings

Pressure	PN25
Temperature	NBR -20°C to 100°C
Viton	-20°C to 150°C
PTFE	-20°C to 200°C


Dimensions	DN	P	A	C	H	H1	Q	Kg
	32	20	16	77	83.5	45	18	0.43
	40	26.5	16	86.5	88.75	49	21	0.54
	50	33	18.5	99	98.5	53	30	0.82
	65	43	18.5	118	107	63	44	1.25
	80	53	22	134	115	73	56	1.83
	100	75	23.5	154	131	92	70	2.42
	125	96	29	184	138	119	80	3.1
	150	118	34.5	208	137	129	96	5.3
	200	164	36	264	169	167	125	8.5

Material / SI
1. Body ASTM A351 gr. CF8M
2. Disc ASTM A351 gr. CF8M
3. Plate ASTM A351 gr. CF8M
5. O-ring NBR/Viton/PTFE
6. Spring AISI 302
8. Screw Stainless Steel A2

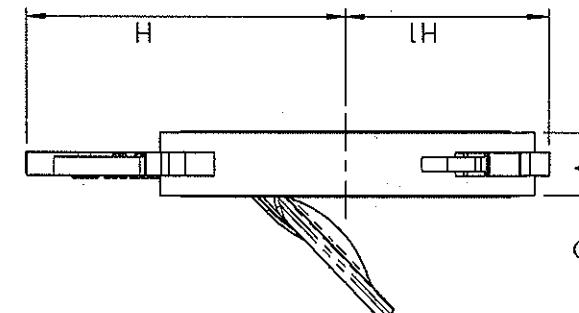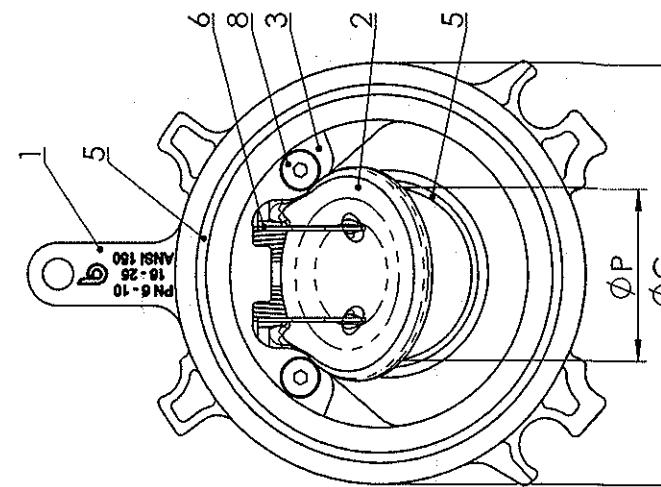

Stainless Steel Spring Check Valve (Wafer Type)

Head Loss Fluid:water (1m H₂O = 0.098bar)

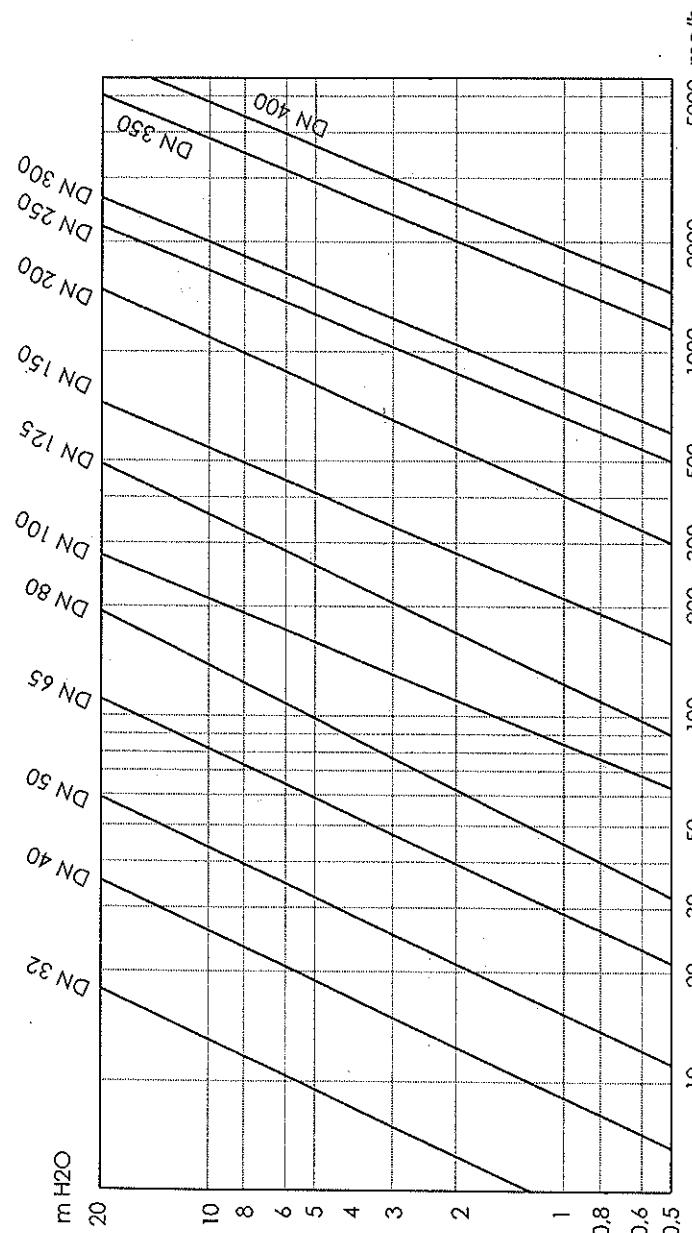

Cracking Pressure (mmH ₂ O)						
Kv	32	40	50	65	80	100
DN	32	40	50	65	80	100
With Spring ↗	321	210	194	198	196	174
With Spring ↘	242	138	126	130	120	106
Without Spring ↗	80	73	70	70	76	68
						100
						110

(1m H₂O = 0.098bar)

Certifications

1 of 5

Job Test Certificate


SOP 30216 Job ID 1527 PO 11817CN3217EB Aqua Cooling Solutions Ltd

1 X SS.CVA-250 250mm Microbubble (de-aerator) Air Separator- Stainless

How Tested: Tested with air @ 21 Bar

Date Tested: 13 / 08 / 2015

Tested By (full name) : Liam Kennedy Sign. 

Witnessed By (full name) : Joe Haychone Sign. 

TESTED
Tested with air @ 21 Bar
OK PASSED
Fabricated Products UK Ltd

Job Test Certificate

SOP 31571 Job ID 1534 PO 11858CN3194MLH Aqua Cooling Solutions Ltd

**1 X SS.CVA-200 200mm Microbubble (de-aerator) Air Separator- Stainless
25mm top & Bottom conection**

How Tested: Tested with air @ 21 Bar

Date Tested: 13 / 08 / 15

Tested By (full name) : Joe Haychoose Sign. J. Haychoose

Witnessed By (full name) : Steven G. Sign. S. G.

TESTED

Tested with air @ 21 Bar

OK PASSED

Fabricated Products UK Ltd



Stanier Road , Portmarsh Industrial Estate
Calne , Wiltshire SN11 9PX.
Tel : 01249 813288 Fax : 01249 821266
Email : info@calne-engineering.co.uk
Internet : www.calne-engineering.co.uk

Calne Engineering Ltd

CERTIFICATE OF CONFORMITY



FM No.31808

TO: Aqua Cooling Solutions Ltd. Unit D4 Segensworth Business Centre Segensworth Road Fareham PO15 5RQ	ORDER NO :	11815CN3217EB
	WORKS NO :	00037154
	DEL. DATE :	28/08/2015
	DEL. NOTE NO :	00032310

QTY	DESCRIPTION	ADD. DESCRIPTION	DRAWING NO.	ISS.	REMARKS - TEST
4.000	CDU LPS 500 SP Frame.		L1060/3	1	

'CERTIFIED THAT THE SUPPLIES/SERVICES DETAILED HEREON HAVE BEEN INSPECTED & TESTED IN ACCORDANCE
WITH THE CONDITIONS & REQUIREMENTS OF THE CONTRACT OR PURCHASE ORDER, & UNLESS QUOTED ABOVE
CONFORM IN ALL RESPECTS TO THE SPECIFICATION(S), DRAWING(S) RELEVANT THERETO'

SIGNED: *M.J.Humphreys*
(QUALITY CONTROLLER)

All Products compliant to ROHS unless otherwise stipulated. (Zinc & Yellow , Zinc & Black & Chrome Plating is Not Compliant)

Registered in England No. 1405035

V.A.T. Reg. No. 318 733 941