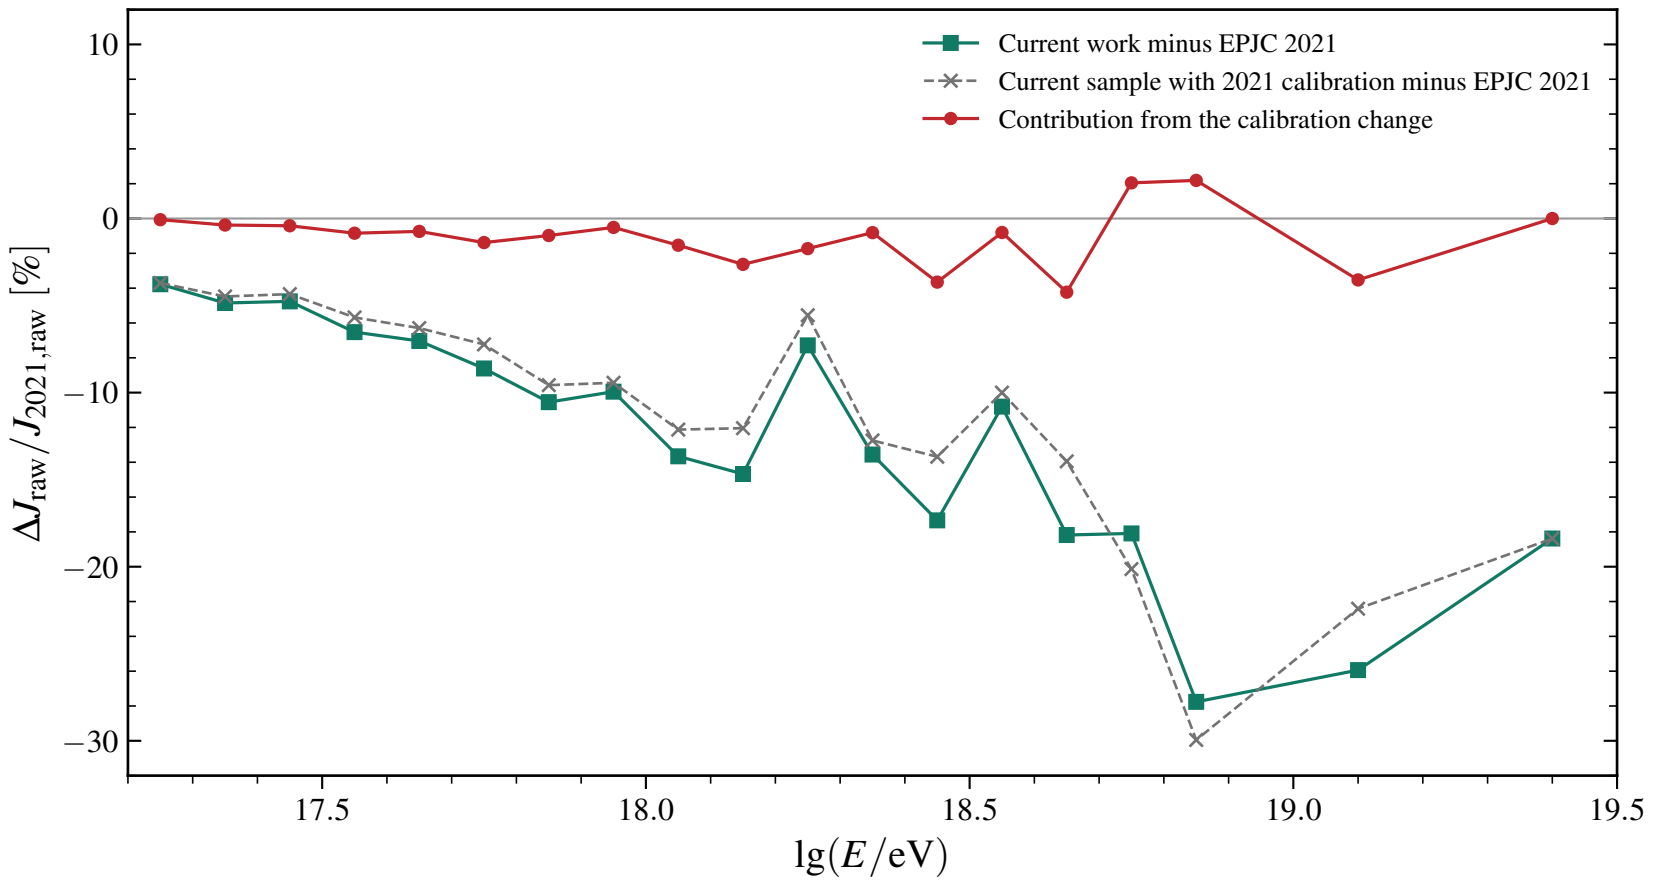

Current work minus EPJC 2021
Current sample with 2021 calibration minus EPJC 2021
Contribution from the calibration change
10
0
−10
−20
−30
$\Delta J_{\mathrm{raw}}/J_{2021,\mathrm{raw}}$ [%]
17.5
18.0
18.5
19.0
19.5
lg(E/eV)