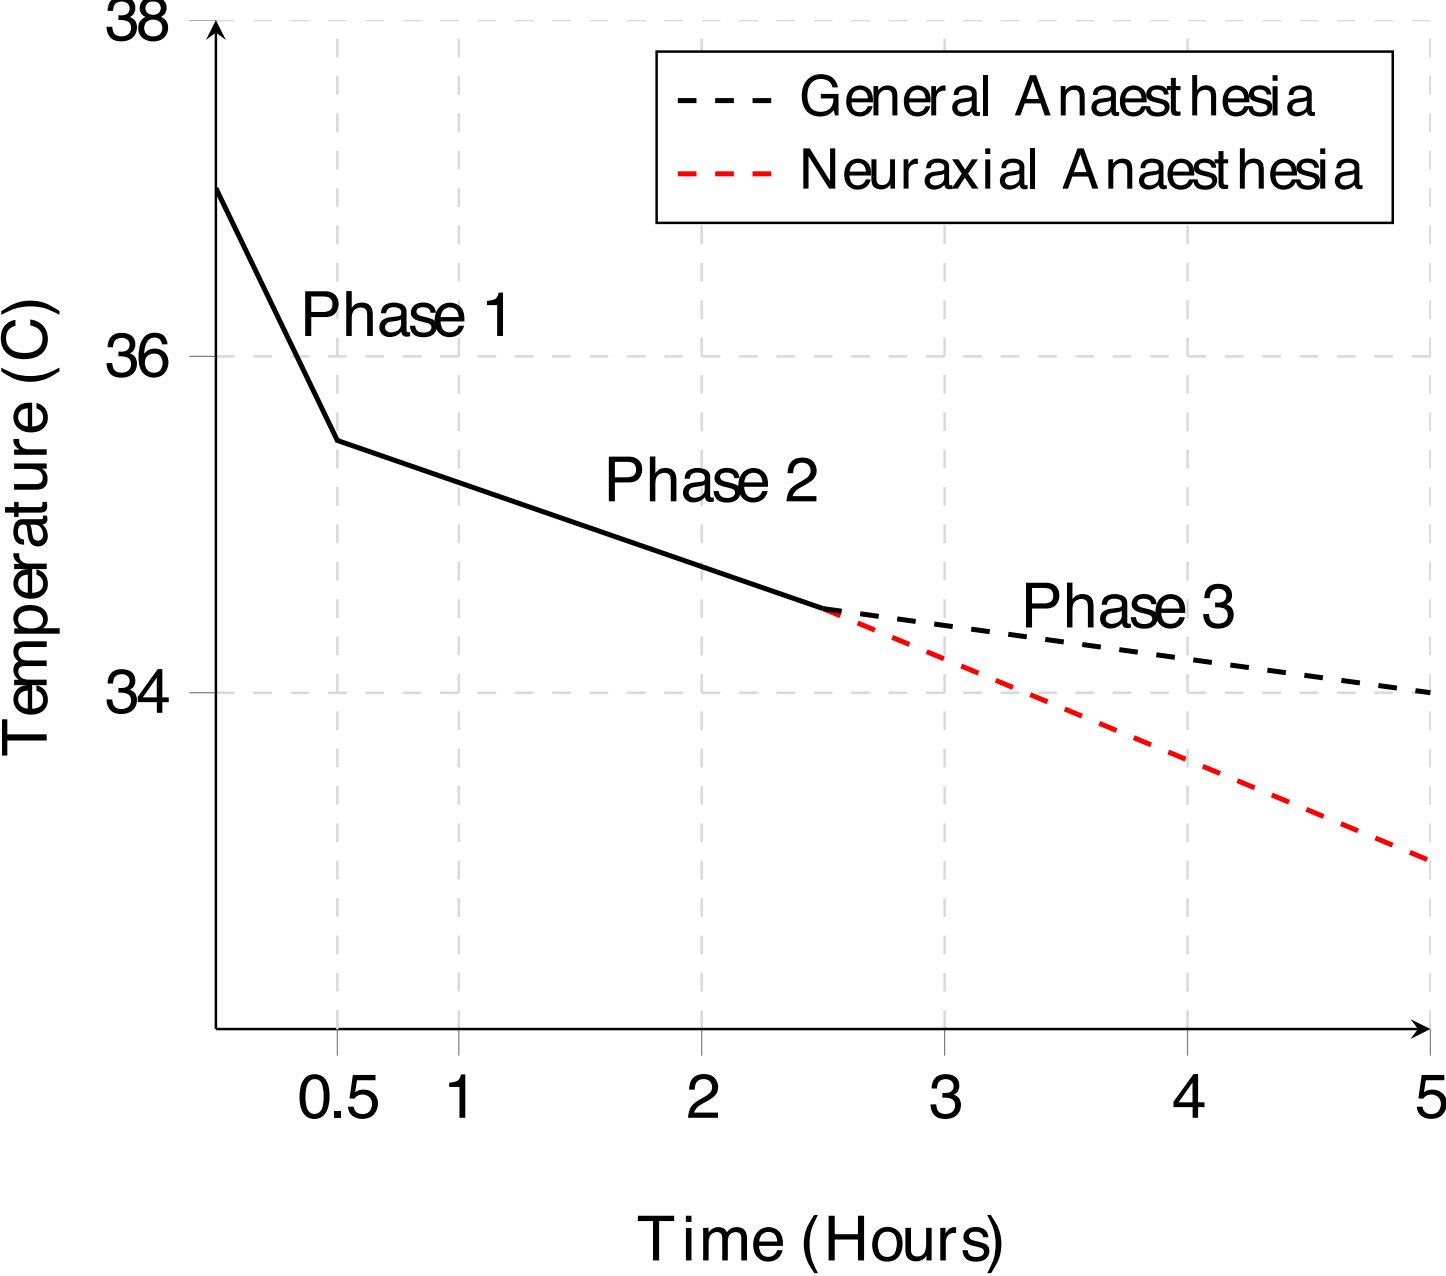
38
36
34
Temperature (C)
General Anaesthesia
Neuraxial Anaesthesia
Phase 1
Phase 2
Phase 3
0.5
1
2
3
4
5
Time (Hours)