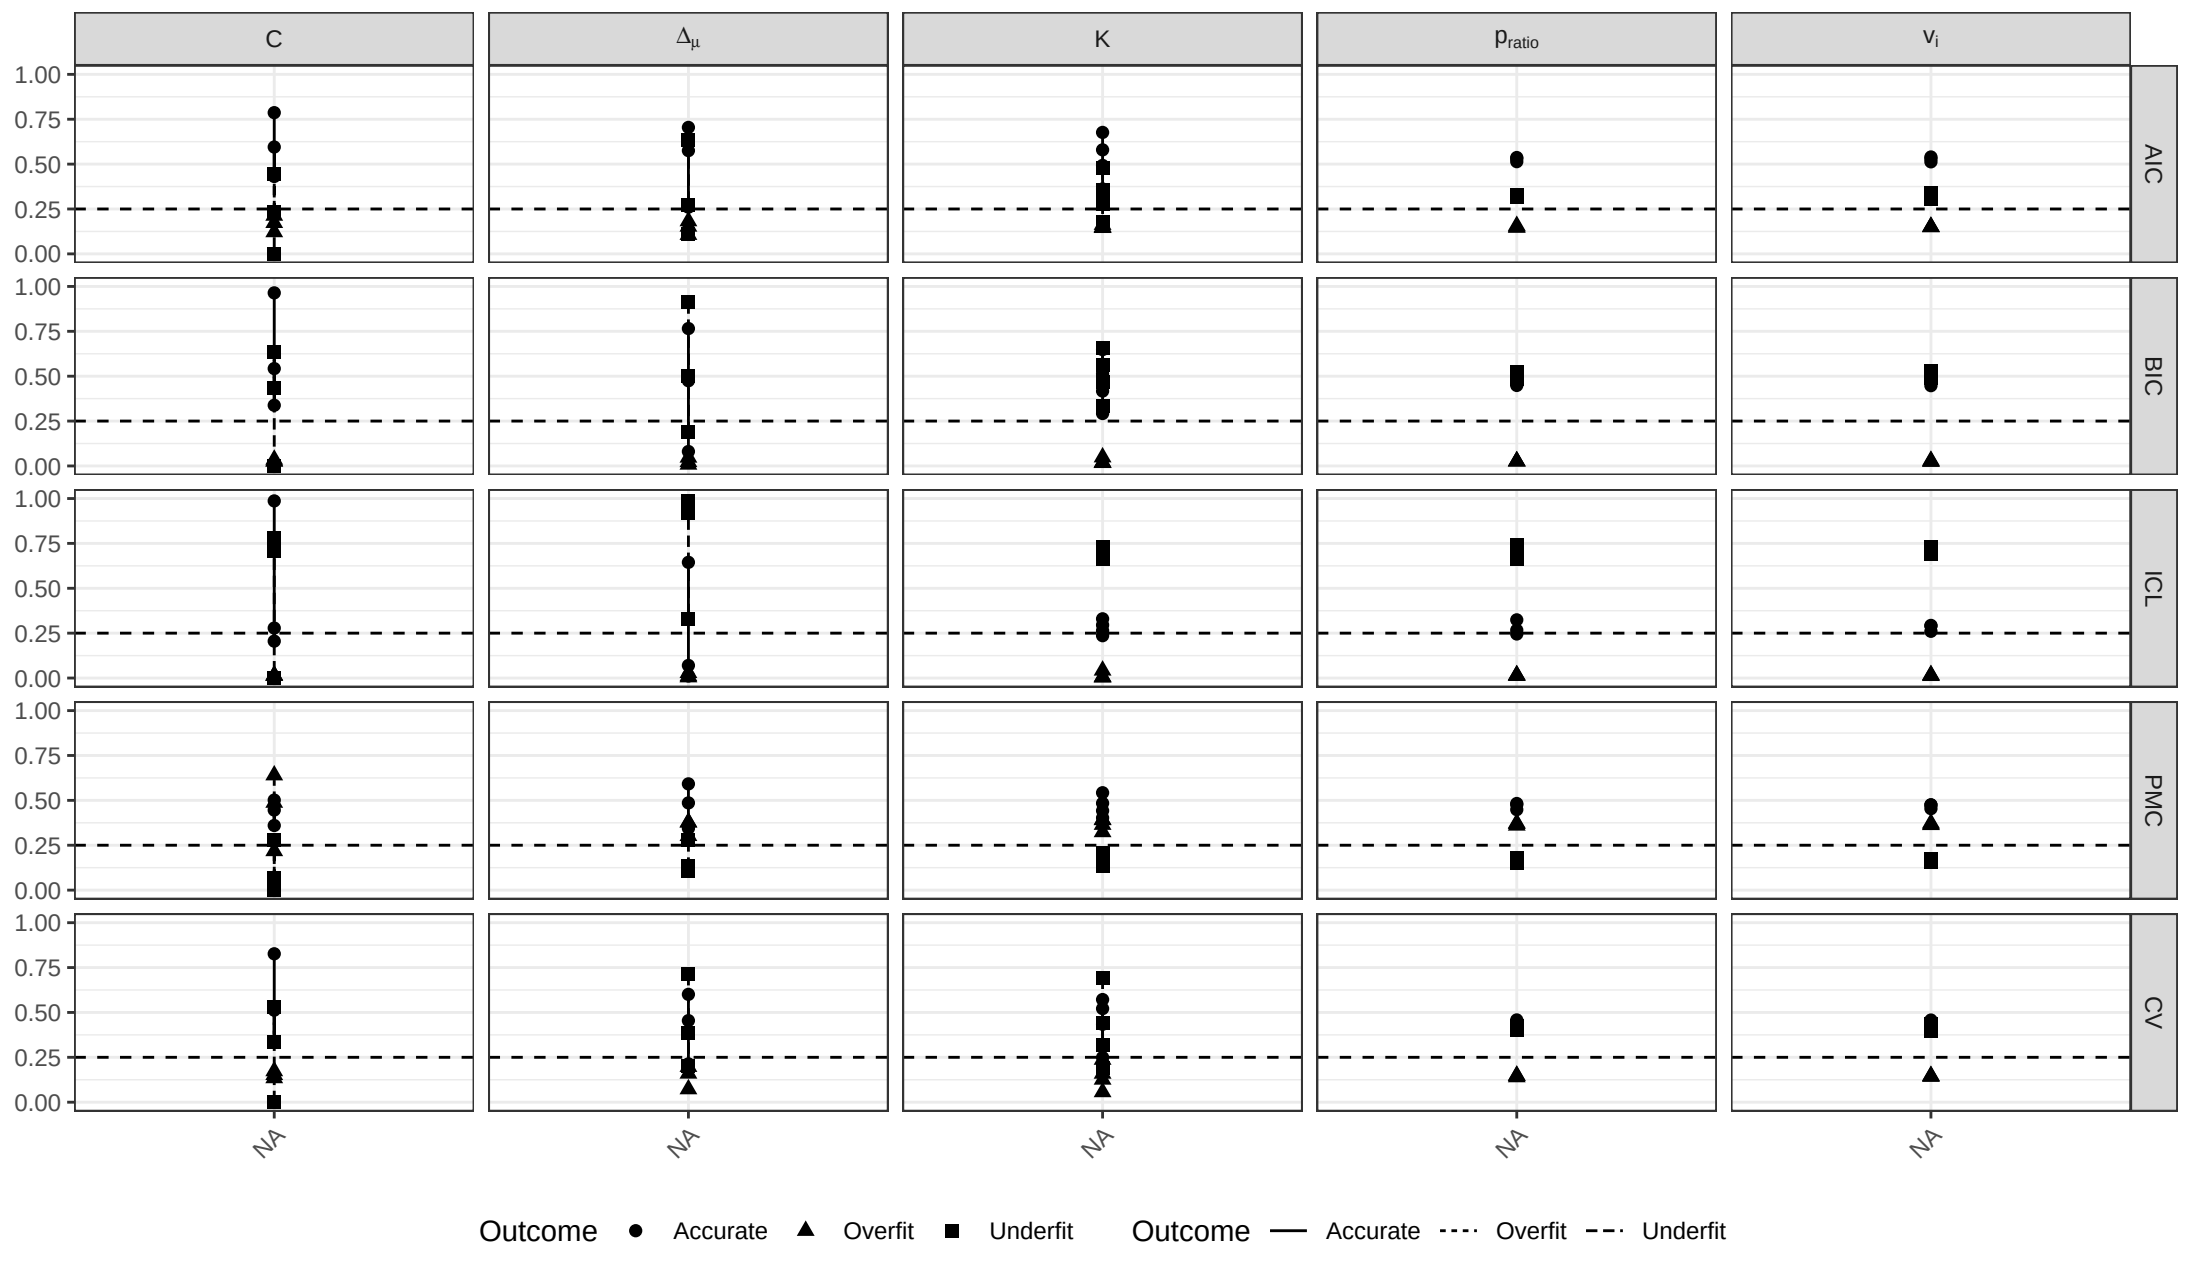
C
Δ_μ
K
p_{ratio}
v_i
AIC
BIC
ICL
PMC
CV
1.00
0.75
0.50
0.25
0.00
NA
Outcome
Accurate
Overfit
Underfit
Outcome
Accurate
Overfit
Underfit