


UL NUMBERS

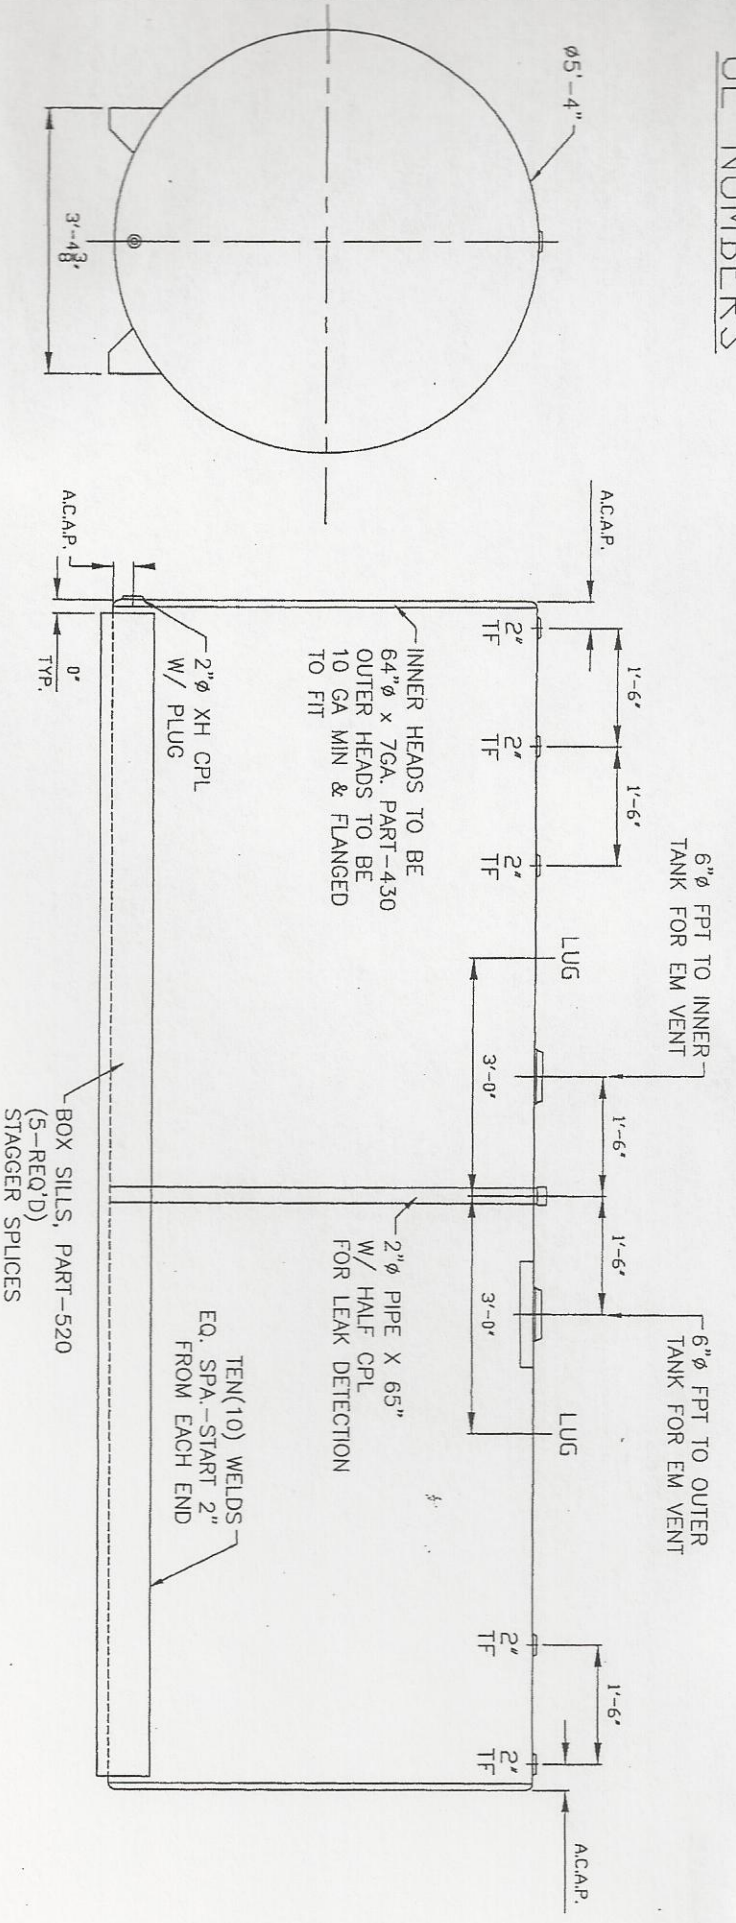

- NOTES:
1. CLEAN TANK COMPLETELY AFTER WELDING.
 2. INSPECT TANK FOR UNDERCUT & CONCAVE WELDS BEFORE SECOND TEST.
 3. SECOND TEST TANK AFTER SILLS ARE WELDED.

DESCRIPTION: 2500 GAL DOUBLE WALL SKID TANK				FOR: AVALON PETROLEUM KANKAKEE, IL			
QUANTITY	TWO (2)	CAPACITY	2500 GAL	PAINT	WHITE DURETHANE/BRUSH BLAST	CHECKED	MRR
DIMETER	64"	LENGTH	15'-0"	LABEL	UL-142	DATE	9/4/15
MATERIAL	MCS	HEADS	NOTED	SHELL	NOTED	BY	
REVISIONS				SCALE	NTS	CUSTOMER ORDER #	1904
1	-	2	-	FILENAME	2500KDW/SKIDTANK.DWG	SHEET	1 OF 1

STEEL TANK & FABRICATION CORP. COLUMBIA CITY, INDIANA 46725
800-852-9102/260-248-8971/FAX 260-248-8973