
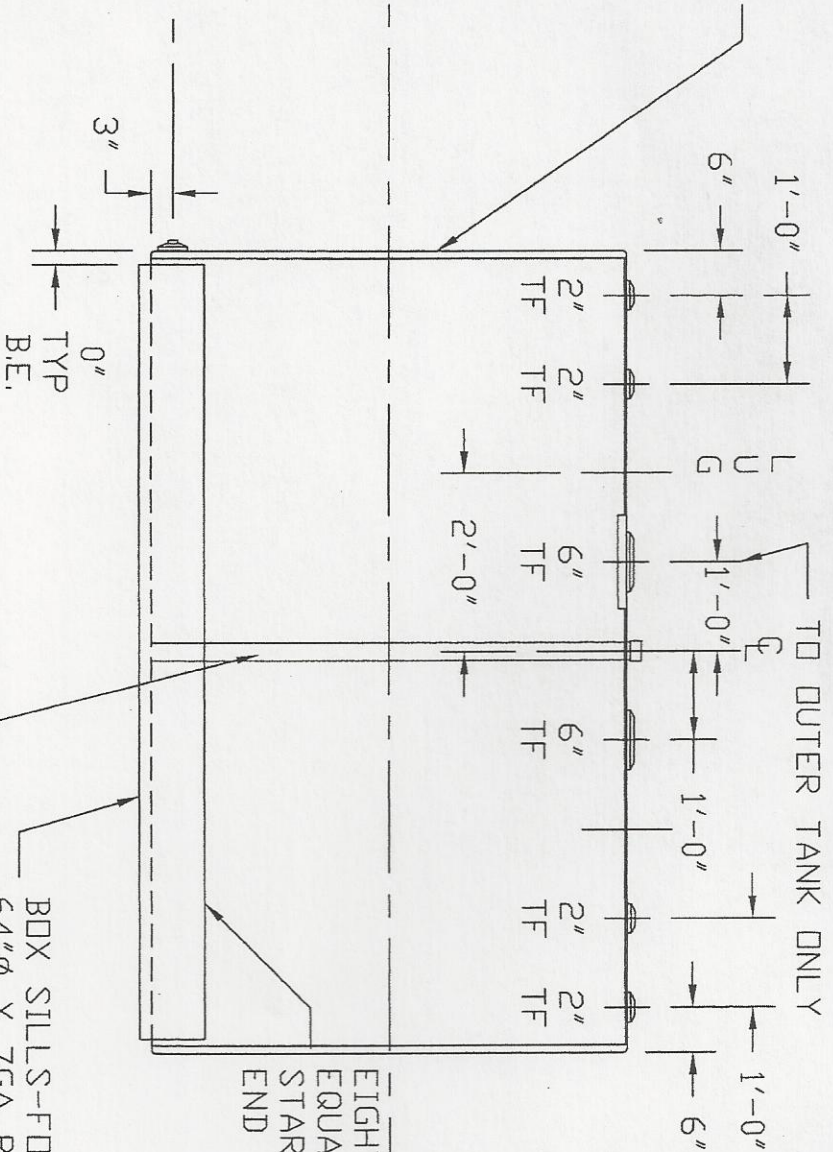


64"Ø X 7GA INNER HEAD
(2 REQ'D)
64"Ø X 10GA OUTER HEAD
(2 REQ'D)

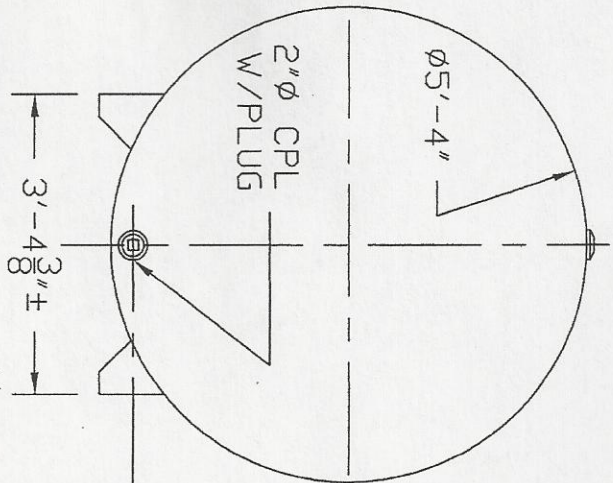

NOTES

1. SECOND TEST TANK AFTER SILLS ARE WELDED
2. CLEAN TANK COMPLETELY AFTER WELDING
3. INSPECT TANK FOR UNDERCUT & CONCAVE WELDS BEFORE SECOND TEST

2"Ø PIPE X 65" LONG
HALF CPL FOR
LEAK DETECTION

BOX SILLS-FDUR(4) REQ'D
64"Ø X 7GA P-75

STEEL TANK & FABRICATION CORP.

COLUMBIA CITY, INDIANA, 46725
800-852-9102/219-248-8971/FAX 248-8973

QUANTITY	DNE (1)	CAPACITY	1500 GAL	PAINT	RED ENAMEL/PRIMER/MILL SURFACE
DESCRIPTION	HORIZONTAL DOUBLE WALL SKID TANK W/345° WRAP			FDR	
DIAMETER	64"	LENGTH	108"	LABEL	UL-142
MATL	MCS	HEADS	INNER-7 GA OUTER-10 GA	SHELL	INNER-7 GA OUTER-10 GA
		DRAWN BY	AMK	DATE	2/11/15
		CUSTOMER ORDER #	-	STAFCD ORDER #	2903
		CK'ED BY			