


UL NUMBERS

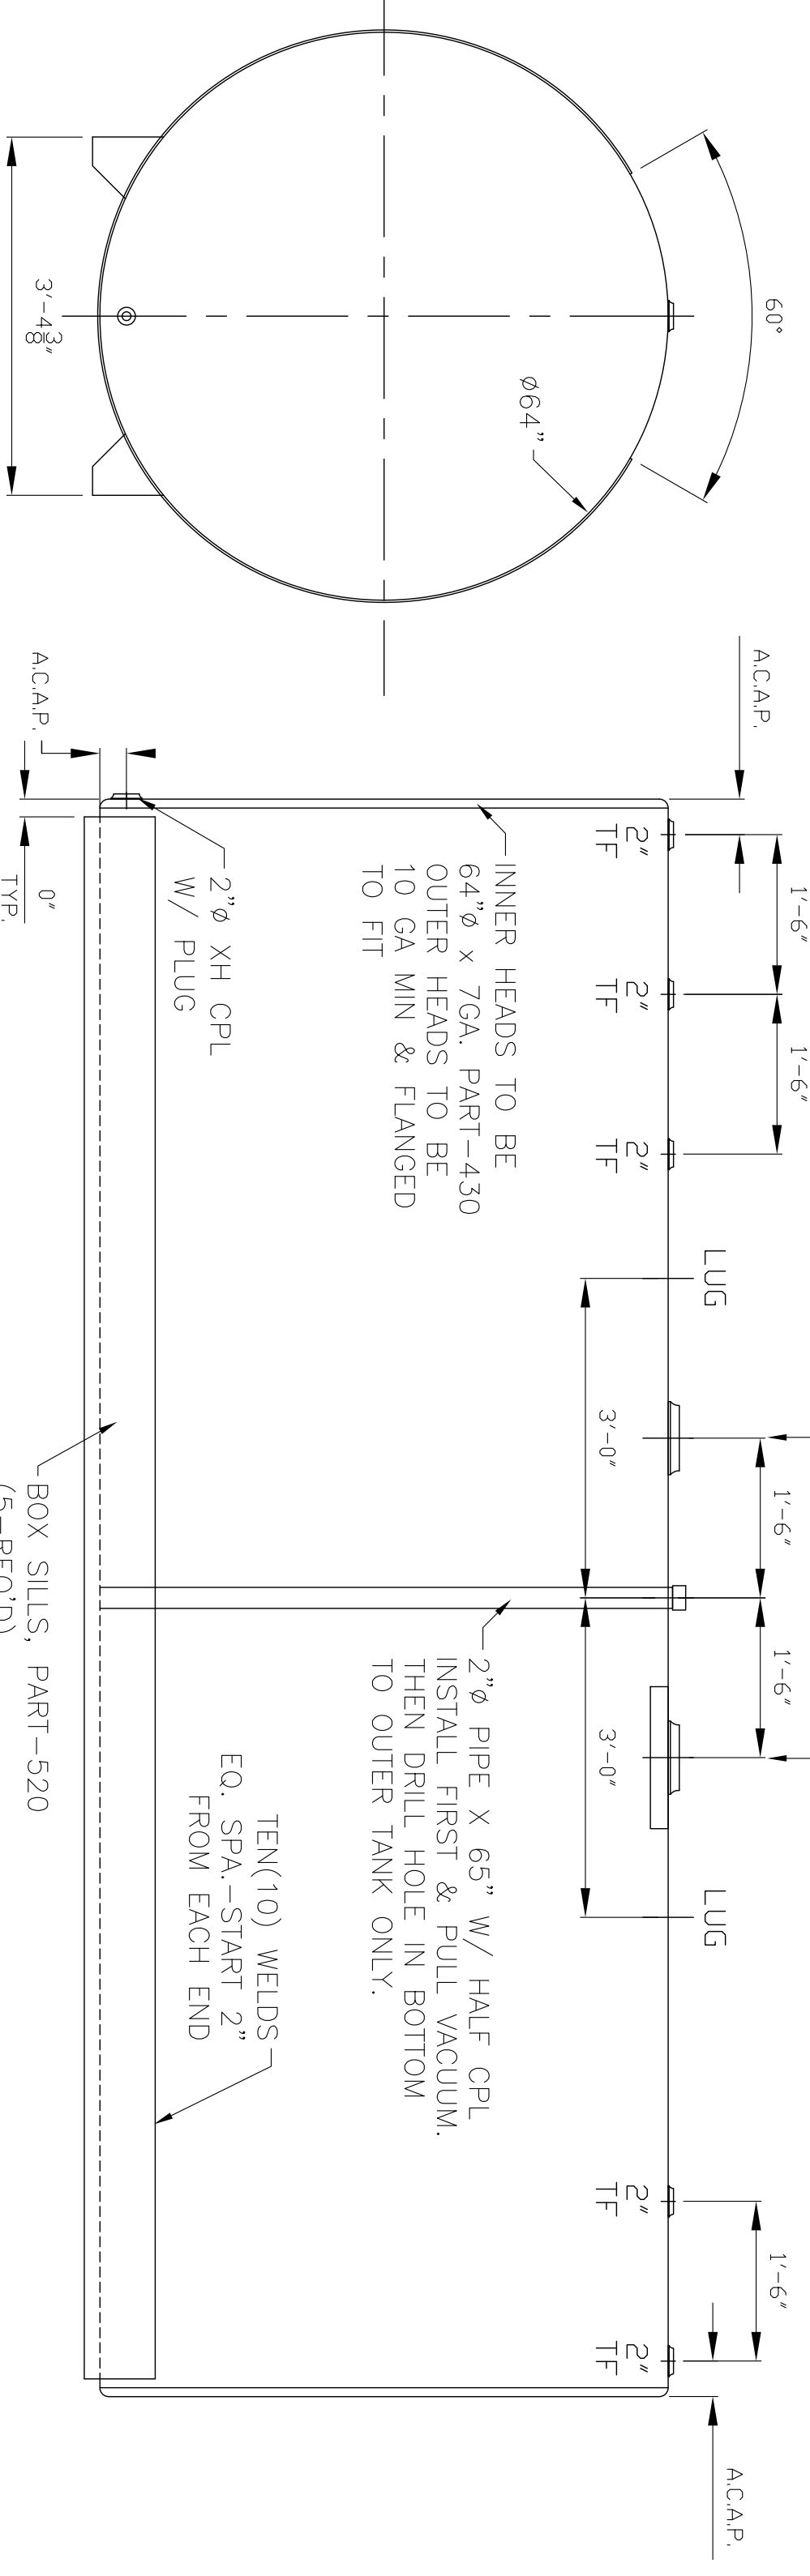

- NOTES:
1. CLEAN TANK COMPLETELY AFTER WELDING.
 2. INSPECT TANK FOR UNDERCUT & CONCAVE WELDS BEFORE SECOND TEST.
 3. SECOND TEST TANK AFTER SILLS ARE WELDED.

STEEL TANK & FABRICATING CORP.						COLUMBIA CITY, INDIANA 46725 800-852-9102/260-248-8971/FAX 260-248-8973	
DESCRIPTION: 2500 GAL FLAMESHIELD SKID TANK WITH 300° WRAP				FOR: AVALON PETROLEUM KANKAKEE, IL			
QUANTITY: ONE (1)		CAPACITY: 2500 GAL					
DIAMETER: 64"	LENGTH: 15'-0"	LABEL: UL-142		PAINT: T.B.D./BLAST IF REQ'D			
MATERIAL: MCS	HEADS: INNER 7GA. OUTER 10GA.	SHELL: INNER 7GA. OUTER 10GA.		DRAWN BY: AMK		DATE: 3/10/18	CHECKED BY: MRR
REVISIONS				SCALE: NTS			
1	-	3	-	CUSTOMER ORDER #:		STAFCD ORDER #:	-
2	-	4	-	FILENAME: FSDW2500SKT64D.DWG		SHEET 1 OF 1	