

# Thermal comfort models and measurement techniques as proxies of simplified occupant comfort

Hongshan Guo<sup>a</sup>, Eric Teitelbaum<sup>a</sup>, Forrest Meggers<sup>a,b,\*</sup>

<sup>a</sup>*School of Architecture, Princeton University, USA*

<sup>b</sup>*Andlinger Center for Energy and the Environment, Princeton University, USA.*

---

## Abstract

Thermal comfort of the occupants remains a red-hot topic at this day and age despite all the emerging technologies in sensing and control technologies. We want to understand why: After more than 100 years of introducing mechanical systems, how could architects and engineers still continue to struggle with the seemingly easy goal of keeping the occupants comfortable in the built environment? We will first begin with examining the metrics that they have developed to characterize a built environment as a proxy of thermal comfort. While most metrics are either temperature-like or vote-like which supposedly are good placeholders for actual occupants response, there are some key elements missing in these metrics: the direct physiological responses and individual differences of the occupants, not to mention further simplifications regarding hard-to-measure/control environmental parameters. We conclude that there is not a definitive answer to achieve the best possible thermal comfort, but it surely should not be completely taking the occupants and their differences out from the equations. We then examined the conventional methods used in monitoring occupants' comfort - both their strengths, weaknesses and their corresponding simplifications involved when being used to predict the actual comfort of the occupants.

There are mainly two things this paper wants to address: First, how occupants are simplified into not only an average hypothetical person, where the hypothetical person's thermal comfort gets further simplified into a few or even a single environmental parameter.

*Keywords:* thermal comfort, radiant sensing, operative temperature, mean radiant temperature

---

## Contents

<b>1</b>	<b>Introduction</b>	<b>2</b>
<b>2</b>	<b>Existing metrics</b>	<b>5</b>
2.1	Indoor . . . . .	5
2.1.1	Operative temperature . . . . .	5
2.1.2	Predicted Mean Vote . . . . .	7

---

\*Corresponding author

Email address: [fmeggers@princeton.edu](mailto:fmeggers@princeton.edu) (Forrest Meggers)

2.1.3	The adaptive comfort model . . . . .	10
2.2	Outdoor . . . . .	11
2.2.1	Non-measurable metrics . . . . .	11
2.2.2	Measurable metrics . . . . .	12
<b>3</b>	<b>Common Simplifications and Assumptions found in the equivalence of thermal comfort</b>	<b>12</b>
3.1	Occupant-related Simplifications . . . . .	12
3.1.1	Outputs from the occupants . . . . .	12
3.1.2	Inputs for individual occupants that haven't been modelled and or gauged . . . . .	12
3.2	Environmental Parameters Simplifications . . . . .	12
3.2.1	Mean Radiant Temperature . . . . .	12
3.2.2	One MRT in one room . . . . .	13
3.2.3	Air == MRT . . . . .	13
3.2.4	Simplified RH . . . . .	14
3.3	Other sensed data . . . . .	14
<b>4</b>	<b>Latest Efforts in addressing the absence of occupant in OCC</b>	<b>14</b>
4.1	Subjective feedback . . . . .	14
4.2	Objective measurement . . . . .	14
4.2.1	Direct physiological parameters from wearable sensors . . . . .	14
4.2.2	Thermal Imagery and other direct measurement techniques . . . . .	15
4.3	Direct physiological feedback . . . . .	15
4.4	Occupant-centric building control . . . . .	15
4.5	Personalized thermal comfort model . . . . .	15
<b>5</b>	<b>Conclusion</b>	<b>15</b>

## 1. Introduction

Originally developed to ensure the productivity of occupants in relation to industrial hygiene[1], thermal comfort is a topic that exhibits linkage to health and well-being as well as the learning capabilities. Its definition remains as ‘that condition of mind that expresses satisfaction with the thermal environment’ as it was in 1966 (Standard 55-1966), but also needs to be ‘assessed by subjective evaluation’ [2] according to the latest standard published in 2017. This is an interesting change that marks two things: First, the challenge posed by unsatisfactory indoor climate remains 46 years after Fanger’s PMV/PPD model appeared to have addressed the long-standing challenge of quantifying thermal comfort through physical parameters[3]. Second, the subjective evaluation of the thermal environment from individual occupant is also crucial to the correct characterization of thermal comfort.

The need to understand the thermal comfort of the occupants in the urban environment has also been growing during the last few decades. Attempting to ensure social equity while designing urban spaces and addressing the heat-related mortality, metrics including the directly measurable  $W/m^2$  (or as later translated to mean radiant temperature - CITE) as well as simulation-based/complicated Physiologically Equivalent Temperature[4] and Universal Thermal Climate Index (UTCI) became widely used among urban climatologists[5].

Despite these efforts, ensuring the thermal comfort for all occupants appears to have remained a huge challenge. It is precisely due to the ample amount of research and their application in the building industry that the thermal comfort of occupants go through a two-stage simplification: first, the occupants of different demographics are simplified into a hypothetical person; second, this hypothetical person is then simplified into the combination of a few, or a single a single environmental parameter, or more explicitly, the air temperature within the state-of-the-art building systems. Even when there are multiple environmental parameters included in the building automation control, most of the other parameters are often supplementary while air temperature remains to be the main feedback variable.

This resulted in not only rapid increase of occupants dissatisfied with the indoor environment during the last decades, but also a growing amount of concentration on improving the indoor thermal comfort. Many researchers uses the concept of performance gap to explain the unpredictability of post-occupancy stage[6, 7], which can be viewed as an attitude of compromise to the challenge: the occupants and their behaviors are beyond prediction and therefore the regulations and mandates of the thermal comfort should be loosen up. For researchers who are insisting that the behaviors of the occupants can still be modelled and predicted, machine and reinforced learning[8], artificial neural networks[9] as well as model predictive control [10, 11] are common approaches used in identifying the occupants' preference and behaviors.

In the meantime, there have already been many reviews on the thermal comfort of the occupants, the differences between thermal preferences/sensations/perceptions[12], and how using either adaptive [13, 14] or personalized thermal comfort models[15] might be able to solve this long-standing problem. These studies spans across the last two decades and utilizes the states-of-the-art techniques, but has yet to create a satisfying solution for fatiguing battle with the indoor environment[16].

We hope to contribute to the understanding and characterization of thermal comfort from a more bottom-up perspective in this paper. Unlike previous researchers who focused more on providing a solution that easily quantifies the thermal comfort of the occupant, we want to examine the existing comfort metrics, their underlying relationship with the occupants, and the simplifications or assumptions that are currently used in conjunction of these models' deployment in existing systems. In order to do so, we have examined both the existing metrics of thermal comfort for the indoor and outdoor environment, and how some unintended simplifications took place during the process of these metrics' proliferation. We also documented and reviewed some of the latest efforts to address this from either a top-down crowd-modeling approach[17] or calibrating existing control algorithms with actual occupant votes[18] or feedback from wearable sensors[19]. We conclude that it is extremely crucial to include the actual response - direct or indirect - from the occupants into the

control logic of the building automation system with additional energy and comfort benefits.

However, this does not mean that we understood the thermal comfort accurately. Extremely well-conditioned systems are also considered to require significantly more financial investment - both the capital and the operational costs.

Energy consumption of buildings to ensure comfort delivery gradually increases, casting even larger pressure on providing improved thermal comfort with smaller energy budget. Under the premises of increasing demand of thermal comfort, designing systems and buildings that provide better comfort without excessive energy consumption becomes more important.

This can obviously be investigated by proposing alternative solutions that provides agreeable thermal comfort at smaller energy costs spent on heating/cooling. However, recent studies that links improved PMV/PPD values with improved designs have showed that the resulting satisfaction of the occupants and the higher PMV/PPD values do not always coincide. Existing studies attempts to point these results to the individual differences between occupants, where metabolic rates and various individual thermal preferences were used as potential explanations for these results.

We want to take an alternative route to tackle this problem in this paper by examining the metrics used when characterizing thermal comfort - more specifically on the assumptions and simplifications used in the conventional methods. Specifically, we would like to provide answers to these following questions:

- What has been decided as necessary inputs to characterize occupant thermal comfort?
- What are we currently (actually) measuring instead?
- How are we justifying not measuring all of the required inputs?
- How will these simplifications affect our understanding of the occupants' comfort and behavior?

Or more fundamentally, how did we advance from solving the pareto front of the thermal comfort of many people to controlling for a single environmental parameter for the indoor environment? How did we justify this, and what much more can and have we done about this gap of what needs to be accomplished and what we have already achieved? It is very important that we understand this as an independent problem, and that we are currently dealing with it from a more top-down fashion when compared to... whatever.

It's also important to emphasize that this paper specifically address the negligence of the occupants and their physiological responses within the current status-quo practices and standards, and how it's often grossly interpreted into overly simplified metrics such as operative temperatures or even air temperatures.

Majority of the methods we as designers and engineers are currently using to approach thermal comfort simplifies a group of occupants into a hypothetical average person, whose thermal comfort is further simplified into a combination of a few or a single environmental parameter. To better understand the function and meaning of these simplifications and the assumptions they were based on, we propose to examine both of these paths in this paper: Regarding the simplification from a hypothetical average occupant being simplified

into a couple or even a single environmental parameter, we primarily focus on the required inputs, prevailing underlying assumptions when assessing or simulating the thermal comfort condition of a given environment.

## 2. Existing metrics

### 2.1. Indoor

Within the indoor environment, there are currently many metrics used in quantifying the level of occupant thermal comfort(or discomfort). The ISO 7730/7726 and ASHRAE Standard 55 are two sets of standards that are particularly popular among researchers and engineers.

Ranging from PMV/PPD models to operative temperatures as well as some less-used metrics such as the effective temperature. Also popular among researchers and engineers is the adaptive thermal comfort model, which predicts the comfort of occupants by placing the state of the air within a "comfort zone" on psychrometric chart as outlined in ANSI/ASHRAE Standard 55[20].

#### 2.1.1. Operative temperature

Operative temperature is a good metric that accounts for both the convective and radiant heat transfer that occupants may experience.

As outlined in ANSI/ASHRAE Standard 55-2017, the operative temperature is the "uniform temperature of an imaginary black enclosure, and the air within it, in which an occupant would exchange the same amount of heat by radiation plus convection as in the actual nonuniform environment". Its mathematical definition follows Equation 1, where it ( $t_{op}$ ) can also be defined as the average of the mean radiant temperature  $t_r$  and air temperature  $t_a$  weighted by their respective heat transfer coefficients,  $h_r$  and  $h_c$ .

$$t_{op} = \frac{h_r t_r + h_c t_a}{h_r + h_c} \quad (1)$$

The radiative heat transfer coefficient can be calculated by Equation 2, where the effective surface area ratio of the body is 0.70 for a seated person and 0.73 for a standing one [21], and the emissivity close to unity (typically 0.95 according to ASHRAE Handbook[22])(need update). ANSI/ASHRAE Standard 55-2017 pointed out is not always possible to solve Equation 2 explicitly for  $h_r$ , and hence a single value of  $4.7 \text{ W}/(\text{m}^2 \cdot \text{K})$  can be used for  $h_r$ [2]. In the case of emissivities significantly less than unity, the radiative heat transfer coefficient can be adjusted by Equation 3 where  $\varepsilon$  represents area-weighted average emissivity for the overall clothing/body surface. The convective heat transfer coefficients, on the other hand, can be expressed with Equation 4 for air velocity between 0.2 and 4.0 m/s, alongside other expressions in Table 1.

$$h_r = 4\varepsilon\sigma \frac{A_r}{A_D} \left(273.2 + \frac{t_{cl} + t_r}{2}\right)^3 \quad (2)$$

$$h_r = 4.7\varepsilon \quad (3)$$

$$h_c = 8.3V^{0.6} \quad (4)$$

Equation	Limits	Condition	Remarks/Sources
$h_c = 8.3V^{0.6}$ $h_c = 3.1$	$0.2 < V < 4.0$ $0.0 < V < 0.2$	Seated, moving air	Mitchell (1974)
$h_c = 2.7 + 8.7V^{0.67}$ $h_c = 5.1$	$0.15 < V < 1.5$ $0.0 < V < 0.15$	Reclining, moving air	Colin and Houdas (1967)
$h_c = 8.6V^{0.53}$	$0.5 < V < 2.0$	Walking, still air	V is walking speed (Nishi and Gagge 1970)
$h_c = 5.7(M - 0.8)^{0.39}$ $h_c = 6.5V^{0.39}$	$1.1 < M < 3.0$ $0.5 < V < 2.0$	Active, still air Waking on treadmill, still air	Gagge et al. (1976) V is treadmill speed (Nishi and Gagge 1970)
$h_c = 14.8V^{0.69}$	$0.15 < V < 1.5$	Standing person, moving air	Developped from data presented by Seppaen et al. (1972)

Table 1: Equations for Convection Heat Transfer Coefficients (ASHRAE Handbook Fundamentals (2009)).

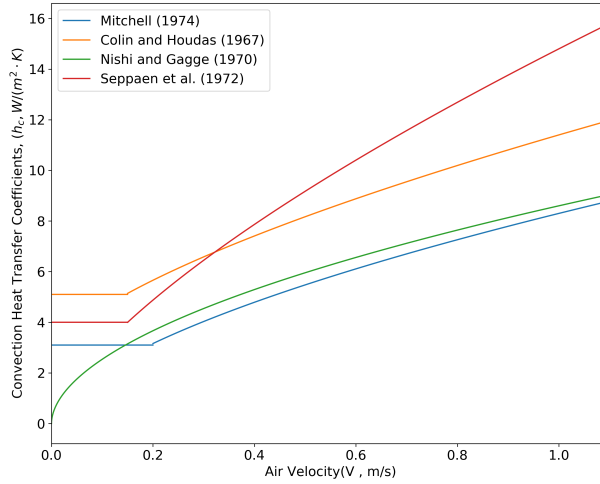


Figure 1:  $h_c$  with relation to air speed  $V_a$  as defined in ASHRAE Handbook - Fundamentals 2009.

Observing the relationship between the air velocity and resulting  $h_c$ , there is a very interesting relationship between the air velocity and the resulting operative temperature when substituting the expressions for  $h_c$  in Table 1 to Equation 1.

A very interesting phenomenon that we can observe, however, is the variation of operative temperature when holding air temperature and mean radiant temperature constant. As we're showing in Figure 2, increasing air velocity results in an increase of  $T_{op}$  when  $T_r < T_a$ , or a decrease of  $T_{op}$  when  $T_r > T_a$ .

Alternatively, the definition of operative temperature as calculated per the formula given by ASHRAE 55-2017, where parameter  $A$  is selected with respect to air velocity, or  $V_a$ .  $A$  is evaluated at 0.5 when  $V_a < 0.2 \text{ m/s}$ , 0.6 when  $V_a$  is between 0.2 and 0.6  $\text{m/s}$ , and 0.7 when  $V_a$  is between 0.6 and 1.0  $\text{m/s}$ . As

pointed out by SOMELIT, the overall clothing surface of a hypothetical average occupant is roughly 33.4 °C, thus any increase in  $V_a$  when the ambient air temperature  $T_a$  is below this number should be enhancing the convective heat transfer between the body and the surrounding environment, thus resulting in a decrease in perceived temperature. The operative temperature, in these cases, however, increases as the air velocity increases, which will result in the opposite direction of the prediction of thermal comfort. We believe this is a significant caveat of operative temperature to be used as a metric for thermal comfort assessment and would like to emphasize this in the current paper. More importantly, if we were to look back to the expression of operative temperature in Equation 1, it is evident that the definition itself is just a weighted average of air temperature and mean radiant temperature, which can easily become problematic when one of the heat transfer coefficient becomes much larger than the other - in this case  $h_c > h_r$ .

Alternatively, the operative temperature can also be calculated from Equation 5 to behave the same as indicated in Figure 1 where the operative temperature increases with increase of air velocity  $V_a$  when  $T_a > T_r$ , which is the opposite of how an occupant exchanges heat with the surrounding environment as suggested by ASHRAE Standard 55-2017[2]. This will, again, not solve the effect of how higher  $h_c$  influences

$$t_o = At_a + (1 - A)\bar{t}_r \quad (5)$$

Consequently, we believe there is a clear limitation of operative temperature to be used in indoor environment when radiant cooling is coupled with forced convection. Under scenarios created by such systems, the resulting operative temperature could be very misleading, i.e. increasing with the increase of air velocity despite the perceived temperature should have decreased for a hypothetical occupant. Examples that such a combination could exist are not uncommon:

### 2.1.2. Predicted Mean Vote

Predicted Mean Vote (PMV) is a very popular concept in describing indoor thermal comfort. Developed in the 1970s, Fanger's PMV model is based on both thermoregulation and heat balance theories as well as laboratory and climate chamber study results. The PMV model takes four physical variables (also referred to as environmental variables, i.e.  $T_a$ ,  $V_a$ , MRT and relative humidity  $\phi$ ) and personal variables (level of activity and clothing). Fanger's PMV model takes the six variables and produces a score that corresponds to the ASHRAE thermal sensation scale and represent the average thermal sensation felt by a large group of occupants [22, 23].

There are some obvious benefits of using PMV. With the improvements in environmental control technologies, and the growth in personal wealth and office sizes (McIntyre, 1984), the need of better indoor environment requires a solution to predict the optimum temperature for a group of occupants, which can then be achieved by architects and engineers. Since its proposition in 1970, the PMV model has become the internationally accepted model for predicting and representing the mean thermal sensation vote by a large group of occupants

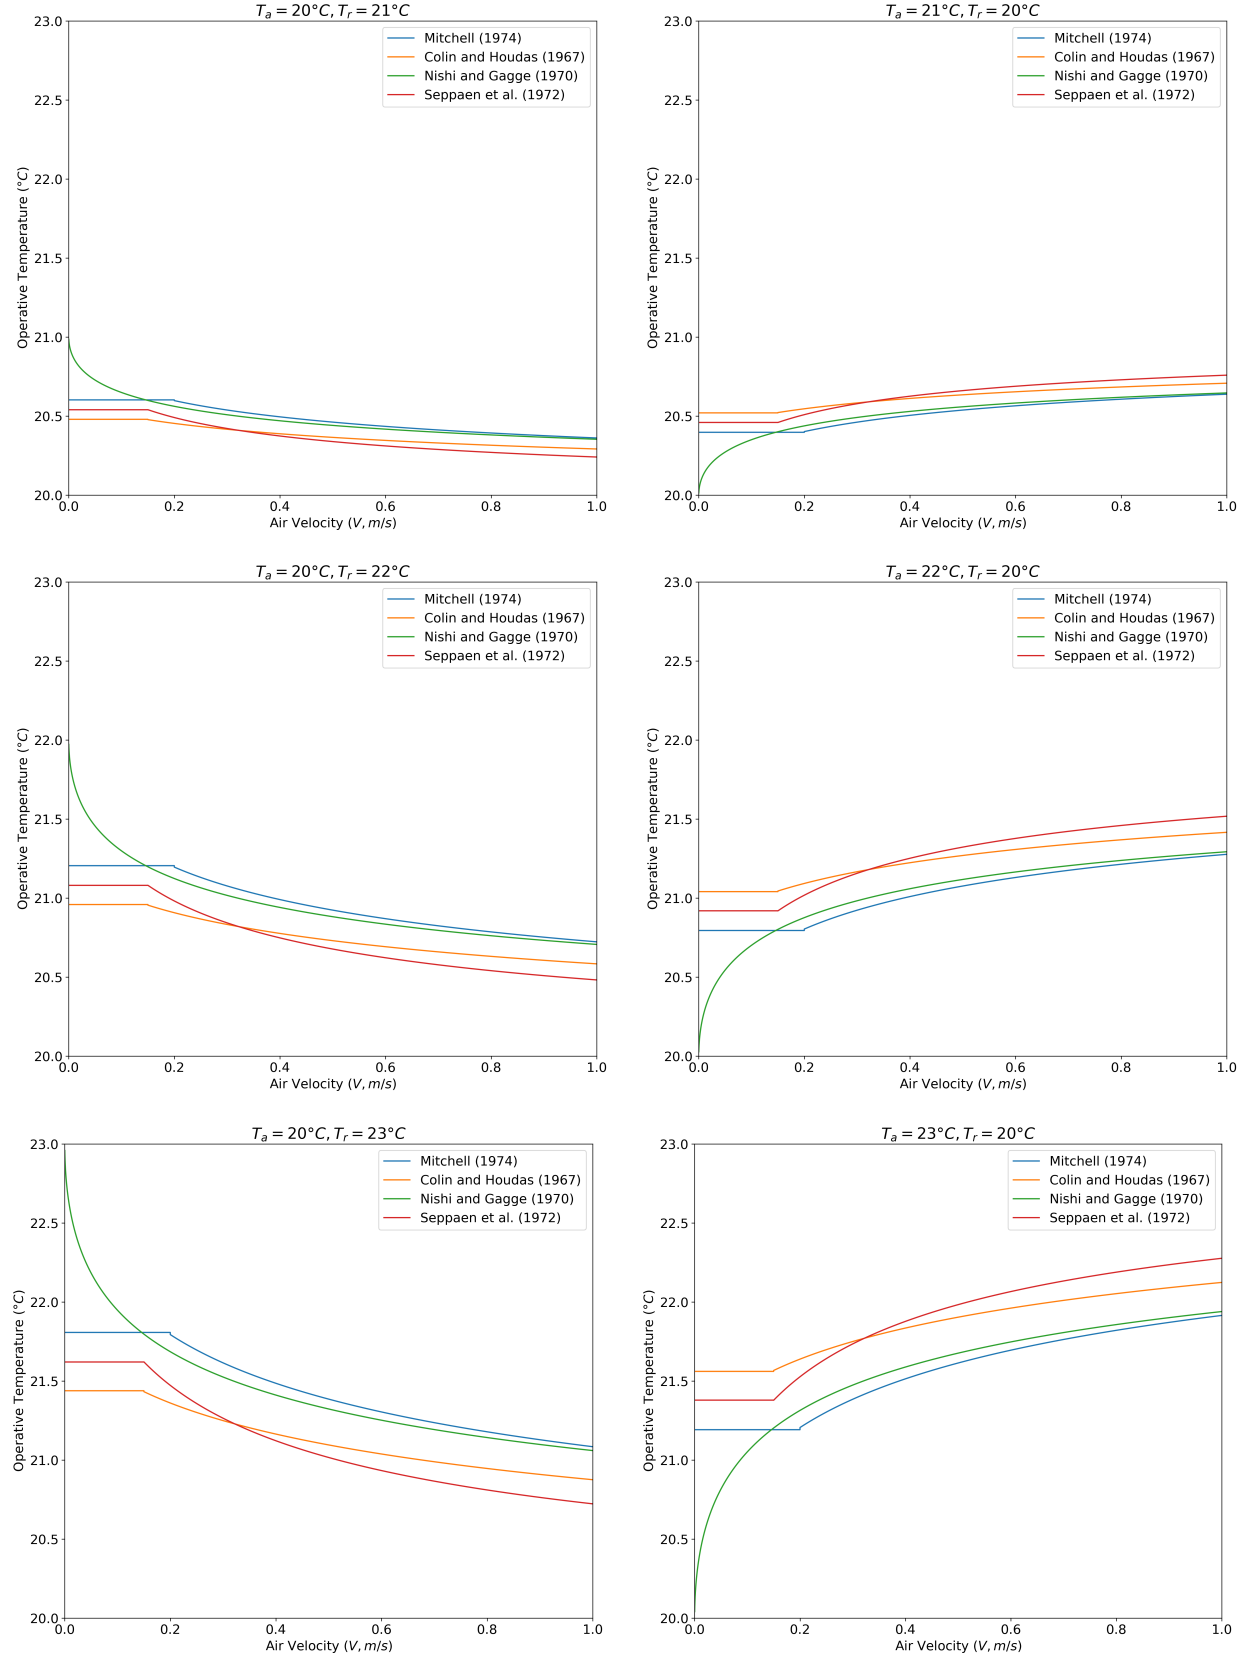


Figure 2: Relationship between air velocity ( $V$ ) and operative temperature ( $T_{op}$ ) when holding air temperature and mean radiant temperature constant.



for a set of given environmental variables. It has also since become the guideline for multiple international standards, where both ISO and ASHRAE indicated that a comfortable indoor environment can be insured when the PMV is kept at 0 with a tolerance of  $\pm 0.5$ .

This does not mean there are not caveats in using PMV to describe the thermal sensation of occupants. To begin with, there is an obvious difference in what Fanger's model can predict when compared to thermal comfort. As Fanger himself admitted, the usage of the heat balance models describes the balance between the thermoregulatory system and the environmental variables 'even if comfort does not exist'. The neutral thermal sensation of an average person is not the same thing as thermal satisfaction, acceptability or preference. As Charles has pointed out in 1993, it is entirely possible for the occupants to vote on a neutral thermal sensation scale and to not feel comfortable. Neglecting the personal factors that reflect on their individual thermoregulation and personal psychophysics is Natsume 1992, Havenith 2002

The PMV/PPD model also considers the inter-individual differences irrelevant from a series of experiments conducted in the 1960s. Fanger concluded from the results that the neutral temperature of a large group of occupants was independent of age, build, menstrual cycle, time of day, color and crowdedness of the room or gender, race as well as national geographic locations[23]. van Hoof pointed out that the original PMV model only accounts for the approximately 1,396 students who wear standardized clothes in a sedentary activity in Denmark, which does not reflect the larger and more diverse demographics of occupants in real buildings[24]. Subsequent studies have since showed that there is a substantial gender difference where female occupants tend to feel significantly cooler (Hill/Parsons 2002), and could be less satisfied with room temperatures while preferring higher room temperatures. Fanger made a similar observation earlier and concluded women are more sensitive to deviations than men[3]. To this observation, Parsons proceeded to conclude that during identical clothing and activity, the gender differences in thermal comfort responses for neutral and slightly warm conditions are smaller.

The applicability of PMV has also become the subject of debate in some of the more recent publications. Despite some early validation of the PMV as a valid index when a meta-analysis is performed, Humphreys and Nicol[25] found evidence of PMV bias often exceeding 0.25 scale units, and could reach as much as 1.0 - and the larger the deviation from neutral, the larger the bias. Their results suggested that PMV is only reliable between -0.5 and 0.5 unlike the range of validity stated by Fanger in his dissertation [21] and ISO (-2.0 and 2.0). More recently, Cheong et al. found PMV only correctly predict thermal sensation correctly one out of three times[26]. This limitation of the PMV and PPD model is, however, not very well understood by practitioners who are simply seeking a better metric and/or better adaptive model for conducting quick analysis of the thermal comfort requirements of an existing design. For practical purposes in existing projects, it is therefore highly desirable for practitioners to have a more accessible parameter to use for new and existing buildings, particularly when there are only limited information regarding the occupants and their schedules.

The latest standard published on determining the indoor occupants' thermal comfort is the ANSI/ASHRAE Standard 55-2017, which supersedes ANSI/ASHRAE Standard 55-2013, which is partially in agreement with

ISO 7730, published as the ASRAE 55 Thermal Comfort Tool by the Center of Built Environment at Berkeley in 2017(Insert web citation).

As briefly introduced previously, the comfort zone is defined as combinations of air temperature, mean radiant temperature  $\bar{t}_r$  and humidity that are predicted to be an acceptable thermal environment at particular values of air speed, metabolic rate and clothing insulation  $I_{cl}$ (ASHRAE Standard 2017). It's also more commonly understood as two overlapping zones represented on psychrometric chart, where the air conditions are solved from a PMV of -0.5 to 0.5. This graphical approach assumes the rest of the environmental parameters (MRT, air velocity) and personal parameters (metabolic rate and clothing factors) as constants, and is the most widely accepted representation of the concept. There are actually two different ways of obtaining these boundary lines at PMV of -0.5 and 0.5.

To determine the boundary of the comfort zone, both ISO 7730 and ASHRAE Standard 55 provide guidelines on how to do the actual calculation. There are currently three methods outlined in ASHRAE Standard 55, which applies to different ranges of average air speed. With air speed lower than 0.2 m/s and a humidity ratio smaller than 0.012 kg- $H_2O$ /kg dry air, the graphic comfort zone method should be used, where the operative temperature can be determined by linear interpolation the upper and lower operative temperature limit with a given clothing insulation. Alternatively, the comfort zone's boundaries can also be determined by using the Analytical Comfort Zone Method. This method can be applied to metabolic rate between 1.0 and 2.0, and clothing factor between 0 to 1.5 for all humidity ratios. This method incorporates the PMV calculation method used by ISO 7730.

### 2.1.3. The adaptive comfort model

The adaptive approach, first suggested by de Dear and Brager [27] was developed to account for the occupant adaptability in environments that have wider bandwidth than air-conditioned buildings such as naturally ventilated buildings. According to de Dear and Brager, the PMV model is not applicable for these environments because it only partly accounts for the adaptation process and were results from limited laboratory studies. They therefore proposed an adaptive thermal comfort model for free-running buildings, linking the neutral temperature indoors to the outdoor monthly average temperatures. According to van Hoof, Fanger responded to this model in 2004 by pointing out that adaptation should be 'a process of machines adapting to human requirements and ergonomics, not the adaptation of humans to technology'[28], but this did not stop the expansion of the usage of the adaptive thermal comfort model in the subsequent studies. The adaptive thermal comfort is currently included in the ASHRAE Standard 55 as an optional method that can be applied to naturally ventilated office buildings when outdoor temperature is between 10 and 33 °C.

As suggested by ASHARE Standard 55, the adaptive model applies to indoor environments with air speeds beyond 0.3 m/s, specifically where occupants have better control over their own built environment. Although not explicitly addressing the occupants in the room, this model appears to have worked well for scenarios including open offices, classrooms, and many other cases of natural or hybrid ventilation.

However, it is important to point out that a majority of the laboratory studies that appeared to have

demonstrated the usage of the adaptive thermal comfort models are more commonly found in studies conducted in classrooms among younger children - who exhibits not only higher metabolic rates, higher activity levels and smaller muscle/fat ratio. It is important to point out that these studies are more conclusive may not be a coincidence, i.e. that the younger occupants of an indoor environment. However, as these experiments are, in fact, conclusive, understanding their results are far more important than what was previously observed.

Despite some clear strength over the PMV/PPD models, the first limitation of the adaptive thermal comfort is its exclusion of the six input parameters of PMV that regards the human heat balance as a crucial component to consider for the indoor environment.

Comparing to the operative temperature and the predicted mean vote, the adaptive thermal comfort model is much less specific, since it is a non-deterministic metric. The exploration of this model is a branch that stems out from

The adaptive thermal comfort model also has an equivalent definition of the ‘comfort zone’ for naturally ventilated spaces[20]. As outlined in the ASHRAE Standard 55, the upper and lower 80% acceptability limit of the operative temperature can be calculated from its linear relationship with the prevailing daily outdoor air temperature.

## 2.2. Outdoor

### 2.2.1. Non-measurable metrics

A significant portion of the metrics used in the outdoor environment when assessing thermal comfort are not directly measurable. Among these variables, the physiologically equivalent temperature (PET) and the universal thermal climate index (UTCI) are becoming increasingly popular.

*PET.* is first proposed by Hoppe who pointed out the necessity of a universal index describing the well-being of the occupant for both the indoor and outdoor environment.

benefits and caveats of PET

The physiological equivalent temperature (PET) was proposed by Hoppe[4]

*UTCI.* , or universal thermal climate index is a concept specifically developed by urban climatologists to address the challenges posed by the ongoing/upcoming challenges observed in the urban environment.

Its application among the existing studies primarily sits within the urban climate studies and simulations.

It’s important to point out that all these metrics are non-measurable and unverifiable on their own. Unlike vote-like systems such as PMV that the results can directly be compared with the actual mean vote among the occupants, these variables cannot be compared with directly measured values without making assumptions about what is the best proxy of comfort. Attempts to verify the simulated results often ends up. A common trait between these variables is that none of them can be actually measured or calibrated.

### 2.2.2. Measurable metrics

$W/m^2$  is the surface-area-averaged incoming radiation at any given time. It can be directly measured by radiant flux sensors - often a thermopile (Jones, 1985). Thermopiles are capable of measuring the voltage difference generated between two sets of WBGT -> wet bulb globe temperature MRT -> Application of globe thermometers

## 3. Common Simplifications and Assumptions found in the equivalence of thermal comfort

### 3.1. Occupant-related Simplifications

The first and foremost simplification that we observe in the existing models of thermal comfort is how a group of occupants became a single occupant, or a synthetical one for that matter.

Fanger's research back in the 1970s were among the first to suggest that occupants can be represented by a single hypothetical occupant[23]. Based on his own deterministic thermoregulation-based model that calculates the absolute state of thermal comfort developed in 1967[21], his dissertation asserts a calculated PMV within the range of -0.5 and +0.5 is sufficient to be representative of the entire population of any occupant group. Using experimental results collected from 1,394 college students, Fanger concluded that demographic variations among the occupants are not significant enough to affect the thermal comfort conditions. Although there are many further research suggesting otherwise[29, 30], the simplification of the occupants into a single occupant gradually became mainstream[2].

#### 3.1.1. Outputs from the occupants

Physiological responses - why aren't they measured? State of art Challenges in directly measuring physiological feedback of the human body

Challenges for Using actual comfort votes as control feedback signal

#### 3.1.2. Inputs for individual occupants that haven't been modelled and or gauged

The first and perhaps the largest simplification among occupants is the metabolic rate. Following Fanger's proposition in 1967 [21], the metabolic rate of the occupants has been assumed to be  $58.2W/m^2$ , or 1 MET in most of the follow-up literatures and regulations, such as the ASHRAE Standard 55[20] and ISO 7730[31]. Metabolic rate, clothing factor, age, build and sex are all ignored in conventional comfort modelling, where a middle-aged, medium-built hypothetical man is considered.

### 3.2. Environmental Parameters Simplifications

#### 3.2.1. Mean Radiant Temperature

Defined as the temperature of a homogeneous sphere that exchanges the same amount of heat as the actual surrounding with the human body, mean radiant temperature is arguably the most problematic environmental parameter within both the indoor and outdoor environment [32]. Its definition is very easy to follow but difficult to compute, particularly due to the challenges of quantifying the view factors between the human body and

the surrounding environments. In the meantime, mean radiant temperatures are required to calculate thermal comfort and heat stress indices such as the UTCI(Jendritzky, 2012), PT (Staiger, 2012), PET (Hoppe,1999) as well as PMV [21].

Recent expansions of its definition to include the influence of the sun also add up to the challenge, as the mean radiant temperature now has two subsets with respect to the wavelength of the incoming radiation: longwave and shortwave[2]. Partially due to these inherent complexity of the mean radiant temperature, it is one of the most abstracted environmental parameter of all the environmental parameters. These simplifications are shared among existing standards (such as ISO 7726 [33] and ASHRAE Standard 55 [2]) with both literal definitions and measurement techniques that are underlined with various simplifications.

### 3.2.2. *One MRT in one room*

The first simplification for the mean radiant temperature that it is a room-specific variable. This simplification is very common among the existing literature and standards such as the ISO 7726[33] and ASHRAE Standard 55. Within the ISO Standard, the thermal comfort ergonomics and its measurement was meant to be the focus. Despite acknowledging the Standard 55 - 2017 from ASHRAE provided similar guidelines where the literal definitions of mean radiant temperature and the relationship between the long wave and shortwave radiations.

Problems in under MRT as a concept: difficulty to interpret Iterations attempting to simplify MRT: ISO, surface averaged, etc. Causes problems in measuring MRTs.

Measurement protocols of MRT and IEQ (check PoE protocols). Existing tools that evaluates the spatial variation of MRTs are also very rare. On the simulation side, the most common building simulation engines such as EnergyPlus [34] do account for the temperature variations and calculate the respective view factors, but still remains to assess the mean radiant temperature as a single node inside a specific thermal zone despite accounting for the surrounding surface temperatures and their respective view factors. More recently, the Center for the Built Environment published a Spatial Thermal Comfort Tool [35] that focuses on the spatial resolution of mean radiant temperature, which calculates both the spatial MRT and the corresponding PMV assuming constant inputs from the other five parameters.

The relationship between MRTs and the resulting PMVs have also been a subject of interests for many studies.

### 3.2.3. *Air == MRT*

Aside from assuming that mean radiant temperatures can be treated as a homogeneous parameter for an indoor environment, another very common simplification is to consider mean radiant temperature the equivalent of air temperature[32? ](Langer, 2013; matzarakis 2008). Cases where this assumption might be true. Scenarios where Air IS NOT MRT needs to be better recognized: Radiant systems Shortwave radiation through huge fenestration systems Larger view-factors of adjacent cold/hot surface areas: ocean/river

#### 3.2.4. *Simplified RH*

Maybe briefly mention how we are suggesting we have already kept HR in check? Complexity in creating two-objective systems? Price?

#### 3.3. *Other sensed data*

A good(?) question is whether we want to keep the structure of the paper - or add more stuffs. There's the performance gap that should go in somewhere, and problem of the two-stage simplification is that it's not super clear yet. How do you simplify a group into a person, that part is not clear enough. Or is it? In 3-1 and 3-2?

### 4. Latest Efforts in addressing the absence of occupant in OCC

Despite all the implicit assumptions and simplifications within the existing models, there have already been attempts to address the challenge of thermal comfort among multiple occupants. To address the challenge of satisfying occupants of different demographic/physiological conditions, these efforts share an important trait of including actual occupants responses, but can be further categorized into two groups: those that include only the subjective feedback from the occupants, and those that also include the objective measurements of the occupants.[? ]

#### 4.1. *Subjective feedback*

We categorize studies that use the subjective votes without direct physiological measurements as subjective. Occupants are no longer providing involuntary feedback but rather intentional, voluntary responses as signals collected by the control system or algorithm.

#### 4.2. *Objective measurement*

Regarding the latest research focusing on addressing the two-step simplification of occupants into environmental parameters, we can categorize them based on their means of planned intervention and its relationship to the occupants into objective and subjective. For the objective interventions, occupants' physiological responses are directly measured through different sensing techniques, and calibrated by the actual votes of the occupants.

##### 4.2.1. *Direct physiological parameters from wearable sensors*

Measuring the physiological response of the human body has been historically challenging.

Among other measurable responses, the skin temperature of the human body is more common in existing research. To accurately measure the physiological responses of the human body, traditional sensing techniques are often intrusive: sensors that need to be strapped onto the body [36], or needing to be ingested (e.g. core-temperature-measuring radio pill [1]) effectively make it impossible to measure real-time responses for multiple multiples in a real office environment.

Development in sensing technology has helped researchers to come up with solutions to the comfort conundrum.

Studies on how sensitive different locations of the human skin are sensitive to changes of the thermal environment have pointed to a few specific locations including the wrist temperature, which later became a major research concentration for researchers[37].

? Occupancy, infrared-based occupancy sensing? Can we suggest that is also measuring

*4.2.2. Thermal Imagery and other direct measurement techniques*

*4.3. Direct physiological feedback*

*4.4. Occupant-centric building control*

*4.5. Personalized thermal comfort model*

## **5. Conclusion**

We reviewed some of the most canonical parameters for thermal comfort in this paper, focusing particularly on their limitations and underlying simplifications. Our hypothesis of the occupants as larger groups went through a two-step simplification process was verified, upon which we also identified some of the most recent efforts to address the thermal comfort gap - which we believe is caused by the negligence of both the individual differences between occupants and the human physiological responses.

We discovered many problems in the existing simplification methods from a group of occupants to a single hypothetical occupant - it is not to say that the occupants cannot/should not be simplified, but the context of this simplification needs to be better understood among researchers and practitioners.

We also feel we need to better understand what and how many of those simplifications are used when their results are cited and used elsewhere. Many of the assumptions were passed on alongside their cited results. This also affects the data-driven approach when reviewing these papers, since the underlying assumptions will again go unexamined, and the assumptions get passed on without being re-examined.

Using direct methods to collect the outputs from occupants may be an alternative that could solve the comfort gap. Existing research in this direction uses either direct physiological measurements or actual feedback from the occupants, which can both be viewed as attempts to re-introduce the occupants back to the control loop of building systems. Other efforts include the status-quo research on personal thermal comfort models that characterizes the individual thermal differences, which includes both the physiological feedback and the actual votes from the occupants. We believe personalized thermal comfort model is a promising alternative to the existing comfort/occupant-centric explorations, despite their limited scale at the time of this paper.

To re-introduce the occupants to monitoring and control of indoor environment, it is necessary

We wanted to focus primarily on the two step abstraction of the thermal comfort of occupants in this paper and concentrated on how different simplifications and assumptions chronologically emerged during this simplification. This is further coupled with investigation on how recent awareness of the importance of thermal comfort. What are some of the basic traits of C++ as a language? How is this practical - or non-practical is a key problem that we're currently facing.

## References

- [1] T. Bedford, C. G. Warner, The Globe Thermometer in Studies of Heating and Ventilation, *The Journal of Hygiene* 34 (4) (1934) 458–473.  
URL <https://www.ncbi.nlm.nih.gov/pmc/articles/PMC2170907/>
- [2] ANSI/ASHRAE, Standard 55-2017, thermal environmental conditions for human occupancy.  
URL <https://www.ashrae.org/technical-resources/bookstore/standard-55-thermal-environmental-conditions>
- [3] P. O. Fanger, Assessment of man’s thermal comfort in practice 30 (4) 313–324.  
URL <https://www.ncbi.nlm.nih.gov/pmc/articles/PMC1069471/>
- [4] H. Hoppe, A new procedure to determine the mean radiant temperature outdoors, *Wetter und Leben* 44 (1992) 147–151.
- [5] P. Höppe, Different aspects of assessing indoor and outdoor thermal comfort 34 (6) 661–665. doi:10.1016/S0378-7788(02)00017-8.  
URL <http://www.sciencedirect.com/science/article/pii/S0378778802000178>
- [6] X. Shi, B. Si, J. Zhao, Z. Tian, C. Wang, X. Jin, X. Zhou, Magnitude, causes, and solutions of the performance gap of buildings: A review 11 (3) 937. doi:10.3390/su11030937.  
URL <http://www.mdpi.com/2071-1050/11/3/937>
- [7] I. Allard, T. Olofsson, G. Nair, Energy evaluation of residential buildings: Performance gap analysis incorporating uncertainties in the evaluation methods 11 (4) 725–737. doi:10.1007/s12273-018-0439-7.  
URL <http://link.springer.com/10.1007/s12273-018-0439-7>
- [8] Y. Peng, A. Rysanek, Z. Nagy, A. Schlüter, Using machine learning techniques for occupancy-prediction-based cooling control in office buildings 211 1343–1358. doi:10.1016/j.apenergy.2017.12.002.  
URL <http://www.sciencedirect.com/science/article/pii/S0306261917317129>
- [9] C. Sugimoto, Human sensing using wearable wireless sensors for smart environments, in: 2013 Seventh International Conference on Sensing Technology (ICST), pp. 188–192. doi:10.1109/ICSensT.2013.6727640.
- [10] F. Jazizadeh, A. Ghahramani, B. Becerik-Gerber, T. Kichkaylo, M. Orosz, User-led decentralized thermal comfort driven HVAC operations for improved efficiency in office buildings 70 398–410. doi:10.1016/j.enbuild.2013.11.066.  
URL <http://www.sciencedirect.com/science/article/pii/S0378778813007731>
- [11] J. Brooks, S. Goyal, R. Subramany, Y. Lin, T. Middelkoop, L. Arpan, L. Carloni, P. Barooah, An experimental investigation of occupancy-based energy-efficient control of commercial building indoor climate, in: 53rd IEEE Conference on Decision and Control, pp. 5680–5685. doi:10.1109/CDC.2014.7040278.



- [12] K. E. Charles, Fanger’s thermal comfort and draught models. doi:10.4224/20378865.  
URL <https://nrc-publications.canada.ca/eng/view/object/?id=7525d344-a508-4fdc-9c04-d9d3a9767bdb>
- [13] J. F. Nicol, M. A. Humphreys, Adaptive thermal comfort and sustainable thermal standards for buildings 34 (6) 563–572. doi:10.1016/S0378-7788(02)00006-3.  
URL <http://www.sciencedirect.com/science/article/pii/S0378778802000063>
- [14] F. Nicol, M. Wilson, An overview of the European Standard EN 15251, in: proceedings of Conference: Adapting to Change: New Thinking on Comfort. Cumberland Lodge, Windsor, UK, Vol. 911, 2010.
- [15] J. Kim, Y. Zhou, S. Schiavon, P. Raftery, G. Brager, Personal comfort models: Predicting individuals’ thermal preference using occupant heating and cooling behavior and machine learning 129 96–106. doi:10.1016/j.buildenv.2017.12.011.  
URL <http://www.sciencedirect.com/science/article/pii/S0360132317305772>
- [16] Occupational Health Impacts of Climate Change: Current and Future ISO Standards for the Assessment of Heat Stress.  
URL [https://www.jstage.jst.go.jp/article/indhealth/51/1/51\\_2012-0165/\\_article](https://www.jstage.jst.go.jp/article/indhealth/51/1/51_2012-0165/_article)
- [17] F. Salamone, L. Belussi, C. Currò, L. Danza, M. Ghellere, G. Guazzi, B. Lenzi, V. Megale, I. Meroni, Integrated method for personal thermal comfort assessment and optimization through users’ feedback, IoT and machine learning: A case study † 18 (5) 1602. doi:10.3390/s18051602.  
URL <https://www.mdpi.com/1424-8220/18/5/1602>
- [18] Y. Gao, E. Tumwesigye, B. Cahill, K. Menzel, Using data mining in optimisation of building energy consumption and thermal comfort management, in: The 2nd International Conference on Software Engineering and Data Mining, pp. 434–439.
- [19] Abdallah Moatassem, Clevenger Caroline, Vu Tam, Nguyen Anh, Sensing occupant comfort using wearable technologies 940–950doi:10.1061/9780784479827.095.  
URL <https://ascelibrary.org/doi/abs/10.1061/9780784479827.095>
- [20] ASHRAE, ANSI/ASHRAE Standard 55-2013. Thermal Environmental Conditions for Human Occupancy (2013).
- [21] P. O. Fanger, Calculation of Thermal Comfort: Introductiof a Basic Comfort Equation, ASHRAE Transactions 73.
- [22] ASHRAE, Thermal Environmental Conditions for Human Occupancy ASHRAE Standard 55-1966, Tech. rep., American Society of Heating, Refrigerating and Air-conditioning Engineers (May 2003).
- [23] P. O. Fanger, Thermal comfort. Analysis and applications in environmental engineering., Thermal comfort. Analysis and applications in environmental engineering.  
URL <https://www.cabdirect.org/cabdirect/abstract/19722700268>

- [24] J. van Hoof, J. L. M. Hensen, Quantifying the relevance of adaptive thermal comfort models in moderate thermal climate zones 42 (1) 156–170. doi:10.1016/j.buildenv.2005.08.023.  
URL <http://www.sciencedirect.com/science/article/pii/S0360132305003550>
- [25] M. A. Humphreys, J. Fergus Nicol, The validity of ISO-PMV for predicting comfort votes in every-day thermal environments 34 (6) 667–684. doi:10.1016/S0378-7788(02)00018-X.  
URL <http://www.sciencedirect.com/science/article/pii/S037877880200018X>
- [26] K. Cheong, W. Yu, S. Sekhar, K. Tham, R. Kosonen, Local thermal sensation and comfort study in a field environment chamber served by displacement ventilation system in the tropics, Building and Environment 42 (2) (2007) 525–533. doi:10.1016/j.buildenv.2005.09.008.  
URL <http://linkinghub.elsevier.com/retrieve/pii/S036013230500380X>
- [27] R. de Dear, G. S. Brager, Developing an adaptive model of thermal comfort and preference.  
URL <https://escholarship.org/uc/item/4qq2p9c6>
- [28] J. van Hoof, Forty years of fanger’s model of thermal comfort: comfort for all? 18 (3) 182–201. doi:10.1111/j.1600-0668.2007.00516.x.  
URL <https://onlinelibrary.wiley.com/doi/full/10.1111/j.1600-0668.2007.00516.x>
- [29] B. Kingma, W. van Marken Lichtenbelt, Energy consumption in buildings and female thermal demand 5 (12) 1054–1056. doi:10.1038/nclimate2741.  
URL <https://www.nature.com/articles/nclimate2741>
- [30] Z. Wang, R. de Dear, M. Luo, B. Lin, Y. He, A. Ghahramani, Y. Zhu, Individual difference in thermal comfort: A literature review 138 181–193. doi:10.1016/j.buildenv.2018.04.040.  
URL <http://www.sciencedirect.com/science/article/pii/S0360132318302518>
- [31] ISO, ISO 7730:2005(en), Ergonomics of the thermal environment — Analytical determination and interpretation of thermal comfort using calculation of the PMV and PPD indices and local thermal comfort criteria, Tech. rep., International Standard Organization (2005).  
URL <https://www.iso.org/obp/ui/#iso:std:iso:7730:ed-3:v1:en>
- [32] N. Kántor, J. Unger, The most problematic variable in the course of human-biometeorological comfort assessment — the mean radiant temperature, Central European Journal of Geosciences 3 (1) (2011) 90–100. doi:10.2478/s13533-011-0010-x.  
URL <https://link.springer.com/article/10.2478/s13533-011-0010-x>
- [33] I. O. f. Standardization, ISO7726 Ergonomics of the thermal environment. Instruments for measuring physical quantities..pdf, Tech. Rep. ICS 13.180 (2001).

- [34] EnergyPlus, Engineering Reference, THE BOARD OF TRUSTEES OF THE UNIVERSITY OF ILLINOIS AND THE REGENTS OF THE UNIVERSITY OF CALIFORNIA THROUGH THE ERNEST ORLANDO LAWRENCE BERKELEY NATIONAL LABORATORY., 2013, p 743 of 847.
- [35] E. Arens, T. Hoyt, X. Zhou, L. Huang, H. Zhang, S. Schiavon, Modeling the comfort effects of short-wave solar radiation indoors, *Building and Environment* 88 (2015) 3–9. doi:10.1016/j.buildenv.2014.09.004.  
URL <http://linkinghub.elsevier.com/retrieve/pii/S0360132314002960>
- [36] C. McCarthy, N. Pradhan, C. Redpath, A. Adler, Validation of the empatica e4 wristband, in: 2016 IEEE EMBS International Student Conference (ISC), pp. 1–4. doi:10.1109/EMBSISC.2016.7508621.
- [37] J. H. Choi, CoBi: Bio-sensing building mechanical system controls for sustainably enhancing individual thermal comfort.