


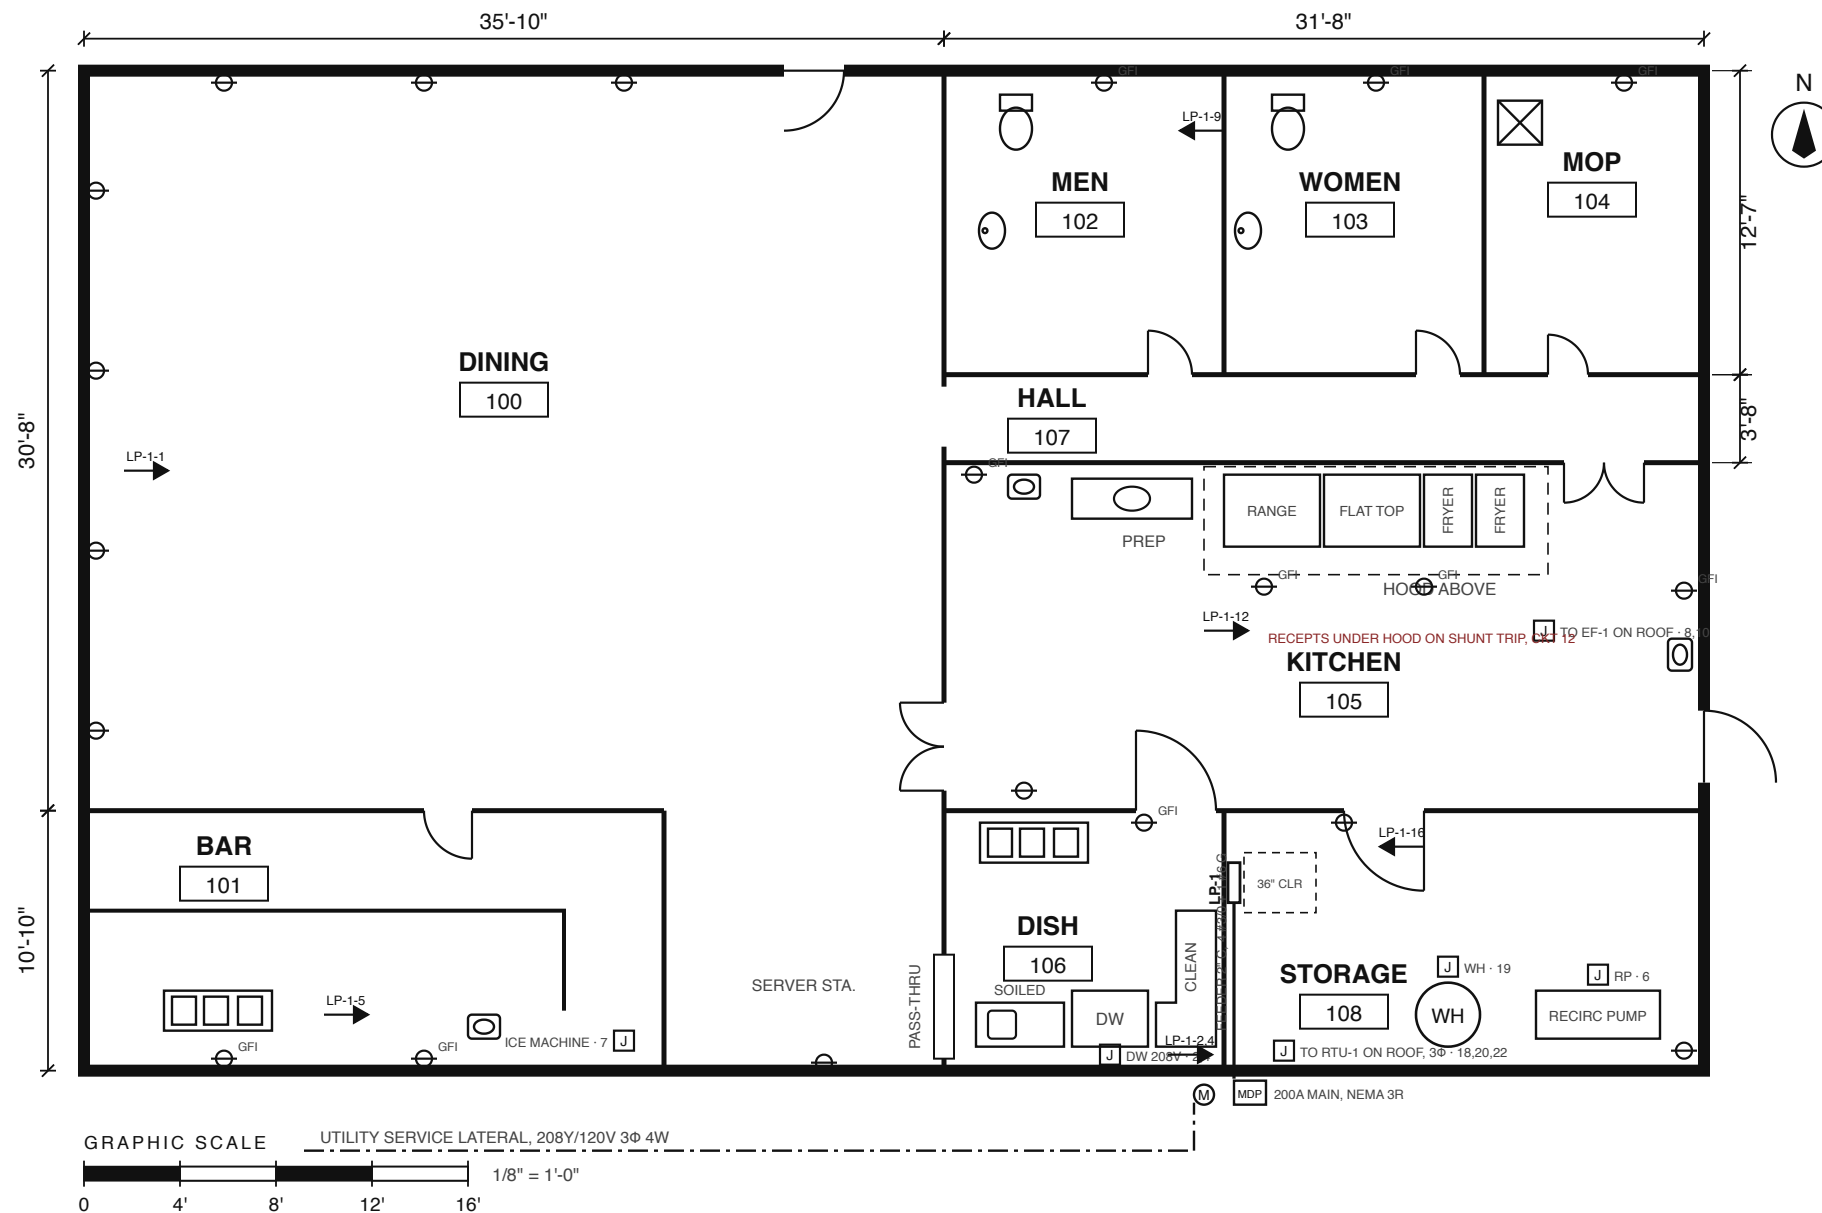

POWER KEYNOTES

ALL BRANCH CIRCUITS 2 #12 CU THHN + 1 #12 G IN 3/4" EMT, UNLESS NOTED.
RECEPTACLES IN THE KITCHEN, THE BAR, THE RESTROOMS AND WITHIN 6 FT OF ANY SINK ARE GFCI (NEC 210.8(B)).
RECEPTACLES UNDER THE HOOD ARE ON A SHUNT-TRIP BREAKER INTERLOCKED WITH THE HOOD SUPPRESSION (NFPA 96).
DW, RP, EF-1, RTU-1: ONE CIRCUIT EACH, DISCONNECT WITHIN SIGHT OF THE UNIT.
PANEL LP-1: 208Y/120V 3Φ 4W, 200A MCB, 42 POLES, SURFACE, TOP AT 78" AFF.
KEEP 36" CLEAR IN FRONT OF LP-1 (NEC 110.26).
FEEDER: UP FROM THE MDP INTO THE CEILING, DOWN INTO THE TOP OF LP-1.
SEE E-501 FOR THE PANEL SCHEDULE, E-601 FOR THE ONE-LINE.

LEGEND

- ⊕ DUPLEX RECEPTACLE, 20A, 18" AFF
- ⊕^{GFI} GFCI RECEPTACLE, 20A, 44" AFF AT COUNTERS
- Ⓜ JUNCTION BOX, EQUIPMENT CONNECTION
- ➔ HOMERUN TO PANEL, CIRCUIT NUMBER AS NOTED
- ▭ PANELBOARD, SURFACE
- - - WORKING CLEARANCE, 36" DEEP x 30" WIDE



COUNTTOOLING — SAMPLE PLAN

PROJECT MAIN ST RESTAURANT

SHEET

SCALE

DATE



1/8" = 1'-0"

07/31/26

POWER PLAN

DRAWN: CT

E-101

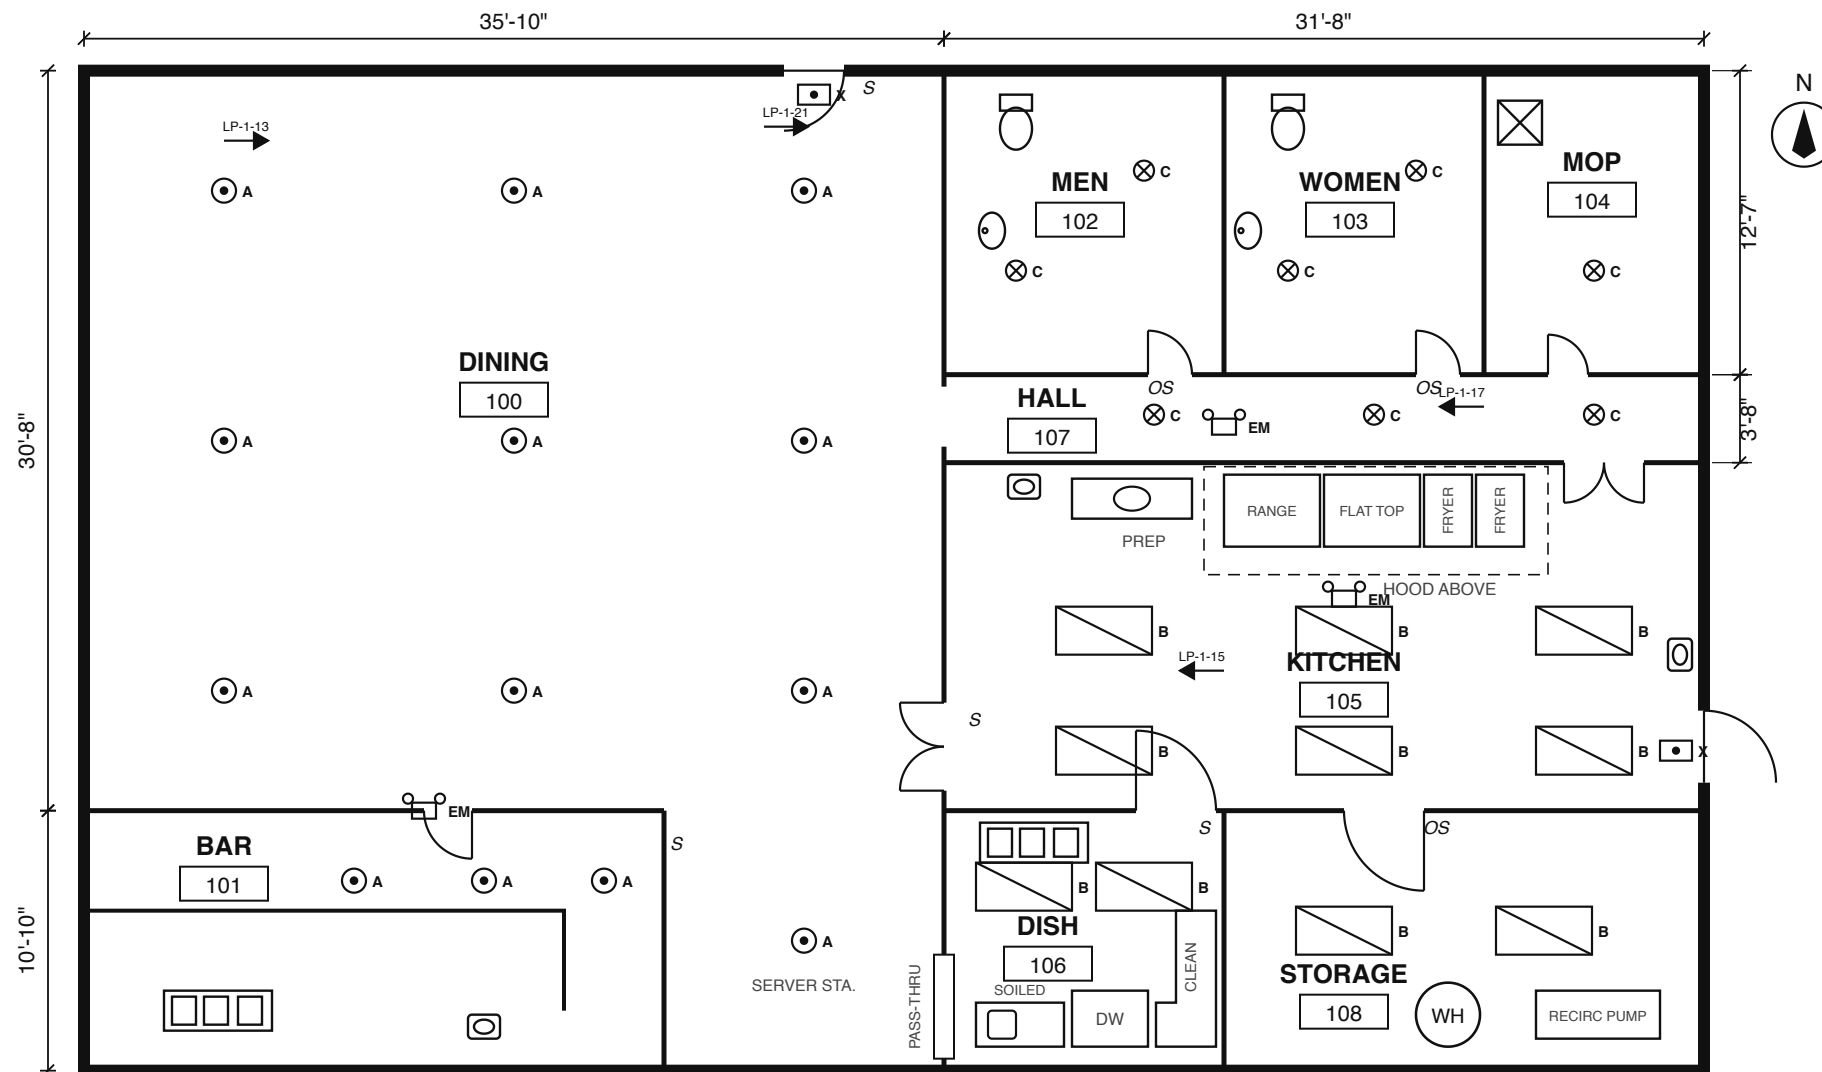

LEGEND

- TYPE A · PENDANT
- ▧ TYPE B · 2x4 TROFFER, RECESSED
- ⊗ TYPE C · 6" DOWNLIGHT
- ⊠ TYPE X · EXIT SIGN W/ BATTERY
- ⬡ TYPE EM · EMERGENCY LIGHT, BATTERY
- S SWITCH, 48" AFF · OS = OCCUPANCY SENSOR

LIGHTING KEYNOTES

FIXTURE TYPES PER SCHEDULE, E-501.
LIGHTING CIRCUITS 2 #12 + 1 #12 G
IN 3/4" EMT, 120V.
EXIT SIGNS AND EMERGENCY LIGHTS ON
CIRCUIT 21 WITH A LOCK-ON, BATTERY
BACKED, 90 MIN (IBC 1008.3, NEC 700.12).
OCCUPANCY SENSORS SWITCH THE
RESTROOMS AND STORAGE
(IECC C405.2.1).
DINING PENDANTS ON A TIME SWITCH
(IECC C405.2.2), DIMMED AT THE ENTRY.
MOUNTING: SWITCHES 48" AFF, EXIT
SIGNS 90" AFF, EM LIGHTS 90" AFF.



COUNTTOOLING — SAMPLE PLAN

PROJECT	MAIN ST RESTAURANT	SHEET	⚠
SCALE	DATE	E-201	
1/8" = 1'-0"	07/31/26		
LIGHTING PLAN	DRAWN: CT		

LIGHTING FIXTURE SCHEDULE

TYPE	DESCRIPTION	LAMP	VOLTS	WATTS	MOUNTING
A	PENDANT, LED, DINING AND BAR	LED 18W	120	18	SURFACE, 9'-0" AFF
B	2X4 TROFFER, LED, RECESSED	LED 40W	120	40	RECESSED, CEILING
C	6" DOWNLIGHT, LED, RECESSED	LED 12W	120	12	RECESSED, CEILING
X	EXIT SIGN, LED, W/ BATTERY	LED 3W	120	3	WALL, 90" AFF
EM	EMERGENCY LIGHT, TWIN HEAD, W/ BATTERY	LED 5W	120	5	WALL, 90" AFF

PANEL SCHEDULE · LP-1

208Y/120V, 3Φ, 4W · 200A MAIN BREAKER · 42 POLES · SURFACE, STORAGE 108 · FED FROM MDP, 2" C, 4 #3/0 CU + 1 #6 G

CKT	LOAD SERVED	VA	P	BKR	WIRE	COND.
1	DINING RECEPTACLES, WEST WALL	720	1	20	#12	3/4"
3	DINING RECEPTACLES, NORTH + SERVER	720	1	20	#12	3/4"
5	BAR GFCI RECEPTACLES	360	1	20	#12	3/4"
7	ICE MACHINE	1200	1	20	#12	3/4"
9	RESTROOM + MOP GFCI	540	1	20	#12	3/4"
11	KITCHEN GFCI	360	1	20	#12	3/4"
13	LTG, DINING AND BAR (13 × A)	234	1	20	#12	3/4"
15	LTG, KITCHEN, DISH, STORAGE (10 × B)	400	1	20	#12	3/4"
17	LTG, HALL, RESTROOMS, MOP (8 × C)	96	1	20	#12	3/4"
19	WATER HEATER CONTROLS	200	1	20	#12	3/4"
21	EXIT + EMERGENCY LIGHTS, LOCK-ON	21	1	20	#12	3/4"
2,4	DISHWASHER, 208V 1Φ, GFCI BKR	4800	2	30	#10	3/4"
6	HW RECIRC PUMP	400	1	20	#12	3/4"
8,10	EF-1 HOOD EXHAUST FAN, 208V 1Φ	2400	2	20	#12	3/4"
12	COOK LINE GFCI RECEPTACLES (SHUNT TRIP)	360	1	20	#12	3/4"
14	DISH PIT GFCI	180	1	20	#12	3/4"
16	STORAGE RECEPTACLES	360	1	20	#12	3/4"
18,20,22	RTU-1, 208V 3Φ	9000	3	40	#8	1"
23-42	SPARE					

CONNECTED LOAD 22.3 kVA · 62 A AT 208V 3Φ · MAIN 200A FOR THE KITCHEN'S FUTURE LOAD (NEC 220, SEE E-601)

SCHEDULE NOTES

1. BRANCH CIRCUITS #12 CU THHN, 3/4" EMT, UNLESS NOTED.
2. GFCI RECEPTACLES IN THE KITCHEN, BAR, RESTROOMS AND WITHIN 6 FT OF ANY SINK (NEC 210.8(B)).
3. CKT 12 ON A SHUNT-TRIP BREAKER INTERLOCKED WITH THE HOOD SUPPRESSION (NFPA 96).
4. MOUNTING: RECEPTACLES 18" AFF, GFCI AT COUNTERS 44" AFF, SWITCHES 48" AFF, PANEL TOP 78" AFF.
5. OCCUPANCY SENSORS IN THE RESTROOMS AND STORAGE (IECC C405.2.1).
6. #12 CU IS PROTECTED AT 20 A MAX (NEC 240.4(D)).
7. DISHWASHER BREAKER GFCI (NEC 422.5(A)(7)).



COUNTTOOLING — SAMPLE PLAN

PROJECT MAIN ST RESTAURANT

SHEET



SCALE

DATE

NONE

07/31/26


SCHEDULES

DRAWN: CT

E-501

ONE-LINE DIAGRAM · SERVICE AND PANEL LP-1

NOT TO SCALE

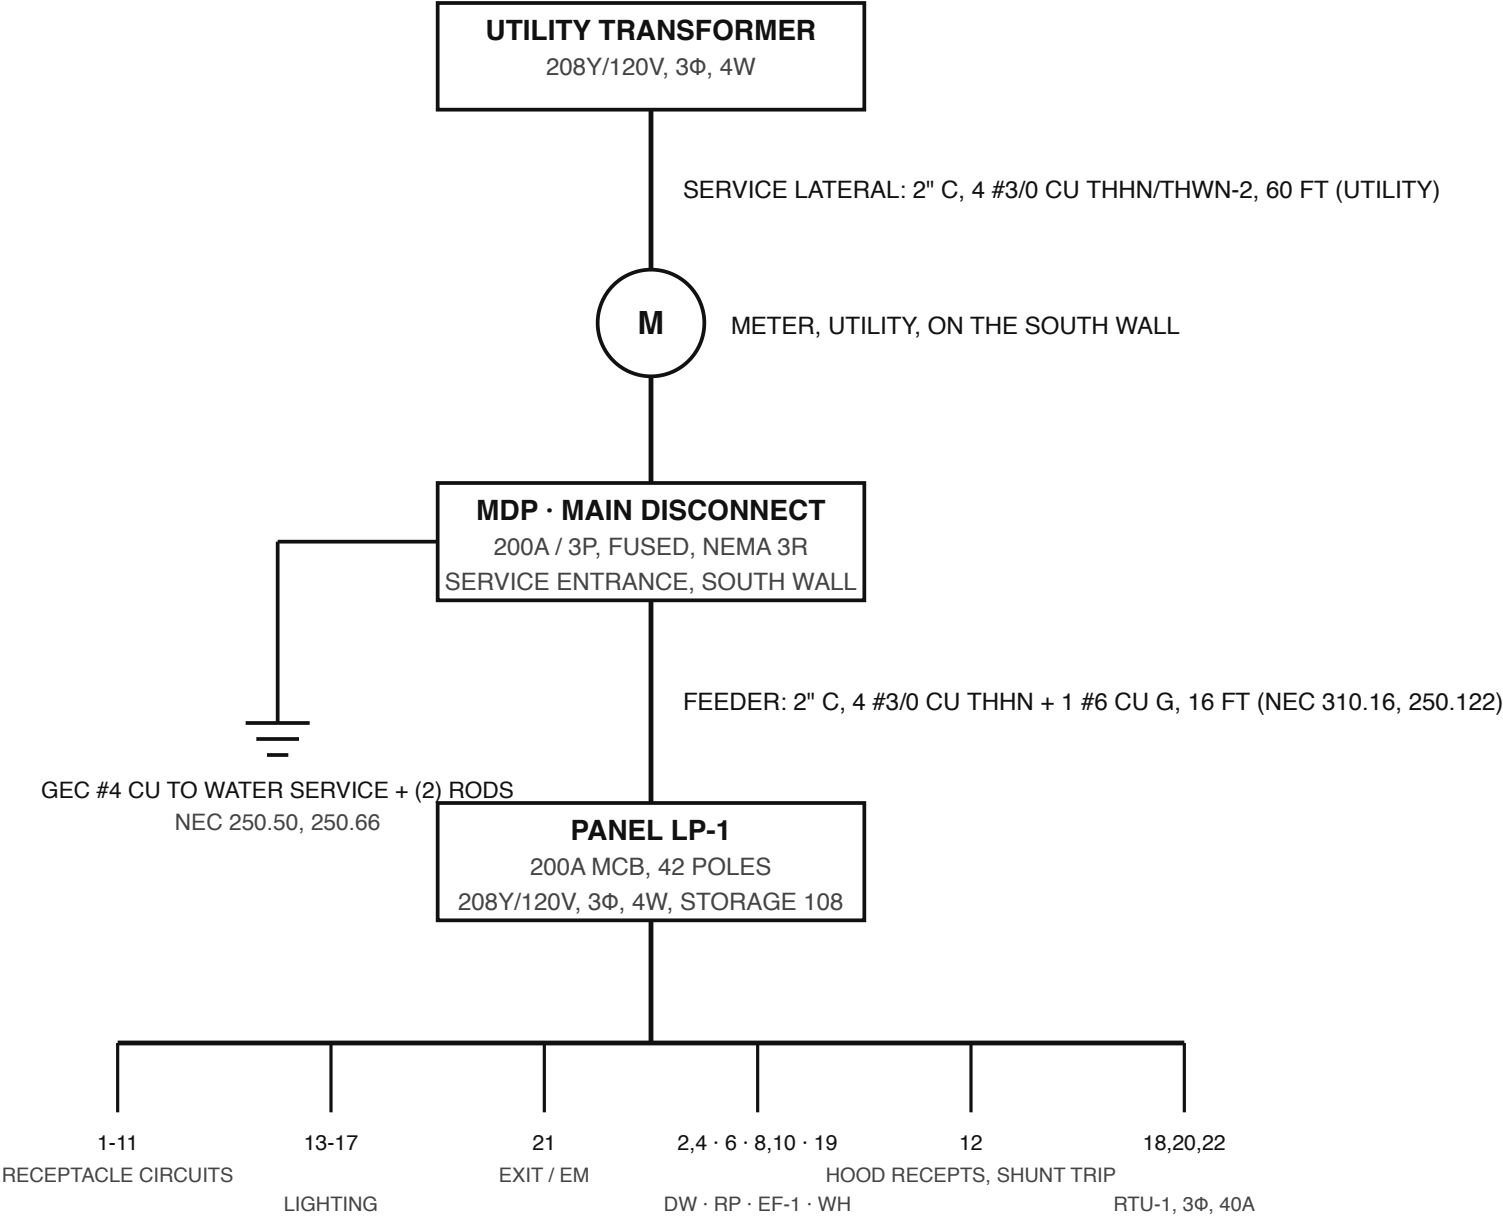

ONE-LINE NOTES

- SERVICE: 200A, 208Y/120V, 3Φ, 4W. CONNECTED LOAD 22.3 kVA (62 A); 200A CARRIES THE KITCHEN'S FUTURE LOAD (NEC 220).
- THREE PHASE FOR RTU-1; 120V FROM ANY PHASE TO NEUTRAL.
- FEEDER AND SERVICE CONDUCTORS 3/0 CU THHN/THWN-2, 200 A AT 75°C (NEC 310.16); #6 CU EGC WITH THE FEEDER ONLY (250.122).
- CONDUIT FILL: 4 #3/0 + 1 #6 IN 2" EMT = 33% (NEC CH. 9 TABLE 1, 40% MAX).
- CKT 12 SHUNT TRIP INTERLOCKED WITH THE HOOD SUPPRESSION.
- DISCONNECT WITHIN SIGHT OF EF-1 AND RTU-1 (NEC 430.102, 440.14).



COUNTTOOLING — SAMPLE PLAN

PROJECT MAIN ST RESTAURANT

SHEET



SCALE
NONE

DATE
07/31/26

ONE-LINE DIAGRAM

DRAWN: CT

E-601