


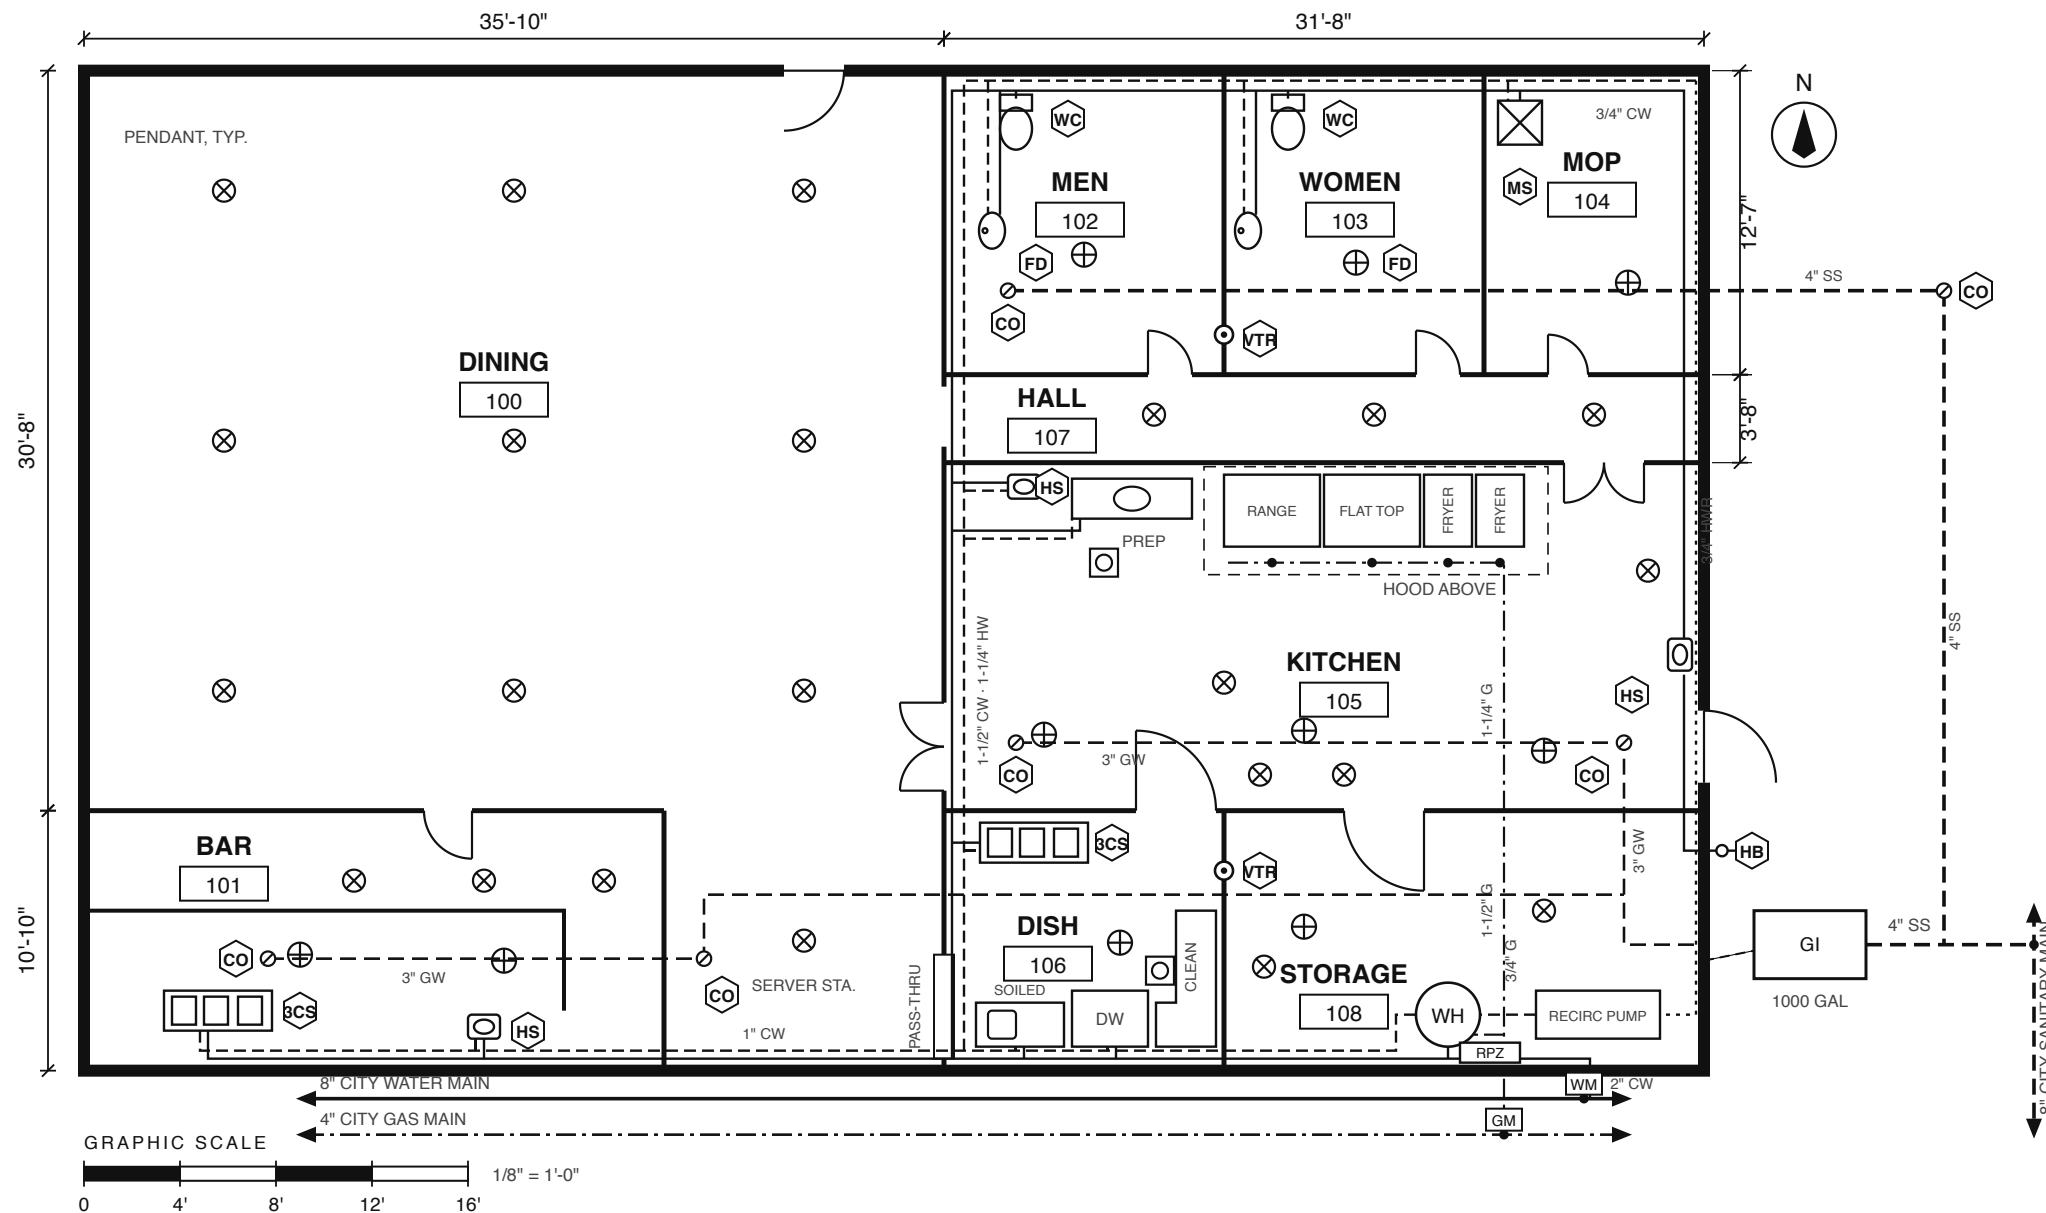

PLUMBING KEYNOTES

- WC WATER CLOSET, FLOOR MTD
- HS HAND SINK, WALL HUNG
- 3CS 3-COMPARTMENT SINK
- MS MOP SINK, FLOOR MTD
- FD FLOOR DRAIN W/ TRAP PRIMER, TYP.
- FS FLOOR SINK, 1/2 GRATE
- DW COMMERCIAL DISHWASHER, INDIRECT WASTE TO FS
- GI GREASE INTERCEPTOR, 1000 GAL, EXTERIOR
- WH WATER HEATER, 100 GAL GAS
- RP RECIRC PUMP ON THE HW RETURN
- SS SANITARY SEWER TO CITY
- W DOMESTIC WATER FROM CITY
- G GAS SERVICE FROM CITY
- RPZ BACKFLOW PREVENTER, RPZ
- HB HOSE BIBB, FREEZEPROOF
- CO CLEANOUT
- VTR VENT THROUGH ROOF

ALL KITCHEN WASTE THROUGH GREASE INTERCEPTOR, TYP.

GENERAL NOTES

- WATER: TYPE L COPPER. GAS: SCH 40 BLACK STEEL, THREADED.
- WASTE AND VENT: PVC DWV SCH 40, BELOW SLAB AND IN WALLS.
- SLOPE 1/4" PER FT TO 2-1/2" AND ALL GW, 1/8" PER FT AT 3" AND UP.
- CLEANOUTS AT EACH UPSTREAM END AND FIRST TURN, 100 FT MAX APART.
- EVERY FIXTURE TRAPPED AND VENTED. VENTS THROUGH ROOF AT VTR.
- RESTROOM WASTE DIRECT TO SEWER. KITCHEN AND BAR WASTE VIA GI.


LEGEND

- CW DOMESTIC COLD WATER
- HW DOMESTIC HOT WATER
- HWR HOT WATER RETURN
- G GAS
- SS SANITARY SEWER
- GW GREASE WASTE TO GI
- GAS DROP W/ SHUTOFF, TYP.
- LIGHT FIXTURE, TYP.



COUNTTOOLING — SAMPLE PLAN


PROJECT MAIN ST RESTAURANT		SHEET
SCALE 1/8" = 1'-0"	DATE 07/31/26	
PLUMBING PLAN	DRAWN: CT	P-101

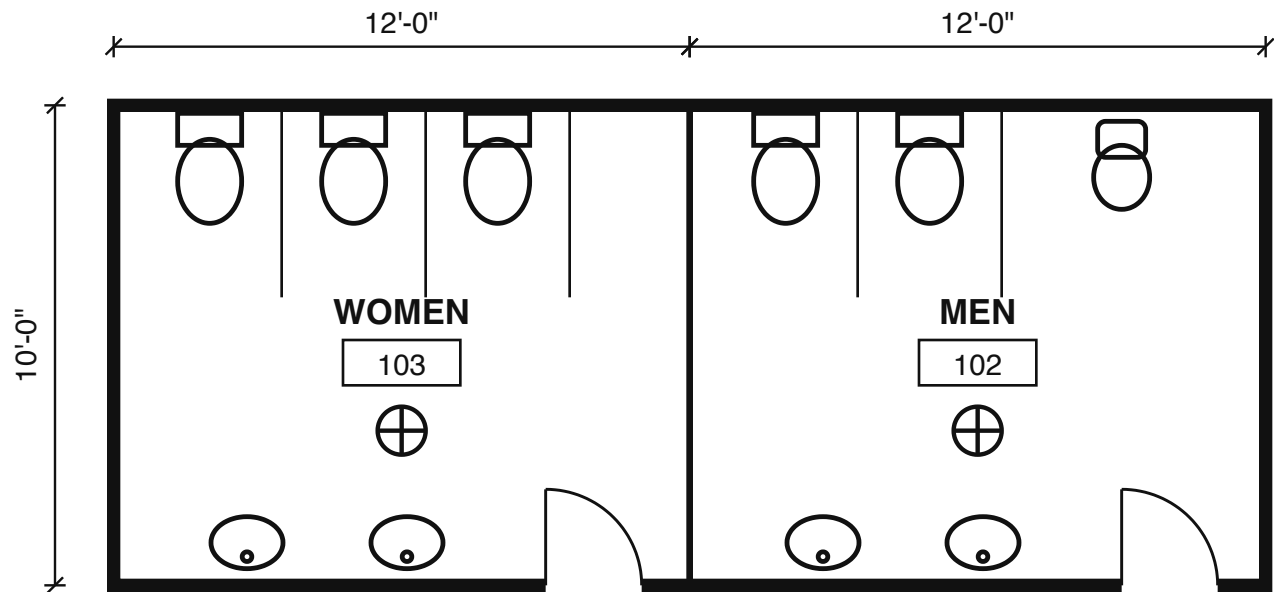

1 ENLARGED RESTROOM PLAN
SCALE: 1/4" = 1'-0"

SHEET NOTES

1. PLAN 1 IS DRAWN AT 1/4" = 1'-0". DETAIL 2 IS DRAWN AT 1/2" = 1'-0".
2. PROVIDE DETAIL 2 AT EACH OF (4) COOK LINE AND BAR STATIONS.
3. FLOOR DRAINS W/ TRAP PRIMER, TYP.
4. ALL DIMENSIONS TO FACE OF FINISH.

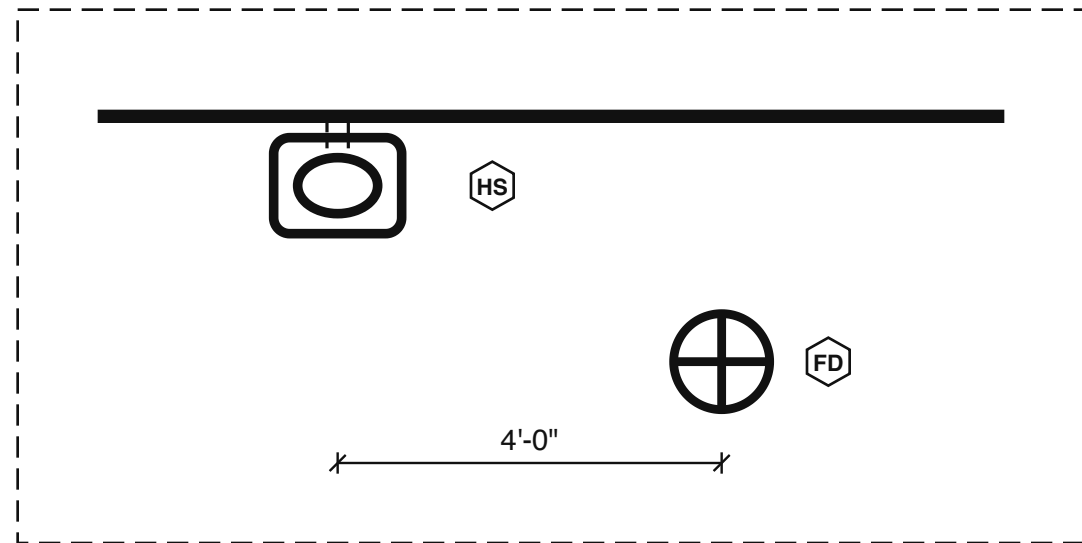

2 HAND SINK STATION · TYP. OF 4
SCALE: 1/2" = 1'-0"



COUNTTOOLING — SAMPLE PLAN

PROJECT MAIN ST RESTAURANT

SHEET



SCALE
AS NOTED

DATE
07/31/26

ENLARGED PLANS

DRAWN: CT

P-401


PLUMBING FIXTURE SCHEDULE

TAG	FIXTURE	CW	HW	W	V	WSFU	DFU
WC-1	WATER CLOSET, FLOOR MTD, FLUSH VALVE	1"	-	4"	2"	10	4
U-1	URINAL, WALL HUNG, FLUSH VALVE	3/4"	-	2"	1-1/2"	5	2
L-1	LAVATORY, COUNTER MTD	1/2"	1/2"	1-1/2"	1-1/4"	2	1
HS-1	HAND SINK, WALL HUNG	1/2"	1/2"	1-1/2"	1-1/4"	2	1
3CS-1	3-COMPARTMENT SINK	3/4"	3/4"	2"	1-1/2"	4	3
MS-1	MOP SINK, FLOOR MTD	3/4"	3/4"	3"	2"	3	2
FD-1	FLOOR DRAIN W/ TRAP PRIMER	1/2"	-	3"	2"	-	2
FS-1	FLOOR SINK, 1/2 GRATE	-	-	3"	2"	-	5

SCHEDULE NOTES

1. ROUGH-IN SIZES ARE MINIMUMS; SEE PLANS FOR RUN SIZES.
2. ALL FIXTURES ADA WHERE SHOWN ON THE ARCHITECTURAL PLANS.
3. WSFU AND DFU PER IPC APPENDIX E AND TABLE 709.1, PUBLIC OCCUPANCY.
4. DRAINAGE LOAD ON P-101: 51 DFU. BUILDING SEWER 4" AT 1/8" PER FT (180 DFU MAX);
- A 3" SEWER AT 1/8" PER FT WOULD CARRY 36 (TABLE 710.1(1)).

COUNTTOOLING — SAMPLE PLAN	
PROJECT	MAIN ST RESTAURANT
SCALE	DATE
NONE	07/31/26
SCHEDULES	DRAWN: CT
P-501	

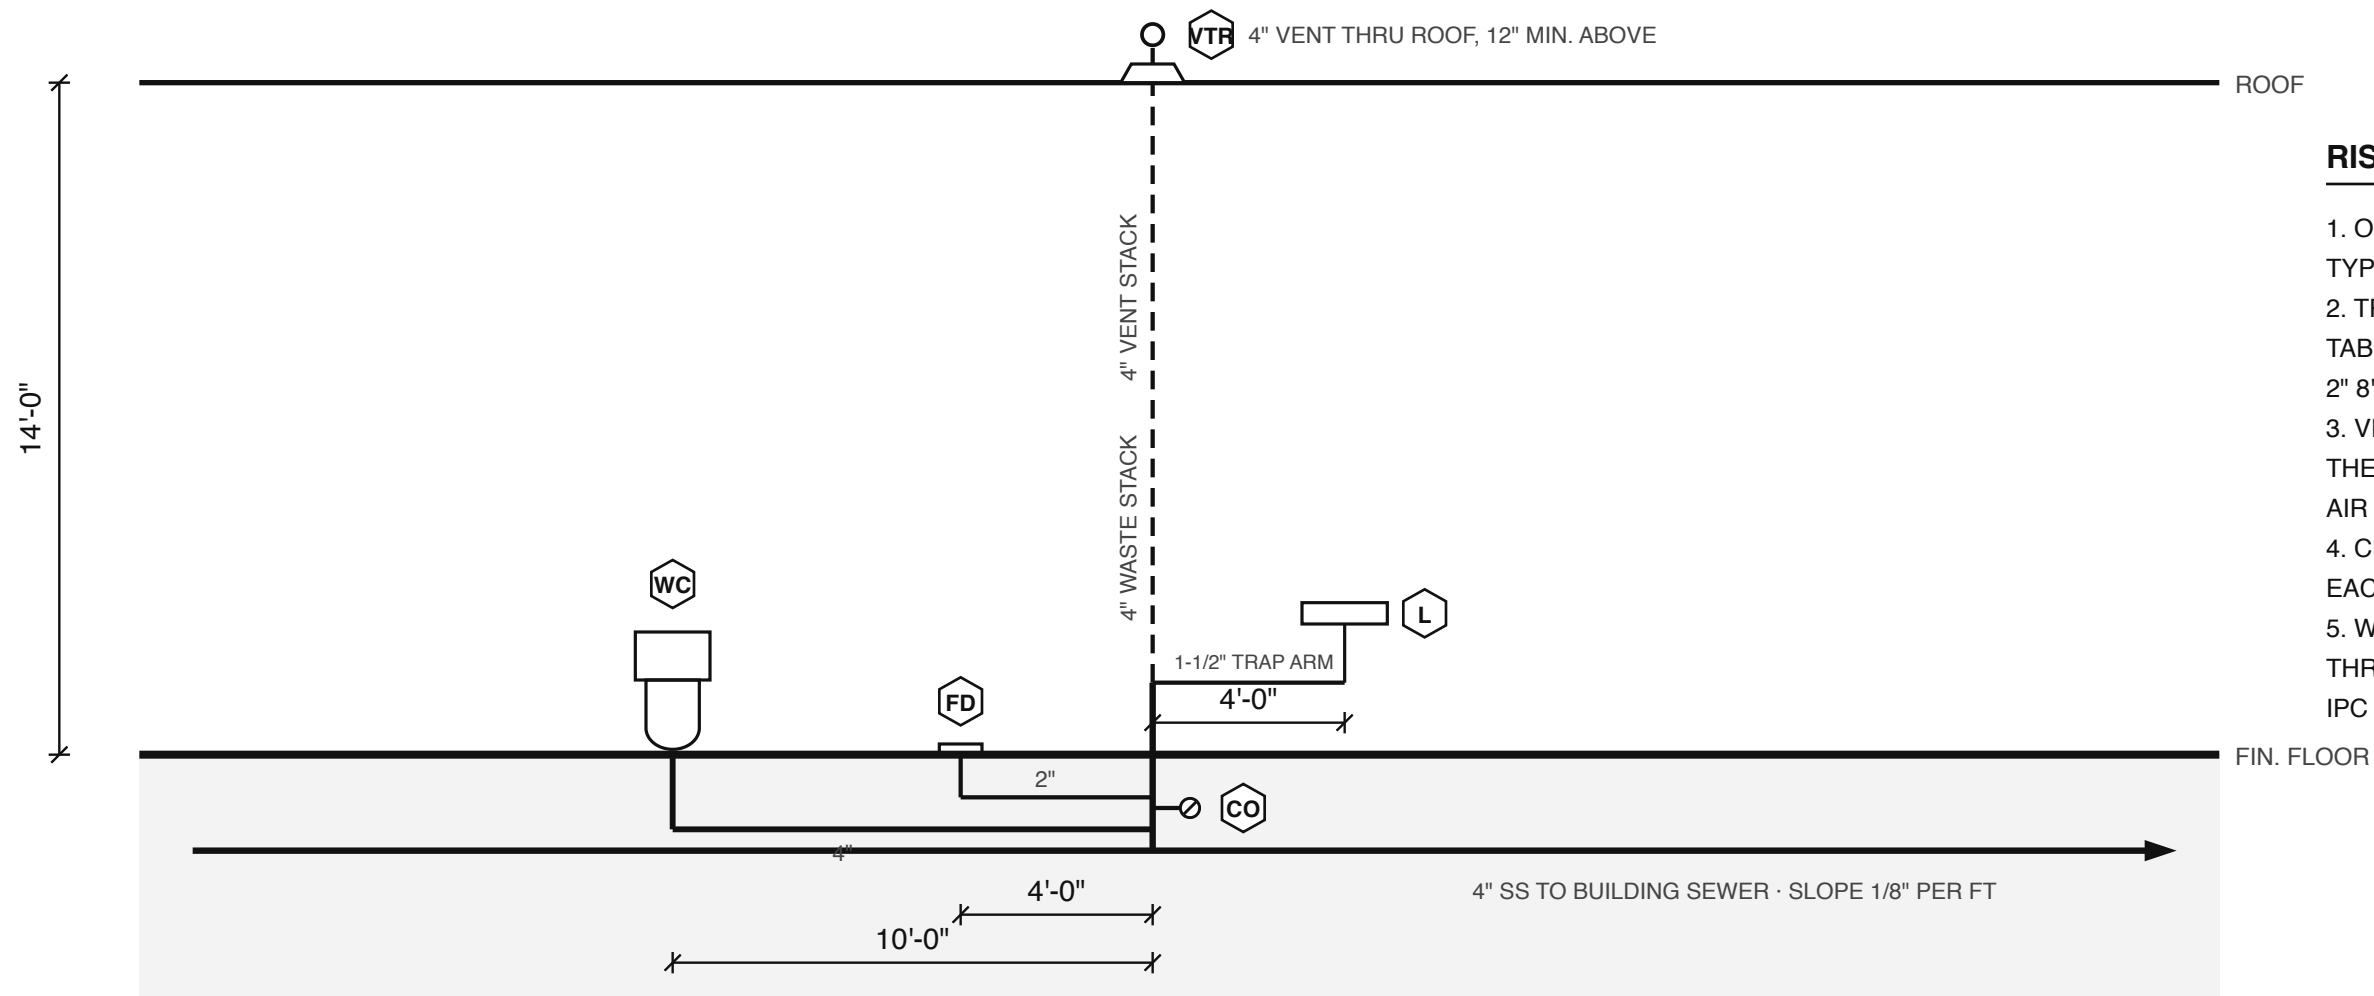

RISER NOTES

1. ONE OF EACH FIXTURE SHOWN, TYPICAL OF BOTH RESTROOMS.
2. TRAP ARM LENGTHS PER IPC TABLE 909.1: 1-1/2" 6'-0" MAX, 2" 8'-0", 4" 16'-0".
3. VENT TERMINAL 12" MIN. ABOVE THE ROOF, 10'-0" FROM ANY AIR INTAKE.
4. CLEANOUT AT THE BASE OF EACH STACK.
5. WC AND FD ARE WET VENTED THROUGH THE LAVATORY DRAIN, IPC 912.1.1. VERIFY WITH AHJ.

1 WASTE & VENT RISER, RESTROOMS 102 / 103, TYP.
SCALE: 1/4" = 1'-0"



COUNTTOOLING — SAMPLE PLAN

PROJECT MAIN ST RESTAURANT

SHEET



SCALE
1/4" = 1'-0"

DATE
07/31/26

WASTE & VENT RISER

DRAWN: CT

P-601