


- NOTES
1. NOTES ON ALL DRAWINGS APPLY WHERE APPROPRIATE.
2. THE FOLLOWING SYMBOLS DENOTE:--

- ⊕ HEAT DETECTOR
- ⊕ COMBINED HEAT DETECTOR, SPEECH SOUNDER & STROBE
- ⊕ COMBINED HEAT & CARBON MONOXIDE DETECTOR
- ⊕ SMOKE DETECTOR
- ⊕ SMOKE DETECTOR LOCATED IN CEILING
- ⊕ COMBINED SMOKE DETECTOR, SPEECH SOUNDER & STROBE
- ⊕ OPTICAL HEAT MULTISENSOR, SPEECH SOUNDER, STROBE FIRE ALARM HEAD.
- ⊕ MANUAL CALL POINT (NUMBER BELOW DENOTES FIRE PANEL LOOP.
- ⊕ OPEN MANUAL CALL POINT FOR OVERRIDING ELECTRONIC DOOR CONTROLS.
- ⊕ FIREMANS WINDOW CONTROL.
- ⊕ SPEECH SOUNDER STROBE.
- ⊕ MAIN FIRE ALARM PANEL.
- ⊕ MOTORIZED FIRE DAMPER.
- ⊕ REFUGE INTERCOM.
- ⊕ MAIN REFUGE INTERCOM
- ⊕ DOOR HOLD OPEN DEVICES.
- ⊕ FLOOR MOUNTED DOOR HOLD OPEN DEVICE.
- ⊕ AUTOMATIC INTERFACE TO THE FIRE ALARM SYSTEM.
3. ALL VOID DETECTION TO HAVE REMOTE VISIBLE INDICATIONS

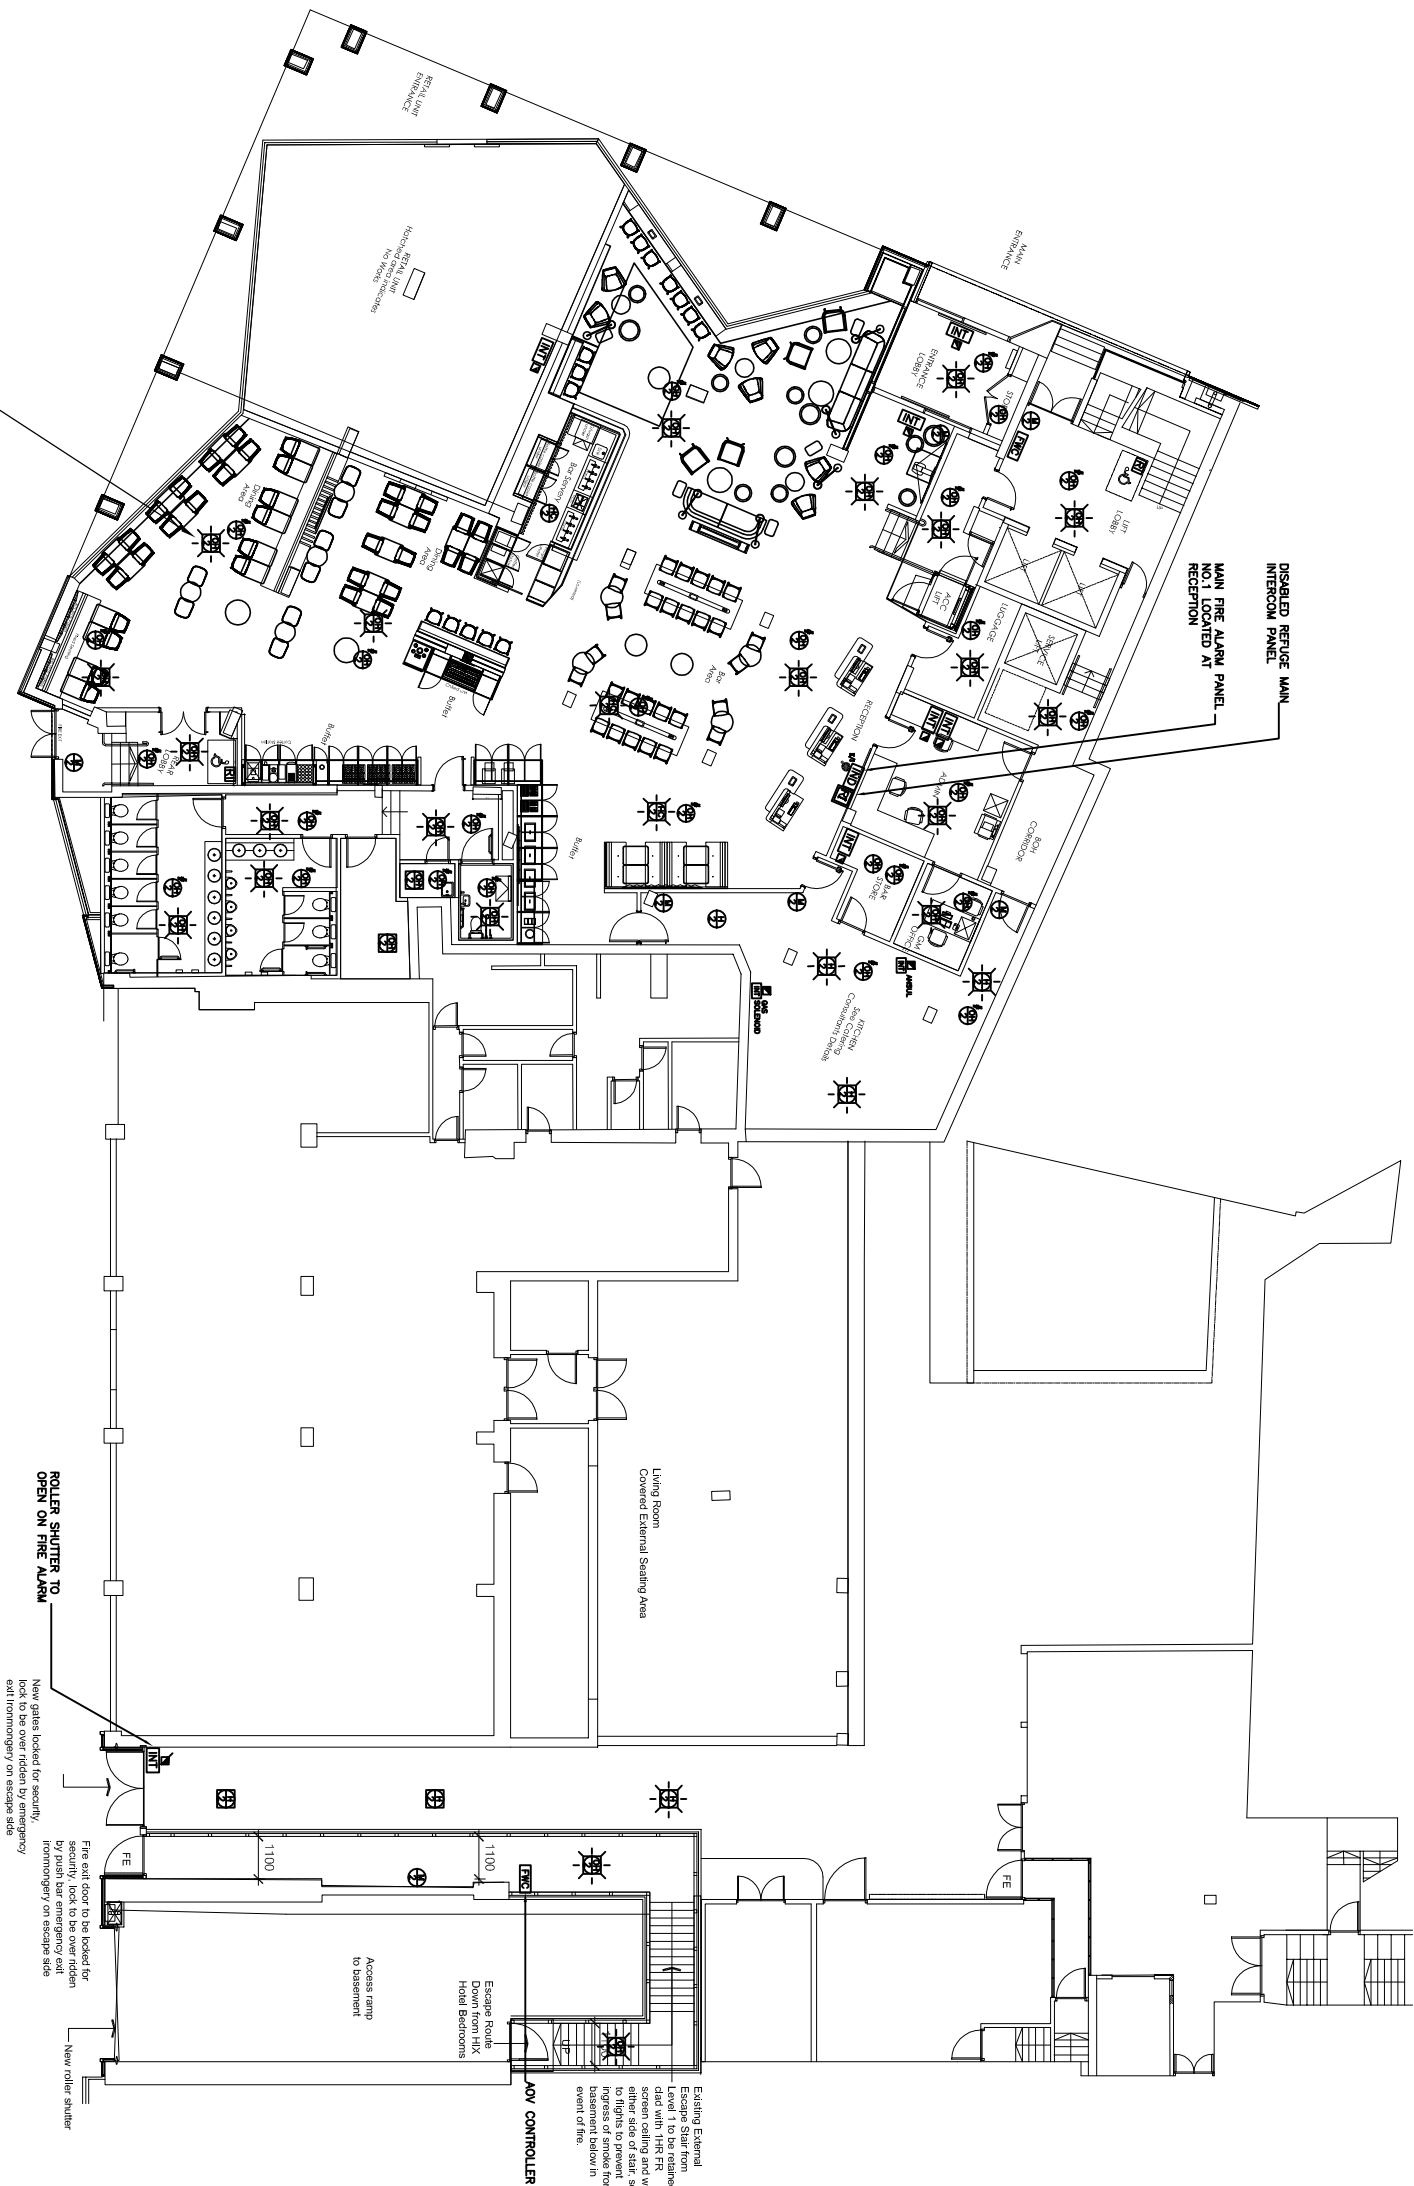

C4	06.06.16	ARCH LAYOUT REVISED	DW	1/8
C2	29.03.16	ARCH LAYOUT REVISED	DW	1/8
C2	12.03.16	ARCH LAYOUT REVISED	DW	1/8
C2	12.03.16	CA CONSTRUCTION ISSUE	DW	1/8
T1	15.01.16	TENDER ISSUE	DW	1/8
REV DATE	DESCRIPTION		DR	SK

Caldwell

ARCHITECT
ICA ARCHITECTS

JOB
FINDLATER HOUSE DUBLIN
HOLIDAY INN EXPRESS

DRAWING
ELECTRICAL SERVICES INSTALLATION
FIRE ALARM

GROUND FLOOR

DRAWING NO./REVISION
3682/E302
SCALE/PRINTED AT
1:1250A1 JAN'15 DW

C4

INCLUDE ALL NECESSARY OFFSETS OF SERVICES IN CEILING VOIDS, SERVICE DUCTS AND ALL OTHER AREAS TO ACHIEVE CROSSOVERS AND CO-ORDINATION OF MECHANICAL AND ELECTRICAL SERVICES.

- LOOP 1 = BASEMENT
LOOP 2 = GROUND FLOOR
LOOP 3 = LEVEL 1
LOOP 4 = LEVEL 2
LOOP 5 = LEVEL 3
LOOP 6 = LEVEL 4
LOOP 7 = LEVEL 5
LOOP 8 = LEVEL 6 & ROOF