

NOTES

1. NOTES DETAILED ON ALL DRAWINGS APPLY WHERE APPROPRIATE
2. THE FOLLOWING SYMBOLS DENOTE: -

☐ PRE SET DIMMER CONTROL PLATE

⌘ K KEY SWITCH TEST OVERRIDE FOR EMERGENCY TEST

[D2P] DIMMER CONTROL PANEL

Ⓢ PIR PRESENCE DETECTOR FOR USE IN BACK OF HOUSE AREAS. DELAY TIME SHALL BE FIXED AT 35 MINUTES

Ⓢ COMBINED PIR AND DAYLIGHT SENSOR TO DIN OFFICE LIGHT FITTINGS

3. FOR DETAILS ON BEDROOMS REFER TO THE RELEVANT DRAWINGS

4. WHERE STANDALONE EMERGENCY LUMINAIRES AND UNLIMITED EMERGENCY ESCAPE SIGNAGE ARE INDICATED WITHOUT A CIRCUIT REFERENCE, THE LUMINAIRE SHALL BE SUPPLIED FROM THE CLOSEST LOCAL GENERAL LIGHTING CIRCUIT.

STAIRWELL LIGHTING CONTROLLED VIA A TIMELOCK AND PHOTO EYE SENSOR. SENSORS LOCATED IN THE MAIN OFFICE BEHIND RECEPTION. LOCAL PIR SENSORS IN THE STAIRWELLS SHALL OVERRIDE THE TIMELOCK FOR STAIRS THEN PRESET BACK TO TIMELOCK CONTROL.

PIR MUST BE OVERRIDDEN DURING FIRE ALARMS THAT ALL FITTINGS ARE ILLUMINATED. FIRE ALARM INTERFACES SHALL BE PROVIDED UNDER THIS CONTRACT TO BE PROVIDED BY THE CONTRACTOR TO THE PIR CONTRACTORS


LOCATION OF BASEMENT DIMMER BACK

PIR

PIR

PIR

PRE SET DIMMER CONTROLLER FOR MEETING ROOM

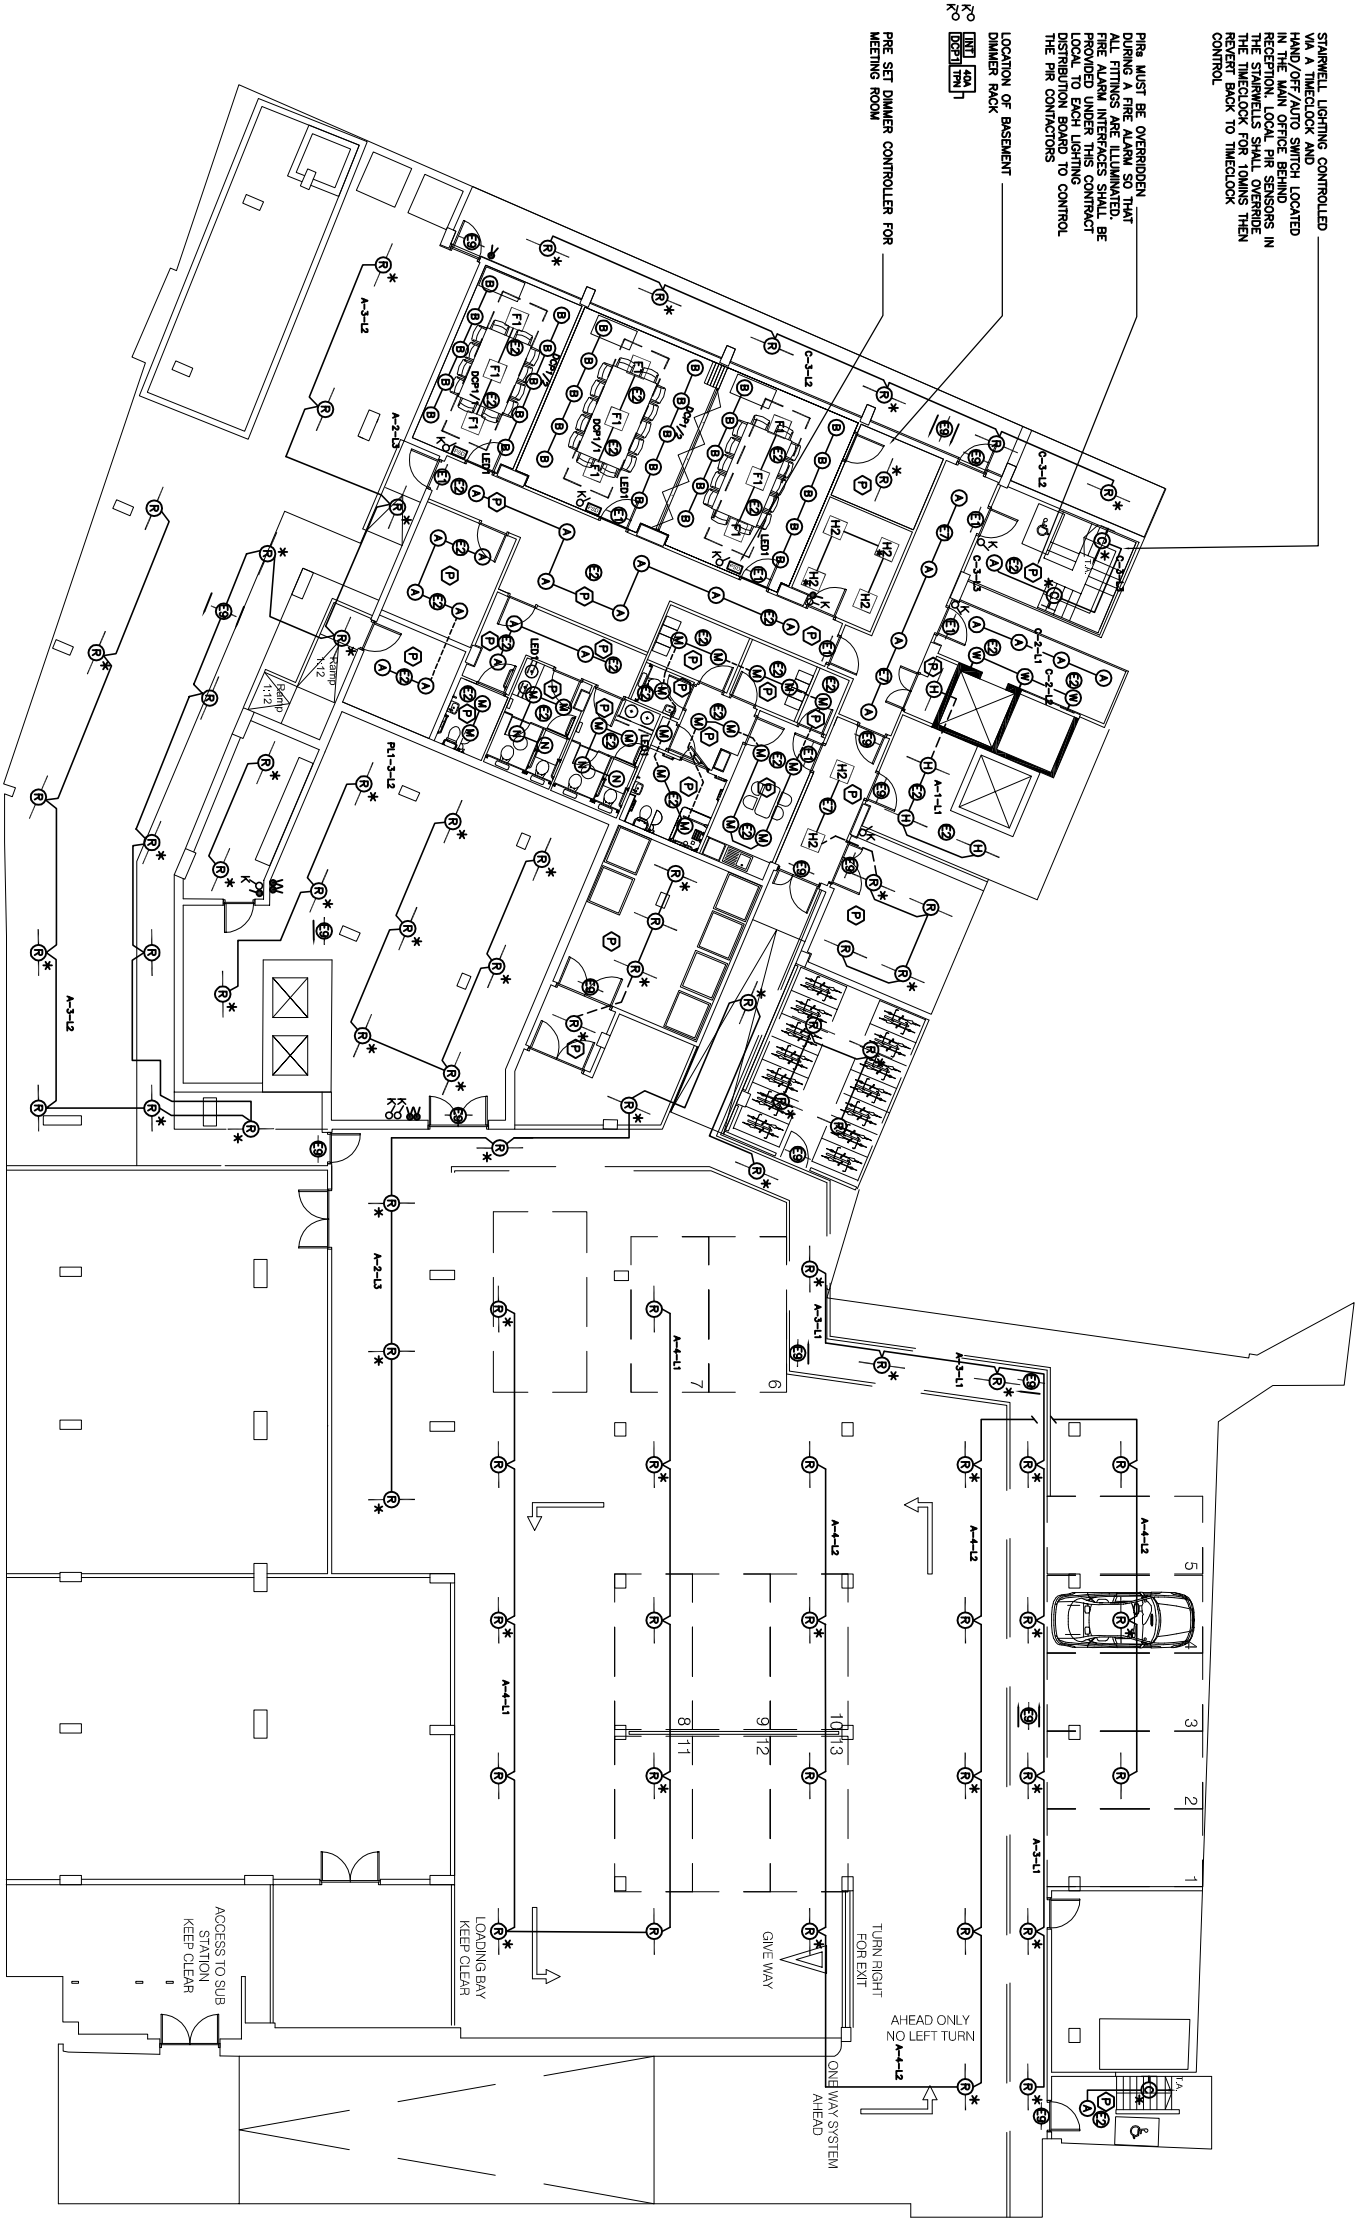

C4 06.06.16 ARCH LAYOUT REVISED	DW	MB
C2 29.03.16 ARCH LAYOUT REVISED	DW	MB
C2 12.06.15 ARCH LAYOUT REVISED	DW	MB
C2 12.06.15 CA CONSTRUCTION ISSUE	DW	MB
T1 15.01.15 TENDER ISSUE	DW	MB
REV DATE DESCRIPTION	DR	SK

Caldwell

ARCHITECT
ICA ARCHITECTS

JOB
FINDLATER HOUSE DUBLIN
HOLIDAY INN EXPRESS

DRAWING
ELECTRICAL SERVICES INSTALLATION
GENERAL PURPOSE & EMERGENCY LIGHTING

BASEMENT

Drawing No./Revision
3682/E101

C4

SCALE / PRINTED AT
1:1250x1 JAN'15 DW

DRAWN

CHECKED

UNIT 6 PRESTONROSE BUSINESS PARK TEL: (0283) 9069720 FAX: (0283) 90641625
NEWBANGOR, BT9 6AW EMAIL: admin@caldwelldesigning.net