


NOTES

1. NOTES ON ALL DRAWINGS APPLY WHERE APPROPRIATE.
2. THE FOLLOWING SYMBOLS DENOTE--

- ② HEAT DETECTOR
- ☼ COMBINED HEAT DETECTOR, SPEECH
SOUNDER & STROBE
- ☼ COMBINED HEAT & CARBON MONOXIDE
DETECTOR
- ☼ SMOKE DETECTOR
- ☼ SMOKE DETECTOR LOCATED IN CEILING
VOID
- ☼ COMBINED SMOKE DETECTOR, SPEECH
SOUNDER & STROBE
- ☼ OPTICAL, HEAT, MULTISENSOR, SPEECH
SOUNDER, STROBE FIRE ALARM HEAD,
MANUAL CALL POINT (NUMBER BELOW
DENOTES FIRE PANEL LOOP).
- ☼ GREEN MANUAL CALL POINT FOR
OVERRIDEING ELECTRONIC DOOR
CONTROLS.
- ☼ FIREMAN'S WINDOW CONTROL.
- ☼ SPEECH SOUNDER STROBE.
- ☼ MAIN FIRE ALARM PANEL.
- ☼ MOTORIZED FIRE DAMPER.
- ☼ REFUGE INTERCOM.
- ☼ MAIN REFUGE INTERCOM
- ☼ DOOR HOLD OPEN DEVICES.
- ☼ FLOOR MOUNTED DOOR HOLD OPEN
DEVICE.
- ☼ AUTOMATIC INTERFACE TO THE FIRE
ALARM SYSTEM.
3. ALL VOID DETECTION TO HAVE REMOTE VISIBLE
INDICATORS

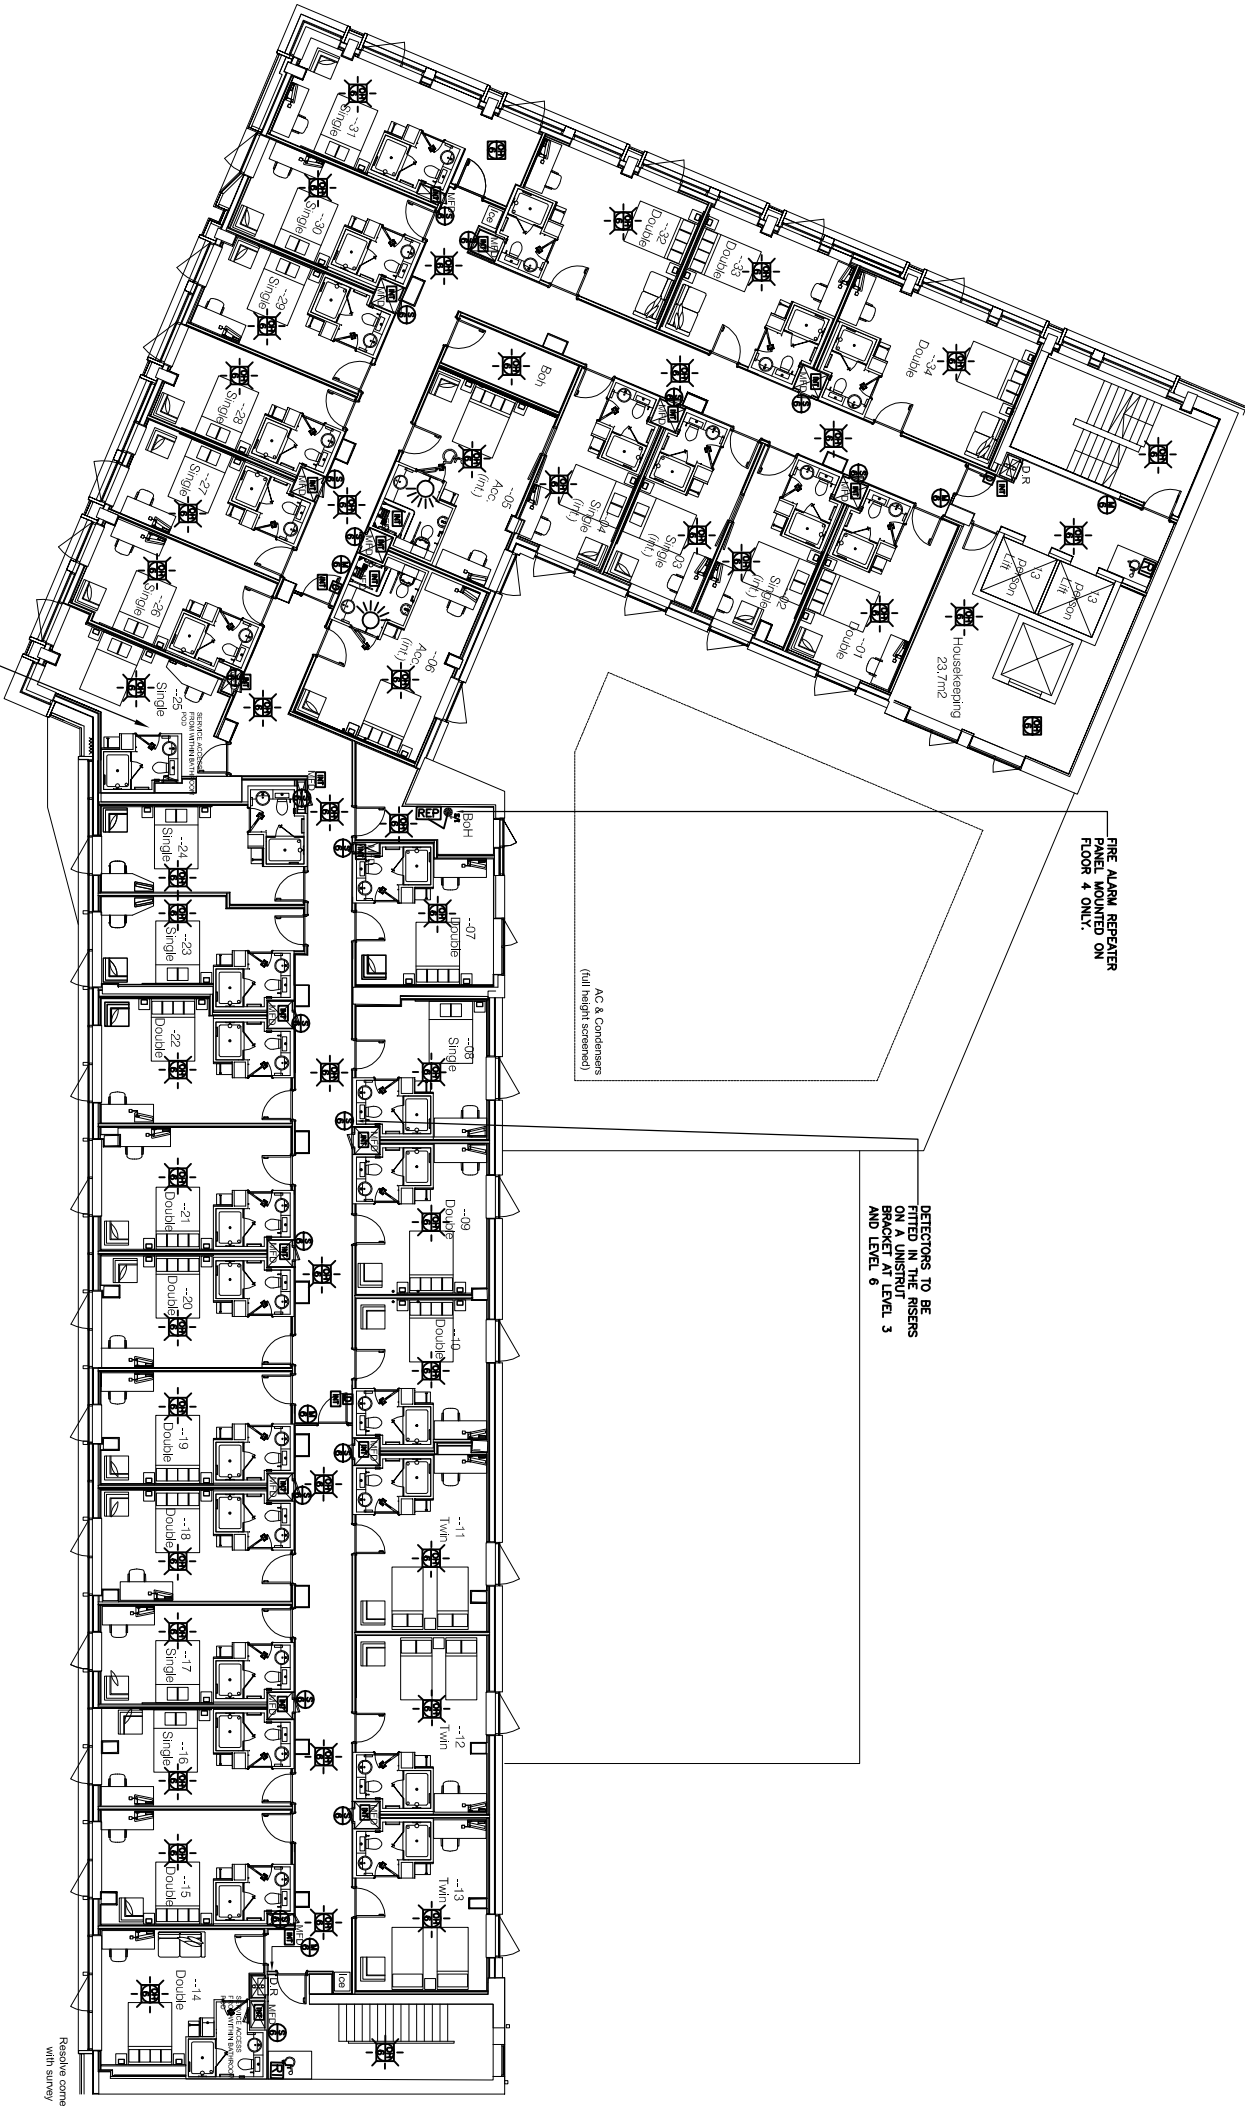

T1 15.01.15	TENDER ISSUE	DW	148
REV DATE	DESCRIPTION	OR	SK

Caldwell
Engineering Environments

ARCHITECT
ICA ARCHITECTS

JOB
FINDLATER HOUSE DUBLIN
HOLIDAY INN EXPRESS

DRAWING
ELECTRICAL SERVICES INSTALLATION

FIRE ALARM

FLOOR 3 + 4

DRAWING NO./REVISION
3682/E304

T1

SCALE/PRINTED AT	DATE	DRAWN	CHECKED
1:1250x1	JAN'15	DW	

UNIT 6 FREESTORE BUSINESS PARK TEL (028)9069720 FAX (028)90641025
NEWBOWNREACH BT6 6AW EMAIL: cdm@caldwellconsulting.net