

NOTES

1. NOTES ON ALL DRAWINGS APPLY WHERE APPROPRIATE.


2. THE FOLLOWING SYMBOLS DENOTE:-

- ②1 HEAT DETECTOR
- ☼ COMBINED HEAT DETECTOR, SPEECH
SOUNDER & STROBE
- ☼ COMBINED HEAT & CARBON MONOXIDE
DETECTOR
- ☼ SMOKE DETECTOR
- ☼ SMOKE DETECTOR LOCATED IN CEILING
VOID
- ☼ COMBINED SMOKE DETECTOR, SPEECH
SOUNDER & STROBE
- ☼ OPTICAL HEAT MULTISENSOR, SPEECH
SOUNDER, STROBE FIRE ALARM HEAD,
MANUAL CALL POINT (NUMBER BELOW
DENOTES FIRE PANEL LOOP).
- ☼ GREEN MANUAL CALL POINT FOR
OVERRIDING ELECTRONIC DOOR
CONTROLS.
- ☼ FREEMANS WINDOW CONTROL.
- ☼ SPEECH SOUNDER STROBE.
- ☼ MAIN FIRE ALARM PANEL.
- ☼ MOTORIZED FIRE DAMPER.
- ☼ REFUGE INTERCOM.
- ☼ MAIN REFUGE INTERCOM
- ☼ DOOR HOLD OPEN DEVICES.
- ☼ FLOOR MOUNTED DOOR HOLD OPEN
DEVICE.
- ☼ AUTOMATIC INTERFACE TO THE FIRE
ALARM SYSTEM.
3. ALL VOID DETECTION TO HAVE REMOTE VISIBLE
INDICATORS

FIRE ALARM INTERFACE AND SUPPLY TO ADV
CONTROLLER AT HIGH LEVEL IN STAIR CORE.
ALL FINAL CONNECTIONS AND CONTROL CABLEING
UNDER THIS CONTRACT. CONTROLS CABLED TO
BREAK GLASS ON GROUND FLOOR. BREAK GLASS
WITH OPEN / CLOSE FUNCTION PROVIDED AND
INSTALLED UNDER THIS CONTRACT

DETECTORS TO BE
FITTED IN THE RESERVES
SPACE AT LEVEL 3
AND LEVEL 6

FIRE ALARM INTERFACE AND SUPPLY TO ADV
CONTROLLER AT HIGH LEVEL IN STAIR CORE.
ALL FINAL CONNECTIONS AND CONTROL CABLEING
UNDER THIS CONTRACT. CONTROLS CABLED TO
BREAK GLASS ON GROUND FLOOR. BREAK GLASS
WITH OPEN / CLOSE FUNCTION PROVIDED AND
INSTALLED UNDER THIS CONTRACT

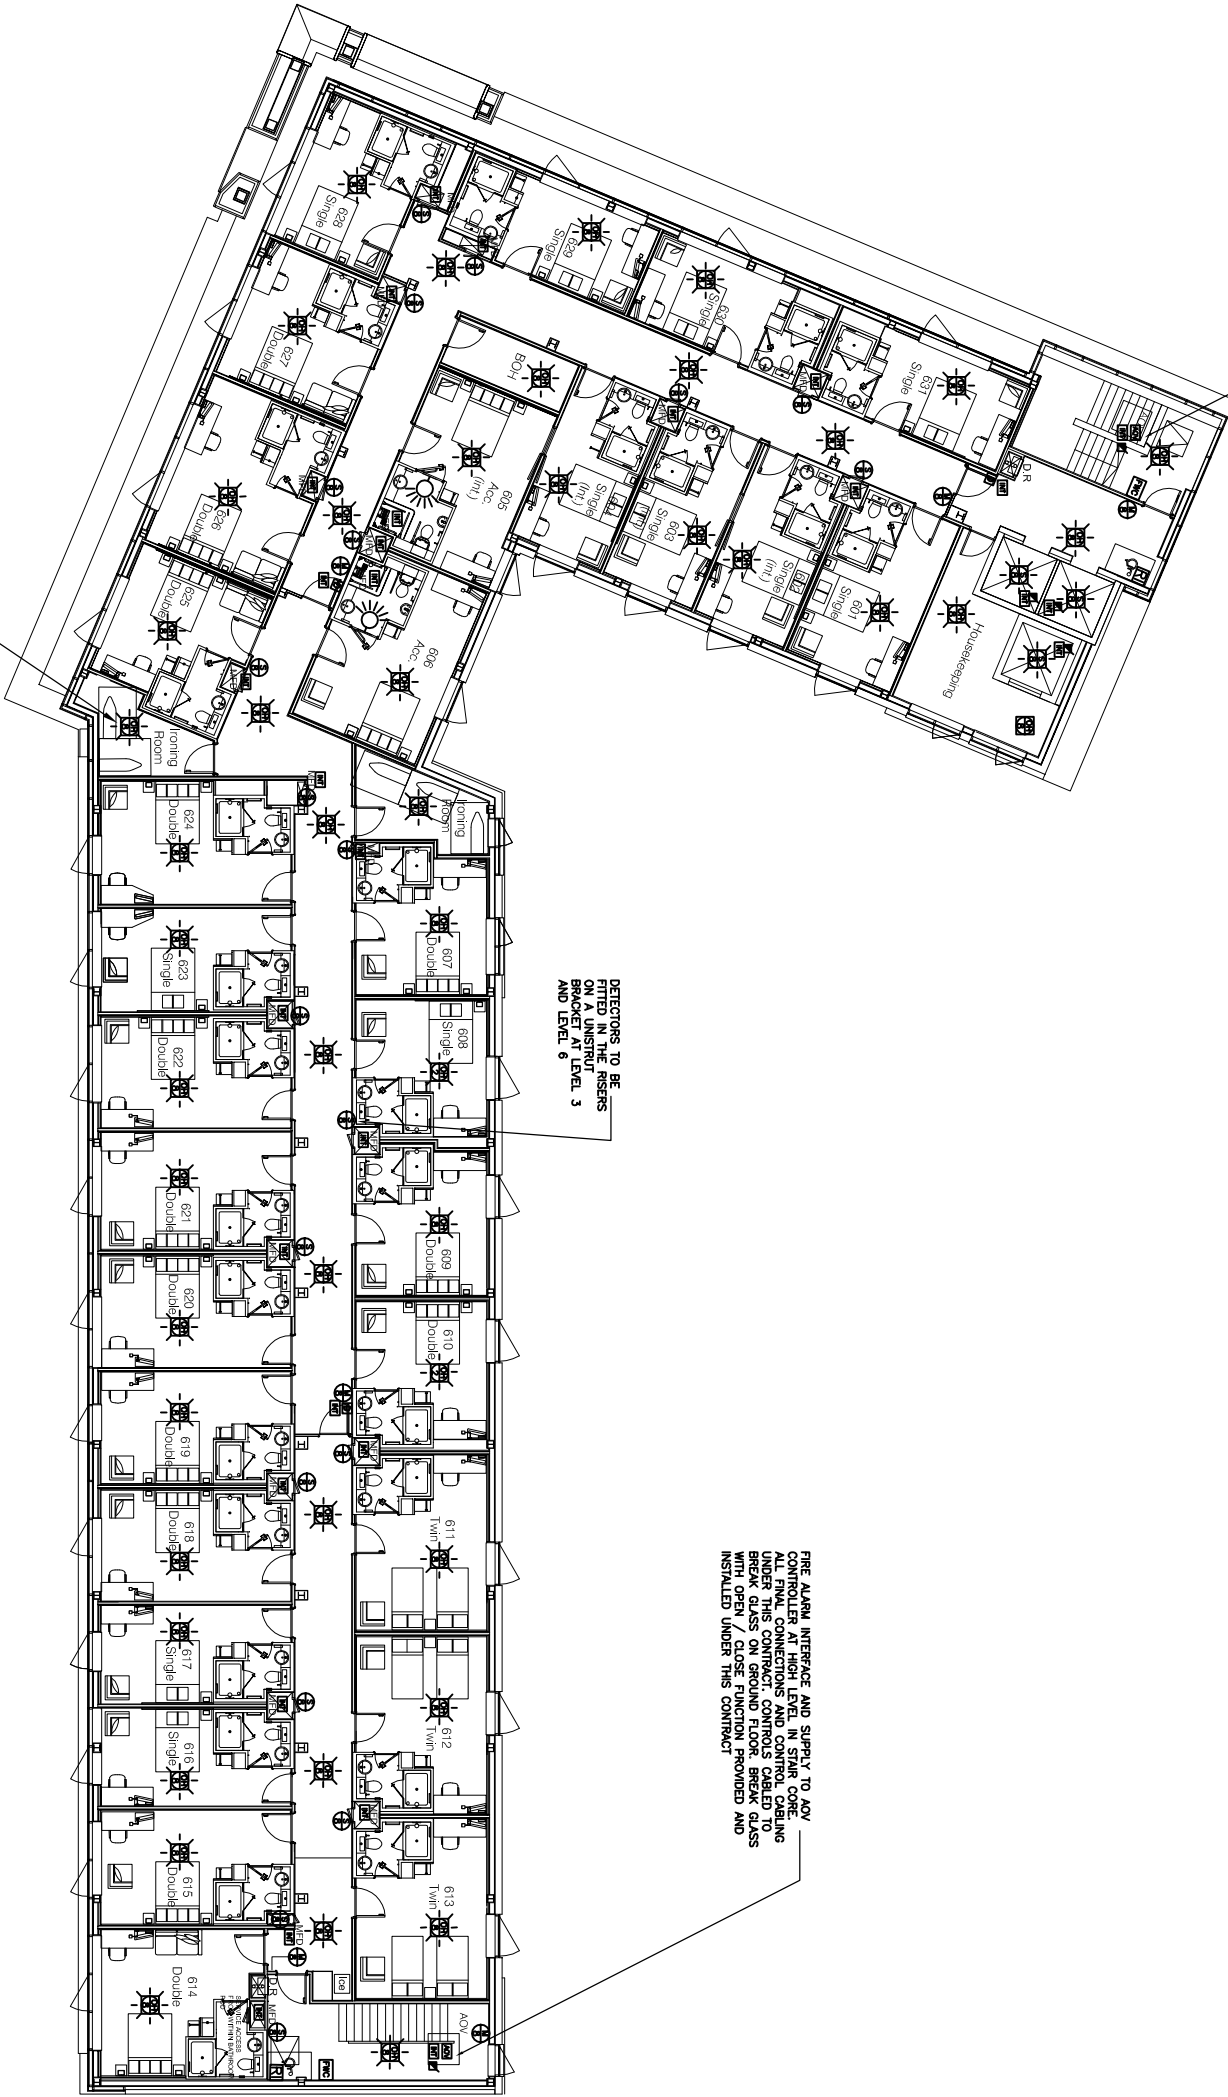

T1 15.01.15	TENDER ISSUE	DW	148
REV DATE	DESCRIPTION	DR	SK

Caldwell
Engineering Environments

ARCHITECT
ICA ARCHITECTS

JOB
FINDLATER HOUSE DUBLIN
HOLIDAY INN EXPRESS

DRAWING
ELECTRICAL SERVICES INSTALLATION

FIRE ALARM

6TH FLOOR

DRAWING NO./REVISION
3682/E306

SCALE / PRINTED AT
1:1250A1 JAN'15

DRAWN
DW

CHECKED
T1

INCLUDE ALL NECESSARY OFFSETS OF
SERVICES IN CEILING VOIDS, SERVICE
DUCTS AND ALL OTHER AREAS TO ACHIEVE
CROSSOVERS AND CO-ORDINATION OF
MECHANICAL AND ELECTRICAL SERVICES.

LOOP 1 = BASEMENT
LOOP 2 = GROUND FLOOR
LOOP 3 = LEVEL 1
LOOP 4 = LEVEL 2
LOOP 5 = LEVEL 3
LOOP 6 = LEVEL 4
LOOP 7 = LEVEL 5
LOOP 8 = LEVEL 6 & ROOF

UNIT 6 FREDSTROKE BUSINESS PARK TEL: (028) 9069720 FAX: (028) 90641025
NEWTOWNREACH BT5 6AW EMAIL: admin@caldwellconsulting.net