


NOTES

1. NOTES ON ALL DRAWINGS APPLY WHERE APPROPRIATE.
2. THE FOLLOWING SYMBOLS DENOTE:-

- HEAT DETECTOR
- COMBINED HEAT DETECTOR, SPEECH
SOUNDER & STROBE
- COMBINED HEAT & CARBON MONOXIDE
DETECTOR
- SMOKE DETECTOR
- SMOKE DETECTOR LOCATED IN CEILING
VOID
- COMBINED SMOKE DETECTOR, SPEECH
SOUNDER & STROBE
- OPTIONAL HEAT MULTISENSOR, SPEECH
SOUNDER, STROBE FIRE ALARM HEAD,
MANUAL CALL POINT (NUMBER BELOW
DENOTES FIRE PANEL LOOP).
- GREEN MANUAL CALL POINT FOR
OVERRIDING ELECTRONIC DOOR
CONTROLS.
- FIREMAN'S WINDOW CONTROL.
- SPEECH SOUNDER STROBE.
- MAIN FIRE ALARM PANEL.
- MOTORIZED FIRE DAMPER.
- REFUGE INTERCOM.
- MAIN REFUGE INTERCOM.
- DOOR HOLD OPEN DEVICES.
- FLOOR MOUNTED DOOR HOLD OPEN
DEVICE.
- AUTOMATIC INTERFACE TO THE FIRE
ALARM SYSTEM.
- ALL VOID DETECTION TO HAVE REMOTE VISIBLE
INDICATORS

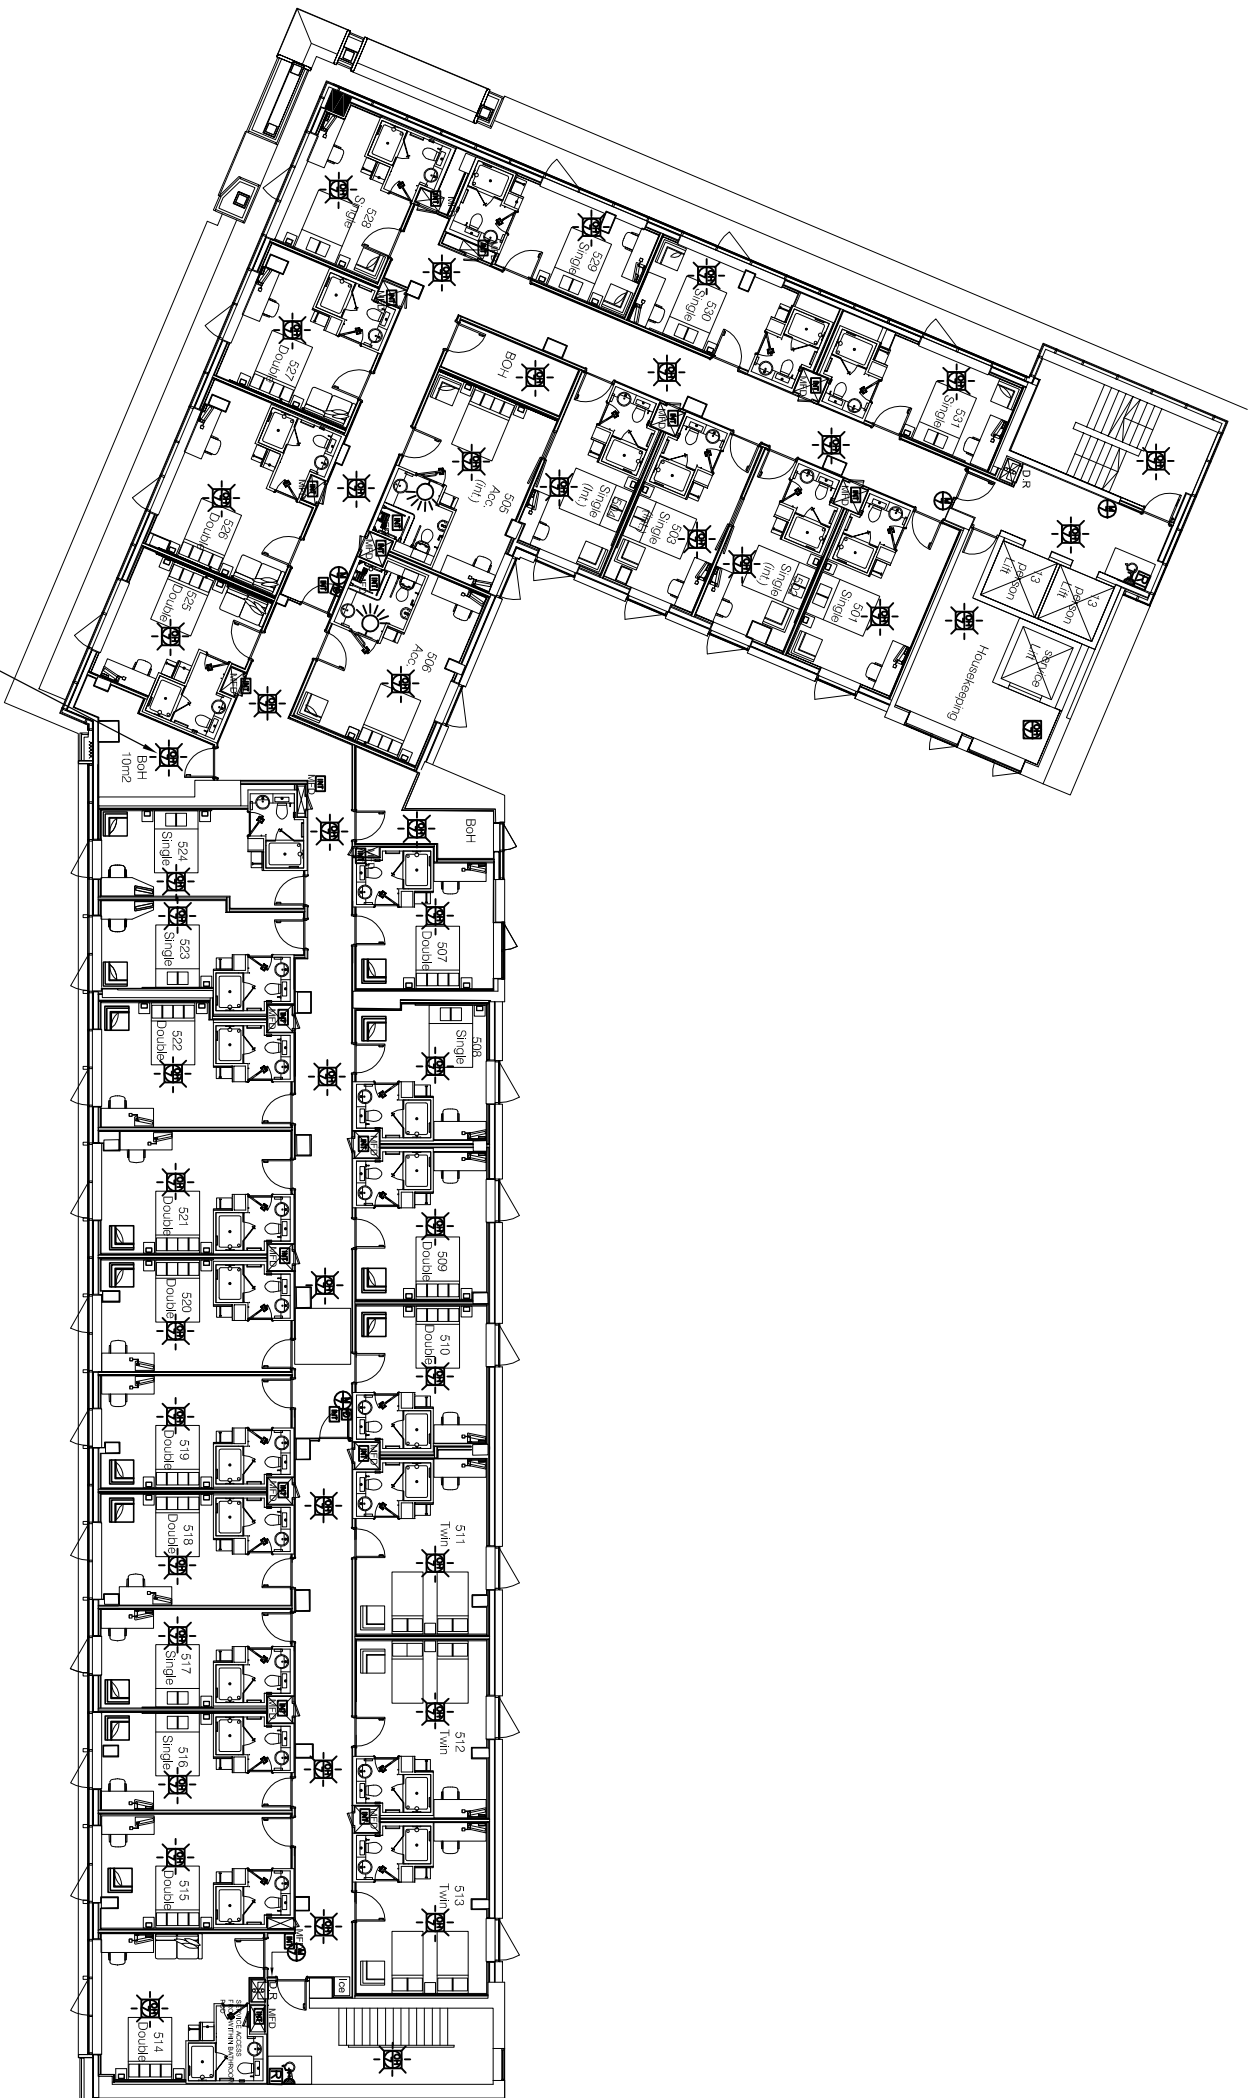

- LOOP 1 - BASEMENT
LOOP 2 - GROUND FLOOR
LOOP 3 - LEVEL 1
LOOP 4 - LEVEL 2
LOOP 5 - LEVEL 3
LOOP 6 - LEVEL 4
LOOP 7 - LEVEL 5
LOOP 8 - LEVEL 6 & ROOF

INCLUDE ALL NECESSARY OFFSETS OF
SERVICES IN CEILING VOIDS, SERVICE
DUCTS AND ALL OTHER AREAS TO ACHIEVE
CROSSOVERS AND CO-ORDINATION OF
MECHANICAL AND ELECTRICAL SERVICES.

Caldwell
Engineering Environments

ARCHITECT
ICA ARCHITECTS

JOB
FINDLATER HOUSE DUBLIN
HOLIDAY INN EXPRESS

DRAWING
ELECTRICAL SERVICES INSTALLATION

FIRE ALARM

5TH FLOOR

DRAWING NO./REVISION
3682/E305 **T1**

SCALE/PRINTED AT
1:1250A1 JAN.15 DW

UNIT 6 FORTYFOUR BUSINESS PARK TEL: (0283)9069720 FAX: (0283)90641025
NEWRY/NEWRY BT6 6AW EMAIL: cdm@caldwellconsulting.net