


Pipeline Freshness by Source		
source_name	latest_ingested_at	lag_hours
wri_power_plants	Jul 11, 2026	9

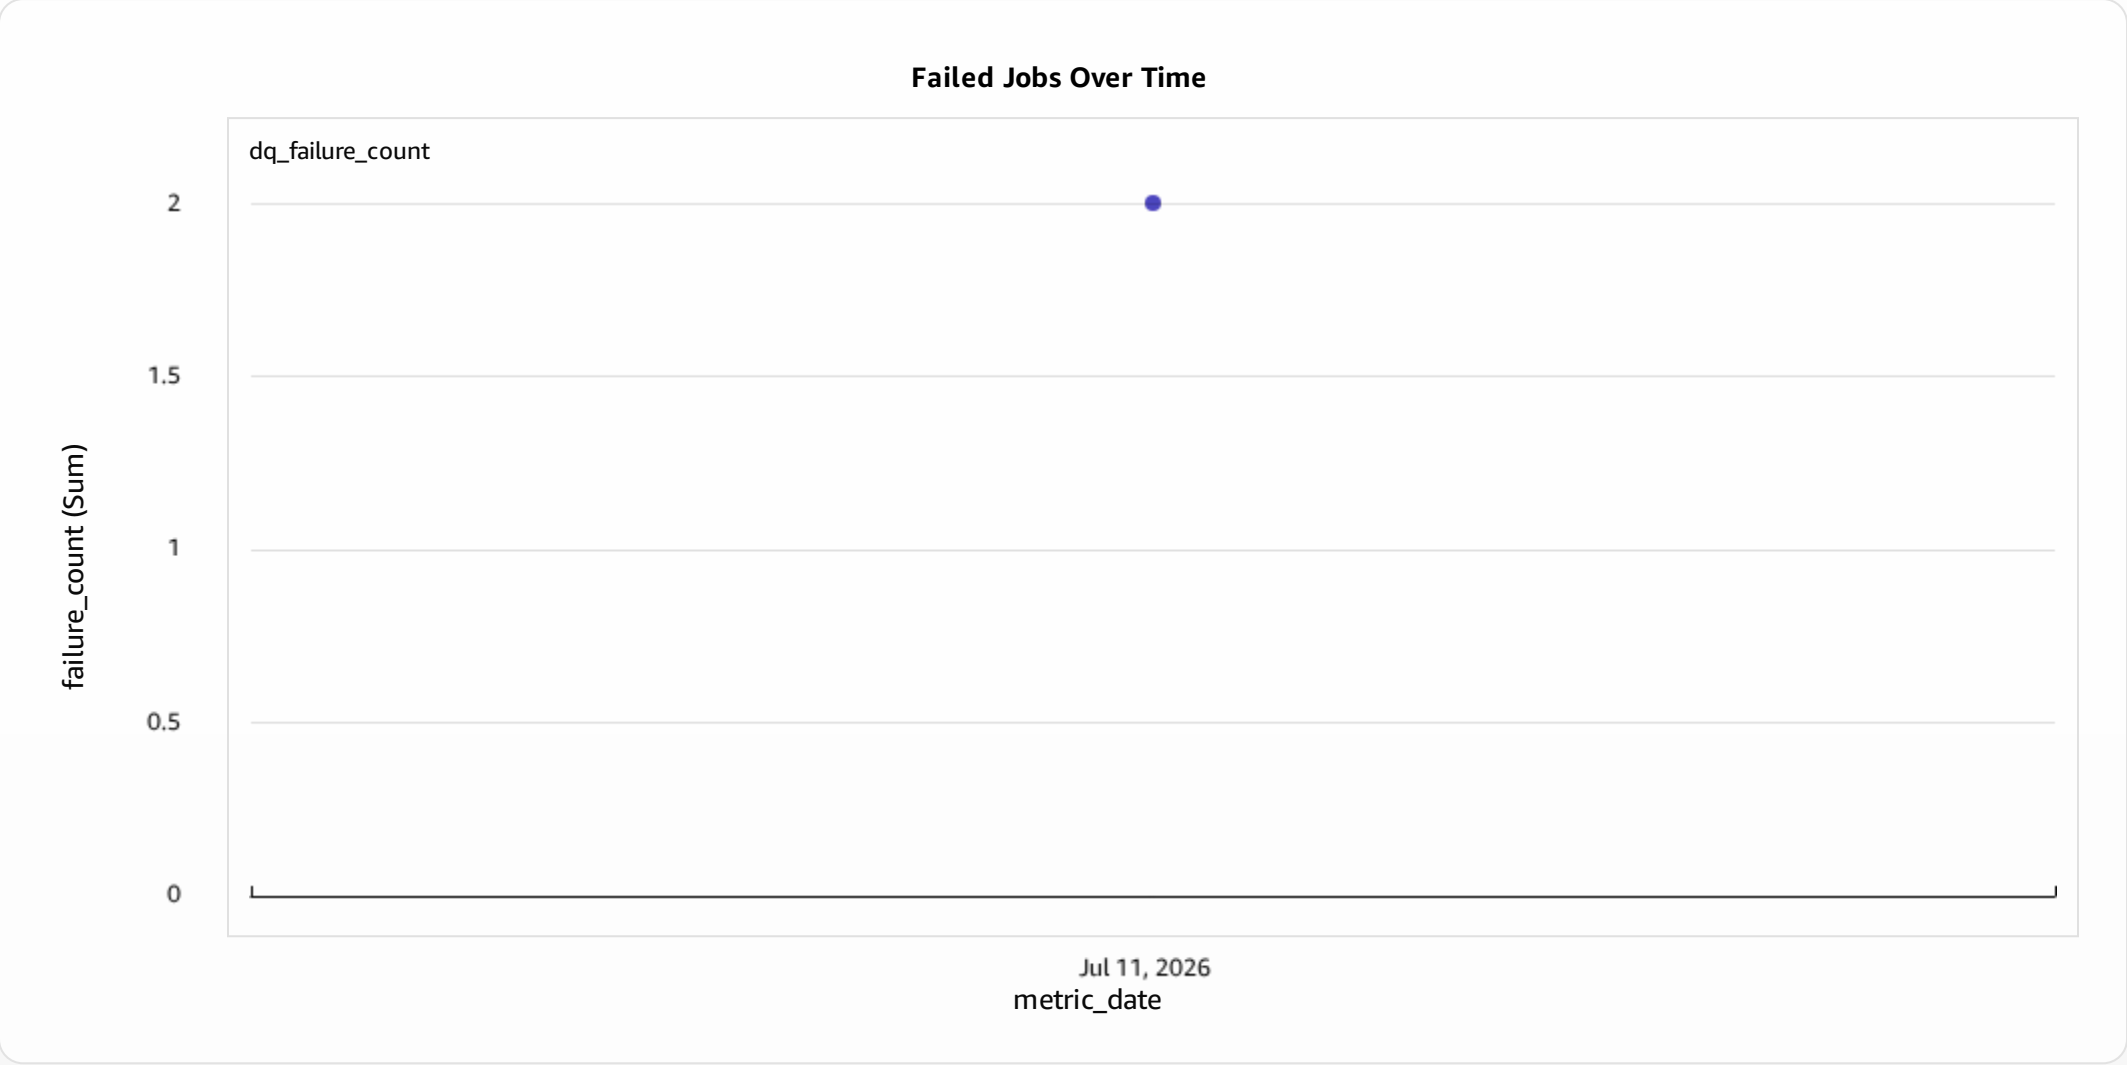

Average Valid Ratio

83.33%

Data Quality Runs					
run_timestamp	input_rows	dataset	valid_rows	malformed_rows	valid_ratio
Jul 11, 2026	6	stg_power_plants	5	1	0.83

Bronze to Silver (min)

1

Silver to Gold (min)

1

Gold to Visualization (min)

2