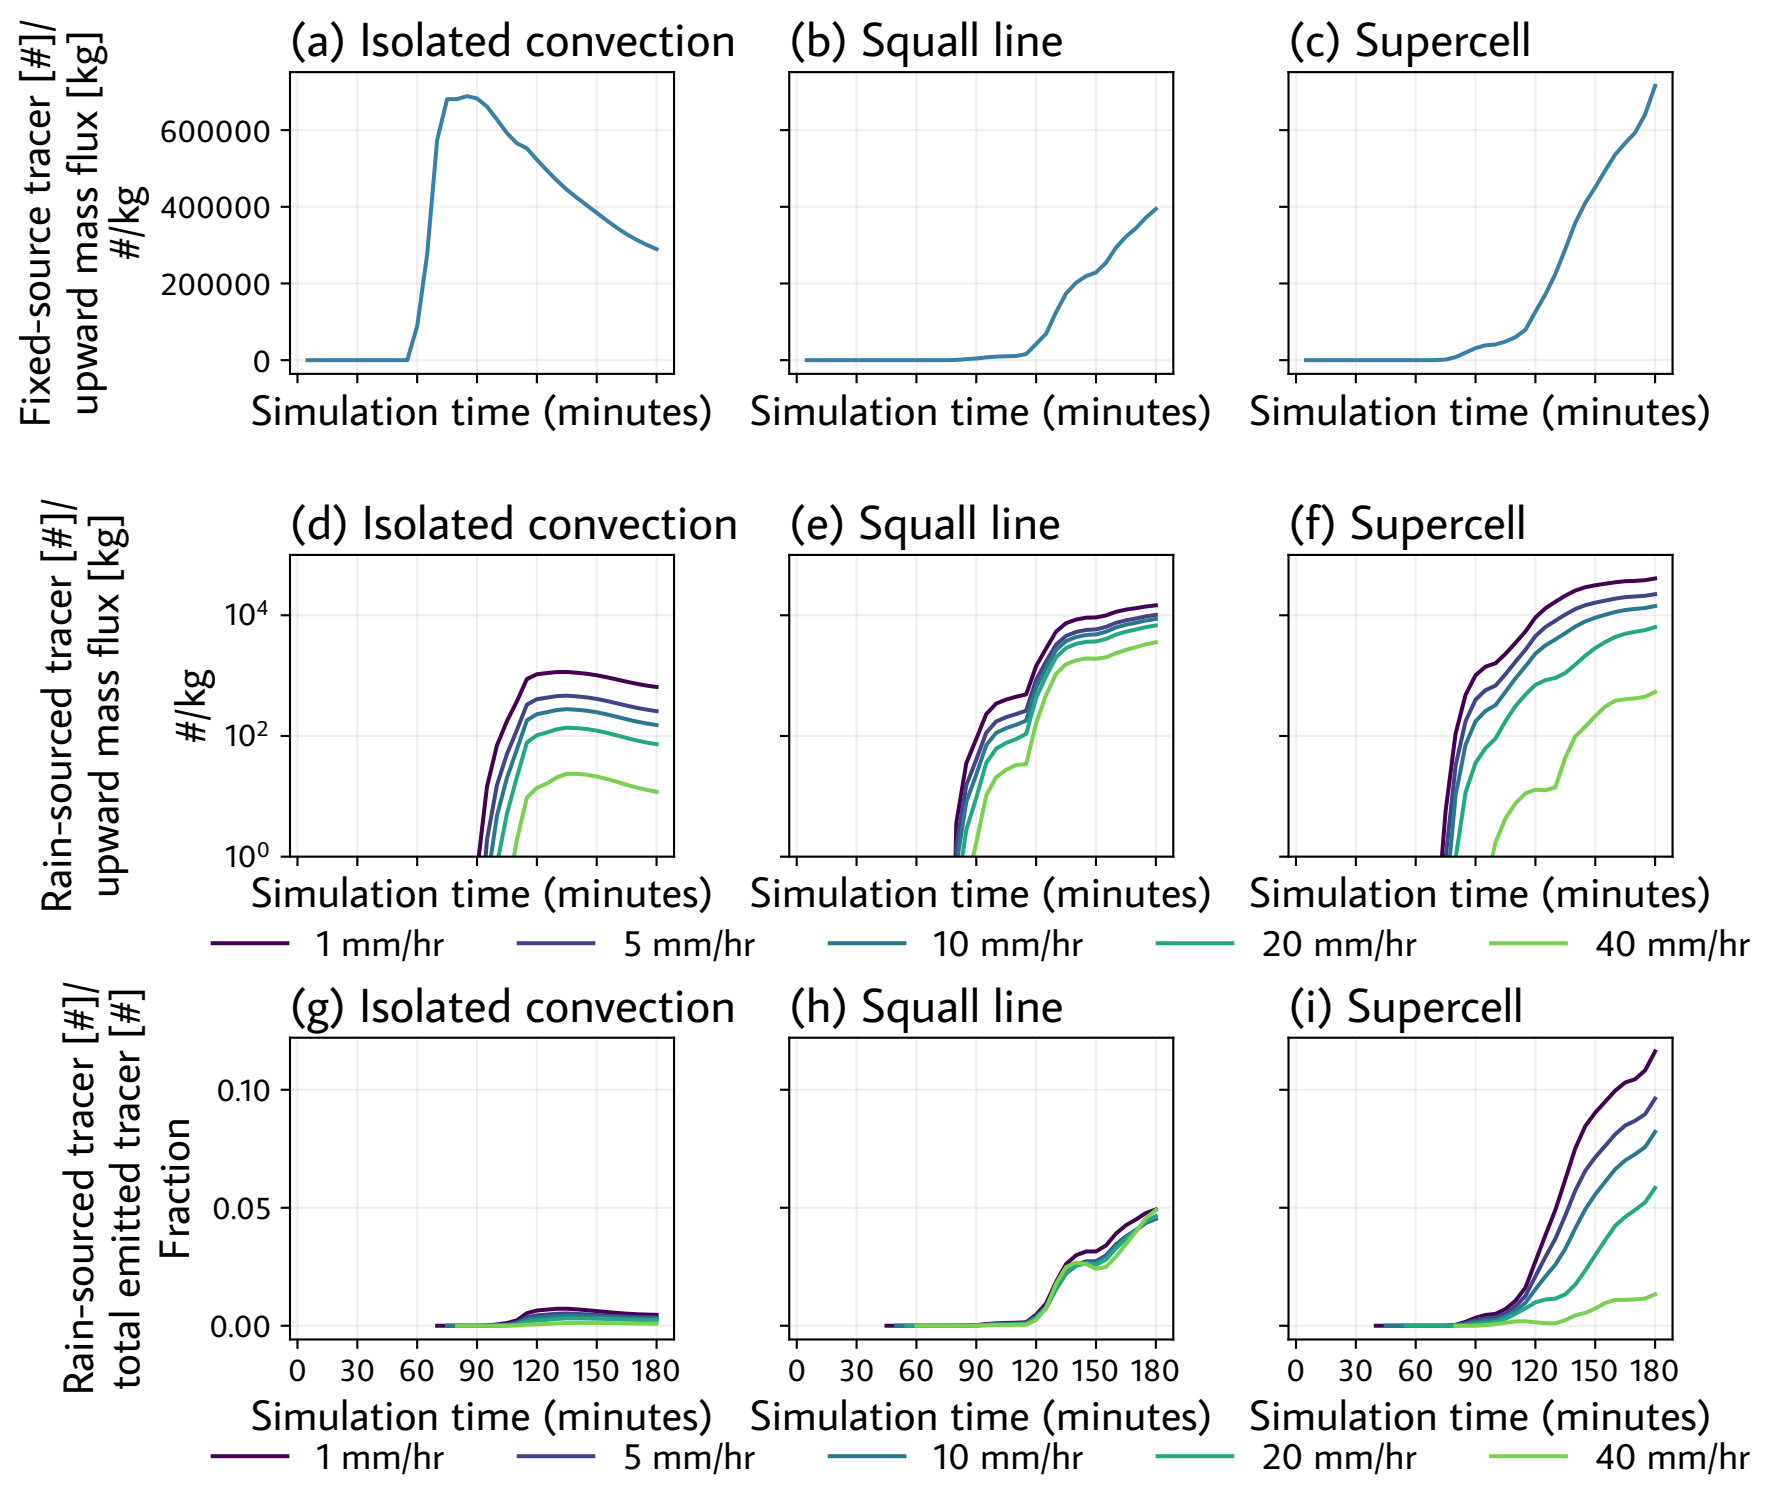
(a) Isolated convection
(b) Squall line
(c) Supercell
Fixed-source tracer [#]/
upward mass flux [kg]
#/kg
600000
400000
200000
0
Simulation time (minutes)
(d) Isolated convection
(e) Squall line
(f) Supercell
Rain-sourced tracer [#]/
upward mass flux [kg]
#/kg
10^4
10^2
10^0
(g) Isolated convection
(h) Squall line
(i) Supercell
Rain-sourced tracer [#]/
total emitted tracer [#]
Fraction
0.10
0.05
0.00
0 30 60 90 120 150 180
1 mm/hr
5 mm/hr
10 mm/hr
20 mm/hr
40 mm/hr