

GENERAL NOTES

- THESE DRAWINGS SHALL BE READ WITH THE ARCHITECTURAL, CIVIL, MECHANICAL AND ELECTRICAL DRAWINGS AND THE PROJECT SPECIFICATIONS.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS IN THE FIELD AND NOTIFY THE ENGINEER OF ANY DISCREPANCY BEFORE PROCEEDING.
- DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS GOVERN.
- TEMPORARY BRACING IS THE RESPONSIBILITY OF THE ERECTOR UNTIL ALL DIAPHRAGMS AND BRACED FRAMES ARE COMPLETE.
- SHOP DRAWINGS SHALL BE SUBMITTED FOR REVIEW PRIOR TO FABRICATION.
- SEE S-501 FOR TYPICAL CONNECTION DETAILS.
- ALL WORK SHALL CONFORM TO THE 2021 IBC AS AMENDED BY THE CITY.

DESIGN CRITERIA

RISK CATEGORY: II
ROOF LIVE LOAD: 20 PSF
GROUND SNOW LOAD Pg: 30 PSF
FLAT ROOF SNOW LOAD Pt: 21 PSF
FLOOR LIVE LOAD (STORAGE, LIGHT): 125 PSF
FLOOR LIVE LOAD (OFFICE): 50 PSF + 15 PSF PARTITIONS
COLLATERAL LOAD: 10 PSF
BASIC WIND SPEED V: 115 MPH, EXPOSURE C
SEISMIC: SDS=0.211, SD1=0.098, SITE CLASS D
SEISMIC DESIGN CATEGORY: B
LATERAL SYSTEM: STEEL SYSTEMS NOT SPECIFICALLY DETAILED
FOR SEISMIC RESISTANCE (R=3), CONCENTRICALLY BRACED FRAMES

SPECIAL INSPECTIONS

- STRUCTURAL STEEL: PERIODIC - HIGH STRENGTH BOLTING, FILLET WELDS, CONTINUOUS - CJP WELDS.
- CONCRETE: PERIODIC - REINFORCING PLACEMENT; CONTINUOUS - CONCRETE PLACEMENT, SAMPLING AND TESTING.
- SOILS: PERIODIC - VERIFY BEARING AT EACH FOOTING.

STRUCTURAL STEEL

- W SHAPES: ASTM A992, Fy = 50 KSI.
- HSS RECTANGULAR: ASTM A500 GR. C, Fy = 50 KSI.
- CHANNELS, ANGLES, PLATES: ASTM A36 U.N.O.
- HIGH STRENGTH BOLTS: ASTM F3125 GR. A325-N, 3/4" DIA. U.N.O.
- ANCHOR RODS: ASTM F1554 GR. 36 U.N.O.
- WELDING: AWS D1.1, E70XX ELECTRODES.
- FABRICATOR SHALL BE AISC CERTIFIED.
- SHOP PRIME ALL STEEL EXCEPT SURFACES TO RECEIVE FIREPROOFING OR FIELD WELDING.
- BEAM CAMBER SHOWN AS (c=x") ON PLANS. CAMBER TOLERANCE PER AISC 303.
- PROVIDE L4x4x1/4 FRAMING AT ALL DECK OPENINGS GREATER THAN 12" IN ANY DIMENSION.

STEEL DECK AND JOISTS

- ROOF DECK: 1.5" TYPE B, 20 GA, GALV. G60.
- FLOOR DECK: 2" COMPOSITE, 20 GA, W/ 4.5" NW CONCRETE TOPPING (6.5" TOTAL).
- ROOF DECK FASTENING: 5/8" PUDDLE WELDS 36/7 PATTERN, SIDE LAP #10 TEK SCREWS @ 12" O.C.
- SHEAR STUDS: 3/4" DIA x 4.5" @ 12" O.C. U.N.O.
- STEEL JOISTS: SJI STANDARD SPECIFICATIONS, JOIST MANUFACTURER TO DESIGN FOR NET UPLIFT OF 12 PSF.

FOUNDATIONS AND CONCRETE

- ALLOWABLE BEARING PRESSURE: 2,500 PSF PER GEOTECH. REPORT NO. G-2211, DATED 03/04/26.
- FOOTINGS SHALL BEAR ON UNDISTURBED SOIL OR ENGINEERED FILL. MIN. FROST DEPTH 30" BELOW FINISH GRADE.
- CONCRETE: Fc = 4,000 PSI AT 28 DAYS.
- REINFORCING: ASTM A615 GR. 60.
- SLAB ON GRADE: 6" W/ #4 @ 16" O.C. EACH WAY, CENTERED.

SHEET INDEX

SHEET	TITLE
S-001	GENERAL NOTES AND DESIGN CRITERIA
S-101	FOUNDATION PLAN
S-201	SECOND FLOOR FRAMING PLAN
S-202	ROOF FRAMING PLAN
S-301	BRACED FRAME ELEVATIONS
S-501	TYPICAL CONNECTION DETAILS

ABBREVIATIONS

ABBR.	MEANING
AB	ANCHOR BOLT
BF	BRACED FRAME
CJP	COMPLETE JOINT PENETRATION
EQ	EQUAL
HSS	HOLLOW STRUCTURAL SECTION
TOS	TOP OF STEEL
T/FTG	TOP OF FOOTING
U.N.O.	UNLESS NOTED OTHERWISE
W.P.	WORK POINT

RIDGELINE

STRUCTURAL ENGINEERS
1400 FOUNDRY ST., SUITE 210
COLORADO SPRINGS, CO

NORTHGATE SUPPLY CO.

WAREHOUSE ADDITION
4410 INDUSTRIAL WAY



REV	DESCRIPTION	DATE
0	ISSUED FOR BID	06/12/26
1	ADDENDUM 1	07/02/26
2	ISSUED FOR CONSTRUCTION	08/14/26




SHEET TITLE
GENERAL NOTES AND DESIGN CRITERIA

SCALE
NONE

PROJECT NO.
26-0418

DRAWN: JRM CHECKED: DKW DATE: 08/14/26

SHEET
S-001





RIDGELINE
STRUCTURAL ENGINEERS
1400 FOUNDRY ST., SUITE 210
COLORADO SPRINGS, CO

NORTHGATE SUPPLY CO.
WAREHOUSE ADDITION
4410 INDUSTRIAL WAY

FICTIONAL PROJECT
DEMONSTRATION
DRAWING ONLY
NOT FOR CONSTRUCTION

REV	DESCRIPTION	DATE
0	ISSUED FOR BID	06/12/26
1	ADDENDUM 1	07/02/26
2	ISSUED FOR CONSTRUCTION	08/14/26

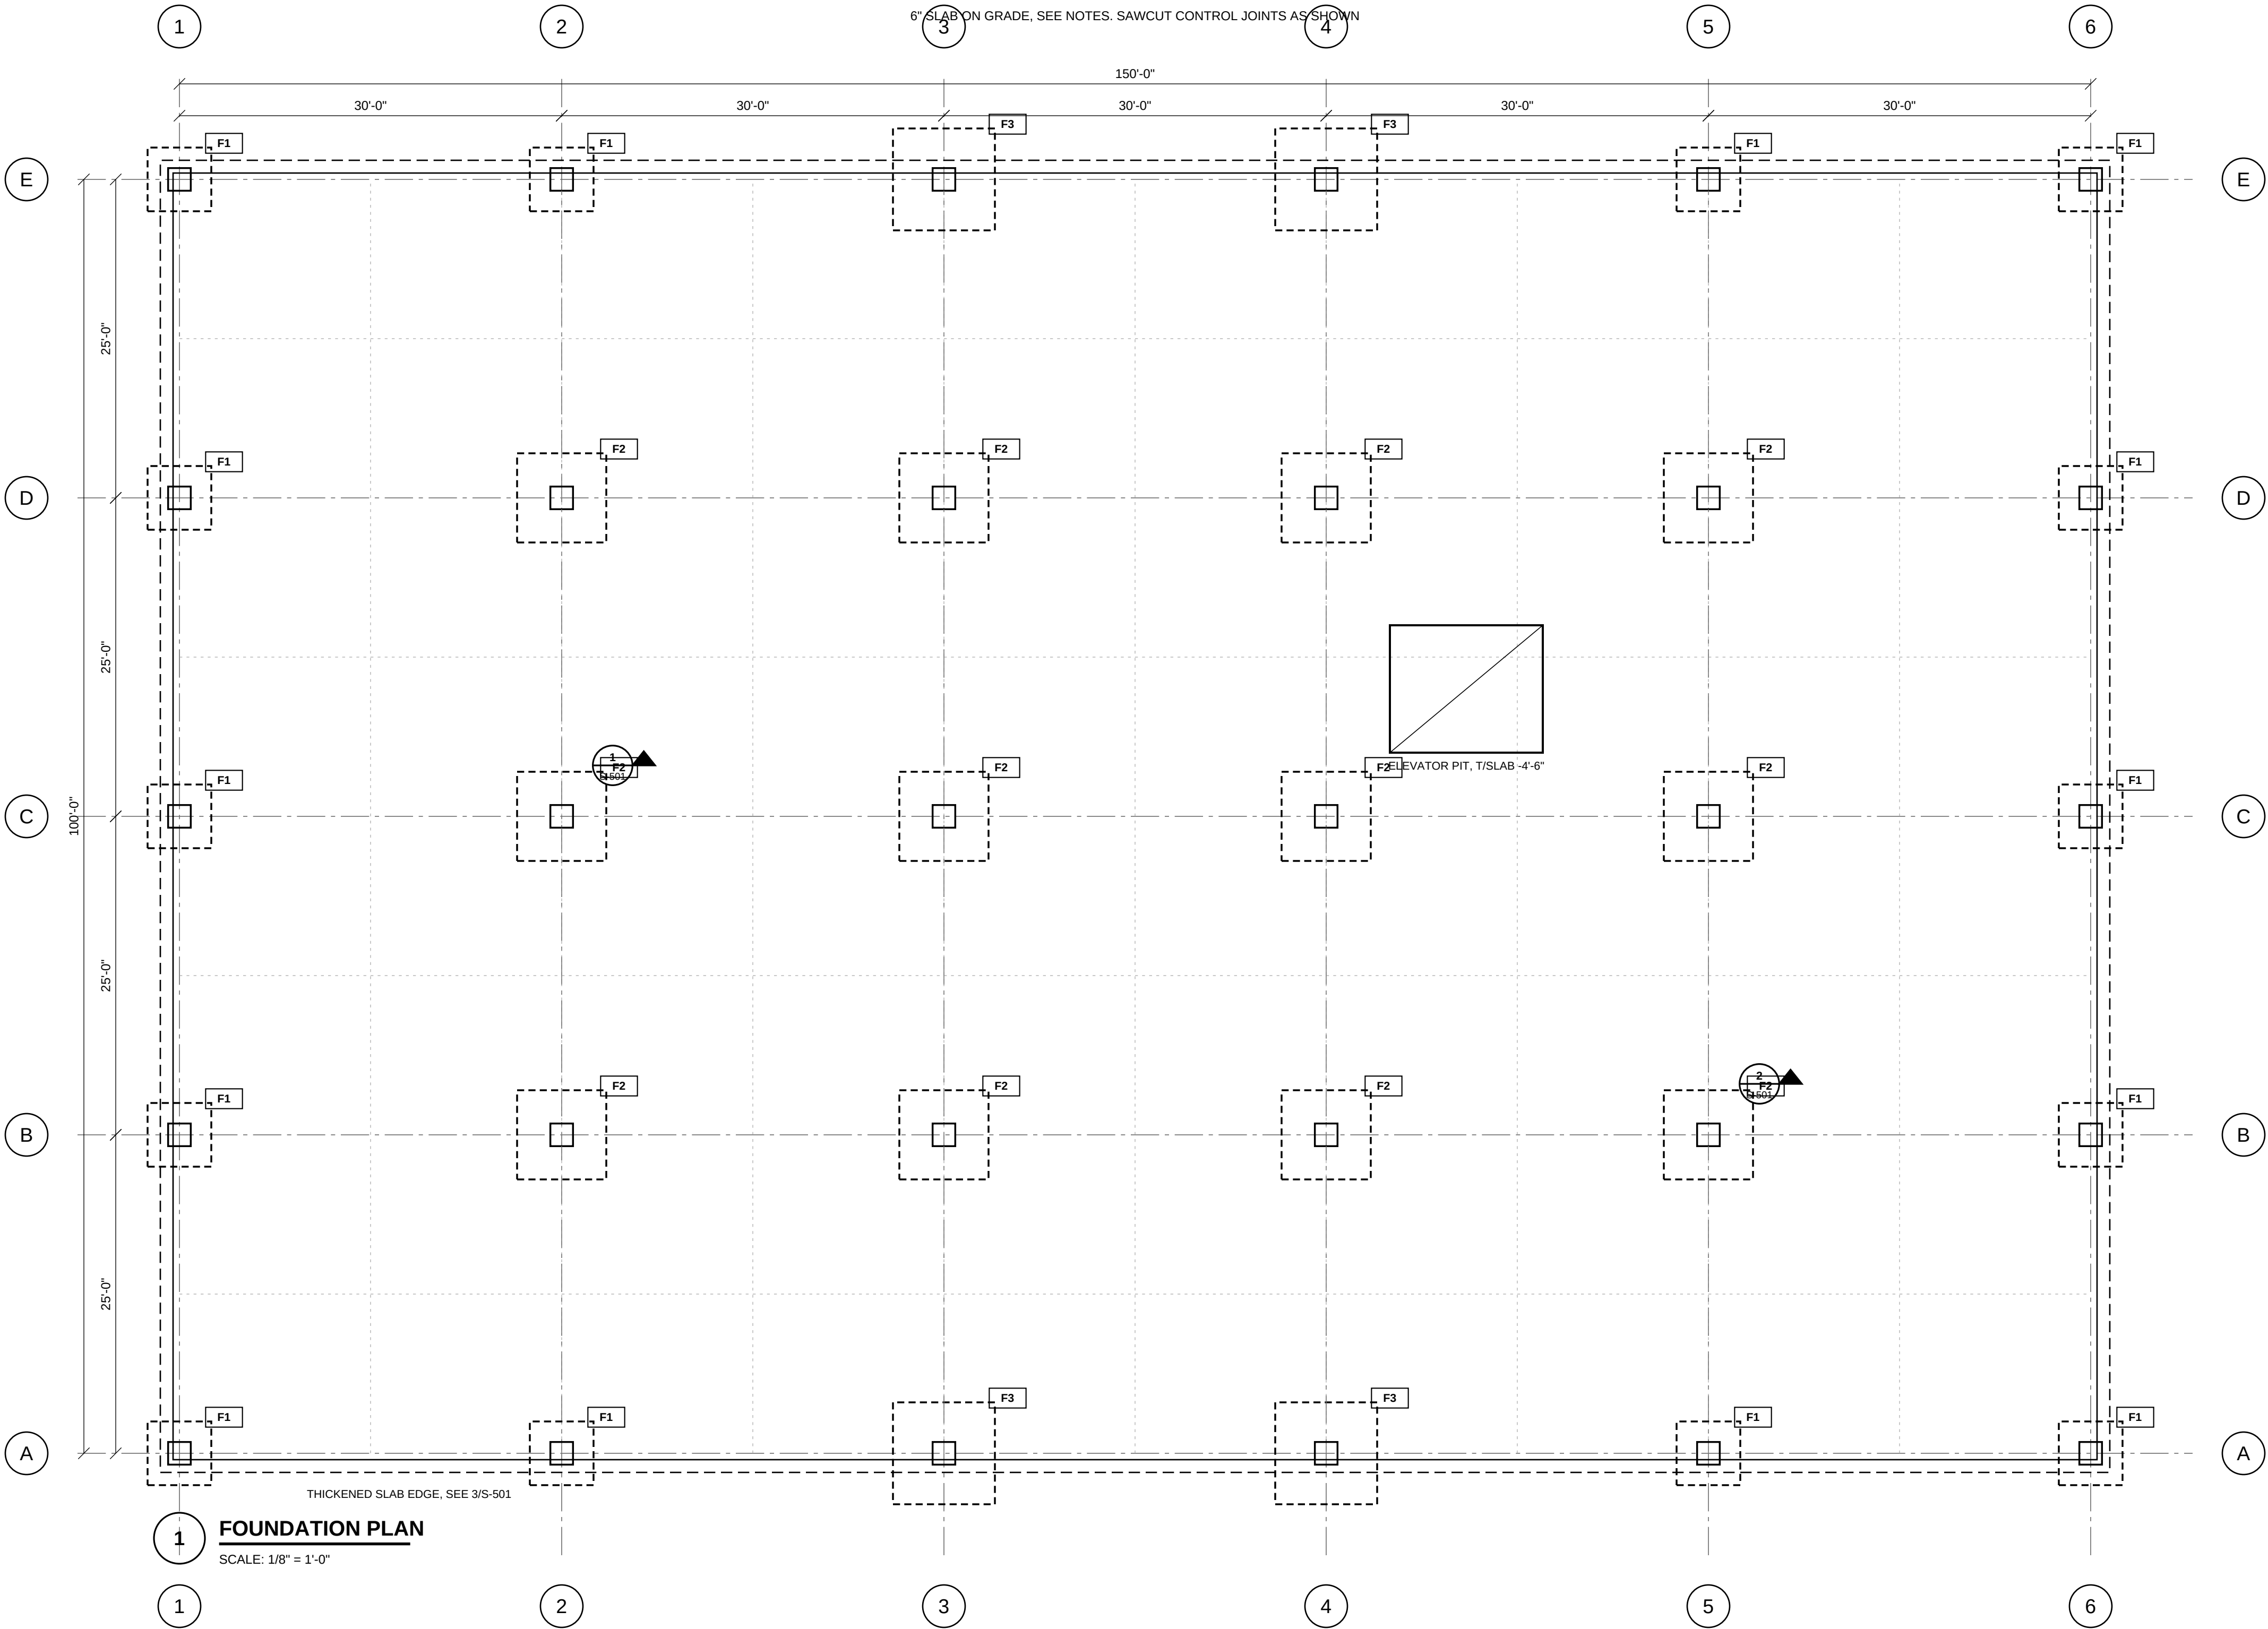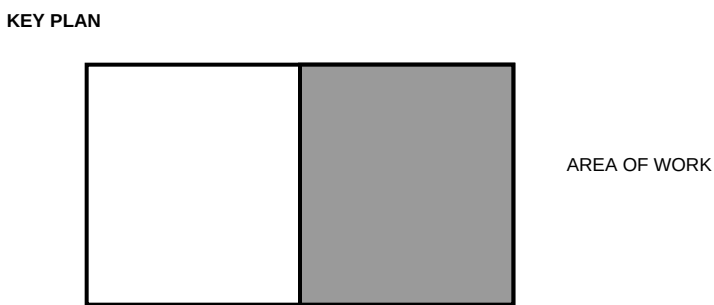

FOOTING SCHEDULE

MARK	SIZE	DEPTH	REINFORCING	REMARKS
F1	5'-0" x 5'-0"	1'-4"	(6) #5 E.W. BOT.	EXTERIOR / CORNER
F2	7'-0" x 7'-0"	1'-8"	(8) #6 E.W. BOT.	INTERIOR
F3	8'-0" x 8'-0"	2'-0"	(9) #6 E.W. BOT.	BRACED FRAME COLUMNS

BASE PLATE SCHEDULE

MARK	PLATE	ANCHOR RODS	EMBED
BP1	3/4" x 14" x 14"	(4) 3/4" DIA.	12"
BP2	1" x 18" x 18"	(4) 1" DIA.	18"

SHEET TITLE
FOUNDATION PLAN

SCALE
1/8" = 1'-0"

PROJECT NO.
26-0418

DRAWN: JRM CHECKED: DKW DATE: 08/14/26

SHEET
S-101




STRUCTURAL ENGINEERS

1400 FOUNDRY ST. SUITE 211
COLORADO SPRINGS, CO

NORTHGATE SUP

4410 INDUSTRIAL WA



REV	DESCRIPTION	DATE
0	ISSUED FOR BID	06/12/
1	ADDENDUM 1	07/02/
2	ISSUED FOR CONSTRUCTION	08/14/

KEY PLA



SCALE: 1/8" = 1'-0"

COLUMN SCHEDULE

MARK	SIZE	BASE PL.	SPLICE	REMARKS
C1	HSS8x8x3/8	BP1	NONE	TYPICAL
C2	W12x53	BP2	NONE	BRACED FRAME COLUMNS
C3	HSS8x8x1/2	BP1	NONE	GRID 3-4 / C-D

FRAMING NOTE

1. MOMENT CONNECTIONS SHOWN THUS: SEE 5/S-501.
2. BRACED FRAMES SHOWN THUS: SEE S-301.
3. BEAM CAMBER SHOWN AS (c="X").
4. ALL BEAMS W16x31 @ 8'-4" O.C. U.N.O.
5. PROVIDE L4x4x1/4 AT DECK EDGES AND OPENINGS.

SECOND FLOOR FRAMING PLAN


SCALE $1/8" = 1'-0"$

PROJECT NO. 26-0418

DRAWN: JRM CHECKED: DKW DATE: 08/14/2

SHEE

S-201





RIDGELINE
STRUCTURAL ENGINEERS
1400 FOUNDRY ST., SUITE 210
COLORADO SPRINGS, CO

NORTHGATE SUPPLY CO.
WAREHOUSE ADDITION
4410 INDUSTRIAL WAY

FICTIONAL PROJECT
DEMONSTRATION
DRAWING ONLY
NOT FOR CONSTRUCTION

REV	DESCRIPTION	DATE
0	ISSUED FOR BID	06/12/26
1	ADDENDUM 1	07/02/26
2	ISSUED FOR CONSTRUCTION	08/14/26

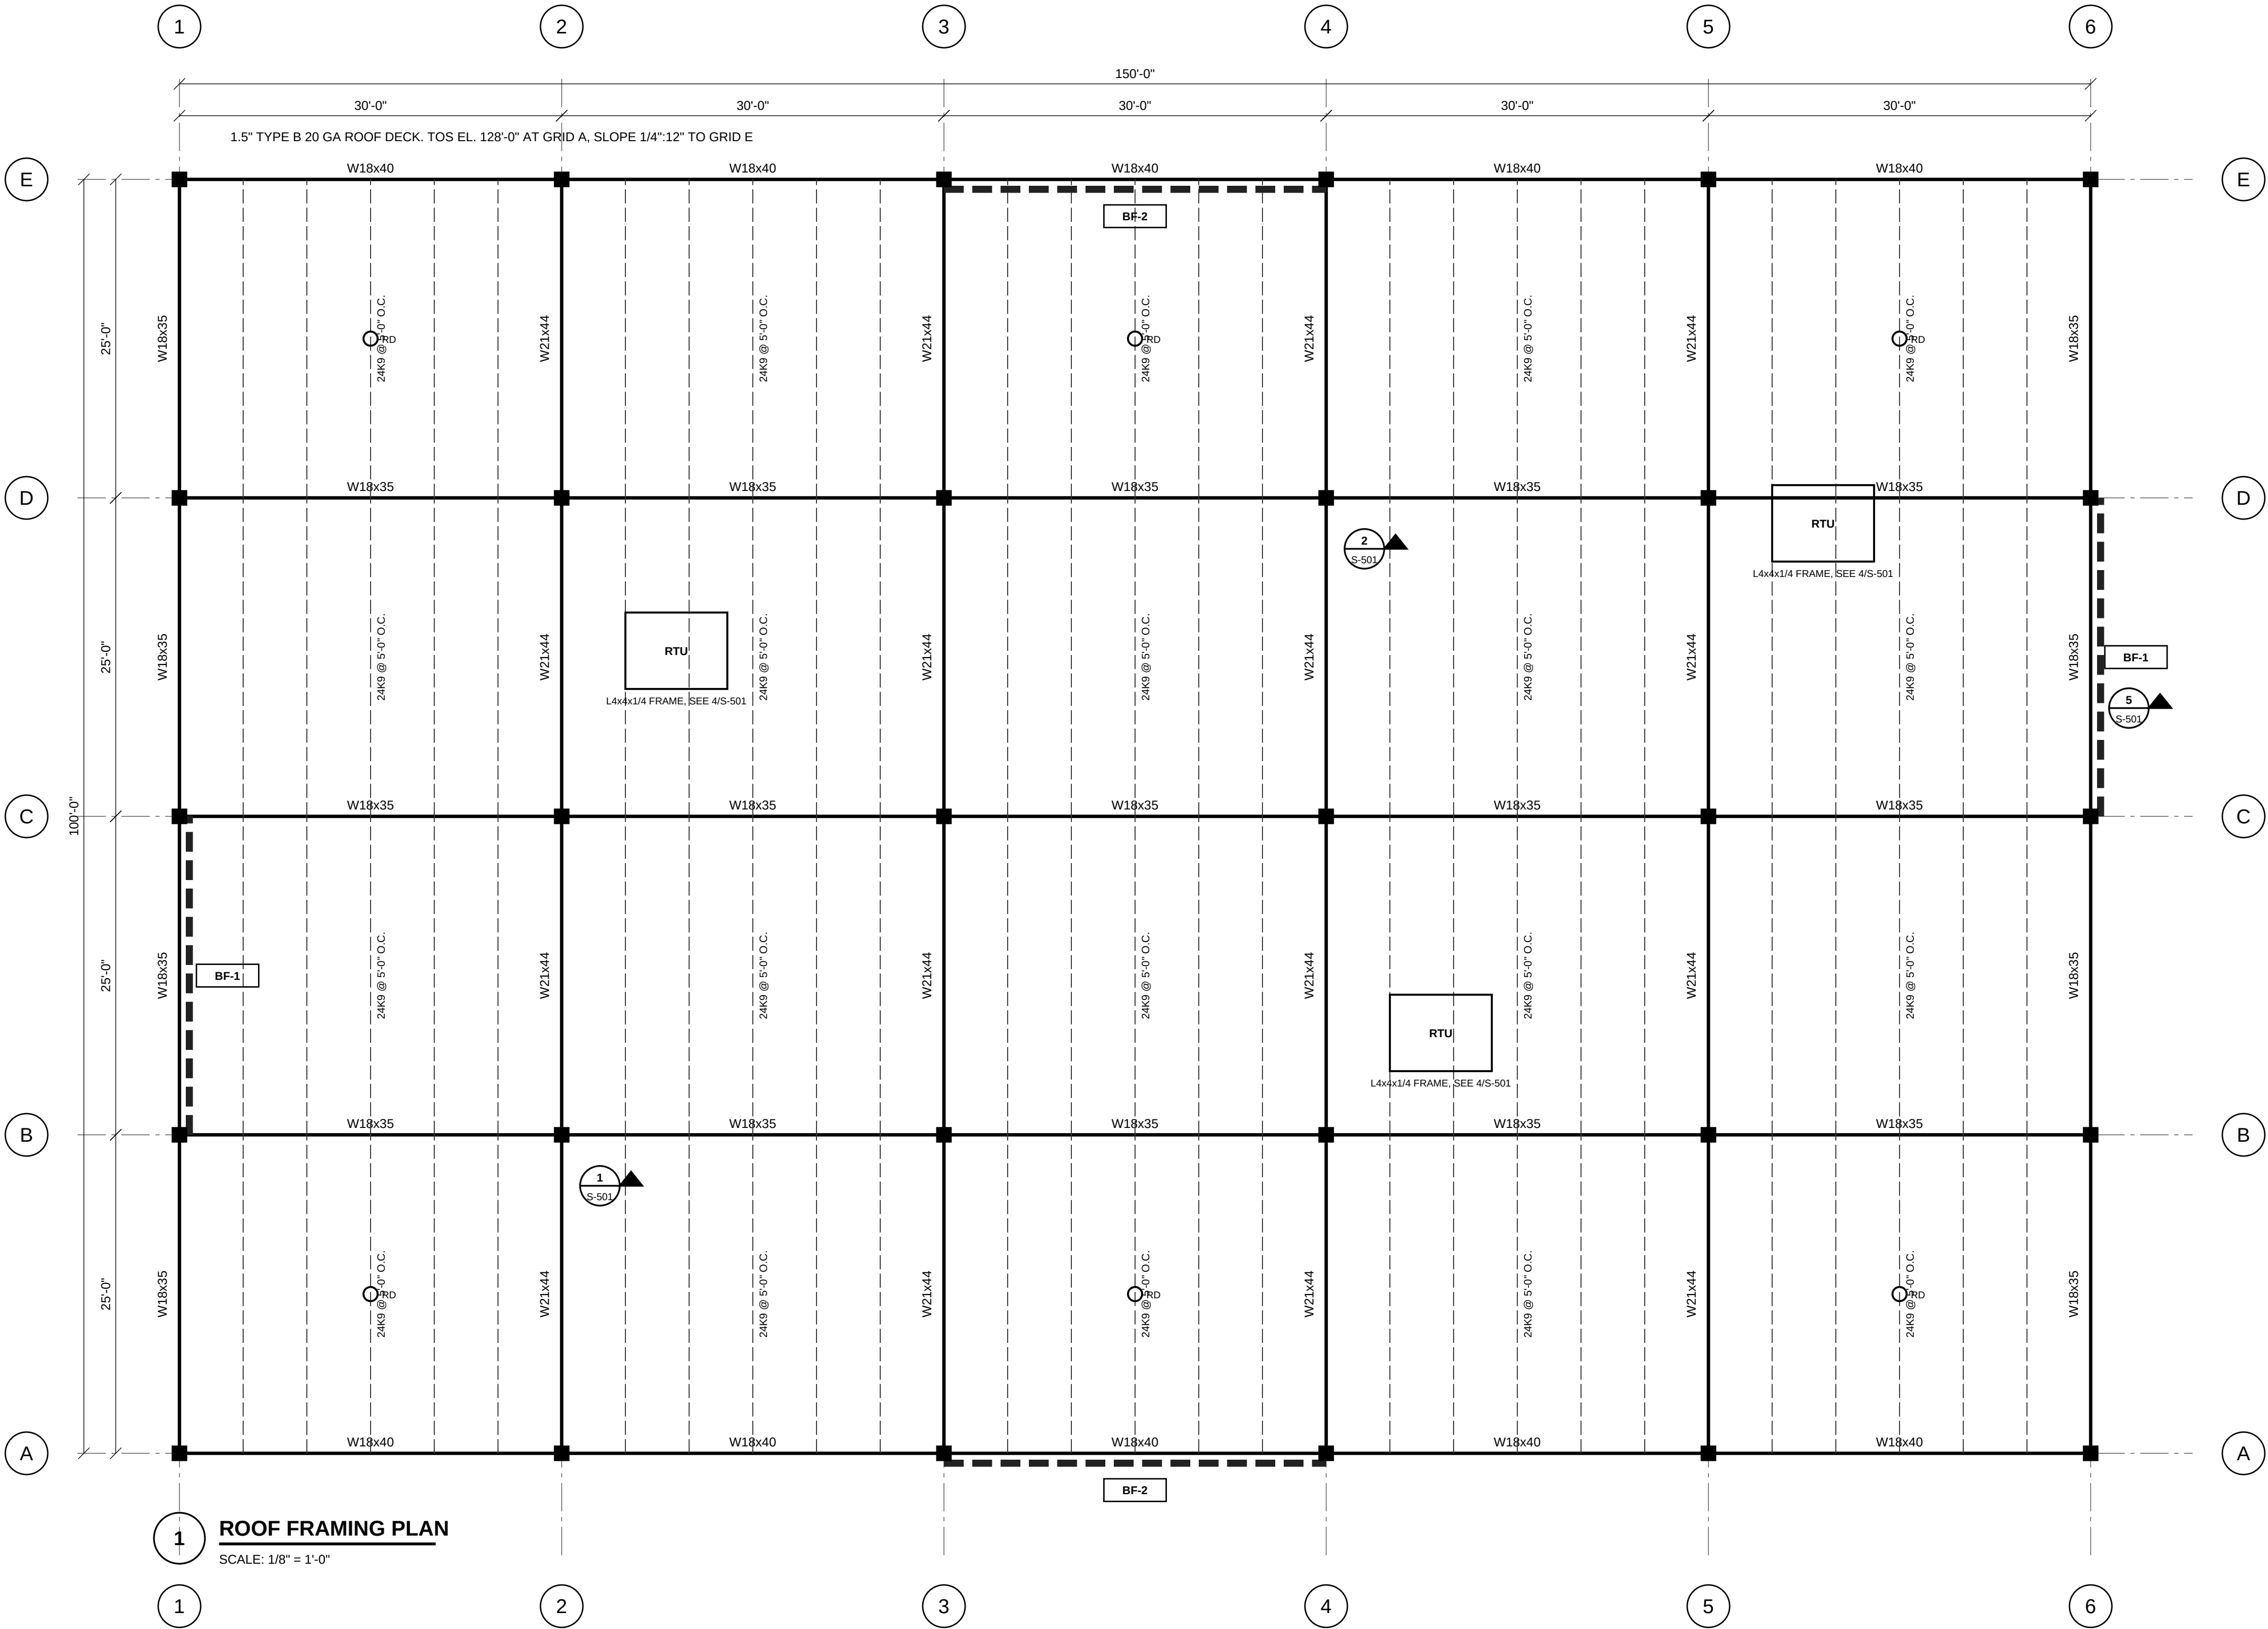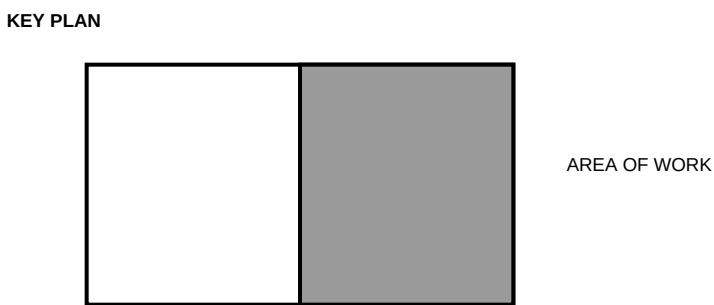

1 ROOF FRAMING PLAN
SCALE: 1/8" = 1'-0"

COLUMN SCHEDULE

MARK	SIZE	BASE PL.	SPLICE	REMARKS
C1	HSS8x8x3/8	BP1	NONE	TYPICAL
C2	W12x53	BP2	NONE	BRACED FRAME COLUMNS
C3	HSS8x8x1/2	BP1	NONE	GRID 3-4 / C-D

FRAMING NOTES

- MOMENT CONNECTIONS SHOWN THUS: SEE 5/S-501.
- BRACED FRAMES SHOWN THUS: SEE 5-301.
- BEAM CAMBER SHOWN AS (c"x").
- JOISTS 24K9 @ 5'-0" O.C. U.N.O.
- PROVIDE L4x4x1/4 AT DECK EDGES AND OPENINGS.

SHEET TITLE
ROOF FRAMING PLAN

SCALE
1/8" = 1'-0"

PROJECT NO.
26-0418

DRAWN: JRM CHECKED: DKW DATE: 08/14/26

SHEET

S-202

RIDGELINE

STRUCTURAL ENGINEERS


1400 FOUNDRY ST., SUITE 210
COLORADO SPRINGS, CO

NORTHGATE SUPPLY CO.


WAREHOUSE ADDITION
4410 INDUSTRIAL WAYFICTIONAL PROJECT
DEMONSTRATION
DRAWING ONLY
NOT FOR CONSTRUCTION

REV	DESCRIPTION	DATE
0	ISSUED FOR BID	06/12/26
1	ADDENDUM 1	07/02/26
2	ISSUED FOR CONSTRUCTION	08/14/26

KEY PLAN

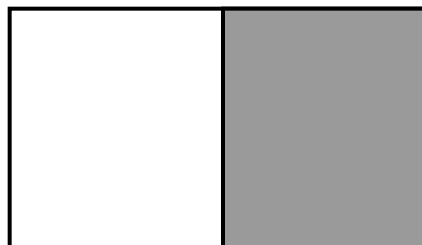


AREA OF WORK

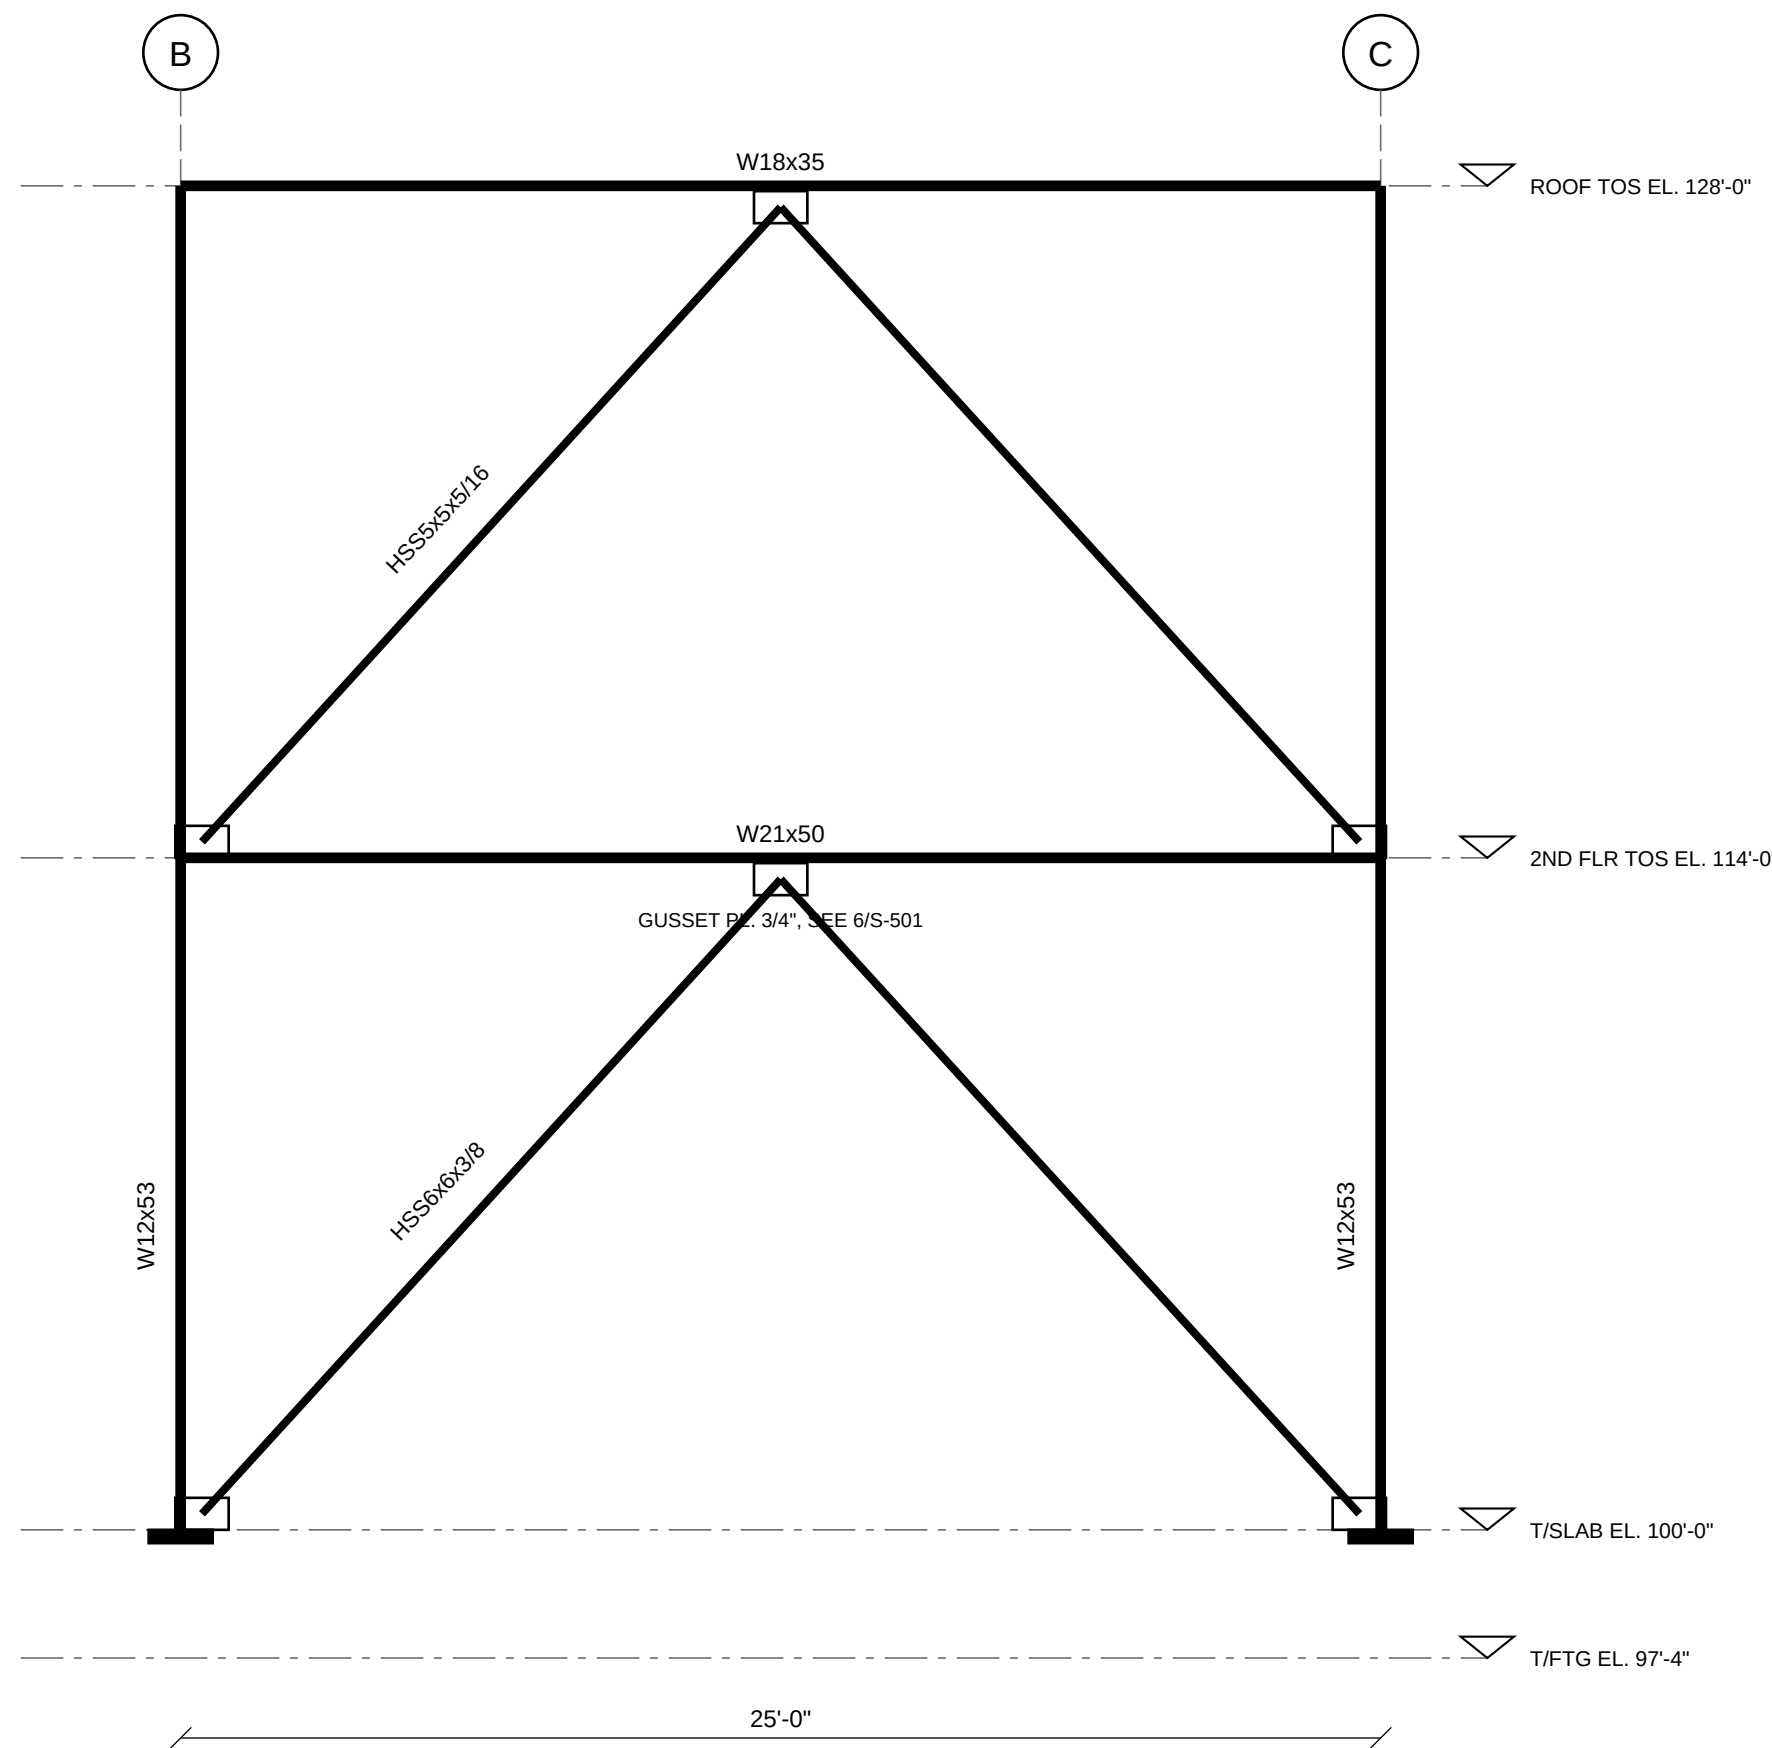

1 BF-1 ELEVATION (GRID 1 & 6)

SCALE: 1/4" = 1'-0"

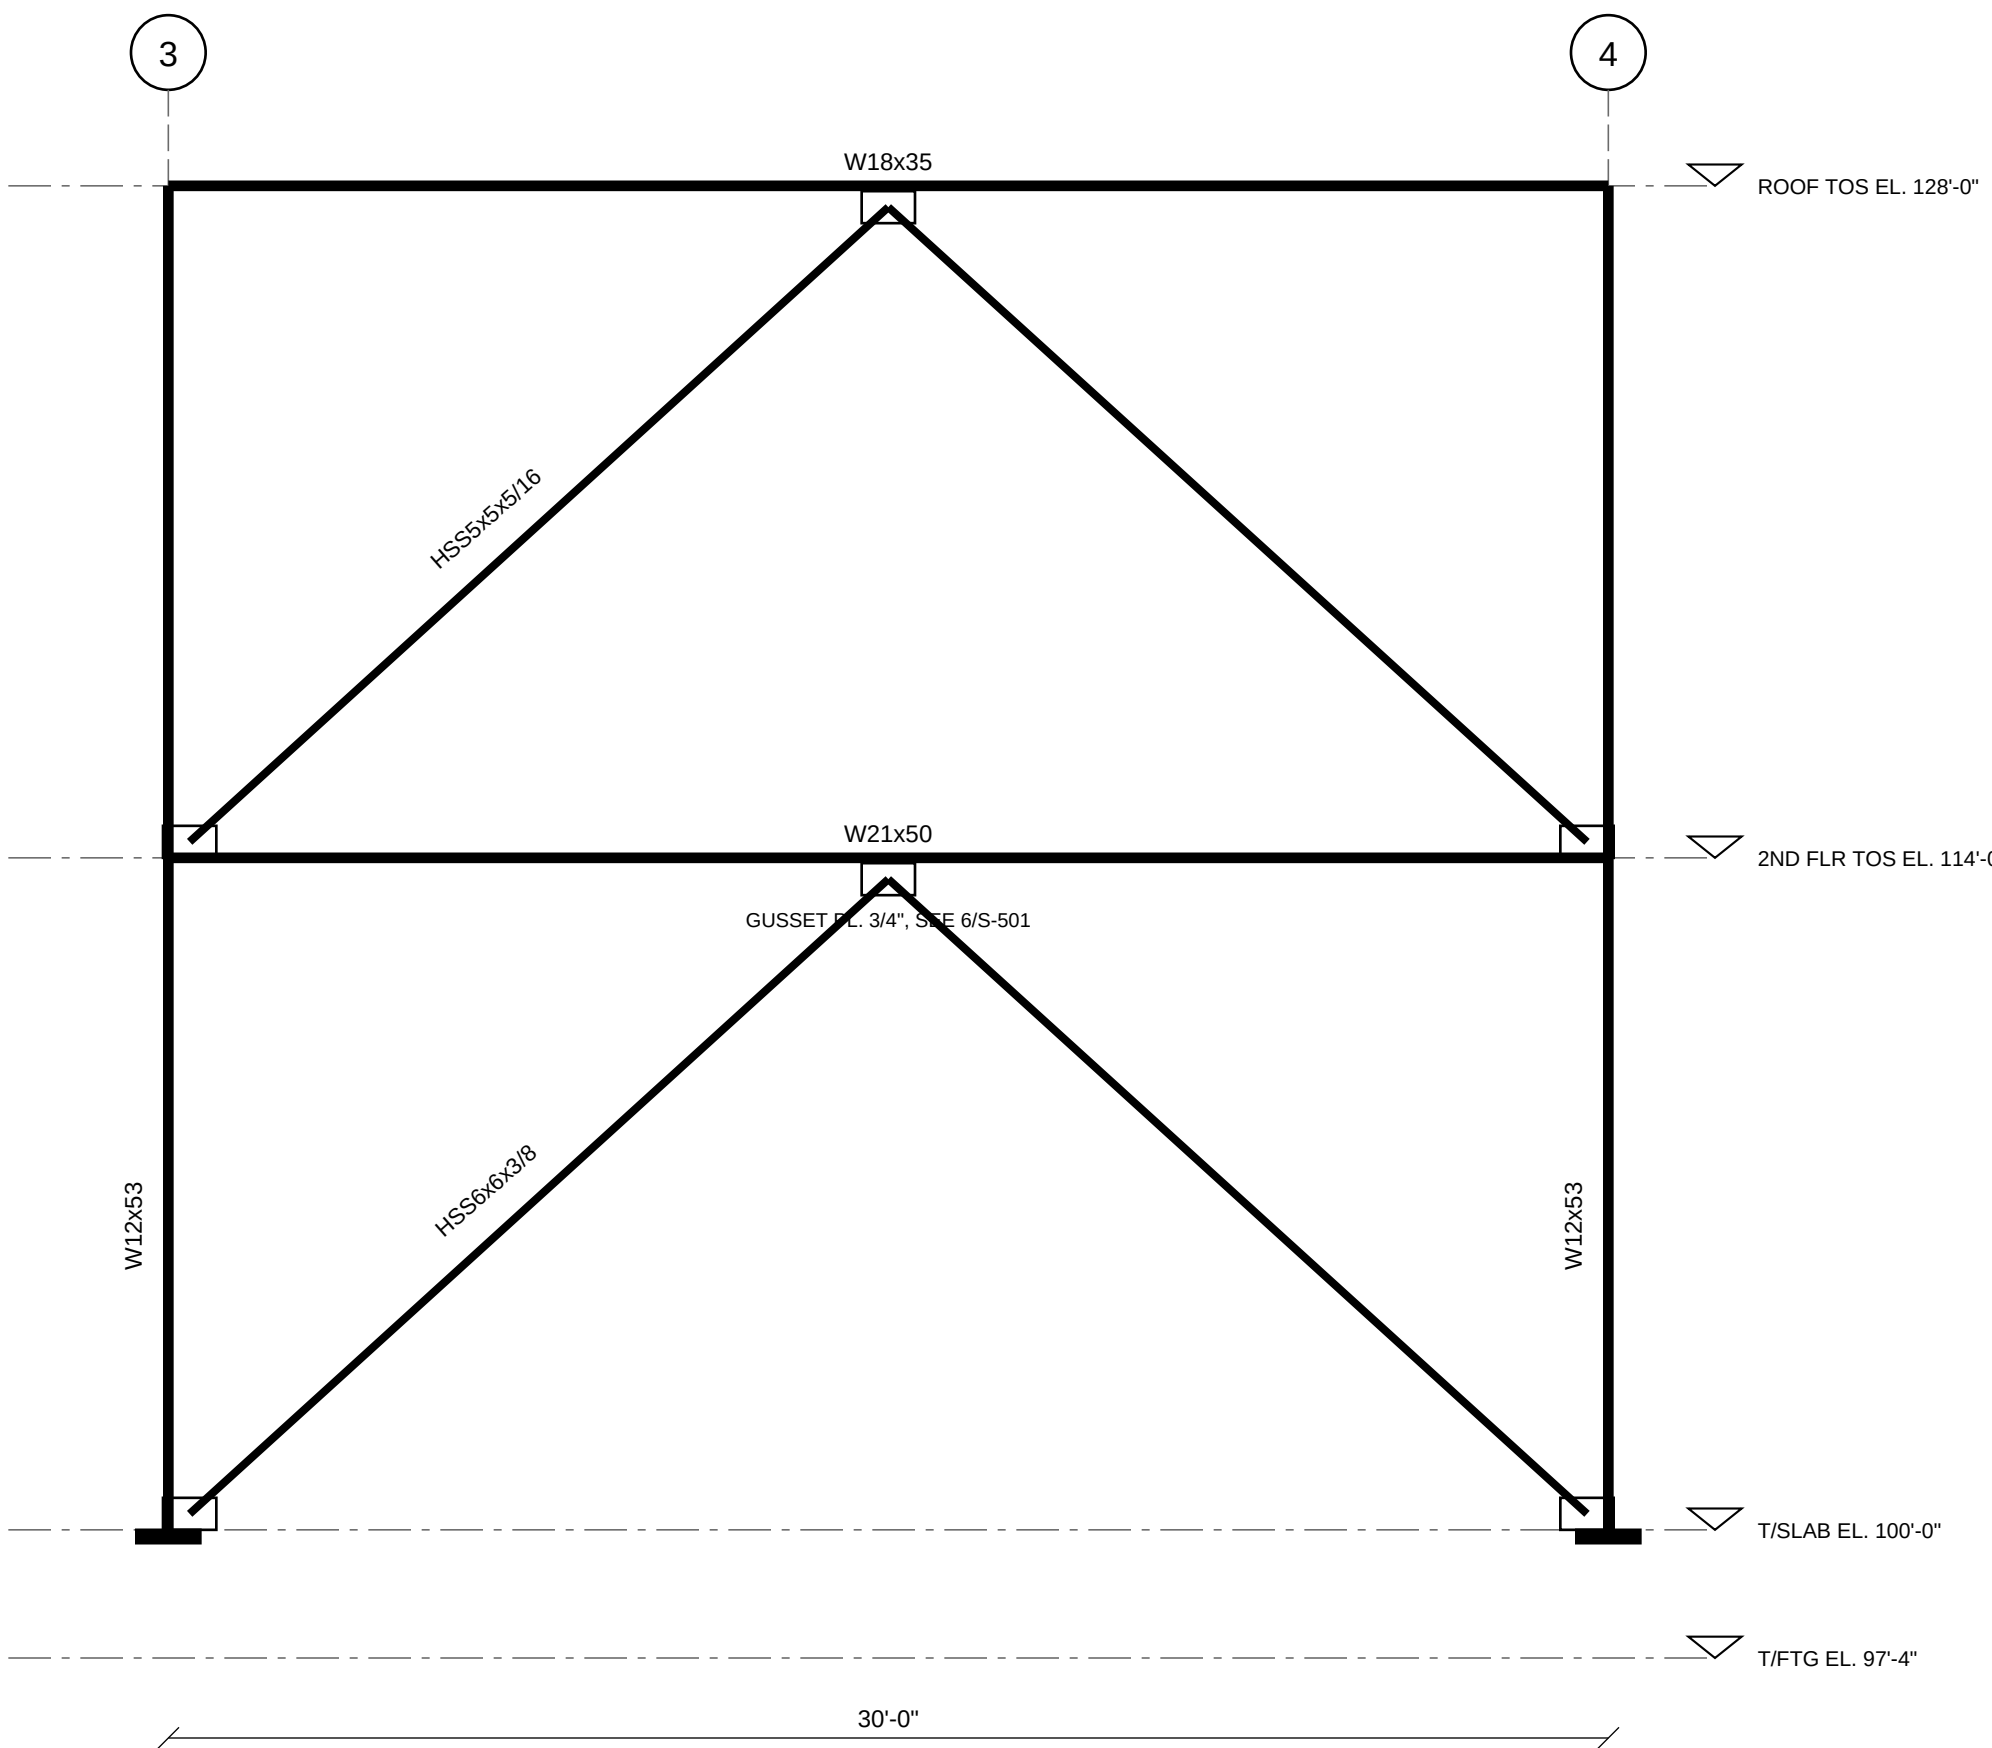

2 BF-2 ELEVATION (GRID A & E)


SCALE: 1/4" = 1'-0"

SHEET TITLE
BRACED FRAME ELEVATIONSSCALE
1/4" = 1'-0"PROJECT NO.
26-0418

DRAWN: JRM CHECKED: DKW DATE: 08/14/26


SHEET

S-301

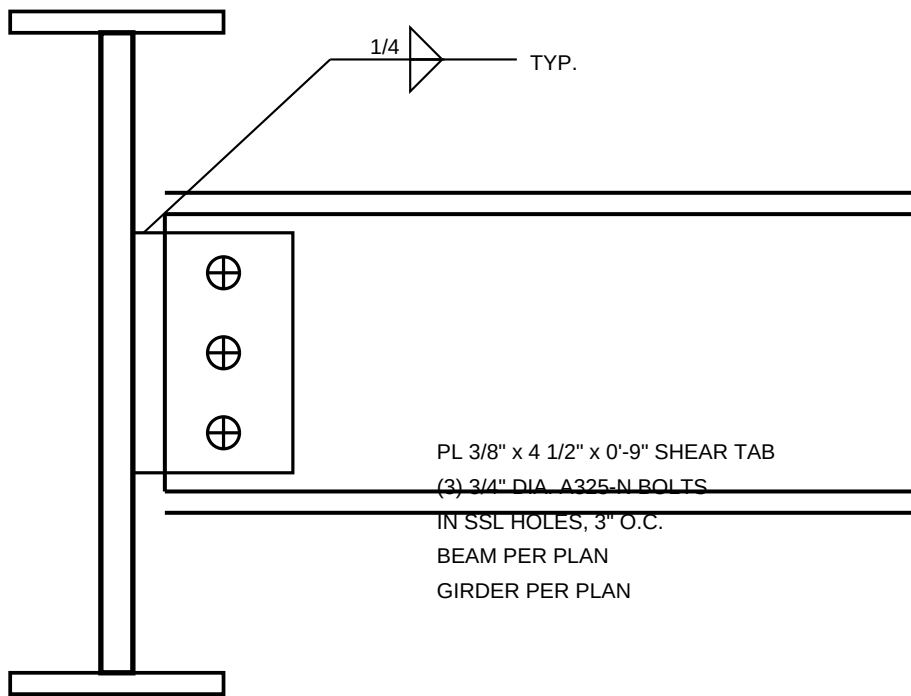


1 SHEAR TAB CONNECTION

SCALE: 1" = 1'-0"

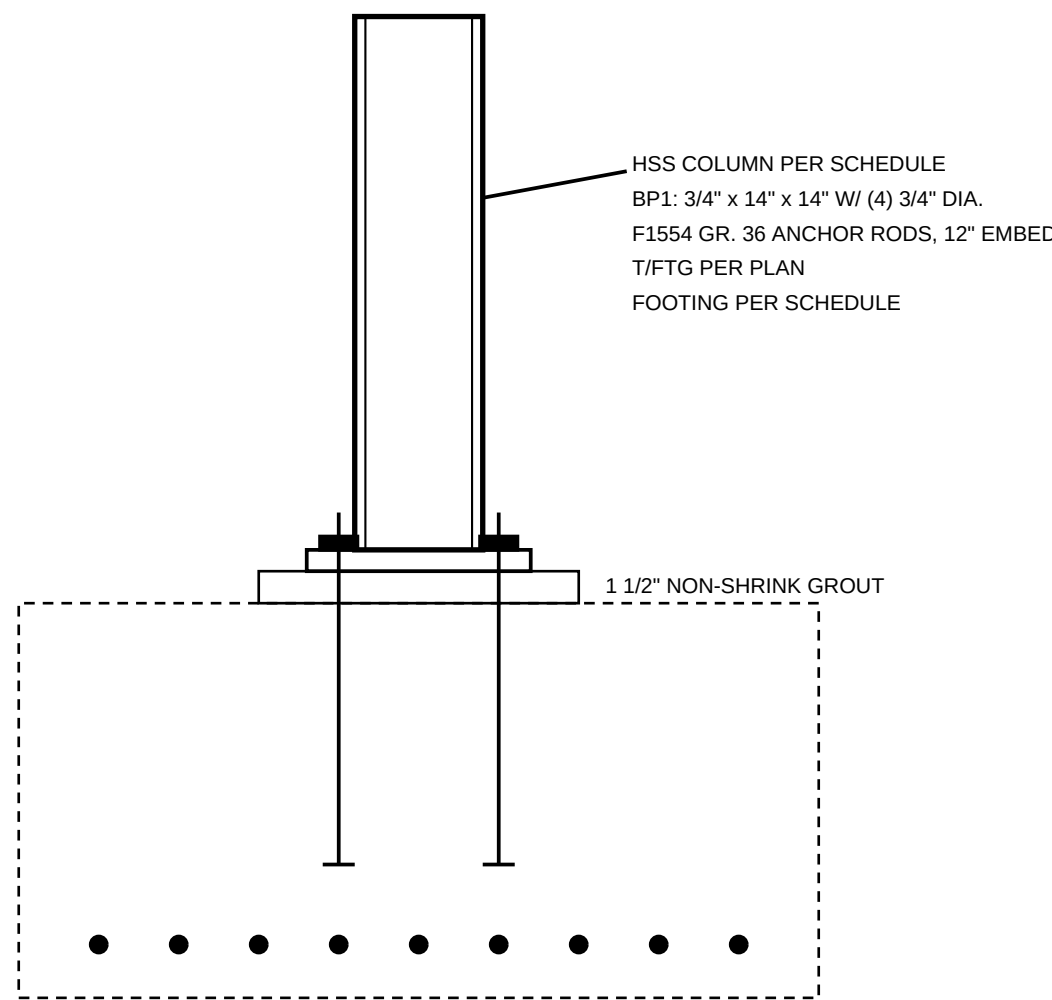


2 COLUMN BASE PLATE

SCALE: 1" = 1'-0"

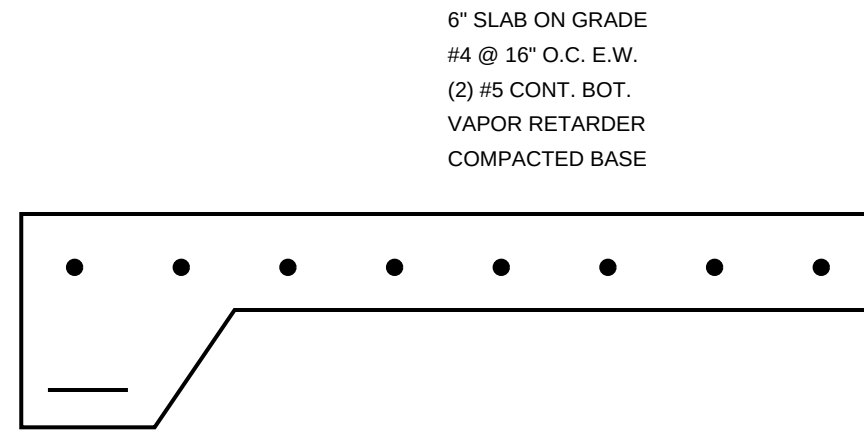


3 THICKENED SLAB EDGE

SCALE: 1" = 1'-0"

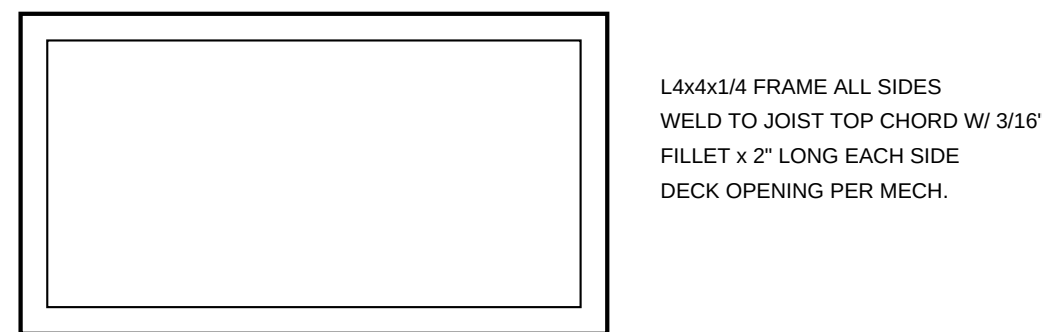


4 DECK OPENING FRAME

SCALE: 1" = 1'-0"

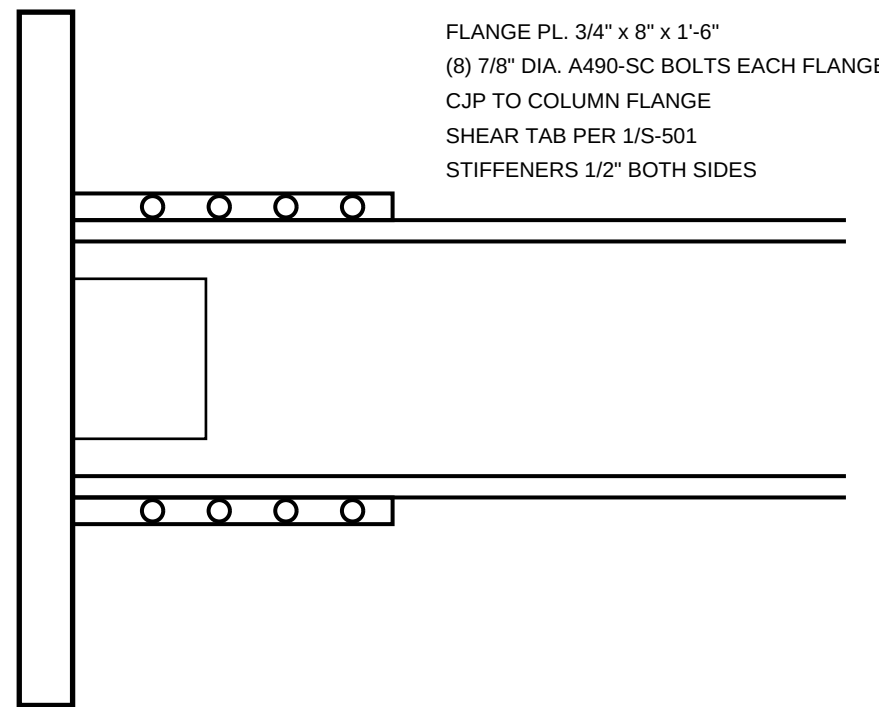

5 BOLTED FLANGE PLATE MOMENT CONN.

SCALE: 1" = 1'-0"

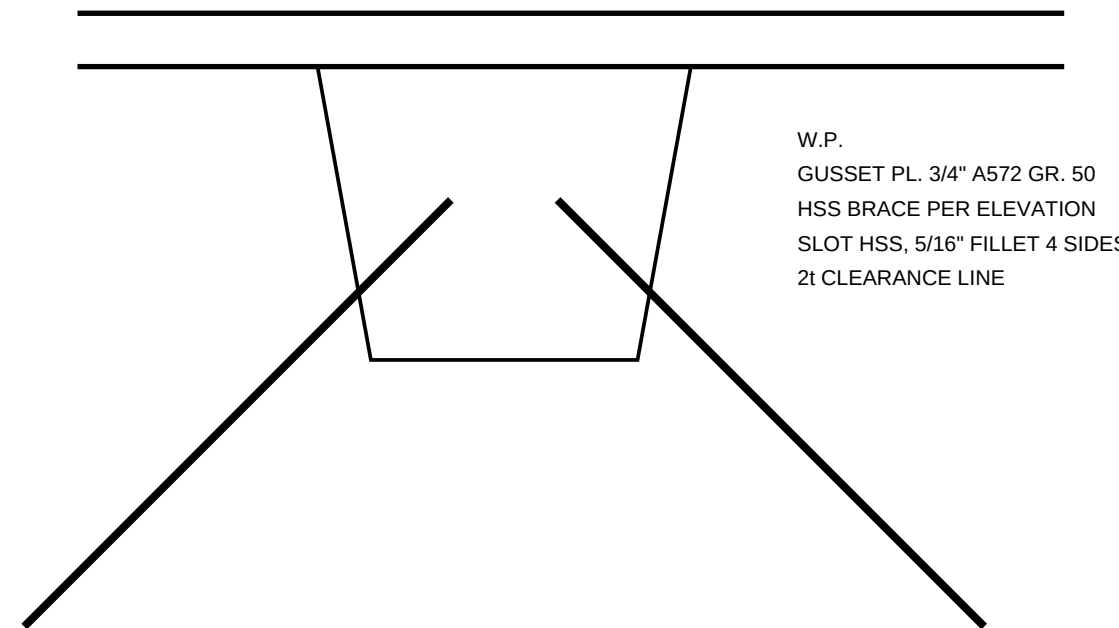

6 CHEVRON BRACE GUSSET

SCALE: 1" = 1'-0"

RIDGELINE

STRUCTURAL ENGINEERS


1400 FOUNDRY ST., SUITE 210
COLORADO SPRINGS, CO

NORTHGATE SUPPLY CO.

WAREHOUSE ADDITION
4410 INDUSTRIAL WAY

FICTIONAL PROJECT
DEMONSTRATION
DRAWING ONLY
NOT FOR CONSTRUCTION

REV	DESCRIPTION	DATE
0	ISSUED FOR BID	06/12/26
1	ADDENDUM 1	07/02/26
2	ISSUED FOR CONSTRUCTION	08/14/26

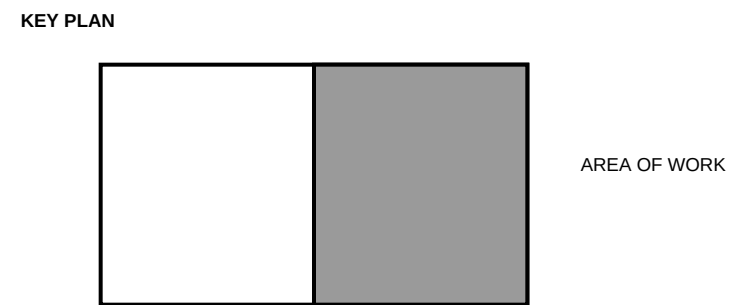

SHEET TITLE
TYPICAL CONNECTION DETAILS

SCALE
1" = 1'-0"

PROJECT NO.
26-0418

DRAWN: JRM CHECKED: DKW DATE: 08/14/26

SHEET

S-501